

NFPA[®]

400

Hazardous Materials Code

2019



IMPORTANT NOTICES AND DISCLAIMERS CONCERNING NFPA® STANDARDS

NOTICE AND DISCLAIMER OF LIABILITY CONCERNING THE USE OF NFPA STANDARDS

NFPA® codes, standards, recommended practices, and guides (“NFPA Standards”), of which the document contained herein is one, are developed through a consensus standards development process approved by the American National Standards Institute. This process brings together volunteers representing varied viewpoints and interests to achieve consensus on fire and other safety issues. While the NFPA administers the process and establishes rules to promote fairness in the development of consensus, it does not independently test, evaluate, or verify the accuracy of any information or the soundness of any judgments contained in NFPA Standards.

The NFPA disclaims liability for any personal injury, property, or other damages of any nature whatsoever, whether special, indirect, consequential or compensatory, directly or indirectly resulting from the publication, use of, or reliance on NFPA Standards. The NFPA also makes no guaranty or warranty as to the accuracy or completeness of any information published herein.

In issuing and making NFPA Standards available, the NFPA is not undertaking to render professional or other services for or on behalf of any person or entity. Nor is the NFPA undertaking to perform any duty owed by any person or entity to someone else. Anyone using this document should rely on his or her own independent judgment or, as appropriate, seek the advice of a competent professional in determining the exercise of reasonable care in any given circumstances.

The NFPA has no power, nor does it undertake, to police or enforce compliance with the contents of NFPA Standards. Nor does the NFPA list, certify, test, or inspect products, designs, or installations for compliance with this document. Any certification or other statement of compliance with the requirements of this document shall not be attributable to the NFPA and is solely the responsibility of the certifier or maker of the statement.

REVISION SYMBOLS IDENTIFYING CHANGES FROM THE PREVIOUS EDITION

Text revisions are shaded. A **Δ** before a section number indicates that words within that section were deleted and a **Δ** to the left of a table or figure number indicates a revision to an existing table or figure. When a chapter was heavily revised, the entire chapter is marked throughout with the **Δ** symbol. Where one or more sections were deleted, a **•** is placed between the remaining sections. Chapters, annexes, sections, figures, and tables that are new are indicated with an **N**.

Note that these indicators are a guide. Rearrangement of sections may not be captured in the markup, but users can view complete revision details in the First and Second Draft Reports located in the archived revision information section of each code at www.nfpa.org/docinfo. Any subsequent changes from the NFPA Technical Meeting, Tentative Interim Amendments, and Errata are also located there.

REMINDER: UPDATING OF NFPA STANDARDS

Users of NFPA codes, standards, recommended practices, and guides (“NFPA Standards”) should be aware that NFPA Standards may be amended from time to time through the issuance of a Tentative Interim Amendment (TIA) or corrected by Errata. An official NFPA Standard at any point in time consists of the current edition of the document together with any TIAs and Errata then in effect.

To determine whether an NFPA Standard has been amended through the issuance of Tentative Interim Amendments or corrected by Errata, go to www.nfpa.org/docinfo to choose from the list of NFPA Standards or use the search feature to select the NFPA Standard number (e.g., NFPA 13). The document information page provides up-to-date document-specific information as well as postings of all existing TIAs and Errata. It also includes the option to register for an “Alert” feature to receive an automatic email notification when new updates and other information are posted regarding the document.

IMPORTANT NOTICES AND DISCLAIMERS CONCERNING NFPA® STANDARDS

ADDITIONAL NOTICES AND DISCLAIMERS

Updating of NFPA Standards

Users of NFPA codes, standards, recommended practices, and guides (“NFPA Standards”) should be aware that these documents may be superseded at any time by the issuance of new editions or may be amended from time to time through the issuance of Tentative Interim Amendments or corrected by Errata. An official NFPA Standard at any point in time consists of the current edition of the document together with any Tentative Interim Amendments and any Errata then in effect. In order to determine whether a given document is the current edition and whether it has been amended through the issuance of Tentative Interim Amendments or corrected through the issuance of Errata, consult appropriate NFPA publications such as the National Fire Codes® Subscription Service, visit the NFPA website at www.nfpa.org, or contact the NFPA at the address listed below.

Interpretations of NFPA Standards

A statement, written or oral, that is not processed in accordance with Section 6 of the Regulations Governing the Development of NFPA Standards shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

Patents

The NFPA does not take any position with respect to the validity of any patent rights referenced in, related to, or asserted in connection with an NFPA Standard. The users of NFPA Standards bear the sole responsibility for determining the validity of any such patent rights, as well as the risk of infringement of such rights, and the NFPA disclaims liability for the infringement of any patent resulting from the use of or reliance on NFPA Standards.

NFPA adheres to the policy of the American National Standards Institute (ANSI) regarding the inclusion of patents in American National Standards (“the ANSI Patent Policy”), and hereby gives the following notice pursuant to that policy:

NOTICE: The user’s attention is called to the possibility that compliance with an NFPA Standard may require use of an invention covered by patent rights. NFPA takes no position as to the validity of any such patent rights or as to whether such patent rights constitute or include essential patent claims under the ANSI Patent Policy. If, in connection with the ANSI Patent Policy, a patent holder has filed a statement of willingness to grant licenses under these rights on reasonable and nondiscriminatory terms and conditions to applicants desiring to obtain such a license, copies of such filed statements can be obtained, on request, from NFPA. For further information, contact the NFPA at the address listed below.

Law and Regulations

Users of NFPA Standards should consult applicable federal, state, and local laws and regulations. NFPA does not, by the publication of its codes, standards, recommended practices, and guides, intend to urge action that is not in compliance with applicable laws, and these documents may not be construed as doing so.

Copyrights

NFPA Standards are copyrighted. They are made available for a wide variety of both public and private uses. These include both use, by reference, in laws and regulations, and use in private self-regulation, standardization, and the promotion of safe practices and methods. By making these documents available for use and adoption by public authorities and private users, the NFPA does not waive any rights in copyright to these documents.

Use of NFPA Standards for regulatory purposes should be accomplished through adoption by reference. The term “adoption by reference” means the citing of title, edition, and publishing information only. Any deletions, additions, and changes desired by the adopting authority should be noted separately in the adopting instrument. In order to assist NFPA in following the uses made of its documents, adopting authorities are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use. For technical assistance and questions concerning adoption of NFPA Standards, contact NFPA at the address below.

For Further Information

All questions or other communications relating to NFPA Standards and all requests for information on NFPA procedures governing its codes and standards development process, including information on the procedures for requesting Formal Interpretations, for proposing Tentative Interim Amendments, and for proposing revisions to NFPA standards during regular revision cycles, should be sent to NFPA headquarters, addressed to the attention of the Secretary, Standards Council, NFPA, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101; email: stds_admin@nfpa.org.

For more information about NFPA, visit the NFPA website at www.nfpa.org. All NFPA codes and standards can be viewed at no cost at www.nfpa.org/docinfo.

Copyright © 2018 National Fire Protection Association®. All Rights Reserved.

NFPA® 400

Hazardous Materials Code

2019 Edition

This edition of NFPA 400, *Hazardous Materials Code*, was prepared by the Technical Committee on Hazardous Chemicals. It was acted on by NFPA at its June Association Technical Meeting held June 11-14, 2018, in Las Vegas, NV. It was issued by the Standards Council on August 14, 2018, with an effective date of September 3, 2018, and supersedes all previous editions.

This edition of NFPA 400 was approved as an American National Standard on September 3, 2018.

Origin and Development of NFPA 400

For the first edition of NFPA 400, four separate documents — NFPA 430, NFPA 432, NFPA 434, and NFPA 490 — were withdrawn in 2010 and included in their entirety in NFPA 400. This edition covered hazardous material categories found in building and fire codes such as corrosives, flammable solids, pyrophoric substances, toxic and highly toxic materials, unstable materials, and water-reactive materials. NFPA 400 also included compressed gases and cryogenic fluids by extracting NFPA 55, *Compressed Gases and Cryogenic Fuels Code*, into Chapter 21.

The code established the need for additional fire protection based on quantity limits for various occupancies using the maximum allowable quantity (MAQ) concept.

In the 2013 edition, the MAQ tables in Chapter 5 were updated to be consistent with changes in fire and building codes and coordinated with requirements for industrial and medical gases based on changes to NFPA 55. The Committee updated the table establishing MAQ values for hazardous materials stored or used in outdoor control areas. The results of the Fire Protection Research Foundation (FPRF) project “Oxidizer Classification Research Project: Tests and Criteria” were used to establish an alternative method for assigning classifications to oxidizing solids. To accomplish that, the committee modified definitions for Class 1, Class 2, and Class 3 oxidizers based on the test protocol and criteria presented in the completely revised Annex G.

The oxidizer table in Annex G was updated for specific oxidizer solids based on the test results. The Committee also incorporated edits consistent with the *Manual of Style for NFPA Technical Committee Documents*.

The 2016 edition incorporated a number of significant changes to the requirements for ammonium nitrate in Chapter 11. Highlights included the addition of sprinkler requirements for existing buildings of combustible construction and content, the requirement for new buildings and storage bins to be of noncombustible construction, and emergency planning and public notification/alert systems for both new and existing facilities.

Additional changes further protected ammonium nitrate from becoming contaminated or from becoming molten and confined, conditions that can lead to an explosion during fires involving ammonium nitrate. Clear guidance for emergency responders on the conditions under which ammonium nitrate can explode, when to fight such fires, and when to evacuate were added to Annex E, which also included information on the properties and uses of ammonium nitrate. A number of oxidizers were reclassified in Annex G based on work performed under the auspices of the Fire Protection Research Foundation (FPRF). In Annex F, the tables were revised based on new test data provided by the Organic Peroxide Producers’ Safety Division (OPPSD) of the Society of the Plastics Industry (SPI). Terminology and content throughout the document have been modified to correlate with OSHA’s revised *Hazard Communication Standard*. A new annex, Annex J, Hazardous Material Definitions Comparison Table, compared the hazardous materials definitions in the new OSHA standard with those in NFPA 400. Finally, the MAQ tables in Chapter 5 were modified to reflect a change in typical container sizes from 50 lb to 55 lb (22.7 kg to 24.9 kg).

In the 2019 edition, multiple terms relating to aisles have been revised for consistent use throughout the code. A major revision has been made to the MAQ tables in Chapter 5 that deletes

most of the occupancy-specific tables in an effort to consolidate information and reduce repetition. MAQ values for assembly, educational, day care, health care, ambulatory health care, detention and correctional, certain residential, and business occupancies have been consolidated, and annex material has been added to provide clarification on amounts needed to be stored within and outside of cabinets when allowed to have increases based on the table footnotes. A new table has also been added to the code to extract common path of travel distance limits from *NFPA 5000*[®], *Building Construction and Safety Code*[®].

Further revisions have been made to the requirements for ammonium nitrate in Chapter 11. Text has been added to clarify which sections apply retroactively, and language has been revised to clarify that molten ammonium nitrate needs to be able to flow away from storage areas to open, unconfined areas free from incompatible materials. Revisions have been made to the fire protection system requirements so that automatic fire sprinkler systems are not required in Type I or Type II construction buildings unless they also have combustible content. Requirements for ammonium nitrate storage in railcars have been added to cover non-transportation-regulated storage.

Class II organic peroxides have been divided into Class IIA and Class IIB based on small-scale burn rate data and alignment with international classifications. Definitions have been added, MAQ tables have been updated to include these two classes, and some of the assignments of organic peroxide formulation classifications in Annex F have been changed accordingly. Changes have been made to the requirements for fire protection systems, and to remove MAQs for segregated storage and cutoff storage, since these are addressed through the protection level and control area concepts.

Finally, new annex material has been added to show an example of a storage layout in a typical sprinklered warehouse storing Class 1 oxidizers.

The 2019 edition of NFPA 400 is dedicated to the memory of Nancy Pearce, who served as Staff Liaison to the Technical Committee on Hazardous Chemicals since the 2013 edition of the code. Nancy passed away on September 5, 2017, after a long and courageous battle with breast cancer — although that did not stop her from sharing her joy and passion with all who had the pleasure of working with her. Nancy worked at NFPA for 6 years, and spent the previous 23 years as an Industrial Hygienist for the Massachusetts Department of Labor Standards, Occupational Safety and Health Program. Often with a smile, she could pull teams of people together with a common mission, never minimizing their important work for making the world a safer place to work and live. Nancy will be remembered and missed for her professionalism, incredible work ethic, and kindness.

Technical Committee on Hazardous Chemicals

Robert J. James, *Chair*

UL LLC, IL [RT]

Rep. UL LLC

Elizabeth C. Buc, Fire & Materials Research Laboratory, LLC, MI [RT]

Chris M. Connealy, Texas Department of Insurance, TX [E]

Edwin D. Cope, Cope Engineering, TX [SE]

Dirk Der Kinderen, U.S. Department of Transportation, DC [E]

Mark J. Dossett, San Diego Fire-Rescue Department, CA [E]
Rep. California Fire Chiefs Association

Henry L. Febo, Jr., Holliston, MA [SE]

Kathleen A. Franklin, U.S. Environmental Protection Agency, DC [E]

Martin T. Gresho, FP2Fire, Inc., CO [SE]

Peter Paul Howell, Mark V, Inc., WV [SE]

Noel Hsu, Orica U.S.A. Inc., CO [M]
Rep. The Fertilizer Institute

Paul A. Iacobucci, Akzo Nobel, IL [M]
Rep. SPI/Organic Peroxide Producers Safety Division

Alwin A. Kelly, JENSEN HUGHES, MD [SE]

Lynne M. Kilpatrick, Sunnyvale Department of Public Safety, CA [E]

Kevin Kreitman, Albany Fire Department, OR [E]

Todd Laberge, Lawrence Berkeley National Laboratory, CA [U]

R. Kenneth Lee, Axiall LLC, AR [M]

Joyce Miles, ExxonMobil Research & Engineering, TX [U]
Rep. American Chemistry Council

Kirk Mitchell, Kirk Mitchell & Associates, LLC, FL [M]
Rep. Isocyanurates Industry Adhoc Committee

Ken Scott Mueller, CHS - Cenex Harvest States, IL [U]
Rep. Agricultural Retailers Association

Eugene Y. Ngai, Chemically Speaking LLC, NJ [SE]

Anthony M. Ordile, Haines Fire & Risk Consulting Corporation, NJ [SE]

Jerald Pierrotti, Lonza Group Ltd., LA [M]

Michael Reilly, Fairfax County Fire & Rescue Department, VA [L]
Rep. International Association of Fire Fighters

Jerrold Sameth, Compressed Gas Association, Inc., NJ [M]

John Louis Schumacher, Advanced Engineering Investigations, CO [SE]

Milton R. Shefter, Miljoy Ent. Incorporated, CA [U]
(VL to Document: NFPA 40)

Jonathan Thomas Shriner, U.S. Architect of the Capitol, DC [U]
(VL to Document: NFPA 40)

Ronald Thomas, Institute of Makers of Explosives, UT [M]
Rep. Institute of Makers of Explosives

Irene Villanueva Uriarte, FM Global, MA [I]
Rep. FM Global

James O. Vigerust, Jr., CB&I, NM [SE]
Rep. NFPA Industrial Fire Protection Section

Jerry W. Wallace, Safety Engineering Laboratories, Inc., MI [SE]

Alternates

James C. Belke, U.S. Environmental Protection Agency, DC [E]
(Alt. to Kathleen A. Franklin)

James Carver, El Segundo Fire Department, CA [E]
(Alt. to Mark J. Dossett)

Joseph Carl Chew, Haines Fire And Risk Consulting, Corp., NJ [SE]
(Alt. to Anthony M. Ordile)

Richard A. Craig, Compressed Gas Association, VA [M]
(Alt. to Jerrold Sameth)

Peter Dluzneski, Arkema Inc., PA [M]
(Alt. to Paul A. Iacobucci)

Richard H. Ferguson, Axiall LLC, PA [M]
(Alt. to R. Kenneth Lee)

Steve Ferrara, Carolina Eastern - Vail Inc., NY [U]
(Alt. to Ken Scott Mueller)

Heather Millikan Heckman, University Of South Carolina, SC [U]
(VL to Document: NFPA 40)
(Alt. to Milton R. Shefter)

Scott M. Heyworth, FP2Fire, Inc., FL [SE]
(Alt. to Martin T. Gresho)

Zachary John Jason, Advanced Engineering Investigations, CO [SE]
(Alt. to John Louis Schumacher)

John A. LeBlanc, FM Global, MA [I]
(Alt. to Irene Villanueva Uriarte)

Kathleen Nehmer, Pond & Company, MA [SE]
(Voting alt.)

Milton L. Norsworthy, Fire and Materials Research Laboratories LLC. (F&MRL), TN [RT]
(Alt. to Elizabeth C. Buc)

Brian P. Sampson, Safety Engineering Laboratories, Inc., MI [SE]
(Alt. to Jerry W. Wallace)

David S. Shatzer, Shatzer & Associates Consulting, PA [SE]
(Alt. to Edwin D. Cope)

Clark D. Shepard, ExxonMobil Corporation, TX [M]
(Alt. to Joyce Miles)

Robert Suarez, Des Moines Fire Department, IA [L]
(Alt. to Michael Reilly)

Nonvoting

David Chicca, OSHA, DC [E]
Rep. Occupational Safety & Health Administration

Richard S. Kraus, API/Petroleum Safety Consultants, VA [M]
Rep. TCC on Flammable and Combustible Liquids

Patrick A. McLaughlin, McLaughlin & Associates, ID [U]
Rep. TC on Industrial, Storage, & Miscellaneous Occupancies

Kathy A. Landkrohn, U.S. Department of Labor, DC [E]
Rep. Occupational Safety & Health Administration

Laura E. Moreno, NFPA Staff Liaison

This list represents the membership at the time the Committee was balloted on the final text of this edition. Since that time, changes in the membership may have occurred. A key to classifications is found at the back of the document.

NOTE: Membership on a committee shall not in and of itself constitute an endorsement of the Association or any document developed by the committee on which the member serves.

Committee Scope: This Committee shall have primary responsibility for documents on, and maintain current codes for, classes of hazardous chemicals and codes for specific chemicals where these are warranted by virtue of widespread distribution or special hazards.

Contents

Chapter 1 Administration	400- 7	Chapter 9 Security for Hazardous Materials	400- 48
1.1 Scope.	400- 7	9.1 General.	400- 48
1.2 Purpose.	400- 7	Chapter 10 Performance-Based Option	400- 48
1.3 Application.	400- 7	10.1 General.	400- 48
1.4 Retroactivity.	400- 8	10.2 Performance Criteria.	400- 49
1.5 Equivalency.	400- 8	10.3 Retained Prescriptive Requirements.	400- 49
1.6 Units and Formulas.	400- 8	10.4 Design Scenarios.	400- 50
1.7 Enforcement.	400- 9	10.5 Evaluation of Proposed Designs.	400- 51
1.8 Permits.	400- 9	10.6 Safety Factors.	400- 51
1.9 Facility Closure.	400- 9	10.7 Documentation Requirements.	400- 52
1.10 Emergency Planning.	400- 9	Chapter 11 Ammonium Nitrate Solids and Liquids	400- 52
1.11 Hazardous Materials Management Plan (HMMP).	400- 9	11.1 General.	400- 52
1.12 Hazardous Materials Inventory Statement (HMIS).	400- 9	11.2 General Requirements for Storage.	400- 53
1.13 Plan Review.	400- 9	11.3 Indoor Storage.	400- 55
1.14 Technical Assistance.	400- 9	11.4 Outdoor Storage.	400- 55
Chapter 2 Referenced Publications	400- 10	11.5 General Requirements for Use.	400- 56
2.1 General.	400- 10	11.6 Indoor Use.	400- 56
2.2 NFPA Publications.	400- 10	11.7 Outdoor Use.	400- 56
2.3 Other Publications.	400- 10	11.8 Handling.	400- 56
2.4 References for Extracts in Mandatory Sections.	400- 11	Chapter 12 Corrosive Solids and Liquids	400- 57
Chapter 3 Definitions	400- 11	12.1 General.	400- 57
3.1 General.	400- 11	12.2 General Requirements for Storage.	400- 57
3.2 NFPA Official Definitions.	400- 11	12.3 Indoor Storage.	400- 57
3.3 General Definitions.	400- 12	12.4 Outdoor Storage.	400- 57
3.4 Special Performance-Based Definitions.	400- 19	12.5 General Requirements for Use.	400- 57
Chapter 4 Classification of Materials, Wastes, and Hazard of Contents	400- 19	12.6 Indoor Use.	400- 57
4.1 Hazardous Material Classification.	400- 19	12.7 Outdoor Use.	400- 58
4.2 Classification of High-Hazard Contents.	400- 20	12.8 Handling.	400- 58
4.3 Mixtures.	400- 20	Chapter 13 Flammable Solids	400- 58
4.4 Multiple Hazards.	400- 20	13.1 General.	400- 58
4.5 Classification of Waste.	400- 20	13.2 General Requirements for Storage.	400- 58
4.6 Combustibility of Materials.	400- 20	13.3 Indoor Storage.	400- 58
Chapter 5 Permissible Storage and Use Locations ...	400- 21	13.4 Outdoor Storage.	400- 58
5.1 General.	400- 21	13.5 General Requirements for Use.	400- 58
5.2 Control Areas.	400- 21	13.6 Indoor Use.	400- 59
5.3 Protection Levels.	400- 25	13.7 Outdoor Use.	400- 59
5.4 Outdoor Areas.	400- 26	13.8 Handling.	400- 59
Chapter 6 Fundamental Requirements	400- 29	Chapter 14 Organic Peroxide Formulations	400- 59
6.1 General Requirements.	400- 29	14.1 General.	400- 59
6.2 Requirements for Occupancies Storing Quantities of Hazardous Materials Exceeding the Maximum Allowable Quantities per Control Area for High-Hazard Contents.	400- 33	14.2 General Requirements for Storage.	400- 59
6.3 Requirements for Use, Dispensing, and Handling of Hazardous Materials in Amounts Exceeding Maximum Allowable Quantities.	400- 42	14.3 Indoor Storage.	400- 60
Chapter 7 Emergency Planning, Fire Risk Control, and Chemical Hazard Requirements for Industrial Processes	400- 46	14.4 Outdoor Storage.	400- 62
7.1 General.	400- 46	14.5 General Requirements for Use.	400- 62
7.2 Process Review and Plan Preparation.	400- 46	14.6 Indoor Use.	400- 63
7.3 Operating and Maintenance Procedures.	400- 47	14.7 Outdoor Use.	400- 63
7.4 Safety Reviews.	400- 47	14.8 Handling.	400- 63
7.5 Incident Investigation Plan.	400- 47	Chapter 15 Oxidizer Solids and Liquids	400- 63
7.6 Document Retention.	400- 47	15.1 General.	400- 63
Chapter 8 Reserved	400- 48	15.2 General Requirements for Storage.	400- 64
		15.3 Indoor Storage.	400- 65
		15.4 Outdoor Storage.	400- 72
		15.5 General Requirements for Use.	400- 72
		15.6 Indoor Use.	400- 73
		15.7 Outdoor Use.	400- 73
		15.8 Handling.	400- 73
		Chapter 16 Reserved	400- 73
		Chapter 17 Pyrophoric Solids and Liquids	400- 73
		17.1 General.	400- 73
		17.2 General Requirements for Storage.	400- 73

17.3	Indoor Storage.	400- 73	21.3	Compressed Gases.	400- 83
17.4	Outdoor Storage.	400- 73	21.4	Cryogenic Fluids.	400- 94
17.5	General Requirements for Use.	400- 74	21.5	Bulk Oxygen Systems.	400- 102
17.6	Indoor Use.	400- 74	21.6	Hydrogen Compressed Gas Systems.	400- 102
17.7	Outdoor Use.	400- 74	21.7	Bulk Liquefied Hydrogen Systems.	400- 102
17.8	Handling.	400- 74	21.8	Gas Generation Systems.	400- 102
Chapter 18	Toxic or Highly Toxic Solids and Liquids .	400- 74	21.9	Insulated Liquid Carbon Dioxide Systems.	400- 102
18.1	General.	400- 74	21.10	Storage, Handling, and Use of Ethylene Oxide for Sterilization and Fumigation.	400- 102
18.2	General Requirements for Storage.	400- 75	21.11	Acetylene Cylinder Charging Plants.	400- 103
18.3	Indoor Storage.	400- 75	21.12	Nitrous Oxide Systems.	400- 103
18.4	Outdoor Storage.	400- 75	Annex A	Explanatory Material	400- 103
18.5	General Requirements for Use.	400- 75	Annex B	Chemical Data	400- 135
18.6	Indoor Use.	400- 76	Annex C	Hazardous Materials Management Plans and Hazardous Materials Inventory Statements	400- 151
18.7	Outdoor Use.	400- 76	Annex D	Security Information	400- 161
18.8	Handling.	400- 76	Annex E	Properties and Uses of Ammonium Nitrate and Fire-Fighting Procedures	400- 162
Chapter 19	Unstable (Reactive) Solids and Liquids	400- 76	Annex F	Typical Organic Peroxide Formulations ...	400- 165
19.1	General.	400- 76	Annex G	Oxidizers	400- 184
19.2	General Requirements for Storage.	400- 76	Annex H	Compressed Gases and Cryogenic Fluids .	400- 196
19.3	Indoor Storage.	400- 76	Annex I	Emergency Response Guideline	400- 197
19.4	Outdoor Storage.	400- 77	Annex J	Hazardous Material Definitions Comparison Table	400- 204
19.5	General Requirements for Use.	400- 77	Annex K	Sample Ordinance for Adopting NFPA 400	400- 221
19.6	Indoor Use.	400- 77	Annex L	Informational References	400- 222
19.7	Outdoor Use.	400- 78	Index	400- 227
19.8	Handling.	400- 78			
Chapter 20	Water-Reactive Solids and Liquids	400- 78			
20.1	General.	400- 78			
20.2	General Requirements for Storage.	400- 78			
20.3	Indoor Storage.	400- 78			
20.4	Outdoor Storage.	400- 78			
20.5	General Requirements for Use.	400- 78			
20.6	Indoor Use.	400- 79			
20.7	Outdoor Use.	400- 79			
20.8	Handling.	400- 79			
Chapter 21	Storage, Use, and Handling of Compressed Gases and Cryogenic Fluids .	400- 79			
21.1	General Provisions.	400- 79			
21.2	Building-Related Controls.	400- 80			

NFPA 400

Hazardous Materials Code

2019 Edition

IMPORTANT NOTE: This NFPA document is made available for use subject to important notices and legal disclaimers. These notices and disclaimers appear in all publications containing this document and may be found under the heading “Important Notices and Disclaimers Concerning NFPA Standards.” They can also be viewed at www.nfpa.org/disclaimers or obtained on request from NFPA.

UPDATES, ALERTS, AND FUTURE EDITIONS: New editions of NFPA codes, standards, recommended practices, and guides (i.e., NFPA Standards) are released on scheduled revision cycles. This edition may be superseded by a later one, or it may be amended outside of its scheduled revision cycle through the issuance of Tentative Interim Amendments (TIAs). An official NFPA Standard at any point in time consists of the current edition of the document, together with all TIAs and Errata in effect. To verify that this document is the current edition or to determine if it has been amended by TIAs or Errata, please consult the National Fire Codes® Subscription Service or the “List of NFPA Codes & Standards” at www.nfpa.org/docinfo. In addition to TIAs and Errata, the document information pages also include the option to sign up for alerts for individual documents and to be involved in the development of the next edition.

NOTICE: An asterisk (*) following the number or letter designating a paragraph indicates that explanatory material on the paragraph can be found in Annex A.

A reference in brackets [] following a section or paragraph indicates material that has been extracted from another NFPA document. As an aid to the user, the complete title and edition of the source documents for extracts in mandatory sections of the document are given in Chapter 2 and those for extracts in informational sections are given in Annex L. Extracted text may be edited for consistency and style and may include the revision of internal paragraph references and other references as appropriate. Requests for interpretations or revisions of extracted text shall be sent to the technical committee responsible for the source document.

Information on referenced publications can be found in Chapter 2 and Annex L.

Chapter 1 Administration

1.1 Scope.

1.1.1* Applicability. This code shall apply to the storage, use, and handling of the following hazardous materials in all occupancies and facilities:

- (1) Ammonium nitrate solids and liquids
- (2) Corrosive solids and liquids
- (3) Flammable solids
- (4) Organic peroxide formulations
- (5) Oxidizer — solids and liquids
- (6) Pyrophoric solids and liquids
- (7) Toxic and highly toxic solids and liquids
- (8) Unstable (reactive) solids and liquids
- (9) Water-reactive solids and liquids
- (10)* Compressed gases and cryogenic fluids as included within the context of NFPA 55

1.1.1.1 Occupancies. Unless otherwise specified in this code, all occupancy definitions and classifications shall be in accordance with the building code.

1.1.1.2 Multiple Hazards. Hazardous materials that are classified in more than one hazard category, as set forth in Section 4.1, shall conform to the code requirements for each hazard category.

1.1.2 Exemptions.

1.1.2.1 The quantity and arrangement limits in this code shall not apply to facilities that use ammonium perchlorate in the commercial manufacture of large-scale rocket motors.

1.1.2.2 This code shall not apply to the following:

- (1) Storage or use of hazardous materials for individual use on the premises of one- and two-family dwellings
- (2) Explosives or blasting agents, which are regulated by NFPA 495, and fireworks
- (3) Refrigerants and refrigerant oil contained within closed-cycle refrigeration systems complying with the fire code and the mechanical code adopted by the jurisdiction
- (4) High-hazard contents stored or used in farm buildings or similar occupancies and in remote locations for on-premises agricultural use
- (5) Corrosive materials in stationary batteries utilized for facility emergency power or uninterrupted power supply, or similar purposes, in accordance with NFPA 1
- (6) Aerosols complying with NFPA 30B
- (7) Corrosive materials displayed in original packaging in mercantile occupancies and intended for personal or household use or as building materials
- (8) Flammable and combustible liquids having no other physical or health hazard properties covered by this code
- (9) Organic peroxide formulations that are capable of detonation as manufactured or when unpackaged or in authorized shipping containers under conditions of fire exposure, when stored, manufactured, or used in accordance with NFPA 495
- (10) Combustible metals, as defined in NFPA 484
- (11) LP-Gas complying with NFPA 58 or NFPA 59
- (12) Where approved, materials that have been satisfactorily demonstrated not to present a potential danger to public health, safety, or welfare, based upon the quantity or condition of storage
- (13) The off-site transportation of hazardous materials when in accordance with Department of Transportation (DOT) regulations
- (14) Cellulose nitrate film complying with NFPA 40

1.2* Purpose. The purpose of this code shall be to provide fundamental safeguards for the storage, use, and handling of hazardous materials as listed in 1.1.1.

1.3 Application. Administrative, operational, and maintenance provisions of this code shall apply to the following:

- (1) Conditions and operations arising after the adoption of the code
- (2) Existing conditions and operations

1.3.1 Conflicts.

1.3.1.1 Where requirements between this code and a referenced NFPA document differ, the requirements of this code shall apply.

1.3.1.2 Where a conflict between a general requirement of this code and a specific requirement of this code exists, the specific requirement shall apply.

1.3.2 Multiple Occupancies. Where two or more classes of occupancy occur in the same building or structure and are so intermingled that separate safeguards are impracticable, means of egress facilities, construction, protection, and other safeguards shall comply with the most restrictive fire safety requirements of the occupancies involved.

1.3.3 Vehicles and Marine Vessels. Vehicles, marine vessels, or other similar conveyances, where in fixed locations and occupied as buildings, as described by Section 11.6 of NFPA 101 shall be treated as buildings and comply with this code.

1.3.4 Buildings.

1.3.4.1 Buildings permitted for construction after the adoption of this code shall comply with the provisions stated herein for new buildings.

1.3.4.2 Repairs, renovations, alterations, reconstruction, change of occupancy, and additions to buildings shall conform with NFPA 101 and the building code.

1.3.4.3 Newly introduced equipment, materials, and operations regulated by this code shall comply with the requirements for new construction or processes.

1.3.5 Severability. If any provision of this code or the application thereof to any person or circumstance is held invalid, the remainder of the code and the application of such provision to other persons or circumstances shall not be affected thereby.

1.4 Retroactivity. The provisions of this code reflect a consensus of what is necessary to provide an acceptable degree of protection from the hazards addressed in this code at the time the code was issued.

1.4.1 Unless otherwise specified, the provisions of this code shall not apply to facilities, equipment, structures, or installations that existed or were approved for construction or installation prior to the effective date of the code. Where specified, the provisions of this code shall be retroactive.

1.4.2 In those cases where the authority having jurisdiction (AHJ) determines that the existing condition presents an unacceptable degree of risk, the AHJ shall be permitted to apply retroactively any portions of this code deemed appropriate.

1.4.3 The retroactive requirements of this code shall be permitted to be modified if their application would be impractical in the judgment of the AHJ, and only where it is evident that a reasonable degree of safety is provided.

1.5 Equivalency. Nothing in this code is intended to prevent the use of systems, methods, or devices of equivalent or superior quality, strength, fire resistance, effectiveness, durability, and safety over those prescribed by this code.

1.5.1 Technical documentation shall be submitted to the AHJ to demonstrate equivalency.

1.5.2 The system, method, or device shall be approved for the intended purpose by the AHJ.

1.5.3 Alternatives. The specific requirements of this code shall be permitted to be altered by the AHJ to permit alternative methods that will secure equivalent fire safety, but in no case shall the alternative afford less fire safety than, in the judgment

of the AHJ, that which would be provided by compliance with the provisions contained in this code.

1.5.4 Modifications. The AHJ shall be authorized to modify any of the provisions of this code upon application in writing by the owner, a lessee, or a duly authorized representative where there are practical difficulties in carrying out the provisions of the code, provided that the intent of the code is met, public safety is secured, and substantial justice is done.

1.5.5 Buildings with equivalency, alternatives, or modifications approved by the AHJ shall be considered as conforming with this code.

1.5.6 Each application for an alternative fire protection feature shall be filed with the AHJ and shall be accompanied by such evidence, letters, statements, results of tests, or other supporting information as required to justify the request.

1.5.7 The AHJ shall keep a record of the actions on the applications specified in 1.5.6, and a signed copy of the AHJ's decision shall be provided for the applicant.

1.5.8 Approval. The AHJ shall approve alternative construction systems, materials, or methods of design when it is substantiated that the proposed alternative provides an equivalent level of protection of this code.

1.5.9 Tests.

1.5.9.1 Where there is insufficient evidence of compliance with the requirements of this code, or where there is evidence that any material or method of construction does not conform to the requirements of this code, or where there is insufficient evidence to substantiate claims for alternative construction systems, materials, or methods of construction, the AHJ shall be permitted to require tests for proof of compliance at the expense of the owner or the owner's agent.

1.5.9.2 Test methods shall be as specified by this code for the material in question.

1.5.9.3 If no appropriate test methods are specified in this code, the AHJ shall be authorized to accept an applicable test procedure from another recognized source.

1.5.9.4 Copies of the results of all tests specified in 1.5.9.2 and 1.5.9.3 shall be retained in accordance with local AHJ guidance.

1.6 Units and Formulas.

1.6.1 The units of measure in this code are presented first in U.S. customary units (inch-pound units), followed by International System (SI) of Units in parentheses.

1.6.2 Either system of units shall be acceptable for satisfying the requirements in the code.

1.6.3 Users of this code shall apply one system of units consistently and shall not alternate between units.

1.6.4 The values presented for measurements in this code are expressed with a degree of precision appropriate for practical application and enforcement. It is not intended that the application or enforcement of these values be more precise than the precision expressed.

1.6.5 Where extracted text contains values expressed in only one system of units, the values in the extracted text have been retained without conversion to preserve the values established

by the responsible technical committee in the source document.

1.7 Enforcement. This code shall be administered and enforced by the AHJ designated by the governing authority. See Annex K for sample wording for enabling legislation.

1.8* Permits. Permits and the permit process shall comply with the requirements of NFPA 1.

1.8.1 Plans and Specifications.

1.8.1.1 The AHJ shall have the authority to require plans and specifications to ensure compliance with applicable codes and standards.

1.8.1.2 Information that is identified by the owner as confidential shall not be made part of the public record.

1.8.2 Stop Work or Evacuation.

1.8.2.1 The AHJ shall have the authority to order an operation or use stopped and the immediate evacuation of any occupied building or area when such building or area has hazardous conditions that present imminent danger.

1.8.2.2 Whenever any work is being done contrary to provisions of this code, the AHJ is hereby authorized to order such work stopped.

1.8.2.3 The work specified in 1.8.2.2 shall immediately stop until authorized by the AHJ to proceed.

1.9 Facility Closure.

1.9.1 Where required by the AHJ, no facility storing hazardous materials listed in 1.1.1 shall close or abandon an entire storage facility without notifying the AHJ at least 30 days prior to the scheduled closing.

1.9.2 The AHJ shall be permitted to reduce the 30-day period specified in 1.9.1 when there are special circumstances requiring such reduction.

1.9.3 Facilities Out of Service.

1.9.3.1 Facilities Temporarily Out of Service. Facilities that are temporarily out of service shall continue to maintain a permit and be monitored and inspected.

1.9.3.2 Facilities Permanently Out of Service. Facilities for which a permit is not kept current or that are not monitored and inspected on a regular basis shall be deemed to be permanently out of service and shall be closed in accordance with 1.9.4.1 through 1.9.4.2.

1.9.4 Closure Plan.

1.9.4.1 Where required by the AHJ, the permit holder or applicant shall submit a closure plan to the fire department to terminate storage, dispensing, handling, or use of hazardous materials at least 30 days prior to facility closure.

1.9.4.2 The plan shall demonstrate that hazardous materials that were stored, dispensed, handled, or used in the facility have been transported, disposed of, or reused in a manner that eliminates the need for further maintenance and any threat to public health and safety.

1.10 Emergency Planning.

1.10.1 Emergency Action Plan. An emergency action plan, consistent with the available equipment and personnel, shall be

established to respond to fire and other emergencies in accordance with requirements set forth in NFPA 1.

1.10.2 Activation. The facility responsible for an unauthorized release shall activate the emergency action element of the Hazardous Materials Management Plan.

1.11 Hazardous Materials Management Plan (HMMP).

1.11.1* When required by the AHJ, new or existing facilities that store, use, or handle hazardous materials covered by this code in amounts above the MAQ specified in 5.2.1.2 through 5.2.1.5 and 5.4.1.2 shall submit a hazardous materials management plan (HMMP) to the AHJ.

1.11.2 The HMMP shall be reviewed and updated as follows:

- (1) Annually
- (2) When the facility is modified
- (3) When hazardous materials representing a new hazard category not previously addressed are stored, used, or handled in the facility

1.11.3 The HMMP shall comply with the requirements of Chapter 6.

1.12* Hazardous Materials Inventory Statement (HMIS).

1.12.1 When required by the AHJ, a hazardous materials inventory statement (HMIS) shall be completed and submitted to the AHJ.

1.12.2 The HMIS shall comply with the requirements in NFPA 1.

1.13 Plan Review.

1.13.1 Where required by the AHJ for new construction, modification, or rehabilitation, construction documents and shop drawings shall be submitted, reviewed, and approved prior to the start of such work as provided in Section 1.13.

1.13.2 The applicant shall be responsible for ensuring that the following conditions are met:

- (1) The construction documents include all of the fire protection requirements.
- (2) The shop drawings are correct and in compliance with the applicable codes and standards.
- (3) The contractor maintains an approved set of construction documents on-site.

1.13.3 It shall be the responsibility of the AHJ to promulgate rules that cover the following:

- (1) Criteria to meet the requirements of Section 1.13
- (2) Review of documents and construction documents within established time frames for the purpose of acceptance or providing reasons for nonacceptance

1.13.4 Review and approval by the AHJ shall not relieve the applicant of the responsibility of compliance with this code.

1.13.5 When required by the AHJ, revised construction documents or shop drawings shall be prepared and submitted for review and approval to illustrate corrections or modifications necessitated by field conditions or other revisions to approved plans.

1.14 Technical Assistance.

1.14.1 The AHJ shall be permitted, upon prior written notification to the applicant, building owner, or owner's agent, to

require a review by an independent third party with expertise in the matter to be reviewed at the submitter's expense.

1.14.2 The independent reviewer shall provide an evaluation and recommend necessary changes to the proposed design, operation, process, or new technology to the AHJ.

1.14.3 The AHJ shall be authorized to require design submittals to bear the stamp of a professional engineer.

1.14.4 The AHJ shall make the final determination as to whether the provisions of this code have been met.

Chapter 2 Referenced Publications

2.1 General. The documents or portions thereof listed in this chapter are referenced within this code and shall be considered part of the requirements of this document.

2.2 NFPA Publications. National Fire Protection Association, 1 Batterymarch Park, Quincy, MA 02169-7471.

NFPA 1, *Fire Code*, 2018 edition.

NFPA 2, *Hydrogen Technologies Code*, 2016 edition.

NFPA 10, *Standard for Portable Fire Extinguishers*, 2017 edition.

NFPA 13, *Standard for the Installation of Sprinkler Systems*, 2019 edition.

NFPA 15, *Standard for Water Spray Fixed Systems for Fire Protection*, 2017 edition.

NFPA 30, *Flammable and Combustible Liquids Code*, 2018 edition.

NFPA 30B, *Code for the Manufacture and Storage of Aerosol Products*, 2019 edition.

NFPA 40, *Standard for the Storage and Handling of Cellulose Nitrate Film*, 2019 edition.

NFPA 45, *Standard on Fire Protection for Laboratories Using Chemicals*, 2015 edition.

NFPA 51, *Standard for the Design and Installation of Oxygen-Fuel Gas Systems for Welding, Cutting, and Allied Processes*, 2018 edition.

NFPA 51B, *Standard for Fire Prevention During Welding, Cutting, and Other Hot Work*, 2019 edition.

NFPA 52, *Vehicular Natural Gas Fuel Systems Code*, 2016 edition.

NFPA 55, *Compressed Gases and Cryogenic Fluids Code*, 2016 edition.

NFPA 58, *Liquefied Petroleum Gas Code*, 2017 edition.

NFPA 59, *Utility LP-Gas Plant Code*, 2018 edition.

NFPA 59A, *Standard for the Production, Storage, and Handling of Liquefied Natural Gas (LNG)*, 2016 edition.

NFPA 68, *Standard on Explosion Protection by Deflagration Venting*, 2018 edition.

NFPA 69, *Standard on Explosion Prevention Systems*, 2014 edition.

NFPA 70®, *National Electrical Code®*, 2017 edition.

NFPA 72®, *National Fire Alarm and Signaling Code®*, 2019 edition.

NFPA 99, *Health Care Facilities Code*, 2018 edition.

NFPA 101®, *Life Safety Code®*, 2018 edition.

NFPA 110, *Standard for Emergency and Standby Power Systems*, 2019 edition.

NFPA 259, *Standard Test Method for Potential Heat of Building Materials*, 2018 edition.

NFPA 318, *Standard for the Protection of Semiconductor Fabrication Facilities*, 2018 edition.

NFPA 484, *Standard for Combustible Metals*, 2019 edition.

NFPA 495, *Explosive Materials Code*, 2018 edition.

NFPA 505, *Fire Safety Standard for Powered Industrial Trucks Including Type Designations, Areas of Use, Conversions, Maintenance, and Operations*, 2018 edition.

NFPA 704, *Standard System for the Identification of the Hazards of Materials for Emergency Response*, 2017 edition.

NFPA 780, *Standard for the Installation of Lightning Protection Systems*, 2017 edition.

NFPA 801, *Standard for Fire Protection for Facilities Handling Radioactive Materials*, 2014 edition.

NFPA 5000®, *Building Construction and Safety Code®*, 2018 edition.

2.3 Other Publications.

2.3.1 ASCE Publications. American Society of Civil Engineers, 1801 Alexander Bell Drive, Reston, VA 20191-4400.

ASCE/SEI 7, *Minimum Design Loads for Building and Other Structures*, 2010.

2.3.2 ASME Publications. American Society of Mechanical Engineers, Two Park Avenue, New York, NY 10016-5990.

ASME A13.1, *Scheme for the Identification of Piping Systems*, 2015.

ASME B31.3, *Process Piping*, 2016.

Boiler and Pressure Vessel Code, 2017.

▲ **2.3.3 ASSE Publications.** American Society of Sanitary Engineering, 18927 Hickory Creek Drive, Suite 220, Mokena, IL 60448.

ANSI/ASSE/IAPMO 6015, *Bulk Medical Gas Systems Installers*, 2015.

2.3.4 ASTM Publications. ASTM International, 100 Barr Harbor Drive, P.O. Box C700, West Conshohocken, PA 19428-2959.

ASTM E84, *Standard Test Method for Surface Burning Characteristics of Building Materials*, 2016.

ASTM E136, *Standard Test Method for Behavior of Materials in a Vertical Tube Furnace at 750°C*, 2016a.

ASTM E681, *Standard Test Method for Concentration Limits of Flammability of Chemicals (Vapors and Gases)*, 2009, reapproved 2015.

ASTM E1591, *Standard Guide for Obtaining Data for Deterministic Fire Models*, 2013.

ASTM E2652, *Standard Test Method for Behavior of Materials in a Tube Furnace with a Cone-Shaped Airflow Stabilizer, at 750°C*, 2016.

2.3.5 CGA Publications. Compressed Gas Association, 14501 George Carter Way, Suite 103, Chantilly, VA 20151-2923.

CGA C-7, *Guide to Classification and Labeling of Compressed Gases*, 2014.

CGA M-1, *Guide for Medical Gas Supply Systems at Health Care Facilities*, 2013.

CGA P-1, *Safe Handling of Compressed Gases in Containers*, 2015.

ANSI/CGA P-18, *Standard for Bulk Inert Gas Systems*, 2013.

CGA P-20, *Standard for the Classification of Toxic Gas Mixtures*, 2009.

CGA P-23, *Standard for Categorizing Gas Mixtures Containing Flammable and Nonflammable Components*, 2015.

ANSI/CGA G-13, *Storage and Handling of Silane and Silane Mixtures*, 2016.

CGA S-1.1, *Pressure Relief Device Standards — Part 1 — Cylinders for Compressed Gases*, 2011.

CGA S-1.2, *Pressure Relief Device Standards — Part 2 — Cargo and Portable Tanks for Compressed Gases*, 2009.

CGA S-1.3, *Pressure Relief Device Standards — Part 3 — Stationary Storage Containers for Compressed Gases*, 2008.

CGA V-6, *Standard Bulk Refrigerated Liquid Transfer Connections*, 2014.

2.3.6 IAPMO Publications. International Association of Plumbing and Mechanical Officials, 4755 E. Philadelphia Street, Ontario, CA 91761.

Uniform Mechanical Code, 2018.

2.3.7 IME Publications. Institute of Makers of Explosives, 1212 New York Avenue, NW, Suite 650, Washington, DC 20005.

IMESLP 2, “American Table of Distances (ATD),” June 1991 (incorporates changes through April 2017).

2.3.8 ISO Publications. International Organization for Standardization, ISO Central Secretariat, BIBC II, Chemin de Blandinnet 8, CP 401, 1214 Vernier, Geneva, Switzerland.

ISO 10156, *Gases and gas mixtures — Determination of fire potential and oxidizing ability for the selection of cylinder valve outlets*, 2010, corrigendum 1, 2010.

ISO 10298, *Determination of toxicity of a gas or gas mixture*, 2010.

2.3.9 TC Publications. Transport Canada, 330 Sparks Street, Ottawa, ON K1A 0N5, Canada.

Canadian Ministry of Transport Regulations.

N 2.3.10 UN Publications. United Nations Publications, Sales and Marketing Section, Room DC2-853, Dept. I004, New York, NY 10017.

Manual of Tests and Criteria, Part II, 5th edition, 2010.

Transportation of Dangerous Goods Regulations.

2.3.11 UL Publications. Underwriters Laboratories Inc., 333 Pfingsten Road, Northbrook, IL 60062-2096.

ANSI/UL 723, *Standard for Test for Surface Burning Characteristics of Building Materials*, 2008, revised 2013.

Δ 2.3.12 U.S. Government Publications. U.S. Government Publishing Office, 732 North Capitol Street, NW, Washington, DC 20401-0001.

Resource Conservation and Recovery Act (RCRA), 1976.

Title 18, United States Code, Part 40, “Importation, Manufacture, Distribution and Storage of Explosive Materials.”

Title 21, Code of Federal Regulations, Part 210, “Current Good Manufacturing Practice in Manufacturing, Processing, Packaging, or Holding of Drugs; General.”

Title 21, Code of Federal Regulations, Part 211, “Current Good Manufacturing Practice for Positron Emission Tomography Drugs.”

Title 29, Code of Federal Regulations, Part 1910.1000, “Air Contaminants.”

Title 49, Code of Federal Regulations, Parts 100–199, “Pipeline and Hazardous Materials, Safety Administration, Department of Transportation.”

Title 49, Code of Federal Regulations, Part 173, “Shippers — General Requirements for Shipments and Packagings.”

2.3.13 Other Publications.

Merriam-Webster’s Collegiate Dictionary, 11th edition, Merriam-Webster Inc., Springfield, MA, 2003.

2.4 References for Extracts in Mandatory Sections.

NFPA 1, *Fire Code*, 2018 edition.

NFPA 30, *Flammable and Combustible Liquids Code*, 2018 edition.

NFPA 30B, *Code for the Manufacture and Storage of Aerosol Products*, 2019 edition.

NFPA 52, *Vehicular Natural Gas Fuel Systems Code*, 2016 edition.

NFPA 55, *Compressed Gases and Cryogenic Fluids Code*, 2016 edition.

NFPA 58, *Liquefied Petroleum Gas Code*, 2017 edition.

NFPA 68, *Standard on Explosion Protection by Deflagration Venting*, 2018 edition.

NFPA 101[®], *Life Safety Code*[®], 2018 edition.

NFPA 318, *Standard for the Protection of Semiconductor Fabrication Facilities*, 2018 edition.

NFPA 495, *Explosive Materials Code*, 2018 edition.

NFPA 652, *Standard on the Fundamentals of Combustible Dust*, 2019 edition.

NFPA 914, *Code for Fire Protection of Historic Structures*, 2015 edition.

NFPA 5000[®], *Building Construction and Safety Code*[®], 2018 edition.

Chapter 3 Definitions

3.1* General. The definitions contained in this chapter shall apply to the terms used in this code. Where terms are not defined in this chapter or within another chapter, they shall be defined using their ordinarily accepted meanings within the context in which they are used. *Merriam-Webster’s Collegiate Dictionary*, 11th edition, shall be the source for the ordinarily accepted meaning.

3.2 NFPA Official Definitions.

3.2.1* Approved. Acceptable to the authority having jurisdiction.

3.2.2* Authority Having Jurisdiction (AHJ). An organization, office, or individual responsible for enforcing the requirements of a code or standard, or for approving equipment, materials, an installation, or a procedure.

3.2.3* Code. A standard that is an extensive compilation of provisions covering broad subject matter or that is suitable for adoption into law independently of other codes and standards.

3.2.4 Labeled. Equipment or materials to which has been attached a label, symbol, or other identifying mark of an organization that is acceptable to the authority having jurisdiction and concerned with product evaluation, that maintains periodic inspection of production of labeled equipment or materials, and by whose labeling the manufacturer indicates compliance with appropriate standards or performance in a specified manner.

3.2.5* Listed. Equipment, materials, or services included in a list published by an organization that is acceptable to the authority having jurisdiction and concerned with evaluation of products or services, that maintains periodic inspection of production of listed equipment or materials or periodic evaluation of services, and whose listing states that either the equipment, material, or service meets appropriate designated standards or has been tested and found suitable for a specified purpose.

3.2.6 Shall. Indicates a mandatory requirement.

3.2.7 Should. Indicates a recommendation or that which is advised but not required.

3.3 General Definitions.

3.3.1* Absolute Pressure [Gas]. Pressure based on a zero reference point, the perfect vacuum. [55, 2016]

N 3.3.2* Access Aisle. Limited-width spaces used to move between storage piles.

N 3.3.3* Aisle. A clear area between the faces of two storage piles or the faces of two storage racks providing access to the storage with material-handling equipment.

3.3.4 Area.

3.3.4.1 Control Area. A building or portion of a building or outdoor area within which hazardous materials are allowed to be stored, dispensed, used, or handled in quantities not exceeding the MAQ.

3.3.4.2 Indoor Area [Gas]. An area that is within a building or structure having overhead cover, other than a structure qualifying as “weather protection” in accordance with Section 6.6 of NFPA 55. [55, 2016] (*See also 3.3.4.4, Outdoor Area.*)

3.3.4.3 Organic Peroxide Storage Area. An area used for the storage of organic peroxide formulations.

3.3.4.4 Outdoor Area [Gas]. An area that is not an indoor area. [55, 2016]

3.3.4.5 Outdoor Control Area. An outdoor area within which hazardous materials are allowed to be stored, dispensed, used, or handled in quantities not exceeding the MAQ.

3.3.5 ASME. American Society of Mechanical Engineers. [58, 2017]

3.3.6 ASTM [Gas]. American Society for Testing and Materials, now known as “ASTM International.” [55, 2016]

3.3.7 Basement. Any story of a building wholly or partly below grade plane that is not considered the first story above grade plane. [5000, 2018].

3.3.8 Building. Any structure used or intended for supporting or sheltering any use or occupancy. [101, 2018]

3.3.9 Building Code. The building or construction code adopted by the jurisdiction.

3.3.10 Bulk Ammonium Nitrate. Large quantities of ammonium nitrate solids in the form of a pile, not divided into parts or packaged into separate units.

3.3.11* Bulk Hydrogen Compressed Gas System. A gaseous hydrogen (GH₂) system with a storage capacity of more than 5000 scf (141.6 Nm³) of compressed hydrogen gas. [55, 2016]

3.3.12* Bulk Inert Gas System. An assembly of equipment, that consists of, but is not limited to, storage containers, pressure regulators, pressure relief devices, vaporizers, manifolds, and piping, with a storage capacity of more than 20,000 scf (566 m³) of inert gas, including unconnected reserves on hand at the site, and that terminates at the source valve. [55, 2016]

3.3.13* Bulk Liquefied Hydrogen System [Gas]. A liquefied hydrogen (LH₂) system with a storage capacity of more than 39.7 gal (150 L) of liquefied hydrogen. [55, 2016]

3.3.14* Bulk Oxygen System. An assembly of equipment, such as oxygen storage containers, pressure regulators, pressure relief devices, vaporizers, manifolds, and interconnecting piping, that has a storage capacity of more than 20,000 scf (566 m³) of oxygen and that terminates at the source valve. [55, 2016]

3.3.15 CFR. The Code of Federal Regulations of the United States Government. [1, 2018]

3.3.16 CGA [Gas]. Compressed Gas Association. [1, 2018]

3.3.17 Combustible. A substance that will burn.

Δ 3.3.18* Combustible Dust. A finely divided combustible particulate solid that presents a flash-fire hazard or explosion hazard when suspended in air or the process-specific oxidizing medium over a range of concentrations. [652, 2019]

3.3.19 Combustible Liquid. Any liquid that has a closed-cup flash point at or above 100°F (37.8°C), as determined by the test procedures and apparatus set forth in NFPA 30. Combustible liquids are classified in accordance with the following: (1) Class II Liquid — any liquid that has a flash point at or above 100°F (37.8°C) and below 140°F (60°C); (2) Class III Liquid — any liquid that has a flash point at or above 140°F (60°C); (a) Class IIIA Liquid — any liquid that has a flash point at or above 140°F (60°C), but below 200°F (93°C); and (b) Class IIIB Liquid — any liquid that has a flash point at or above 200°F (93°C). [30, 2018]

3.3.20* Compressed Gas System. An assembly of equipment designed to contain, distribute, or transport compressed gases. [318, 2018]

3.3.21 Container. A containment device including, but not limited to, cylinders, tanks, intermediate bulk containers, pressure vessels, drums, carboys, cans, bottles, boxes, bags, bins, and portable tanks that vary in shape, size, and material of construction and are used for holding, storing, and transporting hazardous materials covered by this code.

3.3.21.1 ASME Container. A container constructed in accordance with the ASME *Boiler and Pressure Vessel Code*.

3.3.21.2* Container [Flammable and Combustible Liquid]. Any vessel of 119 gal (450 L) or less capacity used for transporting or storing liquids. [30, 2018]

3.3.21.3 Closed Container [Flammable and Combustible Liquid]. A container as herein defined, so sealed by means of a lid or other device that neither liquid nor vapor will escape from it at ordinary temperatures. [30, 2018]

3.3.21.4 Combustible Containers. Containers that include paper bags, fiber drums, plastic containers, and wooden or fiber boxes or barrels, as well as noncombustible containers having removable combustible liners or packing, and noncombustible containers having combustible overpacks.

3.3.21.5 Noncombustible Containers. Containers constructed of glass or metal that can be coated with a polymeric material no more than $\frac{1}{32}$ in. (2 mils) in thickness.

3.3.21.6* Nonmetallic Container [Solid, Flammable, and Combustible Liquid]. A container as defined in 3.3.21 constructed of glass, plastic, fiber, or a material other than metal. [30, 2018]

3.3.21.7 Overpack Container. A closed container intended to encapsulate and contain a leaking or damaged liquid or solid material container thereby preventing the release of liquids, solids, or vapors and is made of the same material or similarly protective material as the leaking or damaged container.

3.3.21.8 Cylinder Containment Vessel [Gas]. See 3.3.27.

3.3.21.9 Storage Tank [Flammable and Combustible Liquid]. Any vessel having a liquid capacity that exceeds 60 gal (230 L), is intended for fixed installation, and is not used for processing. [30, 2018]

3.3.21.9.1* Stationary Tank [Gas]. A packaging designed primarily for stationary installations not intended for loading, unloading, or attachment to a transport vehicle as part of its normal operation in the process of use. [55, 2016]

3.3.21.10 Aboveground Tank [Flammable and Combustible Liquid]. A storage tank that is installed above grade, at grade, or below grade without backfill. [30, 2018]

3.3.21.10.1* Atmospheric Tank [Flammable and Combustible Liquid]. A storage tank that has been designed to operate at pressures from atmospheric through a gauge pressure of 1.0 psi (6.9 kPa) (i.e., 760 mm Hg through 812 mm Hg) measured at the top of the tank. [30, 2018]

3.3.21.10.2 Secondary Containment Tank [Flammable and Combustible Liquid]. A tank that has an inner and outer wall with an interstitial space (annulus) between the walls and which has a means of monitoring the interstitial space for a leak. [30, 2018]

3.3.21.11* Portable Tank [Flammable and Combustible Liquid]. Any vessel having a liquid capacity over 60 gals (230 L) intended for storing liquids and not intended for fixed installation. [30, 2018]

3.3.21.11.1* Portable Tank [Gas]. Any packaging over 60 U.S. gal (227.1 L) capacity designed primarily to be loaded into or on, or temporarily attached to, a transport vehicle or ship and equipped with skids, mountings, or accessories to facilitate handling of the tank by mechanical means. [55, 2016]

3.3.21.11.2* Nonmetallic Portable Tank [Flammable and Combustible Liquid]. A portable tank as herein defined

constructed of plastic, fiber, or a material other than metal. [30, 2018]

3.3.21.12* Pressure Vessel. A container, process vessel, or other component designed in accordance with the ASME Boiler and Pressure Vessel Code, DOT, or other approved standards.

3.3.21.13 Cylinder [Gas]. See 3.3.25.

3.3.21.13.1 Cylinder Pack [Gas] See 3.3.28.

3.3.21.14 Compressed Gas Container (Gas). A pressure vessel designed to hold compressed gas at an absolute pressure greater than 1 atmosphere at 68°F (20°C) that includes cylinders, containers, and tanks. [55, 2016]

3.3.21.14.1* Tube Trailer [Gas]. See 3.3.87.

3.3.21.15* ISO Module. A single unit or unit assembly of containers, IBCs, portable tanks, or cylinders permanently mounted in a frame conforming to International Organization for Standardization (ISO) requirements.

3.3.21.16* Safety Can [Liquid]. A listed container of not more than 5.3 gal (20 L) capacity having a screen or strainer in each fill and pour opening and having a spring closing lid and spout cover designed to safely relieve internal pressure when exposed to fire. [30, 2018]

3.3.21.17 Aerosol Container [Liquid]. A metal can or plastic container up to a maximum size of 33.8 fl oz (1000 ml) or a glass, stone, or metal bottle up to a maximum size of 4 fl oz (118 ml) that is designed and intended to dispense an aerosol. [30B, 2019]

3.3.22 Continuous Gas Detection System [Gas]. A gas detection system in which the instrument is maintained in continuous operation and the interval between sampling of any point does not exceed 30 minutes. [55, 2016]

3.3.23 Court. An open, uncovered, unoccupied space, unobstructed to the sky, bounded on three or more sides by exterior building walls. [101, 2018]

3.3.23.1 Enclosed Court. A court bounded on all sides by the exterior walls of a building or by the exterior walls and lot lines on which walls are permitted. [5000, 2018]

3.3.24 Cryogenic Fluid [Gas]. A fluid with a boiling point lower than -130°F (-90°C) at an absolute pressure of 14.7 psi (101.325 kPa). [55, 2016]

3.3.24.1 Flammable Cryogenic Fluid. A cryogenic fluid that forms flammable mixture in air when in its vapor state. [55, 2016]

3.3.24.2 Inert Cryogenic Fluid. A cryogenic fluid that vaporizes to produce an inert gas when in its vapor state. [55, 2016]

3.3.24.3 Oxidizing Cryogenic Fluid. An oxidizing gas in the cryogenic state. [55, 2016]

3.3.25* Cylinder [Gas]. A pressure vessel designed for pressures higher than absolute pressure of 40 psi (276 kPa) and having a circular cross-section.

3.3.26 Cylinder Containment System [Gas]. A gastight recovery system comprising equipment or devices that can be placed over a leak in a compressed gas container, thereby stopping or

controlling the escape of gas from the leaking container. [55, 2016]

3.3.27 Cylinder Containment Vessel [Gas]. A gastight recovery vessel designed so that a leaking compressed gas container can be placed within its confines, thereby encapsulating the leaking container. [55, 2016]

3.3.28* Cylinder Pack [Gas]. An arrangement of cylinders into a cluster where the cylinders are confined into a grouping or arrangement with a strapping or frame system and connections are made to a common manifold. The frame system is allowed to be on skids or wheels to permit movement. [55, 2016]

3.3.29 Deflagration. Propagation of a combustion zone at a velocity that is less than the speed of sound in the unreacted medium. [68, 2018]

3.3.30 Detached Building. A separate building that is separated from other structures or uses as required by *NFPA 5000* for a freestanding structure. [5000, 2018]

3.3.31 Detonation. Propagation of a combustion zone at a velocity greater than the speed of sound in the unreacted medium. [68, 2018]

3.3.32 Distributor [Gas]. A business engaged in the sale or resale, or both, of compressed gases or cryogenic fluids, or both. [55, 2016]

3.3.33 DOT. U.S. Department of Transportation. [52, 2016]

3.3.34 Emergency Response. Emergency response or responding to emergencies means a response effort by employees from outside the immediate release area or by other designated responders including, but not limited to, private sector emergency responders, mutual aid groups, local fire departments, or other qualified parties to an occurrence that results, or is likely to result, in an uncontrolled release of a hazardous material.

3.3.35 Emergency Response Liaison. A person designated to act as a liaison for emergency response as defined by the emergency plan.

3.3.36 Emergency Shutoff Valve [Gas]. A designated valve designed to shut off the flow of gases or liquids. [55, 2016]

3.3.36.1 Automatic Emergency Shutoff Valve [Gas]. A designated fail-safe automatic closing valve designed to shut off the flow of gases or liquids that is initiated by a control system where the control system is activated by either manual or automatic means. [55, 2016]

3.3.36.2 Manual Emergency Shutoff Valve [Gas]. A designated valve designed to shut off the flow of gases or liquids that is manually operated. [55, 2016]

3.3.37 Excess Flow Control [Gas]. A fail-safe system or approved means designed to shut off flow due to a rupture in pressurized piping systems. [55, 2016]

3.3.38* Exhausted Enclosure [Gas]. An appliance or piece of equipment that consists of a top, a back, and two sides that provides a means of local exhaust for capturing gases, fumes, vapors, and mists. [55, 2016]

3.3.39* Explosion Control [Gas]. A means of either preventing an explosion through the use of explosion suppression, fuel reduction, or oxidant reduction systems or a means to

prevent the structural collapse of a building in the event of an explosion through the use of deflagration venting, barricades, or related construction methods. [55, 2016]

Δ 3.3.40 Explosion Vent. An opening in an enclosure to relieve the developing pressure from a deflagration.

3.3.41* Explosive. Any chemical compound, mixture, or device, the primary or common purpose of which is to function by explosion. [495, 2018]

3.3.42* Explosive Decomposition. Rapid chemical reaction resulting in a large, almost instantaneous, release of energy.

3.3.43* Explosive Reaction. A reaction, which includes both deflagration and detonation, producing a sudden rise in pressure with potentially destructive results.

3.3.44 Fire Prevention Code. The fire prevention code adopted by the jurisdiction.

3.3.45 Fire Protection System. Any fire alarm device or system or fire extinguishing device or system, or a combination thereof, that is designed and installed for detecting, controlling, or extinguishing a fire or otherwise alerting occupants, or the fire department, or both, that a fire has occurred. [1, 2018]

3.3.46* Flammable Liquid (Class I). Any liquid having a closed-cup flash point below 100°F (37.8°C).

3.3.47* Flammable Solid. A solid substance, other than a substance defined as a blasting agent or explosive, that is liable to cause fire resulting from friction or retained heat from manufacture, that has an ignition temperature below 212°F (100°C), or that burns so vigorously or persistently when ignited that it creates a serious hazard.

3.3.48 Gallon [Gas]. A standard U.S. gallon. [55, 2016]

3.3.49 Gas.

3.3.49.1* Compressed Gas [Gas]. A material, or mixture of materials, that (1) is a gas at 68°F (20°C) or less at an absolute pressure of 14.7 psi (101.325 kPa) and (2) that has a boiling point of 68°F (20°C) or less at an absolute pressure of 14.7 psi (101.325 kPa) and that is liquefied, nonliquefied, or in solution, except those gases that have no other health or physical hazard properties are not considered to be compressed gases until the pressure in the packaging exceeds an absolute pressure of 40.6 psi (280 kPa) at 68°F (20°C). [55, 2016]

3.3.49.2 Corrosive Gas [Gas]. A gas that causes visible destruction of or irreversible alterations in living tissue by chemical action at the site of contact. [55, 2016]

3.3.49.3 Flammable Gas [Gas]. A material that is a gas at 68°F (20°C) or less at an absolute pressure of 14.7 psi (101.325 kPa), that is ignitable at an absolute pressure of 14.7 psi (101.325 kPa) when in a mixture of 13 percent or less by volume with air, or that has a flammable range at an absolute pressure of 14.7 psia (101.325 kPa) with air of at least 12 percent, regardless of the lower limit. [55, 2016]

3.3.49.4 Flammable Liquefied Gas [Gas]. A liquefied compressed gas that, when under a charged pressure, is partially liquid at a temperature of 68°F (20°C) and is flammable. [55, 2016]

3.3.49.5 Highly Toxic Gas [Gas]. A chemical that has a median lethal concentration (LC₅₀) in air of 200 ppm by

volume or less of gas or vapor, or 2 mg/L or less of mist, fume, or dust, when administered by continuous inhalation for 1 hour (or less if death occurs within 1 hour) to albino rats weighing between 0.44 lb and 0.66 lb (200 g and 300 g) each. [55, 2016]

3.3.49.6 Inert Gas [Gas]. A nonreactive, nonflammable, noncorrosive gas such as argon, helium, krypton, neon, nitrogen, and xenon. [55, 2016]

3.3.49.7* Irritant Gas [Gas]. A chemical that is not corrosive, but that causes a reversible inflammatory effect on living tissue by chemical action at the site of contact.

3.3.49.8 Nonflammable Gas [Gas]. A gas that does not meet the definition of a flammable gas. [55, 2016]

3.3.49.9* Other Gas [Gas]. A gas that is not a corrosive gas, flammable gas, highly toxic gas, oxidizing gas, pyrophoric gas, toxic gas, or unstable reactive gas with a hazard rating of Class 2, Class 3, or Class 4 gas. [55, 2016]

3.3.49.10 Oxidizing Gas [Gas]. A gas that can support and accelerate combustion of other materials more than air does. [55, 2016]

3.3.49.11 Pyrophoric Gas [Gas]. A gas with an autoignition temperature in air at or below 130°F (54.4°C). [55, 2016]

3.3.49.12 Toxic Gas [Gas]. A gas with a median lethal concentration (LC₅₀) in air of more than 200 ppm, but not more than 2000 ppm by volume of gas or vapor, or more than 2 mg/L, but not more than 20 mg/L of mist, fume, or dust, when administered by continuous inhalation for 1 hour (or less if death occurs within 1 hour) to albino rats weighing between 0.44 lb and 0.66 lb (200 g and 300 g) each. [55, 2016]

3.3.49.13* Unstable Reactive Gas [Gas]. A gas that, in the pure state or as commercially produced, will vigorously polymerize, decompose, or condense, become self-reactive, or otherwise undergo a violent chemical change under conditions of shock, pressure, or temperature. [55, 2016]

3.3.49.13.1 Class 2 Unstable Reactive Gas [Gas]. Materials that readily undergo violent chemical change at elevated temperatures and pressures. [55, 2016]

3.3.49.13.2 Class 3 Unstable Reactive Gas [Gas]. Materials that in themselves are capable of detonation or explosive decomposition or explosive reaction, but that require a strong initiating source or that must be heated under confinement before initiation. [55, 2016]

3.3.49.13.3 Class 4 Unstable Reactive Gas [Gas]. Materials that in themselves are readily capable of detonation or explosive decomposition or explosive reaction at normal temperatures and pressures. [55, 2016]

3.3.50* Gas Cabinet [Gas]. A fully enclosed, noncombustible enclosure used to provide an isolated environment for compressed gas cylinders in storage or use. [55, 2016]

3.3.51 Gas Manufacturer/Producer [Gas]. A business that produces compressed gases or cryogenic fluids, or both, or fills portable or stationary gas cylinders, containers, or tanks. [55, 2016]

3.3.52* Gas Room [Gas]. A separately ventilated, fully enclosed room in which only compressed gases, cryogenic

fluids, associated equipment and supplies are stored or used. [55, 2016]

3.3.53* Gaseous Hydrogen (GH₂) System. An assembly of equipment that consists of, but is not limited to, storage containers, pressure regulators, pressure relief devices, compressors, manifolds, and piping and that terminates at the source valve. [55, 2016]

3.3.54 Handling. The deliberate movement of material by any means to a point of storage or use. [1, 2018]

3.3.55 Hazardous Materials Storage Cabinet. A metal cabinet complying with the conditions set forth in 6.1.18.

3.3.56 High-Hazard Level Contents.

3.3.56.1 High-Hazard Level 1 Contents. For definition and examples see 4.2.1.2.1.

3.3.56.2 High-Hazard Level 2 Contents. For definition and examples see 4.2.1.2.2.

3.3.56.3 High-Hazard Level 3 Contents. For definition and examples see 4.2.1.2.3.

3.3.56.4 High-Hazard Level 4 Contents. For definition and examples see 4.2.1.2.4.

3.3.57* Immediately Dangerous to Life and Health (IDLH) [Gas]. A concentration of airborne contaminants, normally expressed in parts per million (ppm) or milligrams per cubic meter, that represents the maximum level from which one could escape within 30 minutes without any escape-impairing symptoms or irreversible health effects. [55, 2016]

3.3.58* ISO Module [Gas]. An assembly of tanks or tubular cylinders permanently mounted in a frame conforming to International Organization for Standardization (ISO) requirements. [55, 2016]

3.3.59 Limit.

3.3.59.1 Ceiling Limit. The maximum concentration of an airborne contaminant to which a person can be exposed.

3.3.59.2* Permissible Exposure Limit (PEL) [Gas]. The maximum permitted 8-hour, time-weighted average concentration of an airborne contaminant. [55, 2016]

3.3.59.3* Short-Term Exposure Limit (STEL) [Gas]. The concentration to which it is believed that workers can be exposed continuously for a short period of time without suffering from irritation, chronic or irreversible tissue damage, or narcosis of a degree sufficient to increase the likelihood of accidental injury, impairment of self-rescue, or the material reduction of work efficiency, without exceeding the daily permissible exposure limit (PEL). [55, 2016]

3.3.60 Liquefied Hydrogen (LH₂) System. An assembly of equipment that consists of, but is not limited to, storage containers, pressure regulators, pressure relief devices, compressors, manifolds, and piping and that terminates at the source valve. [55, 2016]

3.3.61 Manufacturing Plants. Those facilities where hazardous materials are produced by chemical means or where hazardous materials are pelletized, ground, dissolved, packaged, mixed, or blended.

3.3.62 Material.

3.3.62.1 Combustible (Material). A material that, in the form in which it is used and under the conditions anticipated, will ignite and burn; a material that does not meet the definition of noncombustible or limited-combustible. [5000, 2018]

3.3.62.2* Corrosive Material. A chemical that causes visible destruction of, or irreversible alterations in, living tissue by chemical action at the site of contact.

3.3.62.3 Hazard Material.

3.3.62.3.1 Health Hazard Material. A chemical or substance classified as a toxic, highly toxic, or corrosive material in accordance with definitions set forth in this code.

3.3.62.3.2 Physical Hazard Material. A chemical or substance classified as a combustible liquid, explosive, flammable cryogen, flammable gas, flammable liquid, flammable solid, organic peroxide, oxidizer, oxidizing cryogen, pyrophoric, unstable (reactive), or water-reactive material.

3.3.62.4* Hazardous Material. A chemical or substance that is classified as a physical hazard material or a health hazard material, whether the chemical or substance is in usable or waste condition. (See also 3.3.62.3.1, *Health Hazard Material*, and 3.3.62.3.2, *Physical Hazard Material*.)

3.3.62.5* Incompatible Material. Materials that, when in contact with each other, have the potential to react in a manner that generates heat, fumes, gases, or by-products that are hazardous to life or property.

3.3.62.6 Limited-Combustible (Material). See 4.6.2.

3.3.62.7* Noncombustible Material. See 4.6.1.

3.3.62.8 Pyrophoric Material. A chemical with an autoignition temperature in air at or below 130°F (54.4°C).

3.3.62.9* Toxic Material. A material that produces a lethal dose or a lethal concentration within any of the following categories: (1) a chemical or substance that has a median lethal dose (LD₅₀) of more than 50 mg/kg but not more than 500 mg/kg of body weight when administered orally to albino rats weighing between 200 g and 300 g each; (2) a chemical or substance that has a median lethal dose (LD₅₀) of more than 200 mg/kg but not more than 1000 mg/kg of body weight when administered by continuous contact for 24 hours, or less if death occurs within 24 hours, with the bare skin of albino rabbits weighing between 2 kg and 3 kg each; (3) a chemical or substance that has a median lethal concentration (LC₅₀) in air of more than 200 parts per million but not more than 2000 parts per million by volume of gas or vapor, or more than 2 mg/L but not more than 20 mg/L, of mist, fume, or dust when administered by continuous inhalation for 1 hour, or less if death occurs within 1 hour, to albino rats weighing between 200 g and 300 g each.

3.3.62.9.1* Highly Toxic Material. A material that produces a lethal dose or lethal concentration that falls within any of the following categories: (1) a chemical that has a median lethal dose (LD₅₀) of 50 mg/kg or less of body weight when administered orally to albino rats weighing between 200 g and 300 g each; (2) a chemical that has a median lethal dose (LD₅₀) of 200 mg/kg or less of body weight when

administered by continuous contact for 24 hours, or less if death occurs within 24 hours, with the bare skin of albino rabbits weighing between 2 kg and 3 kg each or albino rats weighing 200 g and 300 g each; (3) a chemical that has a median lethal concentration (LC₅₀) in air of 200 parts per million by volume or less of gas or vapor, or 2 mg/L or less of mist, fume, or dust, when administered by continuous inhalation for 1 hour, or less if death occurs within 1 hour, to albino rats weighing between 200 g and 300 g each.

3.3.62.10* Unstable (Reactive) Material. A material that, in the pure state or as commercially produced, will vigorously polymerize, decompose or condense, become self-reactive, or otherwise undergo a violent chemical change under conditions of shock, pressure, or temperature.

3.3.62.10.1* Class 1 Unstable (Reactive). Materials that in themselves are normally stable, but that can become unstable at elevated temperatures and pressures.

3.3.62.10.2* Class 2 Unstable (Reactive). Materials that readily undergo violent chemical change at elevated temperatures and pressures.

3.3.62.10.3* Class 3 Unstable (Reactive). Materials that in themselves are capable of detonation or explosive decomposition or explosive reaction, but that require a strong initiating source or that must be heated under confinement before initiation.

3.3.62.10.4* Class 4 Unstable (Reactive). Materials that in themselves are readily capable of detonation or explosive decomposition or explosive reaction at normal temperatures and pressures.

3.3.62.11* Water-Reactive Material. A material that explodes, violently reacts, produces flammable, toxic, or other hazardous gases; or evolves enough heat to cause self-ignition or ignition of nearby combustibles upon exposure to water or moisture.

3.3.63* Maximum Allowable Quantity Per Control Area (MAQ). A threshold quantity of hazardous material in a specific hazard class that once exceeded, requires the application of additional administrative procedures, construction features, or engineering controls.

3.3.64 Mechanical Code [Gas]. The mechanical or mechanical construction code adopted by the jurisdiction. [55, 2016]

3.3.65* Mobile Supply Unit [Gas]. Any supply source that is equipped with wheels so it is able to be moved around. [55, 2016]

3.3.66* Nesting [Gas]. A method of securing cylinders upright in a tight mass using a contiguous three-point contact system whereby all cylinders in a group have a minimum of three contact points with other cylinders or a solid support structure (e.g., a wall or railing). [55, 2016]

3.3.67* Nonbulk Flammable Gas System. A system consisting of cylinders or other storage systems, with each individual cylinder and each individual set of connected cylinders having less than 5000 scf (141.6 Nm³). [55, 2016]

3.3.68* Normal Temperature and Pressure (NTP) [Gas]. A temperature of 70°F (21°C) at an absolute pressure of 14.7 psi (101.325 kPa). [55, 2016]

3.3.69 Occupancy. The purpose for which a building or other structure, or part thereof, is used or intended to be used. [ASCE/SEI 7:1.2]

3.3.69.1* Assembly Occupancy. An occupancy (1) used for a gathering of 50 or more persons for deliberation, worship, entertainment, eating, drinking, amusement, awaiting transportation, or similar uses; or (2) used as a special amusement building, regardless of occupant load. [101, 2018]

3.3.69.2* Business Occupancy. An occupancy used for the transaction of business other than mercantile. [5000, 2018]

3.3.69.3* Day-Care Occupancy. An occupancy in which four or more clients receive care, maintenance, and supervision, by other than their relatives or legal guardians, for less than 24 hours per day. [5000, 2018]

3.3.69.4* Detention and Correctional Occupancy. An occupancy used to house one or more persons under varied degrees of restraint or security where such occupants are mostly incapable of self-preservation because of security measures not under the occupants' control. [5000, 2018]

3.3.69.5* Educational Occupancy. An occupancy used for educational purposes through the twelfth grade by six or more persons for 4 or more hours per day or more than 12 hours per week. [5000, 2018]

3.3.69.6* Health Care Occupancy. An occupancy used to provide medical or other treatment or care simultaneously to four or more patients, on an inpatient basis, where such patients are mostly incapable of self-preservation due to age, physical or mental disability, or because of security measures not under the occupants' control. [5000, 2018]

3.3.69.6.1* Ambulatory Health Care Occupancy. An occupancy used to provide services or treatment simultaneously to four or more patients that provides, on an outpatient basis, one or more of the following: (1) treatment for patients that renders the patients incapable of taking action for self-preservation under emergency conditions without the assistance of others; (2) anesthesia that renders the patients incapable of taking action for self-preservation under emergency conditions without the assistance of others; (3) treatment for patients who, due to the nature of their injury or illness, are incapable of taking action for self-preservation under emergency conditions without the assistance of others. [101, 2018]

3.3.69.7* Industrial Occupancy. An occupancy in which products are manufactured or in which processing, assembling, mixing, packaging, finishing, decorating, or repair operations are conducted. [5000, 2018]

3.3.69.8* Mercantile Occupancy. An occupancy used for the display and sale of merchandise. [5000, 2018]

3.3.69.9 Multiple Occupancy. A building or structure in which two or more classes of occupancy exist. [5000, 2018]

3.3.69.10* Residential Board and Care Occupancy. An occupancy used for lodging and boarding of four or more residents, not related by blood or marriage to the owners or operators, for the purpose of providing personal care services. [5000, 2018]

3.3.69.11* Residential Occupancy. An occupancy that provides sleeping accommodations for purposes other than health care or detention and correctional. [5000, 2018]

3.3.69.12* Storage Occupancy. An occupancy used primarily for the storage or sheltering of goods, merchandise, products, or vehicles. [5000, 2018]

3.3.70 Organic Peroxide. Any organic compound having a double oxygen or peroxy (-O-O-) group in its chemical structure.

3.3.71 Organic Peroxide Formulation. A pure or technically pure organic peroxide or a mixture of organic peroxides with an active oxygen (aO) concentration greater than 1 percent alone or in combination with one or more materials. The transport type for organic peroxide formulations is determined by the UN *Manual of Tests and Criteria, Part II*. Terms such as *accelerator*, *catalyst*, *initiator*, and *curing agent* are sometimes used to describe organic peroxide formulations and are misleading because they can also refer to materials that are not or do not contain organic peroxides, some of which might present increased hazard when mixed with organic peroxides.

3.3.71.1 Class I Organic Peroxide. Describes organic peroxide formulations that are more severe than a Class II but do not detonate and that are characterized as “explosive in package” or by a very fast burning rate. Includes those characterized for transport as Type B, those characterized for transport as Type C with a large-scale burning rate equal to or greater than 300 kg/min, and those characterized for transport as Type C with a small-scale burning rate greater than 9.0 kg/min × m² unless the large-scale burning rate is less than 300 kg/min.

3.3.71.2 Class II Organic Peroxide.

N 3.3.71.2.1 Class IIA Organic Peroxide. Describes organic peroxide formulations characterized for transport as Type C with a large-scale burning rate greater than 140 kg/min but less than 300 kg/min. Includes those characterized as Type C, Type D, and Type E if the small-scale burning rate is greater than 2.2 kg/min × m².

N 3.3.71.2.2 Class IIB Organic Peroxide. Describes organic peroxide formulations characterized for transport as Type C with a large-scale burning rate of greater than 60 kg/min but less than 140 kg/min. Includes those characterized for transport as Type D with a large-scale burning rate greater than 60 kg/min, those characterized for transport as Type E with a large-scale burning rate greater than 60 kg/min, and those characterized as Type C, Type D, and Type E if the small-scale burning rate is greater than 0.9 kg/min × m².

Δ 3.3.71.3 Class III Organic Peroxide. Describes organic peroxide formulations that burn rapidly and present a moderate reactivity hazard. Includes those characterized for transport as Type D with a large-scale burning rate equal to or greater than 10 kg/min but less than 60 kg/min, those characterized for transport as Type E with a large-scale burning rate equal to or greater than 10 kg/min but less than 60 kg/min, those characterized for transport as Type F with a large-scale burning rate equal to or greater than 10 kg/min, and those characterized as Type D, Type E, and Type F if the small-scale burning rate is less than 0.9 kg/min × m².

Δ 3.3.71.4 Class IV Organic Peroxide. Describes organic peroxide formulations that burn in the same manner as ordinary

combustibles and present a minimal reactivity hazard. Includes those characterized for transport as Type E or Type F with a large-scale burning rate less than 10 kg/min.

△ **3.3.71.5 Class V Organic Peroxide.** Describes organic peroxide formulations that burn with less intensity than ordinary combustibles or those that do not sustain combustion and present no reactivity hazard, and those characterized for transport as Type G without additional subsidiary risks.

3.3.72 OSHA [Gas]. The Occupational Safety and Health Administration of the U.S. Department of Labor. [55, 2016]

3.3.73* Oxidizer. Any solid or liquid material that readily yields oxygen or other oxidizing gas or that readily reacts to promote or initiate combustion of combustible materials and that can, under some circumstances, undergo a vigorous self-sustained decomposition due to contamination or heat exposure.

3.3.73.1 Class 1. An oxidizer that does not moderately increase the burning rate of combustible materials with which it comes into contact or a solid oxidizer classified as Class 1 when tested in accordance with the test protocol set forth in Section G.1.

3.3.73.2 Class 2. An oxidizer that causes a moderate increase in the burning rate of combustible materials with which it comes into contact or a solid oxidizer classified as Class 2 when tested in accordance with the test protocol set forth in Section G.1.

3.3.73.3 Class 3. An oxidizer that causes a severe increase in the burning rate of combustible materials with which it comes into contact or a solid oxidizer classified as Class 3 when tested in accordance with the test protocol set forth in Section G.1.

3.3.73.4 Class 4. An oxidizer that can undergo an explosive reaction due to contamination or exposure to thermal or physical shock and that causes a severe increase in the burning rate of combustible materials with which it comes into contact.

3.3.74 Pile. Material in a single contiguous storage area, including any material not properly separated by appropriate distance.

3.3.75* Protection Level. A term used to describe a tier of building safety that exceeds the construction requirements for control areas to accommodate quantities of hazardous materials in excess of those permitted using the control area concept. (See Section 5.3.)

3.3.76 Remotely Located, Manually Activated Shutdown Control [Gas]. A control system that is designed to initiate shutdown of the flow of gas or liquid that is manually activated from a point located some distance from the delivery system. [55, 2016]

3.3.77* Safety Data Sheet (SDS). The document that describes composition of a material, hazardous properties and hazard mitigation, and disposal information.

3.3.78* Secondary Containment. That level of containment that is external to and separate from primary containment.

3.3.79 Spill Control. A method for the control of a hazardous materials spill.

3.3.80 Standard Cubic Foot (scf) of Gas [Gas]. An amount of gas that occupies one cubic foot at an absolute pressure of 14.7 psi (101 kPa) and a temperature of 70°F (21°C). [55, 2016]

3.3.81 Storage, Compressed Gases or Cryogenic Fluids [Gas]. An inventory of compressed gases or cryogenic fluids in containers that are not in the process of being examined, serviced, refilled, loaded, or unloaded.

3.3.81.1 Bulk Solid Storage. The storage of more than 6000 lb (2722 kg) in a single container.

3.3.81.2 Detached Storage. Storage in a separate building or in an outside area located away from all structures. [1, 2018]

3.3.81.2.1 Detached Building. A separate single-story building, without a basement or crawl space, used for the storage or use of hazardous materials and located an approved distance from all other structures.

3.3.81.2.2 Detached Storage (Oxidizers). Storage in either an open outside area or in a separate building containing no incompatible materials and located away from all other structures.

3.3.81.3 Segregated Storage. Storage in the same room or inside area but physically separated by distance, noncombustible partitions, cabinets, or enclosures from incompatible materials.

3.3.82* Storage (Hazardous Material). Hazardous material in the act of being stored as a supply reserved for future use or disposal including, but not limited to, any of the following: (1) hazardous material packaged in individual containers, without active connections, that can be handled, stacked, arranged or transported on site; (2) unconnected mobile equipment or over-the-road transport vehicles containing hazardous materials awaiting transportation; (3) mobile equipment including over-the-road transport vehicles containing hazardous materials when connected and serving as a source of supply; (4) stationary tanks containing hazardous materials, including tanks connected and serving as a source of supply.

3.3.83 Storage Height. The height from the finished floor to the top of the highest container or a pile's peak.

3.3.84* Tank.

3.3.84.1 Container Tank. Any vessel of 119 gal (450 L), 1000 lb (454 kg) or less water capacity used for transporting or storing hazardous chemicals.

3.3.84.2* Portable Tank. A container designed primarily to be loaded into or on or temporarily attached to a transport vehicle or ship and equipped with skids, mountings, or accessories to facilitate handling of the tank by mechanical means and not intended for fixed installation.

3.3.84.3* Stationary Tank. A vessel used for storing hazardous materials designed for stationary installations not intended for loading, unloading, or attachment to a transport vehicle or ship as part of its normal operation in the process of use.

3.3.85 TC [Gas]. Transport Canada. [55, 2016]

3.3.86 Treatment System [Gas]. An assembly of equipment capable of processing a hazardous gas or vapor and reducing

the gas concentration to a predetermined level at the point of discharge from the system to the atmosphere.

3.3.87* Tube Trailer [Gas]. A truck or semitrailer on which a number of very long compressed gas tubular cylinders have been mounted and manifolded into a common piping system. [55, 2016]

3.3.88* Use. To place a material, including solids, liquids, and gases, into action.

3.3.88.1* Closed System Use. Use of a solid or liquid hazardous material in a closed vessel or system that remains closed during normal operations where vapors emitted by the product are not liberated outside of the vessel or system and the product is not exposed to the atmosphere during normal operations and all uses of compressed gases.

3.3.88.2* Open System Use. Use of a solid or liquid hazardous material in a vessel or system that is continuously open to the atmosphere during normal operations and where vapors are liberated or the product is exposed to the atmosphere during normal operations.

3.3.89 Valve Outlet Cap or Plug [Gas]. A removable device that forms a gastight seal on the outlet to the control valve that is provided on a source containing a compressed gas or cryogenic fluid. [55, 2016]

3.3.90 Valve Protection Cap [Gas]. A rigid, removable cover provided for container valve protection during handling, transportation, and storage. [55, 2016]

3.3.91 Valve Protection Device [Gas]. A device attached to the neck ring or body of a cylinder for the purpose of protecting the cylinder valve from being struck or from being damaged by the impact resulting from a fall or an object striking the cylinder. [1, 2018]

3.3.92 Waste. Hazardous materials that have been determined by the user to be beyond their useful life and that are awaiting disposal or processing by either public or private means.

3.4 Special Performance-Based Definitions.

3.4.1 Analysis.

3.4.1.1 Sensitivity Analysis. An analysis performed to determine the degree to which a predicted output will vary given a specified change in an input parameter, usually in relation to models. [5000, 2018]

3.4.1.2 Uncertainty Analysis. An analysis performed to determine the degree to which a predicted value will vary. [5000, 2018]

3.4.2 Data Conversion. The process of developing the input data set for the assessment method of choice. [101, 2018]

3.4.3 Design Fire Scenario. See 3.4.8.1.

3.4.4 Design Specification. See 3.4.18.1.

3.4.5 Design Team. A group of stakeholders including, but not limited to, representatives of the architect, client, and any pertinent engineers and other designers. [101, 2018]

3.4.6* Exposure Fire. A fire that starts at a location that is remote from the area being protected and grows to expose that which is being protected. [101, 2018]

3.4.7* Fire Model. A structured approach to predicting one or more effects of a fire. [101, 2018]

3.4.8* Fire Scenario. A set of conditions that defines the development of fire, the spread of combustion products throughout a building or portion of a building, the reactions of people to fire, and the effects of combustion products. [101, 2018]

3.4.8.1 Design Fire Scenario. A fire scenario selected for evaluation of a proposed design. [914, 2015]

3.4.9* Fuel Load. The total quantity of combustible contents of a building, space, or fire area. [5000, 2018]

3.4.10 Input Data Specification. See 3.4.18.2.

3.4.11 Occupant Characteristics. The abilities or behaviors of people before and during a fire. [101, 2018]

3.4.12* Performance Criteria. Threshold values on measurement scales that are based on quantified performance objectives. [101, 2018]

3.4.13* Proposed Design. A design developed by a design team and submitted to the authority having jurisdiction for approval. [101, 2018]

3.4.14 Safe Location. A location remote or separated from the effects of a fire so that such effects no longer pose a threat. [101, 2018]

3.4.15 Safety Factor. A factor applied to a predicted value to ensure that a sufficient safety margin is maintained. [101, 2018]

3.4.16 Safety Margin. The difference between a predicted value and the actual value where a fault condition is expected. [101, 2018]

3.4.17 Sensitivity Analysis. See 3.4.1.1.

3.4.18 Specification.

3.4.18.1 Design Specification. A building characteristic and other conditions that are under the control of the design team. [5000, 2018]

3.4.18.2 Input Data Specification. Information required by the verification method. [101, 2018]

3.4.19 Stakeholder. An individual, or representative of same, having an interest in the successful completion of a project. [101, 2018]

3.4.20 Uncertainty Analysis. See 3.4.1.2.

3.4.21 Verification Method. A procedure or process used to demonstrate or confirm that the proposed design meets the specified criteria. [101, 2018]

Chapter 4 Classification of Materials, Wastes, and Hazard of Contents

4.1* Hazardous Material Classification. Materials shall be classified into one or more of the following categories of hazardous materials, based on the definitions found in Chapter 3:

- (1) Corrosive solids, liquids, or gases
- (2) Flammable solids
- (3) Flammable gases

- (4) Flammable cryogenic fluids
- (5) Inert cryogenic fluids
- (6) Inert gases
- (7) Organic peroxide formulations
- (8) Oxidizer solids or liquids
- (9) Oxidizing gases
- (10) Oxidizing cryogenic fluids
- (11) Pyrophoric solids, liquids, or gases
- (12) Toxic or highly toxic solids, liquids, or gases
- (13) Unstable (reactive) solids, liquids, or gases
- (14) Water-reactive solids or liquids

4.2 Classification of High-Hazard Contents.

4.2.1 General.

4.2.1.1 High-hazard contents shall include materials defined as hazardous material in Chapter 3, whether stored, used, or handled.

4.2.1.2 High-hazard contents shall include those materials defined as hazardous material solids, liquids, or gases limited to the hazard categories specified in 1.1.1 and classified in accordance with 4.2.1.2.1 through 4.2.1.2.4 whether stored, used, or handled.

4.2.1.2.1 High-Hazard Level 1 Contents. High-hazard Level 1 contents shall include materials that present a detonation hazard, including, but not limited to, the following hazard categories:

- (1) Class 4 oxidizers
- (2) Detonable pyrophoric solids or liquids
- (3) Class 3 detonable and Class 4 unstable (reactive) solids, liquids, or gases
- (4) Detonable organic peroxides

4.2.1.2.2 High-Hazard Level 2 Contents. High-hazard Level 2 contents shall include materials that present a deflagration hazard or a hazard from accelerated burning, including, but not limited to, the following hazard categories:

- (1) Combustible dusts that are stored, used, or generated in a manner that creates a severe fire or explosion hazard
- (2) Class I organic peroxides
- (3) Class 3 solid or liquid oxidizers that are used or stored in normally open containers or systems or in closed containers or systems at gauge pressures of more than 15 psi (103.4 kPa)
- (4) Flammable gases
- (5) Flammable cryogenic fluids
- (6) Nondetonable pyrophoric solids, liquids, or gases
- (7) Class 3 nondetonable unstable (reactive) solids, liquids, or gases
- (8) Class 3 water-reactive solids and liquids

4.2.1.2.3 High-Hazard Level 3 Contents. High-hazard Level 3 contents shall include materials that readily support combustion or present a physical hazard, including, but not limited to, the following hazard categories:

- (1) Flammable solids, other than dusts classified as high-hazard Level 2, that are stored, used, or generated in a manner that creates a high fire hazard
- (2) Class II and Class III organic peroxides
- (3) Class 2 solid or liquid oxidizers
- (4) Class 3 solid or liquid oxidizers that are used or stored in normally closed containers or systems at gauge pressures of less than 15 psi (103.4 kPa)

- (5) Class 2 unstable (reactive) materials
- (6) Class 2 water-reactive solids, liquids, or gases
- (7) Oxidizing gases
- (8) Oxidizing cryogenic fluids

4.2.1.2.4 High-Hazard Level 4 Contents. High-hazard Level 4 contents shall include materials that are acute health hazards, including, but not limited to the following hazard categories:

- (1) Corrosive solids, liquids, or gases
- (2) Highly toxic solids, liquids, or gases
- (3) Toxic solids, liquids, or gases

4.3 Mixtures. Mixtures shall be classified in accordance with the hazards of the mixture as a whole by an approved, qualified organization, individual, or testing laboratory.

4.4* Multiple Hazards. Hazardous materials that have multiple hazards shall conform to the code requirements for each applicable hazard category.

4.5* Classification of Waste. Waste comprised of or containing hazardous materials shall be classified in accordance with Sections 4.1 through 4.4 as applicable.

4.5.1* Waste classified in accordance with Sections 4.1 through 4.4 shall comply with the requirements of Chapters 1 through 9 and the material-specific requirements of Chapters 11 through 21 as applicable.

4.6 Combustibility of Materials.

4.6.1* Noncombustible Material.

4.6.1.1 A material that complies with any one of the following shall be considered a noncombustible material:

- (1)* The material, in the form in which it is used and under the conditions anticipated, will not ignite, burn, support combustion, or release flammable vapors when subjected to fire or heat.
- (2) The material is reported as passing ASTM E136, *Standard Test Method for Behavior of Materials in a Vertical Tube Furnace at 750°C*.
- (3) The material is reported as complying with the pass/fail criteria of ASTM E136 when tested in accordance with the test method and procedure in ASTM E2652, *Standard Test Method for Behavior of Materials in a Tube Furnace with a Cone-Shaped Airflow Stabilizer, at 750°C*.
[5000:7.1.4.1.1]

4.6.1.2 Where the term *limited-combustible* is used in this code, it shall also include the term *noncombustible*. [5000:7.1.4.1.2]

Δ 4.6.2* Limited-Combustible Material. A material shall be considered a limited-combustible material where both of the following conditions of 4.6.2(1) and 4.6.2(2), and the conditions of either 4.6.2.1 or 4.6.2.2 are met:

- (1) The material does not comply with the requirements for a noncombustible material in accordance with 4.6.1.
- (2) The material, in the form in which it is used, exhibits a potential heat value not exceeding 3500 Btu/lb (8141 kJ/kg) when tested in accordance with NFPA 259.
[5000:7.4.1.2]

4.6.2.1 The material shall have a structural base of noncombustible material with a surfacing not exceeding a thickness of 1/8 in. (3.2 mm) where the surfacing exhibits a flame spread index not greater than 50 when tested in accordance with ASTM E84, *Standard Test Method for Surface Burning Characteris-*

tics of Building Materials, or ANSI/UL 723, Standard for Test for Surface Burning Characteristics of Building Materials.

4.6.2.2 The material shall be composed of materials that, in the form and thickness used, neither exhibit a flame spread index greater than 25 nor evidence of continued progressive combustion when tested in accordance with ASTM E84 or ANSI/UL 723 and are of such composition that all surfaces that would be exposed by cutting through the material on any plane would neither exhibit a flame spread index greater than 25 nor exhibit evidence of continued progressive combustion when tested in accordance with ASTM E84 or ANSI/UL 723. [5000:7.4.1.2.2]

4.6.2.3 Where the term *limited-combustible* is used in this code, it shall also include the term *noncombustible*. [5000:7.4.1.2.4]

Chapter 5 Permissible Storage and Use Locations

5.1* General.

5.1.1 Control Areas or Special Protection Required. Hazardous materials shall be stored and used in any of the following:

- (1) In control areas complying with Section 5.2
- (2) In occupancies complying with requirements for Protection Level 1, Protection Level 2, Protection Level 3, or Protection Level 4 in accordance with Section 5.3
- (3) In outdoor areas complying with Section 5.4

5.1.2 Weather Protection Structures. Weather protection, when provided, shall comply with 6.2.7.2.

5.1.3 High-Hazard Contents. Occupancies in which high-hazard contents are stored, used, or handled shall also comply with Chapter 6.

5.2 Control Areas.

5.2.1 Hazardous materials shall be permitted to be stored and used in control areas in accordance with 5.2.1 and 5.2.2.

5.2.1.1 General.

5.2.1.1.1 All occupancies shall be permitted to have one or more control areas in accordance with Section 5.2.

Δ 5.2.1.1.2* The quantity of hazardous materials in an individual control area shall not exceed the MAQ set forth in Table 5.2.1.1.3, except as modified by 5.2.1.2 through 5.2.1.5, which establish additional quantity limits or increases based on occupancy.

N 5.2.1.1.2.1 The quantity of hazardous materials in an individual control area in laboratories classified as business occupancies shall not exceed the MAQ set forth in Table 5.2.1.1.3.

Δ 5.2.1.1.3* The MAQ of hazardous materials per control area shall be as specified in Table 5.2.1.1.3 except as modified by 5.2.1.2 through 5.2.1.5. Ammonium nitrate shall also comply with Chapter 11.

5.2.1.2 Quantity Limits for Occupancies Other than Mercantile, Storage, or Industrial Occupancies.

N 5.2.1.2.1 The MAQ of hazardous materials per control area in occupancies other than mercantile, storage, or industrial occupancies shall be as specified in Table 5.2.1.2.1.

N 5.2.1.2.2 The MAQ set forth in Table 5.2.1.2.1 shall be the maximum aggregate quantity allowed in storage and use.

• 5.2.1.3 Industrial Occupancies. The MAQ of hazardous materials per control area in industrial occupancies shall be as specified in Table 5.2.1.1.3, with increased quantities permitted where storage areas comply with 5.2.1.5.

5.2.1.4 Storage Occupancies. The MAQ of hazardous materials per control area in storage occupancies shall be as specified in Table 5.2.1.1.3, with increased quantities permitted where storage areas comply with 5.2.1.5.

5.2.1.5 Special Quantity Limits for Mercantile, Industrial, and Storage Occupancies.

5.2.1.5.1 General. Where storage in mercantile, industrial, and storage occupancies is in compliance with all of the special controls set forth in 5.2.1.5.2, the MAQ of selected hazardous materials shall be permitted to be increased in accordance with 5.2.1.5.3.

5.2.1.5.2 Special Controls Required for Increased Quantities. Where quantities of hazardous materials are increased in accordance with 5.2.1.5.3, such materials shall be stored in accordance with the following limitations:

- (1) Storage and display of solids shall not exceed 200 lb/ft² (976.4 kg/m²) of floor area actually occupied by solid merchandise.
- (2) Storage and display of liquids shall not exceed 20 gal/ft² (76 L/m²) of floor area actually occupied by liquid merchandise.
- (3) Storage and display height shall not exceed 6 ft (1.8 m) above the finished floor.
- (4) Individual containers less than 5 gal (19 L) or less than 25 lb (11 kg) shall be stored or displayed on pallets, racks, or shelves.
- (5) Racks and shelves used for storage or display shall be in accordance with 6.1.13.
- (6) Containers shall be listed or approved for the intended use.
- (7) Individual containers shall not exceed 100 lb (45.4 kg) capacity for solids or a 10 gal (38 L) capacity for liquids.
- (8) Incompatible materials shall be separated in accordance with 6.1.12.
- (9) Except for surfacing, floors shall be of noncombustible construction.
- (10) Aisles 4 ft (1.2 m) in width shall be maintained on three sides of the storage or display area.
- (11) Hazard identification signs shall be provided in accordance with 6.1.8.

Δ 5.2.1.5.3* Special Maximum Allowable Quantity Increases for Storage in Mercantile, Storage, and Industrial Occupancies.

The aggregate quantity of nonflammable solid and nonflammable or noncombustible liquid hazardous materials permitted within a single control area of a mercantile, storage, or industrial occupancy shall be permitted to exceed the MAQ specified in Table 5.2.1.1.3, without complying with Protection Level 2, Protection Level 3, or Protection Level 4, provided that the quantities comply with Table 5.2.1.5.3(a) and Table 5.2.1.5.3(b) and that materials are displayed and stored in accordance with the special limitations in 5.2.1.5.2.

▲ Table 5.2.1.1.3 Maximum Allowable Quantities (MAQ) of Hazardous Materials per Control Area

Material	Class	High Hazard Protection Level	Storage			Use — Closed Systems			Use — Open Systems	
			Solid Pounds	Liquid Gallons (lb)	Gas (at NTP) ft ³ (lb)	Solid Pounds	Liquid Gallons (lb)	Gas (at NTP) ft ³ (lb)	Solid Pounds	Liquid Gallons (lb)
Physical Hazard Materials										
Combustible liquid ^c	II	3	N/A	120 ^{a,b}	N/A	N/A	See Note 1.	N/A	N/A	See Note 1.
	IIIA	3	N/A	330 ^{a,b}	N/A	N/A	See Note 1.	N/A	N/A	See Note 1.
	IIIB	N/A	N/A	13,200 ^{a,d}	N/A	N/A	See Note 1.	N/A	N/A	See Note 1.
Combustible metals	See Note 1.	See Note 1.	See Note 1.	See Note 1.	See Note 1.	See Note 1.	See Note 1.	See Note 1.	See Note 1.	See Note 1.
Cryogenic fluid [55:Table 6.3.1.1]	Flammable	2	N/A	45 ^{c,f}	N/A	N/A	45 ^{c,f}	N/A	N/A	45 ^{c,f}
	Oxidizing	3	N/A	45 ^{a,b}	N/A	N/A	45 ^{a,b}	N/A	N/A	45 ^{a,b}
	Inert	N/A	N/A	NL	N/A	N/A	NL	N/A	N/A	NL
Explosives	See Note 1.	See Note 1.	See Note 1.	See Note 1.	See Note 1.	See Note 1.	See Note 1.	See Note 1.	See Note 1.	See Note 1.
Flammable gas ^g [55:Table 6.3.1.1]	Gaseous	2	N/A	N/A	1000 ^{a,b}	N/A	N/A	1000 ^{a,b}	N/A	N/A
	Liquefied	2	N/A	N/A	(150) ^{a,b}	N/A	N/A	(150) ^{a,b}	N/A	N/A
	Liquefied petroleum (LP)	2	N/A	N/A	(300) ^{h,i,j}	N/A	N/A	(300) ⁱ	N/A	N/A
Flammable liquid ^c	IA	3	N/A	30 ^{a,b}	N/A	N/A	See Note 1.	N/A	N/A	See Note 1.
	IB and IC	3	N/A	120 ^{a,b}	N/A	N/A	See Note 1.	N/A	N/A	See Note 1.
	Combination (IA, IB, IC)	3	N/A	120 ^{a,b,k}	N/A	N/A	See Note 1.	N/A	N/A	See Note 1.
Flammable solid	N/A	3	125 ^{a,b}	N/A	N/A	125 ^{a,b}	N/A	N/A	25 ^{a,b}	N/A
Inert gas	Gaseous	N/A	N/A	N/A	NL	N/A	N/A	NL	N/A	N/A
	Liquefied	N/A	N/A	N/A	NL	N/A	N/A	NL	N/A	N/A
Organic peroxide	UD	1	1 ^{a,l}	(1) ^{a,l}	N/A	¼ ^l	(¼) ^l	N/A	¼ ^l	(¼) ^l
	I	2	16 ^{a,b}	(16) ^{a,b}	N/A	8 ^{a,b}	(8) ^{a,b}	N/A	8 ^{a,b}	(8) ^{a,b}
	IIA	3	100 ^{a,b}	(100) ^{a,b}	N/A	50 ^b	(50) ^b	N/A	100 ^{a,b}	(100) ^{a,b}
	IIIB	3	400	(400)	N/A	200	(200)	N/A	400	(400)
	III	3	840 ^{a,b}	(840) ^{a,b}	N/A	840 ^b	(840) ^b	N/A	840 ^{a,b}	(840) ^{a,b}
	IV	N/A	NL	NL	N/A	NL	NL	N/A	NL	NL
Oxidizer	4	1	1 ^{a,l}	(1) ^{a,l}	N/A	¼ ^l	(¼) ^l	N/A	¼ ^l	(¼) ^l
	3 ^m	2 or 3	10 ^{a,b}	(10) ^{a,b}	N/A	2 ^b	(2) ^b	N/A	2 ^b	(2) ^b
	2	3	250 ^{a,b}	(250) ^{a,b}	N/A	250 ^b	(250) ^b	N/A	50 ^b	(50) ^b
	1	N/A	4000 ^{a,n}	(4000) ^{a,n}	N/A	4000 ⁿ	(4000) ⁿ	N/A	1000 ⁿ	(1000) ⁿ
	Oxidizing gas [55:Table 6.3.1.1]	Gaseous	3	N/A	N/A	1500 ^{a,b}	N/A	N/A	1500 ^{a,b}	N/A
	Liquefied	3	N/A	N/A	(150) ^{a,b}	N/A	N/A	(150) ^{a,b}	N/A	N/A
Pyrophoric	N/A	2	4 ^{a,l}	(4) ^{a,l}	N/A	1 ^l	(1) ^l	N/A	NP	NP
Pyrophoric gas [55:Table 6.3.1.1]	Gaseous	2	N/A	N/A	50 ^{a,l}	N/A	N/A	50 ^{a,l}	N/A	N/A
	Liquefied	2	N/A	N/A	(4) ^{a,l}	N/A	N/A	(4) ^{a,l}	N/A	N/A
Unstable (reactive)	4	1	1 ^{a,l}	(1) ^{a,l}	N/A	¼ ^l	(¼) ^l	N/A	¼ ^l	(¼) ^l
	3	1 or 2	5 ^{a,b}	(5) ^{a,b}	N/A	1 ^b	(1) ^b	N/A	1 ^b	(1) ^b
	2	2	50 ^{a,b}	(50) ^{a,b}	N/A	50 ^b	(50) ^b	N/A	10 ^b	(10) ^b
	1	N/A	NL	NL	N/A	NL	NL	N/A	NL	NL
Unstable (reactive) gas [55:Table 6.3.1.1]	Gaseous									
	4 or 3									
	detonable	1	N/A	N/A	10 ^{a,l}	N/A	N/A	10 ^{a,l}	N/A	N/A
	3	2	N/A	N/A	50 ^{a,b}	N/A	N/A	50 ^{a,b}	N/A	N/A
non-detonable	2	3	N/A	N/A	750 ^{a,b}	N/A	N/A	750 ^{a,b}	N/A	N/A
	1	N/A	N/A	N/A	NL	N/A	N/A	NL	N/A	N/A
	Liquefied									
	4 or 3									
detonable	1	1	N/A	N/A	(1) ^{a,l}	N/A	N/A	(1) ^{a,l}	N/A	N/A
	3	2	N/A	N/A	(2) ^{a,b}	N/A	N/A	(2) ^{a,b}	N/A	N/A
	non-detonable									
2	3	N/A	N/A	N/A	(150) ^{a,b}	N/A	N/A	(150) ^{a,b}	N/A	N/A
	1	N/A	N/A	N/A	NL	N/A	N/A	NL	N/A	N/A
Water-reactive	3	2	5 ^{a,b}	(5) ^{a,b}	N/A	5 ^b	(5) ^b	N/A	1 ^b	(1) ^b
	2	3	50 ^{a,b}	(50) ^{a,b}	N/A	50 ^b	(50) ^b	N/A	10 ^b	(10) ^b
	1	N/A	NL	NL	N/A	NL	NL	N/A	NL	NL

(continues)

Table 5.2.1.1.3 Continued

Material	Class	High Hazard Protection Level	Storage			Use — Closed Systems			Use — Open Systems	
			Solid Pounds	Liquid Gallons (lb)	Gas (at NTP) ft ³ (lb)	Solid Pounds	Liquid Gallons (lb)	Gas (at NTP) ft ³ (lb)	Solid Pounds	Liquid Gallons (lb)
Health Hazard Materials										
Corrosive	N/A	4	5000 ^{a,b}	500 ^{a,b}	N/A	5000 ^b	500 ^b	N/A	1000 ^b	100 ^b
Corrosive gas [55:Table 6.3.1.1]	Gaseous	4	N/A	N/A	810 ^{a,b}	N/A	N/A	810 ^{a,b}	N/A	N/A
	Liquefied	4	N/A	N/A	(150) ^{a,b}	N/A	N/A	(150) ^{a,b}	N/A	N/A
Highly toxic	N/A	4	10 ^{a,b}	(10) ^{a,b}	N/A	10 ^b	(10) ^b	N/A	3 ^b	(3) ^b
Highly toxic gas [55:Table 6.3.1.1]	Gaseous	4	N/A	N/A	20 ^{b,o}	N/A	N/A	20 ^{b,o}	N/A	N/A
	Liquefied	4	N/A	N/A	(4) ^{b,o}	N/A	N/A	(4) ^{b,o}	N/A	N/A
Toxic	N/A	4	500 ^{a,b}	(500) ^{a,b}	N/A	500 ^b	(500) ^b	N/A	125 ^b	(125) ^b
Toxic gas	Gaseous	4	N/A	N/A	810 ^{a,b}	N/A	N/A	810 ^{a,b}	N/A	N/A
	Liquefied	4	N/A	N/A	(150) ^{a,b}	N/A	N/A	(150) ^{a,b}	N/A	N/A

For SI units, 1 lb = 0.454 kg; 1 gal = 3.785 L; 1 ft³ = 0.0283 m³. Where quantities are indicated in pounds and when the weight per gallon of the liquid is not provided to the AHJ, a conversion factor of 10 lb/gal (1.2 kg/L) shall be used.

NTP: Measured at normal temperature and pressure [70°F (21°C) and 14.7 psi (101.3kPa)].

N/A: Not applicable. NL: Not limited. NP: Not permitted. UD: Unclassified detonable.

Notes:

(1) The hazardous material categories and MAQs that are shaded in this table are not regulated by NFPA 400 but are provided here for informational purposes. See Chapter 2 for the reference code or standard governing these materials and establishing the MAQs. In accordance with 1.1.1.2, materials having multiple hazards that fall within the scope of NFPA 400 shall comply with NFPA 400.

(2) Table values in parentheses correspond to the unit name in parentheses at the top of the column. The aggregate quantity in use and storage is not permitted to exceed the quantity listed for storage.

(3) The use of explosive materials required by federal, state, or municipal agencies while engaged in normal or emergency performance of duties is not required to be limited. The storage of explosive materials is required to be in accordance with the requirements of NFPA 495.

(4) The storage and use of explosive materials in medicines and medicinal agents in the forms prescribed by the official United States Pharmacopeia or the National Formulary are not required to be limited.

(5) The storage and use of propellant-actuated devices or propellant-actuated industrial tools manufactured, imported, or distributed for their intended purposes are required to be limited to 50 lb (23 kg) net explosive weight.

^aQuantities are permitted to be increased 100 percent where stored or used in approved cabinets, gas cabinets, exhausted enclosures, gas rooms explosives magazines, or safety cans, as appropriate for the material stored, in accordance with this code. Where footnote b also applies, the increase for both footnote a and footnote b is permitted to be applied accumulatively.

^bMaximum quantities are permitted to be increased 100 percent in buildings equipped throughout with an automatic sprinkler system in accordance with NFPA 13. Where footnote c also applies, the increase for both footnote c and footnote d is permitted to be applied accumulatively.

^cMedicines, foodstuffs, cosmetics, and other consumer products that contain not more than 50 percent by volume of water-miscible flammable or combustible liquids, with the remainder of the product consisting of components that do not burn, are not limited where packaged in individual containers that do not exceed a 1.3 gal (5 L) capacity. (See 9.1.4 of NFPA 30.)

^dThe permitted quantities are not limited in a building equipped throughout with an automatic sprinkler system installed in accordance with NFPA 13 and designed in accordance with the protection criteria contained in Chapter 16 of NFPA 30.

^eNone allowed in unsprinklered buildings unless stored or used in gas rooms, approved gas cabinets, or exhausted enclosures, as specified in this code.

^fWith pressure-relief devices for stationary or portable containers vented directly outdoors or to an exhaust hood. [55:Table 6.3.1.1]

^gFlammable gases in the fuel tanks of mobile equipment or vehicles are permitted to exceed the MAQ where the equipment is stored and operated in accordance with this code.

^hAdditional storage locations are required to be separated by a minimum of 300 ft (92 m).

ⁱIn mercantile occupancies, storage of LP-Gas is limited to a maximum of 200 lb (91 kg) in nominal 1 lb (0.45 kg) LP-Gas containers.

^jSee NFPA 58 for liquefied petroleum gas (LP-Gas) requirements. LP-Gas is not within the scope of NFPA 400.

^kContaining not more than the MAQ of Class IA, Class IB, or Class IC flammable liquids, individually, per control area.

^lPermitted only in buildings equipped throughout with an automatic sprinkler system in accordance with NFPA 13.

^mA maximum quantity of 220 lb (99 kg) of solid or 22 gal (83 L) of liquid Class 3 oxidizer is permitted where such materials are necessary for maintenance purposes, operation, or sanitation of equipment. Storage containers and the manner of storage are required to be approved.

ⁿThe permitted quantities are not limited in a building equipped throughout with an automatic sprinkler system in accordance with NFPA 13.

^oAllowed only where stored or used in gas rooms, approved gas cabinets, or exhausted enclosures, as specified in this code.

Table 5.2.1.2.1 Maximum Allowable Quantities (MAQ) of Hazardous Materials per Control Area in Occupancies Other Than Mercantile, Storage, or Industrial Occupancies

Material	Class	Solid Pounds	Liquid Gallons (lb)	Gas (at NTP) ft ³ (lb)
Flammable and combustible liquid ^{a,b,c}	I and II	N/A	10	N/A
	IIIA	N/A	60	N/A
	IIIB	N/A	120 ^d	N/A
Cryogenic fluid	Flammable	N/A	10	N/A
	Oxidizing	N/A	10	N/A
Explosives ^{e,f,g,h}	See Note 1.	See Note 1.	See Note 1.	See Note 1.
Flammable gas ^b	Gaseous	N/A	N/A	NP ⁱ
	Liquefied	N/A	N/A	NP ^{ij}
	Liquefied petroleum (LP)	N/A	N/A	(20) ^k
Flammable solid	N/A	5	N/A	N/A
Oxidizers	4	NP	NP	N/A
	3	10 ^l	1 ^l	N/A
	2	250	25	N/A
	1	4,000 ^m	400 ^m	N/A
Oxidizing gas	Gaseous	N/A	N/A	NP ⁱ
	Liquefied	N/A	N/A	NP ⁱ
Organic peroxides	I	NP	NP	N/A
	IIA	NP	NP	N/A
	IIB	NP	NP	N/A
	III	25	(25)	N/A
	IV	NL	NL	N/A
V	NL	NL	NL	N/A
Pyrophoric materials	N/A	1 ⁿ	(1) ⁿ	NP
Unstable (reactive)	4	¼	(¼)	NP
	3	1	(1)	NP
	2	10	(10)	NP ⁱ
	1	NL	NL	NP
Water-reactive	3	1	(1)	N/A
	2	10	(10)	N/A
	1	NL	NL	N/A
Corrosives	N/A	1,000	100	NP
Highly toxic	N/A	3	(3)	NP ^o
Toxic	N/A	125	(125)	NP ^o

(continues)

For SI units, 1 lb = 0.454 kg; 1 gal = 3.785 L, 1 ft³ = 0.0283 m³. Where quantities are indicated in pounds and when the weight per gallon of the liquid is not provided to the AHJ, a conversion factor of 10 lb/gal (1.2 kg/L) shall be used.

NTP: Measured at normal temperature and pressure [70°F (21°C) and 14.7 psi (101 kPa)]. N/A: Not applicable. NP: Not permitted. NL: Not limited. Notes:

(1) The hazardous material categories and MAQs that are shaded in this table are not regulated by NFPA 400 but are provided here for informational purposes. See Chapter 2 for the reference code or standard governing these materials and establishing the MAQs. In accordance with 1.1.1.2, materials having multiple hazards that fall within the scope of NFPA 400 shall comply with NFPA 400.

(2) Table values in parentheses correspond to the unit name in parentheses at the top of the column. The aggregate quantity in use and storage is not permitted to exceed the quantity listed for storage.

^aStorage in excess of 10 gal (38 L) of Class I and Class II liquids combined or 60 gal (227 L) of Class IIIA liquids is permitted where stored in safety cabinets with an aggregate quantity not to exceed 180 gal (681 L).

^bFuel in the tank of operating mobile equipment is permitted to exceed the specified quantity where the equipment is operated in accordance with this code.

^cMedicines, foodstuffs, cosmetics, and other consumer products that contain not more than 50 percent by volume of water-miscible flammable or combustible liquids, with the remainder of the product consisting of components that do not burn, are not limited where packaged in individual containers that do not exceed a 1.3 gal (5 L) capacity. (See 9.1.4 of NFPA 30.)

^dStorage shall be permitted to be increased 100 percent in educational, day care, and health care occupancies if the building is protected throughout with an automatic sprinkler system installed in accordance with NFPA 13.

^eThe use of explosive materials required by federal, state, or municipal agencies while engaged in normal or emergency performance of duties is not required to be limited. The storage of explosive materials is required to be in accordance with the requirements of NFPA 495.

^fThe storage and use of explosive materials in medicines and medicinal agents in the forms prescribed by the official United States Pharmacopeia or the National Formulary are not required to be limited.

^gThe storage and use of propellant-actuated devices or propellant-actuated industrial tools manufactured, imported, or distributed for their intended purposes are required to be limited to 50 lb (23 kg) net explosive weight.

^hThe storage and use of small arms ammunition, and components thereof, are permitted where in accordance with NFPA 495.

ⁱContainers, cylinders, or tanks not exceeding 250 ft³ (7.1 m³) content measured at NTP and used for maintenance purposes, patient care, or operation of equipment shall be permitted.

^jIn residential occupancies consisting of lodging and rooming houses, hotels, dormitories, apartments, and residential board and care facilities, storage containers are not permitted to exceed 0.325 ft³ (0.0092 m³).

^kIn educational occupancies, allowed in laboratories only; additional 20 lb (9 kg) units are permitted where minimum 20 ft (6.1 m) separation is provided.

^lA maximum quantity of 220 lb (99 kg) of solid or 22 gal (83 L) of liquid Class 3 oxidizer is permitted where such materials are necessary for maintenance purposes, operation, or sanitation of equipment. Storage containers and the manner of storage are required to be approved.

^mQuantities are not limited in educational, day care, and health care occupancies protected throughout by automatic sprinkler systems in accordance with NFPA 13.

ⁿNot permitted in health care occupancies.

^oGas containers or cylinders not exceeding 20 ft³ (0.57 m³) content measured at NTP are permitted to be stored or used within gas cabinets or exhausted enclosures of educational occupancies.

5.2.2 Construction Requirements for Control Areas.

5.2.2.1 Number of Control Areas. The maximum number of control areas within a building shall be in accordance with Table 5.2.2.1.

5.2.2.2 Where only one control area is present in a building, no special construction provisions shall be required.

5.2.2.3 Where more than one control area is present in a building, control areas shall be separated from each other by fire barriers in accordance with Table 5.2.2.1.

5.3 Protection Levels.

5.3.1 Where the quantity of hazardous materials in storage or use exceeds the MAQ for indoor control areas as set forth in Section 5.2, the occupancy shall comply with the requirements for Protection Level 1, Protection Level 2, Protection Level 3, or Protection Level 4, as required for the material in storage or use as defined in 6.2.2 through 6.2.5.

5.3.2 Protection level 5 shall apply to semiconductor fabrication facilities where required by the building code.

5.3.3 Protection Level 1.

5.3.3.1 Buildings containing quantities of hazardous materials exceeding the MAQ of high-hazard level 1 contents permitted in control areas shall comply with applicable regulations for Protection Level 1, as set forth in the applicable sections of Chapter 6, Chapters 11 through 21, and the building code.

5.3.3.2 High-hazard level 1 contents shall include materials that present a detonation hazard as defined in 4.2.1.2.1.

5.3.4 Protection Level 2.

5.3.4.1 Buildings, and portions thereof, containing quantities of hazardous materials exceeding the MAQ of high-hazard level 2 contents permitted in control areas shall comply with applicable regulations for Protection Level 2, as set forth in the applicable sections of Chapter 6, Chapters 11 through 21, and the building code.

5.3.4.2 High-hazard level 2 contents shall include materials that present a deflagration hazard or a hazard from accelerated burning as defined in 4.2.1.2.2.

△ **Table 5.2.1.5.3(a) Maximum Allowable Quantity (MAQ) per Indoor and Outdoor Control Area for Selected Hazard Categories in Mercantile, Storage, and Industrial Occupancies**

Hazard Category	Maximum Allowable Quantity ^{a,b}			
	Solids		Liquids	
	lb	kg	gal	L
Physical Hazard Materials: Nonflammable and Noncombustible Solids and Liquids				
Oxidizers				
Class 3	1,350	616	135	511
Class 2	2,250	1,021	225	852
Class 1	18,000 ^c	8,165 ^c	1,800 ^c	6,814 ^c

Note: Maximum quantities for hazard categories not shown are required to be in accordance with Table 5.2.1.1.3.

^aMaximum quantities are permitted to be increased 100 percent in buildings that are sprinklered in accordance with NFPA 13. Where footnote b also applies, the increase for both footnotes is permitted to be applied.

^bMaximum quantities are permitted to be increased 100 percent where stored in approved storage cabinets in accordance with NFPA 1. Where footnote a also applies, the increase for both footnotes is permitted to be applied.

^cQuantities are not limited in buildings protected by an automatic sprinkler system complying with NFPA 13.

5.3.5 Protection Level 3.

5.3.5.1 Buildings, and portions thereof, containing quantities of hazardous materials exceeding the MAQ of high-hazard level 3 contents permitted in control areas shall comply with applicable regulations for Protection Level 3, as set forth in the applicable sections of Chapter 6, Chapters 11 through 21, and the building code.

5.3.5.2 High-hazard level 3 contents shall include materials that readily support combustion or present a physical hazard as defined in 4.2.1.2.3.

5.3.6 Protection Level 4.

5.3.6.1 Buildings, and portions thereof, containing quantities of hazardous materials exceeding the MAQ of high-hazard level 4 contents permitted in control areas shall comply with applicable regulations for Protection Level 4, as set forth in the applicable sections of Chapter 6, Chapters 11 through 21, and the building code.

5.3.6.2 High-hazard level 4 contents shall include materials that are acute health hazards as defined in 4.2.1.2.4.

△ **Table 5.2.1.5.3(b) Maximum Allowable Quantity (MAQ) per Indoor and Outdoor Control Area for Selected Hazard Categories in Mercantile and Storage Occupancies**

Hazard Category	Maximum Allowable Quantity ^{a,b}			
	Solids		Liquids	
	lb	kg	gal	L
Physical Hazard Materials: Nonflammable and Noncombustible Solids and Liquids				
Unstable (reactive)				
Class 3	550	250	55	208
Class 2	1,150	522	115	435
Water-reactive				
Class 3	550	250	55	208
Class 2	1,150	522	115	435
Health Hazard Materials: Nonflammable and Noncombustible Solids and Liquids				
Corrosive	10,000	4,536	1,000	3785
Highly toxic ^c	20	9	2	8
Toxic ^c	1,000	454	100	378

Note: Maximum quantities for hazard categories not shown are required to be in accordance with Table 5.2.1.1.3.

^aMaximum quantities are permitted to be increased 100 percent in buildings that are sprinklered in accordance with NFPA 13. This increase shall not apply to highly toxic solids and liquids. Where footnote b also applies, the increase for both footnotes is permitted to be applied.

^bMaximum quantities are permitted to be increased 100 percent where stored in approved storage cabinets in accordance with NFPA 1. This increase shall not apply to highly toxic solids and liquids. Where footnote a also applies, the increase for both footnotes is permitted to be applied.

^cToxic or highly toxic solids or liquids displayed in original packaging in mercantile or storage occupancies and intended for maintenance, operation of equipment, or sanitation when contained in individual packaging not exceeding 100 lb (45.4 kg) shall be limited to an aggregate of 1200 lb (544.3 kg) or 120 gal (454.2 L).

△ **5.3.7 Detached Building Required for High-Hazard Level 2 and High-Hazard Level 3 Materials.** Buildings required to comply with Protection Level 2 or Protection Level 3 and containing quantities of high-hazard contents exceeding the quantity limits set forth in Table 5.3.7 shall be in accordance with 6.2.3.4 or 6.2.4.4, as applicable.

5.4* Outdoor Areas.

5.4.1 Outdoor Control Areas.

5.4.1.1 General.

5.4.1.1.1 Hazardous materials shall be permitted to be stored or used in outdoor control areas in accordance with 5.4.1.2 and 5.4.1.3.

5.4.1.1.2 Where storage or use is in an outdoor control area, compliance with the outdoor storage and use requirements in Chapters 11 through 21 shall not be required.

5.4.1.2 Maximum Allowable Quantity per Outdoor Control Area. Maximum allowable quantities of hazardous materials in

Table 5.2.2.1 Design and Number of Control Areas

Floor Level	Maximum Allowable Quantity per Control Area (%)*	Number of Control Areas per Floor	Fire Resistance Rating for Fire Barriers† (hr)
Above grade			
>9	5.0	1	2
7–9	5.0	2	2
4–6	12.5	2	2
3	50.0	2	1
2	75.0	3	1
1	100.0	4	1
Below grade			
1	75.0	3	1
2	50.0	2	1
Lower than 2	NP	NP	N/A

NP: Not permitted. N/A: Not applicable.

*Percentages represent the applicable MAQ per control area shown in Table 5.2.1.1.3 or Table 5.2.1.2.1 with all the increases permitted in the footnotes of that table.

†Fire barriers are required to include floors and walls, as necessary, to provide a complete separation from other control areas.

Table 5.3.7 Detached Buildings Required Where Quantity of Material Exceeds Amount Shown

Material	Class	Quantity of Material	
		Solids and Liquids (tons)	Gases ft ³ (m ³)*
Individual bulk hydrogen compressed gas systems	N/A	N/A	15,000 (425)
Oxidizers	3	1,200	N/A
	2	2,000	N/A
Organic peroxides	I, IIA, IIB, III, and IV	See note	N/A
Unstable (reactive) materials	3, nondetonable	1	2,000 (57)†
	2	25	10,000 (283)†
Water-reactive materials	3	1	N/A
	2, deflagrating	25	N/A
Pyrophoric gases		N/A	2,000 (57)

For SI units, 1 ton = 0.9 met ton.

N/A: Not applicable.

Note: See MAQs of organic peroxide formulations in nonsprinklered and sprinklered buildings in Table 14.3.2.1(a) and Table 14.3.2.1(b), respectively.

*See Table 21.2.5.

†Nondetonable.

an outdoor control area shall be as specified in Table 5.2.1.5.3(a) and Table 5.2.1.5.3(b) or Table 5.4.1.2.

5.4.1.3 Number of Outdoor Control Areas.

5.4.1.3.1 A single outdoor control area shall be permitted on any property.

5.4.1.3.2 Where a property exceeds 10,000 ft² (929 m²), a group of two outdoor control areas shall be permitted where approved and where each control area is separated by a minimum distance of 50 ft (15 m).

5.4.1.3.3 Where a property exceeds 35,000 ft² (3252 m²), additional groups of outdoor control areas shall be permitted where approved, provided that each group is separated by a minimum distance of 300 ft (91 m).

5.4.2 Outdoor Storage and Use Areas. Where the quantity of hazardous materials in outdoor storage or use exceeds the MAQ for outdoor control areas as set forth in Table 5.4.1.2, the outdoor area shall comply with the applicable outdoor requirements of Chapter 6 and Chapters 11 through 21.

▲ Table 5.4.1.2 Maximum Allowable Quantities of Hazardous Materials per Outdoor Control Area

Material	Class	Storage			Use — Closed Systems			Use — Open Systems	
		Solid Pounds	Liquid Gallons (lb)	Gas (at NTP) ft ³ (lb)	Solid Pounds	Liquid Gallons (lb)	Gas (at NTP) ft ³ (lb)	Solid Pounds	Liquid Gallons (lb)
Physical Hazard Materials									
Flammable gas									
Gaseous		N/A	N/A	3000	N/A	N/A	1500	N/A	N/A
Liquefied		N/A	N/A	(300)	N/A	N/A	(150)	N/A	N/A
Flammable solid		500	N/A	N/A	250	N/A	N/A	50	N/A
Organic peroxide	Detonable	1	(1)	N/A	¼	(¼)	N/A	¼	(¼)
Organic peroxide	I	20	(20)	N/A	10	(10)	N/A	2	(2)
	IIA	100	(200)	N/A	100	(100)	N/A	100	(100)
	IIB	400	(400)	N/A	400	(400)	N/A	400	(400)
	III	NL	NL	N/A	NL	NL	N/A	NL	NL
	IV	NL	NL	N/A	NL	NL	N/A	NL	NL
	V	NL	NL	N/A	NL	NL	N/A	NL	NL
Oxidizer	4	2	(2)	N/A	1	(¼)	N/A	¼	(¼)
	3	40	(40)	N/A	20	(2)	N/A	2	(2)
	2	1000	(1000)	N/A	500	(250)	N/A	50	(50)
	1	NL	NL	N/A	NL	NL	N/A	NL	NL
Oxidizing gas									
Gaseous		N/A	N/A	6000	N/A	N/A	6000	N/A	N/A
Liquefied		N/A	N/A	(600)	N/A	N/A	(300)	N/A	N/A
Pyrophoric		8	(8)	100	4	(4)	10	0	0
Unstable (reactive)	4	2	(2)	20	1	(1)	2	¼	(¼)
	3	20	(20)	200	10	(10)	10	1	(1)
	2	200	(200)	1000	100	(100)	250	10	(10)
	1	NL	NL	1500	NL	NL	NL	NL	NL
Water-reactive	3	20	(20)	N/A	10	(10)	N/A	1	(1)
	2	200	(200)	N/A	100	(100)	N/A	10	(10)
	1	NL	NL	N/A	NL	NL	N/A	NL	NL
Health Hazard Materials									
Corrosive		20000	2000	N/A	10000	1000	N/A	1000	100
Corrosive gas									
Gaseous		N/A	N/A	1620	N/A	N/A	810	N/A	N/A
Liquefied		N/A	N/A	(300)	N/A	N/A	(150)	N/A	N/A
Highly toxic		20	(20)	N/A	10	(10)	N/A	3	(3)
Highly toxic gas									
Gaseous		N/A	N/A	40*	N/A	N/A	20*	N/A	N/A
Liquefied		N/A	N/A	(8)*	N/A	N/A	(4)*	N/A	N/A
Toxic		1000	(1000)	N/A	500	50	N/A	125	(125)
Toxic gas									
Gaseous		N/A	N/A	1620	N/A	N/A	810	N/A	N/A
Liquefied		N/A	N/A	(300)	N/A	N/A	(150)	N/A	N/A

For SI units, 1 lb = 0.454 kg; 1 gal = 3.785 L; 1 ft³ = 0.0283 m³.

N/A: Not applicable. NL: Not limited.

NTP: Measured at normal temperature and pressure [70°F (21°C) and 14.7 psi (101 kPa)].

Notes:

(1) Table values in parentheses correspond to the unit name in parentheses at the top of the column.

(2) For gallons of liquids, divide the amount in pounds by 10.

(3) The aggregate quantities in storage and use cannot exceed the quantity listed for storage.

(4) The aggregate quantity of nonflammable solid and nonflammable or noncombustible liquid hazardous materials allowed in outdoor storage per single property under the same ownership or control used for retail or wholesale sales is permitted to exceed the MAQ where such storage is in accordance with 5.2.1.13.3.

*Permitted only where stored or used in approved exhausted gas cabinets, exhausted enclosures, or fume hoods.

Chapter 6 Fundamental Requirements

6.1 General Requirements.

6.1.1 Applicability. Storage, use, and handling of hazardous materials in any quantity shall comply with Section 6.1.

6.1.1.1* Storage of hazardous materials in quantities exceeding the MAQ set forth in Chapter 5 shall comply with Section 6.2 and the applicable material specific requirements in Chapters 11 through 21.

6.1.1.2* The use, dispensing, and handling of hazardous materials in quantities exceeding the MAQ set forth in Chapter 5 shall comply with Section 6.3 and the applicable material specific requirements in Chapters 11 through 21.

6.1.2* Safety Data Sheets (SDS). Safety data sheets (SDS) shall be available on the premises for hazardous materials regulated by this code. When approved, SDSs shall be permitted to be retrievable by electronic access.

6.1.3 Release of Hazardous Materials.

6.1.3.1 Prohibited Releases. Hazardous materials shall not be released into a sewer, storm drain, ditch, drainage canal, lake, river, or tidal waterway; upon the ground, a sidewalk, a street, or a highway; or into the atmosphere, unless such release is permitted by the following:

- (1) Federal, state, or local governing regulations
- (2) Permits of the jurisdictional air quality management board
- (3) National Pollutant Discharge Elimination System permit
- (4) Waste discharge requirements established by the jurisdictional water quality control board
- (5) Sewer pretreatment requirements for publicly or privately owned treatment works

6.1.3.2 Control and Mitigation of Unauthorized Releases. Provisions shall be made for controlling and mitigating unauthorized releases.

6.1.3.3 Records of Unauthorized Releases. Accurate records of the unauthorized release of hazardous materials shall be kept by the permittee.

6.1.3.4* Notification of Unauthorized Releases. The fire department shall be notified immediately or in accordance with approved emergency procedures when an unauthorized release becomes reportable under state, federal, or local regulations.

6.1.3.5 Container Failure. When an unauthorized release due to primary container failure is discovered, the involved primary container shall be repaired or removed from service.

6.1.3.6 Overpack Containers. Overpack containers shall be permitted to be used as a means to provide protection for primary containers to be transported for repair or removal from service.

6.1.3.7 Responsibility for Cleanup of Unauthorized Releases.

6.1.3.7.1 The person, firm, or corporation responsible for an unauthorized release shall institute and complete all actions necessary to remedy the effects of such unauthorized release, whether sudden or gradual, at no cost to the AHJ.

6.1.3.7.2 When deemed necessary by the AHJ, cleanup of an unauthorized release shall be permitted to be initiated by the

fire department or by an authorized individual or firm, and costs associated with such cleanup shall be borne by the owner, operator, or other person responsible for the unauthorized release.

6.1.4* Personnel Training. Persons in areas where hazardous materials are stored, dispensed, handled, or used shall be trained in the hazards of the materials employed and actions required by the emergency plan. The level of training to be conducted shall be consistent with the responsibilities of the persons to be trained in accordance with 6.1.4.1 through 6.1.4.5.

6.1.4.1 Awareness. The training provided for persons designated in 6.1.4 shall include awareness training in accordance with 6.1.4.1.1 through 6.1.4.1.3.

6.1.4.1.1 Completion. Initial training shall be completed prior to beginning work in the work area.

6.1.4.1.2 Hazard Communications. Training shall be provided prior to beginning work in the work area to enable personnel to recognize and identify hazardous materials stored, dispensed, handled, or used on site and where to find safety information pertaining to the hazards of the materials employed.

6.1.4.1.3 Emergency Plan. Training shall be provided prior to beginning work in the work area to enable personnel to implement the emergency plan.

6.1.4.2 Operations Personnel. Persons engaged in storing, using, or handling hazardous materials shall be designated as operations personnel and shall be trained in accordance with 6.1.4.1 and 6.1.4.2.1 through 6.1.4.2.6.

6.1.4.2.1 Physical and Health Hazard Properties. Operations personnel shall be trained in the chemical nature of the materials, including their physical hazards and the symptoms of acute or chronic exposure as provided by the safety data sheet (SDS) furnished by the manufacturer or other authoritative sources.

6.1.4.2.2 Dispensing, Using, and Processing. Operations personnel shall be trained in the use of specific safeguards applicable to the dispensing, processing, or use of the materials and equipment employed.

6.1.4.2.3 Storage. Operations personnel shall be trained in the application of storage arrangements and site-specific limitations on storage for the materials employed.

6.1.4.2.4 Transport (Handling). Operations personnel involved in materials handling shall be trained in the requirements for on-site transport of the materials employed.

6.1.4.2.5 Actions in an Emergency. Operations personnel shall be trained in the necessary actions to take in the event of an emergency, including the operation and activation of emergency controls prior to evacuation.

6.1.4.2.6 Changes. Training shall be provided whenever a new hazardous material is introduced into the work area that presents a new physical or health hazard, or when new information is obtained pertaining to physical or health hazards of an existing hazardous material that has not been included in previous training, and when there are changes in any of the following:

- (1) Equipment

- (2) Operations
- (3) Hazardous materials

6.1.4.3 Emergency Response Liaison.

6.1.4.3.1 Responsible persons shall be designated and trained to be emergency response (ER) liaison personnel.

6.1.4.3.2 Emergency response liaison personnel shall do the following:

- (1) Aid emergency responders in pre-planning responses to emergencies
- (2) Identify locations where hazardous materials are located
- (3) Have access to safety data sheets
- (4) Be knowledgeable in the site emergency response procedures

6.1.4.4* Emergency Responders. Emergency responders shall be trained to be competent in the actions to be taken in an emergency event.

6.1.4.4.1* Emergency Response Team Leader. Persons acting as ER team leaders shall be trained under the Incident Command System concept or equivalent.

6.1.4.4.2* Response to Incipient Events. Responses to incidental releases of hazardous materials where the material can be absorbed, neutralized, or otherwise controlled at the time of release by employees in the immediate release area, or by maintenance personnel, shall not be considered emergency responses as defined within the scope of this code.

6.1.4.4.3* On-Site Emergency Response Team. When an on-site emergency response team is provided, emergency responders shall be trained in accordance with the requirements of the specific site emergency plan or as required by federal, state, or local governmental agencies.

6.1.4.5 Training Mandated by Other Agencies. Training required by federal, state, or local regulations that is required based on the quantity or type of hazardous materials stored, dispensed, handled, or used shall be conducted in accordance with the requirements of and under the jurisdiction of the governing agency.

6.1.4.6 Documentation. Training shall be documented and the documentation made available to the AHJ upon written request.

6.1.5 Ignition Source Controls.

6.1.5.1 Smoking. Smoking shall be prohibited in the following locations:

- (1) Within 25 ft (7.6 m) of outdoor storage areas, dispensing areas, or open use areas
- (2) In rooms or areas where hazardous materials are stored or dispensed or used in open systems in amounts requiring a permit in accordance with Section 1.8

6.1.5.2 Open Flames and High-Temperature Devices. Open flames and high-temperature devices shall not be used in a manner that creates a hazardous condition.

6.1.5.3 Energy-Consuming Equipment. Energy-consuming equipment with the potential to serve as a source of ignition shall be listed or approved for use with the hazardous materials stored or used.

6.1.5.3.1* Powered Industrial Trucks. Powered industrial trucks shall be operated and maintained in accordance with NFPA 505. [1:10.18]

6.1.6 Systems, Equipment, and Processes. Processes, methods, specifications, equipment testing and maintenance, design standards, performance, installation, equipment design and construction, and other pertinent criteria shall be in accordance with this section.

6.1.6.1 Design and Construction of Containers and Tanks. Containers, cylinders, and tanks shall be designed and constructed in accordance with approved standards. Containers, cylinders, tanks, and other means used for containment of hazardous materials shall be of an approved type.

Δ 6.1.6.2 Piping, Tubing, Valves, and Fittings. Piping, tubing, valves, fittings, and related components used for hazardous materials shall be in accordance with the following:

- (1) Piping, tubing, valves, fittings, and related components shall be designed and fabricated from materials compatible with the material to be contained and shall be of a strength and durability to withstand the pressure, structural and seismic stress, and exposure to which they are subject.
- (2) Piping and tubing shall be identified in accordance with ASME A13.1, *Scheme for the Identification of Piping Systems*, to indicate the material conveyed.
- (3) Accessible manual valves, or fail-safe emergency shutoff valves operated by a remotely located manually or automatically activated shutdown control, shall be installed on supply piping and tubing at the following locations:
 - (a) Point of use
 - (b) Tank or bulk source
- (4) Manual emergency shutoff valves and remotely located manually activated shutdown controls for emergency shutoff valves shall be identified, and the location shall be clearly visible, accessible, and indicated by means of a sign.
- (5) Backflow prevention or check valves shall be provided when the backflow of hazardous materials could create a hazardous condition or cause the unauthorized discharge of hazardous materials.
- (6) Liquids classified in accordance with NFPA 704 shall be carried in pressurized piping above a gauge pressure of 15 psi (103 kPa) having a hazard ranking as follows:
 - (a) Health hazard Class 3 or Class 4
 - (b) Flammability Class 4
 - (c) Instability Class 3 or Class 4
- (7) The pressurized piping specified in 6.1.6.2(6) shall be provided with an approved means of leak detection and emergency shutoff or excess flow control in accordance with the following:
 - (a) Where the piping originates from within a hazardous material storage room or area, the excess flow control shall be located within the storage room or area.
 - (b) Where the piping originates from a bulk source, the excess flow control shall be located at the bulk source.
 - (c) Piping for inlet connections designed to prevent backflow shall not be required to be equipped with excess flow control.

6.1.6.3 Additional Regulations for Supply Piping for Health Hazard Materials. Supply piping and tubing for liquids or solids having a health hazard ranking of Class 3 or Class 4 in accordance with NFPA 704 shall be in accordance with ASME B31.3, *Process Piping*, and the following:

- (1) Piping and tubing utilized for the transmission of highly toxic, toxic, or highly volatile corrosive liquids shall have welded, threaded, or flanged connections throughout, except for connections located within a ventilated enclosure, or an approved method of drainage or containment.
- (2) Piping and tubing shall not be located within corridors, within any portion of a means of egress required to be enclosed in fire resistance-rated construction, or in concealed spaces in areas not classified as Protection Level 1 through Protection Level 4 occupancies.

6.1.6.4 Equipment, Machinery, and Alarms. Equipment, machinery, and required detection and alarm systems associated with the use, storage, or handling of hazardous materials shall be listed or approved.

6.1.7 Empty Containers and Tanks. Empty containers and tanks previously used for the storage of hazardous materials shall be free from residual material and vapor as defined by DOT, the *Resource Conservation and Recovery Act (RCRA)*, or other regulating authority or shall be maintained as specified for the storage of hazardous material.

6.1.8 Signs.

6.1.8.1 General.

6.1.8.1.1 Design and Construction. Signs shall be durable, and the size, color, and lettering of signs shall be in accordance with nationally recognized standards.

6.1.8.1.2 Language. Signs shall be in English as the primary language or in symbols permitted by this code.

6.1.8.1.3 Maintenance. Signs shall meet the following criteria:

- (1) They shall not be obscured.
- (2) They shall be maintained in a legible condition.
- (3) They shall not be removed, unless for replacement.

6.1.8.2 Hazardous Materials Identification.

6.1.8.2.1 NFPA 704 Placard. Visible hazard identification signs in accordance with NFPA 704 shall be placed at the following locations, except where the AHJ has received a hazardous materials management plan and a hazardous materials inventory statement in accordance with Sections 1.11 and 1.12 and has determined that omission of such signs is consistent with safety:

- (1) On stationary aboveground tanks
- (2) On stationary aboveground containers
- (3) At entrances to locations where hazardous materials are stored, dispensed, used, or handled in quantities requiring a permit
- (4) At other entrances and locations designated by the AHJ

6.1.8.2.2 Identification of Containers, Cartons, and Packages. Individual containers, cartons, or packages shall be conspicuously marked or labeled in accordance with nationally recognized standards.

6.1.8.3 No Smoking Signs. Where “no smoking” is not applicable to an entire site or building, signs shall be provided as follows:

- (1) In rooms or areas where hazardous materials are stored or dispensed or used in open systems in amounts requiring a permit in accordance with Section 1.8
- (2) Within 25 ft (7.6 m) of outdoor storage, dispensing, or open-use areas

6.1.9 Protection from Vehicles.

6.1.9.1 Guard posts or other approved means shall be provided to protect the following where subject to vehicular damage:

- (1) Storage tanks and connected piping, valves, and fittings
- (2) Storage areas containing tanks or portable containers except where the exposing vehicles are powered industrial trucks used for transporting the hazardous materials
- (3) Use areas

6.1.9.2 Where guard posts are installed, the posts shall meet the following criteria:

- (1) They shall be constructed of steel not less than 4 in. (102 mm) in diameter and concrete filled.
- (2) They shall be spaced not more than 4 ft (1.2 m) between posts on center.
- (3) They shall be set not less than 3 ft (0.9 m) deep in a concrete footing of not less than a 15 in. (381 mm) diameter.
- (4) They shall be set with the top of the posts not less than 3 ft (0.9 m) above ground.
- (5) They shall be located not less than 3 ft (0.9 m) from the tank.

6.1.10 Electrical Wiring and Equipment.

6.1.10.1 General. Electrical wiring and equipment shall be installed in accordance with *NFPA 70*.

6.1.10.2 Static Accumulation. When processes or use conditions exist where flammable gases, dusts, or vapors can be ignited by static electricity, means shall be provided to prevent the accumulation of a static charge and to dissipate the static charge to ground.

6.1.11 Protection from Light. Materials that are sensitive to light shall be stored in containers designed to protect them from such exposure.

6.1.12 Separation of Incompatible Materials.

6.1.12.1 Incompatible materials in storage and storage of materials incompatible with materials in use shall be separated when the stored materials are in containers having a capacity of more than 5 lb (2.268 kg) or ½ gal (1.89 L).

6.1.12.2 Separation shall be accomplished by one of the following methods:

- (1) Segregating incompatible materials storage by a distance of not less than 20 ft (6.1 m)
- (2) Isolating incompatible materials storage by a noncombustible partition extending not less than 18 in. (457 mm) above and to the sides of the stored material or by a noncombustible partition that interrupts the line of sight between the incompatible materials

- (3) Storing liquid and solid materials in hazardous materials storage cabinets complying with 6.1.18
- (4) Storing compressed gases in gas cabinets or exhausted enclosures complying with Chapter 21

6.1.12.3 Materials that are incompatible shall not be stored within the same cabinet or enclosure.

6.1.13 General Storage.

6.1.13.1 Storage. The storage arrangement of materials shall be in accordance with this chapter and the material specific requirements of Chapters 11 through 21 as applicable.

6.1.13.2 Shelf Storage. Shelving shall be constructed to carry the design loads and shall be braced and anchored in accordance with the seismic design requirements of the applicable building code.

6.1.13.2.1 Shelf Construction.

6.1.13.2.1.1 Shelving shall be treated, coated, or constructed of materials that are compatible with the hazardous materials stored.

6.1.13.2.1.2 Shelves shall be provided with a lip or guard where used for the storage of individual containers, except under either of the following conditions:

- (1) Where storage is located in hazardous materials storage cabinets or laboratory furniture specifically designed for such use
- (2) Where amounts of hazardous materials in storage do not exceed the quantity threshold for requiring a permit in accordance with Section 1.8

6.1.13.2.2 Shelf storage of hazardous materials shall be maintained in an orderly manner.

6.1.14* Seismic Protection. Machinery and equipment utilizing hazardous materials in areas subject to seismic activity shall be seismically anchored in accordance with the building code.

6.1.14.1 Shock Padding. Materials that are shock sensitive shall be padded, suspended, or otherwise protected against accidental dislodgement and dislodgement during seismic activity.

6.1.15 Outdoor Storage and Use Areas. Outdoor storage and use areas for hazardous materials shall comply with the following:

- (1) Outdoor storage and use areas shall be kept free of weeds, debris, and common combustible materials not necessary to the storage or use of hazardous materials.
- (2) The area surrounding an outdoor storage and use area shall be kept clear of weeds, debris, and common combustible materials not necessary to the storage or use of hazardous materials for a minimum distance of 15 ft (4.5 m).
- (3) Outdoor storage and use areas for hazardous materials shall be located not closer than 20 ft (6.1 m) from a property line that can be built upon, a street, an alley, or a public way, except that a 2-hour fire barrier wall, without openings and extending not less than 30 in. (762 mm) above and to the sides of the storage area, shall be permitted in lieu of such distance.

6.1.16 Maintenance Required.

6.1.16.1* Equipment, machinery, and required detection and alarm systems associated with hazardous materials shall be maintained in an operable condition.

6.1.16.2 Stationary tanks not used for a period of 90 days shall be safeguarded or removed in an approved manner.

6.1.16.2.1 The tanks specified in 6.1.16.2 shall have the fill line, gauge opening, and pump connection secured against tampering.

6.1.16.2.2 Vent lines shall be maintained.

6.1.16.2.3* Tanks that are to be placed back in service shall be tested in an approved manner.

6.1.16.3 The following shall apply to defective containers, cylinders, and tanks:

- (1) They shall be removed from service, repaired, or disposed of in an approved manner.
- (2) Overpack containers shall be permitted to be used as a means to provide protection for primary containers that are transported for repair or removal from service.

6.1.16.4 Defective equipment or machinery shall be removed from service and repaired or replaced.

6.1.16.5 Required detection and alarm systems that are defective shall be replaced or repaired.

6.1.17 Testing.

6.1.17.1 The equipment, devices, and systems listed in 6.1.17.2.1 shall be tested at one of the intervals listed in 6.1.17.2.2. Written records of the tests conducted or maintenance performed shall be maintained.

6.1.17.2 Testing shall not be required under the following conditions:

- (1) Where approved written documentation is provided that testing will damage the equipment, device, or system and the equipment, device, or system is maintained as specified by the manufacturer
- (2) Where equipment, devices, and systems fail in a fail-safe manner
- (3) Where equipment, devices, and systems self-diagnose and report trouble, with records of the self-diagnosis and trouble reporting made available to the AHJ
- (4) Where system activation occurs during the required test cycle for the components activated during the test cycle
- (5) Where approved maintenance in accordance with 6.1.16.1 is performed not less than annually or in accordance with an approved schedule, in which case the testing requirements set forth in 6.1.17.2.1 and 6.1.17.2.2 are permitted to apply.

6.1.17.2.1 Equipment, Devices, and Systems Requiring Testing. The following equipment, devices, and systems shall be tested in accordance with 6.1.17 and 6.1.17.2.2:

- (1) Limit control systems for liquid level, temperature, and pressure required by 6.2.1.7 and 6.3.1.2
- (2) Monitoring and supervisory systems required by 6.2.1.1 and 6.3.2.1.1

6.1.17.2.2 Testing Frequency. The equipment, systems, and devices listed in 6.1.17.2.1 shall be tested at one of the following frequencies:

- (1) Not less than annually
- (2) In accordance with the approved manufacturer's requirements
- (3) In accordance with approved recognized industry standards
- (4) In accordance with an approved schedule

6.1.18 Hazardous Materials Storage Cabinets. When storage cabinets are used to increase MAQ per control area or to otherwise comply with a specific provision in Chapter 6, such cabinets shall be in accordance with the following:

- (1) Cabinets shall be constructed of metal.
- (2) The interior of cabinets shall be treated, coated, or constructed of materials that are nonreactive with the hazardous material stored, and such treatment, coating, or construction shall include the entire interior of the cabinet.
- (3) Cabinets shall be either listed as suitable for the intended storage or constructed in accordance with the following:
 - (a) Cabinets shall be of steel having a thickness of not less than 0.044 in. (1.12 mm) (18 gauge).
 - (b) The cabinet, including the door, shall be double-walled with 1½ in. (38.1 mm) airspace between the walls.
 - (c) Joints shall be riveted or welded and shall be tight-fitting.
 - (d) Doors shall be well fitted, self-closing, and equipped with a self-latching device.
 - (e) The bottoms of cabinets utilized for the storage of liquids shall be liquidtight to a minimum height of 2 in. (51 mm).
 - (f) For requirements regarding electrical equipment and devices within cabinets used for the storage of hazardous liquids, compressed gases, or cryogenic fluids, see *NFPA 70*.
- (4) Cabinets shall be marked in conspicuous lettering that reads as follows: HAZARDOUS — KEEP FIRE AWAY

6.1.19 Installation of Tanks. Installation of tanks shall be in accordance with 6.1.19.1 through 6.1.19.2.

6.1.19.1 Underground Tanks.

6.1.19.1.1 Underground tanks used for the storage of liquid hazardous materials shall be provided with secondary containment.

6.1.19.1.2 In lieu of providing secondary containment for an underground tank, an aboveground tank in an underground vault complying with *NFPA 30* shall be permitted.

6.1.19.2 Aboveground Tanks. Aboveground stationary tanks installed outdoors and used for the storage of hazardous materials shall be located and protected in accordance with the requirements for outdoor storage of the particular material involved and in accordance with the requirements of Chapters 11 through 21.

6.1.19.2.1 Aboveground tanks that are installed in vaults complying with *NFPA 30* shall not be required to comply with location and protection requirements for outdoor storage.

6.1.19.2.2 Aboveground tanks that are installed inside buildings and used for the storage of hazardous materials shall be

located and protected in accordance with the requirements for indoor storage of the particular material involved.

6.1.19.2.3 Marking. Aboveground stationary tanks shall be marked as required by 6.1.8.2.1.

6.1.20 When required, fire alarm systems and smoke detection systems shall be installed in accordance with *NFPA 72*.

6.2 Requirements for Occupancies Storing Quantities of Hazardous Materials Exceeding the Maximum Allowable Quantities per Control Area for High-Hazard Contents.

6.2.1 Indoor Storage General Requirements. The requirements set forth in 6.2.1 shall apply to buildings, or portions thereof, that are required to comply with Protection Level 1 through Protection Level [4] where required by Section 5.3. [5000:34.3.2]

6.2.1.1 Fire Protection Systems. Buildings, or portions thereof, required to comply with Protection Level 1 through Protection Level [4] shall be protected by an approved automatic fire sprinkler system complying with Section 55.3 of *NFPA 5000*. [5000:34.3.2.1]

6.2.1.1.1 The design of the sprinkler system shall be not less than ordinary hazard group 2 in accordance with *NFPA 13* except as follows:

- (1) Where different requirements are specified in Chapters 11 through 21 of this code
- (2) Where the materials or storage arrangement requires a higher level of sprinkler system protection in accordance with nationally recognized standards
- (3) Where approved alternative automatic fire extinguishing systems are permitted

6.2.1.1.2 Electronic supervision of supervisory signals shall be provided in accordance with 55.3.2.1 of *NFPA 5000*. [5000:34.3.2.1.1]

6.2.1.1.3 Waterflow alarms shall be monitored in accordance with 55.3.2.2 of *NFPA 5000*. [5000:34.3.2.1.2]

6.2.1.1.4 Rooms or areas that are of noncombustible construction with wholly noncombustible contents shall not be required to comply with 6.2.1.1. [5000:34.3.2.1.3]

6.2.1.2 Building Height Exception. The height of a one-story building, or portion thereof, containing only tanks or industrial process equipment shall not be limited based on the type of construction. [5000:34.3.2.2]

6.2.1.3 Separation of Occupancies Having High Hazards. The separation of areas containing high-hazard contents from each other and from other use areas shall be as required by Table 6.2.1.3 and shall not be permitted to be reduced with the **installation** of fire protection systems as required by 6.2.1.1. [5000:34.3.2.3]

6.2.1.4 Egress. Egress from areas required to comply with Protection Level 1, Protection Level 2, Protection Level 3, or Protection Level 4 shall comply with 34.3.2.4 of *NFPA 5000* and with 6.2.1.4 of this code. [5000:34.3.2.4]

6.2.1.4.1 Travel Distance Limit. Travel distance to an exit from areas required to comply with Protection Level 1 through Protection Level [4] shall not exceed the distance given in Table 6.2.1.4.1, measured as required in 11.6.3 of *NFPA 5000*. [5000:34.3.2.4.1]

Table 6.2.1.3 Required Separation of Occupancies Containing High-Hazard Contents (hr)

Occupancy	Protection Level 1	Protection Level 2	Protection Level 3*	Protection Level 4	Protection Level 5
Apartment buildings	NP	4	3	4	4
Assembly ≤ 300	NP	4	3	2	4
Assembly > 300 and ≤ 1000	NP	4	3	2	4
Assembly > 1000	NP	4	3	2	4
Board and care, small	NP	4	3	4	4
Board and care, large	NP	4	3	4	4
Business	NP	2	1	1	1
Day-care > 12	NP	4	3	4	4
Day-care homes	NP	4	3	4	4
Detention and correctional	NP	4	3	4	4
Dwellings, one- and two-family	NP	4	3	4	4
Educational	NP	4	3	2	3
Health care, ambulatory	NP	4	4	4	4
Health care, nonambulatory	NP	4	4	4	4
Hotels and dormitories	NP	4	3	4	4
Industrial, general purpose	NP	2	1	1	1
Industrial, special purpose	NP	2	1	1	1
Lodging and rooming houses	NP	4	3	4	4
Mercantile, Class A	NP	2	1	1	1
Mercantile, Class B	NP	2	1	1	1
Mercantile, Class C	NP	2	1	1	1
Mercantile, covered mall	NP	2	1	1	1
Mercantile, bulk retail	NP	2	1	1	1
Protection Level 1	—	NP	NP	NP	NP
Protection Level 2	NP	—	1	2	2
Protection Level 3	NP	1	—	1	1
Protection Level 4	NP	2	1	—	1
Protection Level 5	NP	2	1	1	—
Storage, low and ordinary hazard	NP	2	1	1	1

NP: Not permitted.

*Rooms in excess of 150 ft² (14 m²) storing flammable liquids, combustible liquids, or Class 3 oxidizers are required to be provided with not less than a 2-hour separation.

[5000:Table 34.3.2.3]

Table 6.2.1.4.1 Travel Distance Limits

Protection Level	Distance	
	ft	m
1	75	23
2	100	30
3	150	46
4	175	53

[5000:Table 34.3.2.4.1]

6.2.1.4.2 Capacity of Means of Egress. Egress capacity for high-hazard content areas shall be based on 0.7 in. (18 mm) per person for stairs or 0.4 in. (10 mm) per person for level components and ramps in accordance with 11.3.3.1 of *NFPA 5000*. [5000:34.3.2.4.2]

6.2.1.4.3 Number of Means of Egress. Not less than two means of egress shall be provided from each building, or portion thereof, required to comply with Section 6.2, unless rooms or spaces do not exceed 200 ft² (18.6 m²), have an occupant load not exceeding three persons, and have a travel distance to the room door not exceeding 25 ft (7.6 m). [5000:34.3.2.4.3]

N 6.2.1.4.4 Common Path of Travel Distance Limit. The common path of travel distance from areas required to comply with Protection Level 1 through Protection Level 5 shall not exceed the distance given in Table 6.2.1.4.4, measured as required in 11.6.3 of *NFPA 5000*.

6.2.1.4.5 Dead Ends. Means of egress, for other than rooms or spaces that do not exceed 200 ft² (18.6 m²), have an occupant load not exceeding three persons, and have a travel distance to the room door not exceeding 25 ft (7.6 m), shall be arranged so that there are no dead ends in corridors. [5000:34.3.2.4.4]

6.2.1.4.6 Doors. Doors serving high-hazard contents areas with occupant loads in excess of five shall be permitted to be provided with a latch or lock only if the latch or lock is panic hardware or fire exit hardware complying with 11.2.1.7 of *NFPA 5000*. [5000:34.3.2.4.5]

6.2.1.5 Ventilation. Buildings, or portions thereof, in which explosive, flammable, combustible, corrosive, or highly toxic dusts, mists, fumes, vapors, or gases are, or might be, emitted shall be provided with mechanical exhaust ventilation or natu-

ral ventilation where natural ventilation can be shown to be acceptable for the materials as stored. [5000:34.3.2.5.1]

6.2.1.5.1 Solids and liquids stored in closed containers shall not be required to comply with 6.2.1.5.

6.2.1.5.2 Mechanical exhaust systems shall comply with the *Uniform Mechanical Code* as referenced in Chapter 50 of *NFPA 5000*. [5000:34.3.2.5.2]

6.2.1.5.3 Mechanical ventilation shall be at a rate of not less than 1 ft³/min/ft² (5.1 L/s/m²) of floor area over areas required to comply with Protection Level 1 through Protection Level [4]. [5000:34.3.2.5.3]

6.2.1.5.4 Ventilation requirements shall be determined by calculations based on anticipated fugitive emissions or by sampling of the actual vapor concentration levels under normal operating conditions. [5000:34.3.2.5.5]

6.2.1.5.5 Make-up air shall be provided, and provision shall be made for locating make-up air openings to avoid short-circuiting the ventilation. [5000:34.3.2.5.6]

6.2.1.5.6 Ducts conveying explosives or flammable vapors, fumes, or dusts shall extend directly to the exterior of the building without entering other spaces. [5000:34.3.2.5.7]

6.2.1.5.6.1 Exhaust ducts shall not extend into or through ducts and plenums. [5000:34.3.2.5.7.1]

6.2.1.5.6.2 Ducts conveying vapor or fumes having flammable constituents less than 25 percent of their lower flammability limit shall be permitted to pass through other spaces. [5000:34.3.2.5.7.2]

6.2.1.5.7 Emissions generated by workstations shall be removed from the areas in which they are generated by means of local exhaust installed in accordance with the mechanical code.

6.2.1.5.8 The location of supply and exhaust openings shall be in accordance with the *Uniform Mechanical Code* as referenced in Chapter 50 of *NFPA 5000*. [5000:34.3.2.5.9]

6.2.1.5.9 Systems shall operate continuously unless alternate designs are approved. [5000:34.3.2.5.11]

6.2.1.5.10 A manual shutoff control for ventilation equipment required by 6.2.1.5 shall be provided outside the room adjacent to the principal access door to the room. [5000:34.3.2.5.12]

6.2.1.5.11 The shutoff control described in 6.2.1.5.10 shall be of the break-glass type and shall be labeled as follows:

VENTILATION SYSTEM EMERGENCY SHUTOFF
[5000:34.3.2.5.13]

6.2.1.5.12 Exhaust ventilation shall be arranged to consider the density of the potential fumes or vapors released. [5000:34.3.2.5.14]

6.2.1.5.12.1 For fumes or vapors that are lighter than air, exhaust shall be taken from a point within 12 in. (305 mm) of the high point of the room or area in which they are generated.

6.2.1.5.12.2 For fumes or vapors that are heavier than air, exhaust shall be taken from a point within 12 in. (305 mm) of the floor. [5000:34.3.2.5.14.1]

Table 6.2.1.4.4 Common Path of Travel Distance Limits

Hazard Level	Distance	
	ft	m
1	25	8
2	25	8
3	25	8
4	75	23
5	75	23

[5000:Table 34.3.2.4.6.1]

6.2.1.5.12.3 The location of both the exhaust and inlet air openings shall be arranged to provide air movement across all portions of the floor or room to prevent the accumulation of vapors. [5000:34.3.2.5.14.2]

6.2.1.5.12.4 Exhaust ventilation shall not be recirculated within the room or building if the materials stored are capable of emitting hazardous vapors. [5000:34.3.2.5.14.3]

6.2.1.5.12.5 Recirculation shall be permitted where it is monitored continuously using a fail-safe system that is designed to automatically sound an alarm, stop recirculation, and provide full exhaust to the outside in the event that vapor-air mixtures in concentrations over one-fourth of the lower flammable limit are detected. [5000:34.3.2.5.14.4]

6.2.1.5.12.6 Air contaminated with explosive or flammable vapors, fumes, or dusts, or with radioactive materials, shall not be recirculated.

6.2.1.6* Explosion Control. Buildings, or portions thereof, required to comply with Protection Level 1 through Protection Level 3 and containing materials shown in Table 6.2.1.6 shall be provided with a means of explosion control. [5000:34.3.2.6]

Table 6.2.1.6 Explosion Control Requirements

Hazard Category	Class	Protection Method
Combustible dust presenting an explosion hazard	N/A	Explosion control ^a
Explosives	Detonating Deflagrating	Barricade ^b Explosion control ^a
Flammable gas or cryogen	N/A	Explosion control ^a
Flammable liquid ^c	Class IA, storage >1 gal Class IA, use Class IB, use-open ^d	Explosion control ^a Explosion control ^a
Organic peroxides	Unclassified Class I	Barricade ^b Barricade ^b
Oxidizer liquids and solids	Class 4	Barricade ^b
Pyrophoric gas ^c	N/A	Barricade ^b Explosion control ^a
Unstable Reactive	Class 4 Class 3, detonating Class 3, deflagrating	Barricade ^b Barricade ^b Explosion control ^a
Water-reactive liquids and solids	Class 3 Class 2, deflagrating	Explosion control ^a Explosion control ^a

N/A: Not applicable.

^aExplosion control is required to be a deflagration prevention method, such as combustible concentration reduction or oxidant concentration reduction, or a deflagration control method complying with NFPA 69 or an approved, engineered deflagration-venting method.

^bBarricades are required to comply with NFPA 495.

^cDeflagration venting is not required for rooms that are less than or equal to 500 ft² (46.5 m²) in floor area and do not have any exterior walls as set forth in 34.3.4.2.2 of NFPA 5000.

^dA protection method is required where an explosive environment can occur as a result of the dispensing or use process.

^eWhere gas-air mixtures are capable of detonation, barricade construction is required to be provided [5000:Table 34.3.2.6]

6.2.1.7 Limit Controls. Limit controls shall be provided in accordance with 6.2.1.7.1 and 6.2.1.7.2.

6.2.1.7.1 Temperature Control. Materials that must be kept at temperatures other than normal ambient temperatures to prevent a hazardous reaction shall be provided with an approved means to maintain the temperature within a safe range.

6.2.1.7.1.1 Redundant temperature control equipment that will operate on failure of the primary temperature control system shall be provided.

6.2.1.7.1.2 The use of alternative means that prevent a hazardous reaction shall be permitted subject to the approval of the AHJ.

6.2.1.7.2 Pressure Control.

6.2.1.7.2.1 Stationary tanks and equipment containing hazardous material liquids that can generate pressures exceeding design limits due to exposure fires or internal reaction shall have some form of construction or other approved means that will relieve excessive internal pressure.

6.2.1.7.2.2 The termination point for piped vent systems used for the purpose of operational or emergency venting shall be located to prevent impingement exposure on the system served and to minimize the effects of high-temperature thermal radiation or the effects of contact with the material being vented from the escaping plume on the supply system, personnel, adjacent structures, and ignition sources.

6.2.1.8 Standby and Emergency Power.

6.2.1.8.1 Where mechanical ventilation, treatment systems, temperature control, alarm, detection, or other electrically operated safety systems are required by this code, NFPA 1, or NFPA 5000, such systems shall be provided with standby power or emergency power as required by 6.2.1.8. [5000:34.3.2.7.1]

6.2.1.8.2 Standby power for mechanical ventilation, exhaust treatment, and temperature control systems shall not be required where such systems are engineered and approved as fail-safe. [5000:34.3.2.7.2]

6.2.1.8.3 The secondary source of power shall be an approved means of legally required standby power in accordance with NFPA 70.

6.2.1.9 Spill Control and Secondary Containment for Hazardous Materials Liquids and Solids.

6.2.1.9.1 General. Buildings, or portions thereof, required to comply with Protection Level 1 through Protection Level 4 shall be provided with spill control and secondary containment in accordance with 6.2.1.9.2 and 6.2.1.9.3, except for outdoor storage on containment pallets complying with 6.2.7.3.3.

6.2.1.9.2 Spill Control.

6.2.1.9.2.1 Buildings, or portions thereof, used for storage of hazardous materials liquids in individual containers having a capacity of more than 55 gal (208.2 L) shall be provided with spill control to prevent the flow of liquids to adjoining areas.

6.2.1.9.2.2 Where spill control is required, floors in indoor locations and similar surfaces in outdoor locations shall be constructed to contain a spill from the largest single vessel by one of the following methods:

- (1) Liquidtight sloped or recessed floors in indoor locations or similar areas in outdoor locations
- (2) Liquidtight floors in indoor locations or similar areas in outdoor locations provided with liquidtight raised or recessed sills or dikes
- (3) Sumps and collection systems

[5000:34.3.2.8.2.2]

6.2.1.9.2.3 Except for surfacing, the floors, sills, dikes, sumps, and collection systems shall be constructed of noncombustible material, and the liquidtight seal shall be compatible with the material stored. [5000:34.3.2.8.2.3]

6.2.1.9.2.4 Where liquidtight sills or dikes are provided, they shall not be required at perimeter openings that are provided with an open-grate trench across the opening that connects to an approved collection system. [5000:34.3.2.8.2.4]

6.2.1.9.3 Secondary Containment.

6.2.1.9.3.1 Buildings, or portions thereof, used for any of the following shall be provided with secondary containment:

- (1) Storage of liquids where the capacity of an individual vessel exceeds 55 gal (208.2 L) or the aggregate capacity of multiple vessels exceeds 1000 gal (3785 L)
- (2) Storage of solids where the capacity of an individual vessel exceeds 550 lb (248.8 kg) or the aggregate capacity of multiple vessels exceeds 10,000 lb (4524.8 kg)

6.2.1.9.3.2 Buildings, or portions thereof, containing only hazardous materials in listed secondary containment tanks or systems shall not be required to comply with 6.2.1.9.3.1.

6.2.1.9.3.3 Buildings, or portions thereof, containing only ammonium nitrate solids, organic peroxide solids, flammable solids, pyrophoric solids, or corrosive solids shall not be required to comply with 6.2.1.9.3.1.

6.2.1.9.3.4 The building, room, or area shall contain or drain the hazardous materials and fire protection water through the use of one of the following methods:

- (1) Liquidtight sloped or recessed floors in indoor locations or similar areas in outdoor locations
- (2) Liquidtight floors in indoor locations or similar areas in outdoor locations provided with liquidtight raised or recessed sills or dikes
- (3) Sumps and collection systems
- (4) Drainage systems leading to an approved location

6.2.1.9.3.5 Where incompatible materials are present in open containers or systems, such materials shall be separated from each other in the secondary containment system.

6.2.1.9.3.6 Secondary containment for indoor storage areas shall be designed to contain a spill from the largest vessel plus the design flow volume of fire protection water calculated to discharge from the fire-extinguishing system over the minimum required system design area, or area of the room or area in which the storage is located, whichever is smaller, for a period of 20 minutes.

6.2.1.9.3.7 A monitoring method shall be provided to detect hazardous materials in the secondary containment system.

6.2.1.9.3.8 The monitoring method specified in 6.2.1.9.3.7 shall be permitted to be visual inspection of the primary or secondary containment or other approved means.

6.2.1.9.3.9 Where secondary containment is subject to the intrusion of water, a monitoring method for detecting water shall be provided.

6.2.1.9.3.10 Where monitoring devices are provided, they shall be connected to distinct visual or audible alarms.

6.2.1.9.3.11 Where remote containment systems are provided, drainage systems shall be in accordance with the plumbing code, as referenced in Chapter 2, and the following provisions also shall be met:

- (1) The slope of floors in indoor locations to drains or similar areas in outdoor locations shall be not less than 1 percent.
- (2) Drains from indoor storage areas shall be sized to carry the volume of the fire protection water, as determined by the design density discharged from the automatic fire-extinguishing system over the minimum required system design area, or area of the room or area in which the storage is located, whichever is smaller.
- (3) Materials of construction for drainage systems shall be compatible with the materials stored.
- (4) Separate drainage systems shall be provided to avoid mixing incompatible materials where such materials are present in an open-use condition.
- (5) Drains shall terminate in an approved location away from buildings, valves, means of egress, fire access roadways, adjoining property, and storm drains.

6.2.1.10 Floors in Storage Rooms. Floors in storage areas for ammonium nitrate, organic peroxides, oxidizers, pyrophoric materials, unstable (reactive) materials, water-reactive solids and liquids, corrosive materials, and toxic and highly toxic materials shall be of liquidtight, noncombustible construction.

6.2.1.11 Supervision of Alarm, Detection, and Automatic Fire-Extinguishing Systems. Alarm, detection, and automatic fire-extinguishing systems required by Chapter 6 or other chapters of this code regulating hazardous materials shall be supervised by an approved central, proprietary, or remote station service or shall initiate audible and visual signals at a constantly attended on-site location.

6.2.2 Protection Level 1.

6.2.2.1 General. Buildings, or portions thereof, required to comply with Protection Level 1 shall comply with 6.2.2 and the building code.

6.2.2.2 Detached Building Required.

6.2.2.2.1* Buildings required to comply with Protection Level 1 shall be used for no other purpose, shall not exceed one story in height, and shall be without basements, crawl spaces, or other under-floor spaces. [5000:34.3.3.2.1]

6.2.2.2.2 Roofs of buildings described in 6.2.2.2.1 shall be of lightweight construction with suitable thermal insulation to prevent sensitive material from reaching its decomposition temperature. [5000:34.3.3.2.2]

6.2.2.2.3 Buildings required to comply with both Protection Level 1 and Protection Level 4 shall comply with the most restrictive requirements for both protection levels. [5000:34.3.3.2.3]

Δ 6.2.2.3 Minimum Distance to Property Lines or Horizontal Separation. Buildings required to comply with Protection Level 1 shall be set back from property lines, or be provided

with a horizontal separation in accordance with *NFPA 5000* by a distance of not less than 75 ft (23 m) and of not less than that required by Table 6.2.2.3. [5000:34.3.3.3]

6.2.2.3.1 Explosives that are in accordance with NFPA 495 shall not be required to comply with 6.2.2.3. [5000:34.3.3.3.1]

6.2.2.3.2 Distances shall be measured from the perimeter wall to property lines, including those on a public way. [5000:34.3.3.3.2]

6.2.2.3.3 Quantities of explosives used in applying Table 6.2.2.3 shall be based on equivalent pounds (kilograms) of TNT. [5000:34.3.3.3.3]

6.2.2.4 Frangible Building. Frangible buildings complying with 7.4.1.4.5.3 of *NFPA 5000* shall not be required to be protected with an automatic sprinkler system. [5000:34.3.3.4]

6.2.3 Protection Level 2.

6.2.3.1 General. Buildings, or portions thereof, required to comply with Protection Level 2 shall comply with 6.2.1 and 6.2.3.2 through 6.2.3.5.2. [5000:34.3.4.1]

6.2.3.2 Exterior Wall Required.

6.2.3.2.1 Buildings, or portions thereof, required to comply with Protection Level 2 shall be located on property such that not less than 25 percent of the perimeter wall is an exterior wall. [5000:34.3.4.2.1]

6.2.3.2.2 Rooms utilized for the use, dispensing, mixing, and storage of flammable and combustible liquids having a floor area of not more than 500 ft² (46.5 m²) shall not be required to be located on the outer perimeter of the building where such rooms comply with NFPA 30. [5000:34.3.4.2.2]

6.2.3.3 Minimum Distance to Property Lines or Horizontal Separation.

6.2.3.3.1 Buildings, or portions thereof, required to comply with Protection Level 2 shall be set back from property lines, or be provided with a horizontal separation in accordance with 7.3.4.2 of *NFPA 5000* at any of the following distances:

- (1) Not less than 30 ft (9.1 m) where the area of the occupancy exceeds 1000 ft² (93 m²) and a detached building is not required
- (2) Not less than 50 ft (15 m) where a detached building is required by Table 5.3.7
- (3) Not less than the distances required by Table 6.2.2.3 for buildings containing materials with explosive characteristics

[5000:34.3.4.3.1]

6.2.3.3.2 Distances shall be measured from the walls enclosing the Protection Level 2 area to property lines, including those on a public way, or in accordance with 7.3.4.2 of *NFPA 5000* for buildings on the same lot. [5000:34.3.4.3.2]

6.2.3.4 Detached Building Required.

6.2.3.4.1* Buildings required to comply with Protection Level 2 and containing quantities of high-hazard contents exceeding the quantity limits set forth in Table 5.3.7 shall be used for manufacturing, processing, dispensing, use, or storage of hazardous materials and no other purpose, shall not exceed one story in height, and shall be without basements, crawl spaces, or other under-floor spaces. [5000:34.3.4.4.1]

6.2.3.4.2 Buildings that contain high-hazard level 2 contents also shall be permitted to contain high-hazard level 3 or high-hazard level 4 contents, provided that incompatible materials are separated as otherwise required by the provisions of this code, NFPA 1, and *NFPA 5000*. [5000:34.3.4.4.2]

6.2.3.4.3 The roofs of buildings specified in 6.2.3.4.1 shall be of lightweight construction.

6.2.3.5 Water-Reactive Materials.

6.2.3.5.1 Rooms or areas containing Class 2 or Class 3 water-reactive materials shall be resistant to water penetration. [5000:34.3.4.5.1]

6.2.3.5.2 Piping for conveying water, other than fire protection piping, shall not route over or through areas containing Class 2 or Class 3 water-reactive materials, unless isolated by approved liquidtight construction. [5000:34.3.4.5.2]

6.2.4 Protection Level 3.

6.2.4.1 General. Buildings, or portions thereof, required to comply with Protection Level 3 shall comply with 6.2.1 and 6.2.4.2 through 6.2.4.7.2. [5000:34.3.5.1]

6.2.4.2 Exterior Wall Required.

6.2.4.2.1 Buildings, or portions thereof, required to comply with Protection Level 3 shall be located on property such that not less than 25 percent of the perimeter wall is an exterior wall. [5000:34.3.5.2.1]

6.2.4.2.2 Rooms utilized for the use, dispensing, mixing, and storage of flammable and combustible liquids having a floor area of not more than 500 ft² (46.5 m²) shall not be required to be located on the outer perimeter of the building where such rooms are in accordance with NFPA 30. [5000:34.3.5.2.2]

6.2.4.3 Minimum Distance to Property Lines or Horizontal Separation.

6.2.4.3.1 Buildings, or portions thereof, required to comply with Protection Level 3 shall be set back from property lines, or be provided with a horizontal separation in accordance with 7.3.4.2 of *NFPA 5000* at any of the following distances:

- (1) Not less than 30 ft (9.1 m) where the area of the occupancy exceeds 1000 ft² (93 m²) and a detached building is not required
- (2) Not less than 50 ft (15 m) where a detached building is required by Table 5.3.7
- (3) Not less than the distances required by Table 34.3.3.3 of *NFPA 5000* for buildings containing materials with explosive characteristics

[5000:34.3.5.3.1]

6.2.4.3.2 Distances shall be measured from the walls enclosing the Protection Level 3 area to property lines, including those on a public way, or in accordance with 7.3.4.2 of *NFPA 5000* for buildings on the same lot. [5000:34.3.5.3.2]

6.2.4.4 Detached Building Required.

6.2.4.4.1* Buildings required to comply with Protection Level 3 and containing quantities of high-hazard contents exceeding the quantity limits set forth in Table 5.3.7 shall be used for manufacturing, processing, dispensing, use, or storage of hazardous materials and no other purpose, shall not exceed one story in height, and shall be without basements, crawl spaces, or other under-floor spaces. [5000:34.3.5.4.1]

Table 6.2.2.3 American Table of Distances

Quantity of Explosive Materials ^{1,2,3,4,5}		Distances in Feet							
		Inhabited Buildings ¹⁰		Public Highways Traffic Volume of 3,000 Vehicles/Day or Less ¹²		Passenger Railways — Public Highways with Traffic Volume of More Than 3,000 Vehicles/Day ^{11,12}		Separation of Magazines ^{6,13}	
Pounds Over	Pounds Not Over	Barricaded ^{7,8,9}	Un-barricaded	Barricaded ^{7,8,9}	Un-barricaded	Barricaded ^{7,8,9}	Un-barricaded	Barricaded ^{7,8,9}	Un-barricaded
0	5	70	140	30	60	51	102	6	12
5	10	90	180	35	70	64	128	8	16
10	20	110	220	45	90	81	162	10	20
20	30	125	250	50	100	93	186	11	22
30	40	140	280	55	110	103	206	12	24
40	50	150	300	60	120	110	220	14	28
50	75	170	340	70	140	127	254	15	30
75	100	190	380	75	150	139	278	16	32
100	125	200	400	80	160	150	300	18	36
125	150	215	430	85	170	159	318	19	38
150	200	235	470	95	190	175	350	21	42
200	250	255	510	105	210	189	378	23	46
250	300	270	540	110	220	201	402	24	48
300	400	295	590	120	240	221	442	27	54
400	500	320	640	130	260	238	476	29	58
500	600	340	680	135	270	253	506	31	62
600	700	355	710	145	290	266	532	32	64
700	800	375	750	150	300	278	556	33	66
800	900	390	780	155	310	289	578	35	70
900	1,000	400	800	160	320	300	600	36	72
1,000	1,200	425	850	165	330	318	636	39	78
1,200	1,400	450	900	170	340	336	672	41	82
1,400	1,600	470	940	175	350	351	702	43	86
1,600	1,800	490	980	180	360	366	732	44	88
1,800	2,000	505	1,010	185	370	378	756	45	90
2,000	2,500	545	1,090	190	380	408	816	49	98
2,500	3,000	580	1,160	195	390	432	864	52	104
3,000	4,000	635	1,270	210	420	474	948	58	116
4,000	5,000	685	1,370	225	450	513	1,026	61	122
5,000	6,000	730	1,460	235	470	546	1,092	65	130
6,000	7,000	770	1,540	245	490	573	1,146	68	136
7,000	8,000	800	1,600	250	500	600	1,200	72	144
8,000	9,000	835	1,670	255	510	624	1,248	75	150
9,000	10,000	865	1,730	260	520	645	1,290	78	156
10,000	12,000	875	1,750	270	540	687	1,374	82	164
12,000	14,000	885	1,770	275	550	723	1,446	87	174
14,000	16,000	900	1,800	280	560	756	1,512	90	180
16,000	18,000	940	1,880	285	570	786	1,572	94	188
18,000	20,000	975	1,950	290	580	813	1,626	98	196
20,000	25,000	1,055	2,000	315	630	876	1,752	105	210
25,000	30,000	1,130	2,000	340	680	933	1,866	112	224
30,000	35,000	1,205	2,000	360	720	981	1,962	119	238
35,000	40,000	1,275	2,000	380	760	1,026	2,000	124	248
40,000	45,000	1,340	2,000	400	800	1,068	2,000	129	258
45,000	50,000	1,400	2,000	420	840	1,104	2,000	135	270
50,000	55,000	1,460	2,000	440	880	1,140	2,000	140	280
55,000	60,000	1,515	2,000	455	910	1,173	2,000	145	290
60,000	65,000	1,565	2,000	470	940	1,206	2,000	150	300
65,000	70,000	1,610	2,000	485	970	1,236	2,000	155	310
70,000	75,000	1,655	2,000	500	1,000	1,263	2,000	160	320
75,000	80,000	1,695	2,000	510	1,020	1,293	2,000	165	330
80,000	85,000	1,730	2,000	520	1,040	1,317	2,000	170	340
85,000	90,000	1,760	2,000	530	1,060	1,344	2,000	175	350
90,000	95,000	1,790	2,000	540	1,080	1,368	2,000	180	360
95,000	100,000	1,815	2,000	545	1,090	1,392	2,000	185	370
100,000	110,000	1,835	2,000	550	1,100	1,437	2,000	195	390
110,000	120,000	1,855	2,000	555	1,110	1,479	2,000	205	410
120,000	130,000	1,875	2,000	560	1,120	1,521	2,000	215	430
130,000	140,000	1,890	2,000	565	1,130	1,557	2,000	225	450
140,000	150,000	1,900	2,000	570	1,140	1,593	2,000	235	470
150,000	160,000	1,935	2,000	580	1,160	1,629	2,000	245	490
160,000	170,000	1,965	2,000	590	1,180	1,662	2,000	255	510
170,000	180,000	1,990	2,000	600	1,200	1,695	2,000	265	530

(continues)

△ Table 6.2.2.3 Continued

Quantity of Explosive Materials ^{1,2,3,4,5}		Distances in Feet							
		Inhabited Buildings ¹⁰		Public Highways Traffic Volume of 3,000 Vehicles/Day or Less ¹²		Passenger Railways — Public Highways with Traffic Volume of More Than 3,000 Vehicles/Day ^{11,12}		Separation of Magazines ^{6,13}	
Pounds Over	Pounds Not Over	Barricaded ^{7,8,9}	Un-barricaded	Barricaded ^{7,8,9}	Un-barricaded	Barricaded ^{7,8,9}	Un-barricaded	Barricaded ^{7,8,9}	Un-barricaded
180,000	190,000	2,010	2,010	605	1,210	1,725	2,000	275	550
190,000	200,000	2,030	2,030	610	1,220	1,755	2,000	285	570
200,000	210,000	2,055	2,055	620	1,240	1,782	2,000	295	590
210,000	230,000	2,100	2,100	635	1,270	1,836	2,000	315	630
230,000	250,000	2,155	2,155	650	1,300	1,890	2,000	335	670
250,000	275,000	2,215	2,215	670	1,340	1,950	2,000	360	720
275,000	300,000	2,275	2,275	690	1,380	2,000	2,000	385	770

Superscript numerals refer to explanatory footnotes.

Explanatory Notes Essential to the Application of the American Table of Distances.

¹“Explosive materials” means explosives, blasting agents, and detonators.

²“Explosives” means any chemical compound, mixture, or device, the primary or common purpose of which is to function by explosion. A list of explosives determined to be within the coverage of 18 USC 40, “Importation, Manufacture, Distribution and Storage of Explosive Materials,” is issued at least annually by the Director of the Bureau of Alcohol, Tobacco, and Firearms of the Department of the Treasury. For quantity and distance purposes, detonating cord of 50 grains per foot should be calculated as equivalent to 8 lb (3.7 kg) of high explosives per 1000 ft (305 m). Heavier or lighter core loads should be rated proportionately.

³“Blasting agents” means any material or mixture consisting of fuel and oxidizer, intended for blasting, and not otherwise defined as an explosive, provided that the finished product, as mixed for use or shipment, cannot be detonated by means of a No. 8 test blasting cap where unconfined.

⁴“Detonator” means any device containing any initiating or primary explosive that is used for initiating detonation. A detonator may not be permitted to contain more than 10 g of total explosives by weight, excluding ignition or delay charges. The term includes, but is not limited to, electric blasting caps of instantaneous and delay types, blasting caps for use with safety fuses, detonating cord delay connectors, and nonelectric instantaneous and delay blasting caps that use detonating cord, shock tube, or any other replacement for electric leg wires. All types of detonators in strengths through No. 8 cap should be rated at 1½ lb (0.7 kg) of explosives per 1000 caps.

⁵For strengths higher than No. 8 cap, the manufacturer should be consulted.

⁶“Magazine” means any building, structure, or container, other than an explosives manufacturing building, approved for the storage of explosive materials.

⁷“Natural barricade” means natural features of the ground, such as hills, or timber of sufficient density that the surrounding exposures that need protection cannot be seen from the magazine when the trees are bare of leaves.

⁸“Artificial barricade” means an artificial mound or revetted wall of earth of a minimum thickness of 3 ft (0.9 m).

⁹“Barricaded” means the effective screening of a building containing explosive materials from the magazine or another building, a railway, or a highway by a natural or an artificial barrier. A straight line from the top of any sidewall of the building containing explosive materials to the eave line of any magazine or other building or to a point 12 ft (3.7 m) above the center of a railway or highway shall pass through such barrier.

¹⁰“Inhabited building” means a building regularly occupied in whole or part as a habitation for human beings, or any church, schoolhouse, railroad station, store, or other structure where people are accustomed to assemble, but does not include any building or structure occupied in connection with the manufacture, transportation, storage, or use of explosive materials.

¹¹“Railway” means any steam, electric, or other railroad or railway that carries passengers for hire.

¹²“Public highway” means any road, street, or way, whether on public or private property, open to public travel.

¹³Where two or more storage magazines are located on the same property, each magazine shall comply with the minimum distances specified from inhabited buildings, railways, and highways, and, in addition, they should be separated from each other by not less than the distances shown for “separation of magazines,” except that the quantity of explosive materials contained in detonator magazines shall govern with regard to the spacing of said detonator magazines from magazines containing other explosive materials. If any two or more magazines are separated from each other by less than the specified “separation of magazines” distances, such magazines, as a group, shall be considered as one magazine, and the total quantity of explosive materials stored in such group shall be treated as if stored in a single magazine located on the site of any magazine of the group, and shall comply with the minimum specified distances from other magazines, inhabited buildings, railways, and highways.

¹⁴Storage in excess of 300,000 lb (136,200 kg) of explosive materials in one magazine generally is not necessary for commercial enterprises.

¹⁵This table applies only to the manufacture and permanent storage of commercial explosive materials. It is not applicable to the transportation of explosives or any handling or temporary storage necessary or incident thereto. It is not intended to apply to bombs, projectiles, or other heavily encased explosives.

¹⁶Where a manufacturing building on an explosive materials plant site is designed to contain explosive materials, the building shall be located at a distance from inhabited buildings, public highways, and passenger railways in accordance with the American Table of Distances based on the maximum quantity of explosive materials permitted to be in the building at one time.

Source: Reprinted from IME SLP 2, “American Table of Distances (ATD),” with permission of the Institute of Makers of Explosives, revised in June 1991.

[495:Table 9.4.1(b)]

6.2.4.4.2 Buildings that contain high-hazard level 3 contents also shall be permitted to contain high-hazard level 2 or high-hazard level 4 contents, provided that incompatible materials are separated as otherwise required by the provisions of this code and NFPA 1. [5000:34.3.5.4.2]

6.2.4.5 Detached Unprotected Building. Where acceptable to the AHJ, based on a determination that a protected building is not practical and an assessment of acceptable risk, storage buildings required to comply with Protection Level 3 shall be permitted without fire protection systems, provided that the following provisions are met:

- (1) The building, or portions thereof, shall have a horizontal separation of at least 200 ft (61 m) from exposed business, industrial, mercantile, and storage occupancies on the same lot and from any property line that is or can be built upon. Where protection for exposures is provided in accordance with 6.2.4.5(6)(c), the horizontal separation shall be at least 100 ft (30.5 m).
- (2) The building, or portions thereof, shall have a horizontal separation of at least 1000 ft (305 m) from exposed occupancies other than business, industrial, mercantile, and storage occupancies on the same lot and from any property line that is or can be built upon. Where protection for exposures is provided in accordance with 6.2.4.5(6)(c), the horizontal separation shall be at least 500 ft (150 m).
- (3) The building shall not exceed one story in height.
- (4) The building shall not have basements, crawl spaces, or other under-floor accessible spaces.
- (5) Egress from the building shall not exceed 50 percent of the distances listed in Table 6.2.1.4.1, measured as required in 11.6.2 of *NFPA 5000*, and in compliance with 34.3.2.4.2 through 34.3.2.4.5 of *NFPA 5000*.
- (6) The building shall comply with the requirements of the following:
 - (a) 34.3.2.2 of *NFPA 5000* for building height
 - (b) 6.2.1.5 for ventilation
 - (c) 6.2.1.6 for explosion control
 - (d) 6.2.1.8 for standby and emergency power
 - (e) 6.2.1.10 for floor construction
 - (f) 34.3.2.10 of *NFPA 5000* for unprotected vertical openings
- (7) Spill control shall comply with 6.2.1.9.
- (8) Secondary containment shall comply with 6.2.1.9.3, except that containment for fire protection water shall not be required if the building is not provided with a fire protection sprinkler system.
- (9) Where credit is taken for protection for exposures in accordance with 34.3.5.5(1) and 34.3.5.5(2) of *NFPA 5000*, protection of exposures shall consist of fire protection for structures on property adjacent to the storage building that is provided by (1) a public fire department or (2) a private fire brigade maintained on the property adjacent to the storage building, either of which shall be capable of providing cooling water streams to protect the property adjacent to the storage building.

[5000:34.3.5.5]

6.2.4.6 Roofs. The roofs of buildings specified in 6.2.4.4.1 shall be of lightweight construction.

6.2.4.7 Water-Reactive Materials.

6.2.4.7.1 Rooms or areas containing Class 2 or Class 3 water-reactive materials shall be resistant to water penetration. [5000:34.3.5.7.1]

6.2.4.7.2 Piping for conveying water, other than fire protection piping, shall not route over or through areas containing Class 2 or Class 3 water-reactive materials, unless isolated by approved liquidtight construction. [5000:34.3.5.7.2]

6.2.5 Protection Level 4.

6.2.5.1 Buildings, or portions thereof, required to comply with Protection Level 4 shall comply with 6.2.1, 6.2.5.2, and 6.2.5.3. [5000:34.3.6]

6.2.5.2 Highly Toxic Solids and Liquids. Highly toxic solids and liquids not stored in approved hazardous materials storage cabinets shall be isolated from other hazardous materials storage by a 1-hour fire barrier. [5000:34.3.6.2]

6.2.5.3 Gas Rooms. Exhaust ventilation for gas rooms shall be designed to operate at a negative pressure in relation to the surrounding areas and shall direct the exhaust ventilation to an exhaust system. [5000:34.3.6.1]

6.2.6 Protection Level 5. Buildings, and portions thereof, required to comply with Protection Level 5 shall comply with *NFPA 5000*, *NFPA 1*, and *NFPA 318*.

6.2.7 Outdoor Storage. Outdoor storage areas shall be in accordance with the requirements of Chapters 11 through 21, as applicable.

▲ 6.2.7.1 Clearance from Combustibles. Clearance from combustibles shall comply with 6.1.15(2).

6.2.7.2 Weather Protection. Where weather protection is provided for sheltering outside hazardous material storage or use areas, such storage or use areas shall be considered outside storage or use areas, provided that all of the following conditions are met: [5000:34.2.6]

- (1) The overhead structure shall be approved noncombustible construction with a maximum area of 1500 ft² (140 m²) except that area increases based on location or fire protection systems under the requirements of the building code shall be allowed.
- (2) Supports and walls shall not obstruct more than one side or more than 25 percent of the perimeter of the storage area. [5000:34.2.6]
- (3) The distance from the structure and the structural supports to buildings, lot lines, or public egress to a public way shall not be less than the distance required by Chapters 11 through 21 for an outside hazardous material storage area without weather protection.
- (4) Weather-protection structures containing storage of explosive or detonable materials shall be considered indoor storage.

6.2.7.3 Secondary Containment.

6.2.7.3.1 General. Where secondary containment is required, it shall be in accordance with 6.2.1.9.3.

6.2.7.3.2 Where Required. Where required by Table 6.2.7.3.2, outdoor storage areas used for hazardous materials solids or liquids shall be provided with secondary containment in accordance with 6.2.1.9.3.

Table 6.2.7.3.2 Required Secondary Containment — Hazardous Materials Solids and Liquids Storage

Material	Class	Outdoor Storage	
		Solids	Liquids
Physical Hazard Materials			
Flammable solids		NR	NA
Organic peroxide liquids	I	NR	NR
	II	NR	NR
	III	NR	NR
	IV	NR	NR
Oxidizer liquids	4	NR	NR
	3	NR	NR
	2	NR	NR
Pyrophoric liquids	NR	R	
Unstable (reactive) liquids	4	R	R
	3	R	R
	2	R	R
	1	NR	NR
Water reactive liquids	3	R	R
	2	R	R
	1	NR	NR
Health Hazard Materials			
Corrosive liquids		NR	R
Highly toxic liquids		R	R
Toxic liquids		R	R

NR: Not required. NA: Not applicable. R: Required.

6.2.7.3.3 Containment Pallets. Where used as a substitute for spill control and secondary containment for outdoor storage in accordance with 6.2.1.9.1, containment pallets shall comply with the following:

- (1) A liquidtight sump accessible for visual inspection shall be provided.
- (2) The sump shall be designed to contain not less than 66 gal (249.8 L).
- (3) Exposed surfaces shall be compatible with the material stored.
- (4) Containment pallets shall be protected to prevent collection of rainwater within the sump.

6.3 Requirements for Use, Dispensing, and Handling of Hazardous Materials in Amounts Exceeding Maximum Allowable Quantities.

6.3.1* General. The following shall apply to aggregate quantities of hazardous materials used, dispensed, or handled:

- (1) Where the aggregate quantity of hazardous materials used, dispensed, or handled exceeds the MAQ, the requirements set forth in Section 6.3 shall apply, except as specified in 6.3.1.1.

- (2) Where the aggregate quantity of hazardous materials used, dispensed, or handled does not exceed the MAQ, Section 6.3 shall not apply.

6.3.1.1 Uses Not Required to Comply. The following use conditions shall not be required to comply with Section 6.3:

- (1) Corrosives used in stationary lead–acid battery systems used for standby power, emergency power, or uninterrupted power supply complying with Chapter 52 of NFPA 1
- (2) Application and release of pesticide products and materials intended for use in weed abatement, erosion control, soil amendment or similar applications, where applied in accordance with the manufacturer’s instructions and label directions

6.3.1.2 Limit Controls.

6.3.1.2.1 General. Limit controls shall be provided in accordance with 6.3.1.2.1 through 6.3.1.2.4.2.

6.3.1.2.2 Temperature Control. Process tanks and equipment, which involve temperature control of the material to prevent a hazardous reaction, shall be provided with limit controls to maintain the temperature within a safe range.

6.3.1.2.3 Pressure Control.

6.3.1.2.3.1 Stationary tanks and equipment containing hazardous materials liquids that can generate pressures exceeding design limits due to exposure fires or internal reaction shall have a form of construction or other approved means that relieves excessive internal pressure.

6.3.1.2.3.2 The means of pressure relief shall vent to an approved location.

6.3.1.2.3.3 Where required by Chapter 21, the means of pressure relief shall vent to an exhaust scrubber or treatment system.

6.3.1.2.4 Liquid Level.

6.3.1.2.4.1 High Level. Open tanks in which hazardous materials are used shall be equipped with a liquid level limit control or other means to prevent overfilling of the tank.

6.3.1.2.4.2 Low Level. Open tanks and containers in which hazardous materials are heated shall be equipped with approved automatic shutoff controls, which will sense low liquid levels and shut off the source of heat.

6.3.1.3 Standby and Emergency Power. Where mechanical ventilation, treatment systems, temperature control, alarm, detection, or other electrically operated safety systems are required by this code, NFPA 1, or *NFPA 5000*, such systems shall be provided with standby power or emergency power as required by 6.3.1.3. [5000:34.3.2.7.1]

6.3.1.3.1 Standby power for mechanical ventilation, exhaust treatment, and temperature control systems shall not be required where such systems are engineered and approved as fail-safe. [5000:34.3.2.7.2]

6.3.1.3.2 The secondary source of power shall be an approved means of legally required standby power in accordance with *NFPA 70*, except for areas containing highly toxic or toxic gases, where a legally required emergency power system in accordance with Chapter 52 of *NFPA 5000* and NFPA 55 shall be provided to operate safety systems required by this code, *NFPA 1*, and *NFPA 5000*. [5000:34.3.2.7.3]

6.3.1.4 Spill Control and Secondary Containment for Hazardous Materials Liquids.

6.3.1.4.1 Spill Control. Where spill control is specifically required in 6.3.2 or 6.3.3, such systems shall be in accordance with 6.3.1.4.1.1 through 6.3.1.4.1.3.

6.3.1.4.1.1 General. Where spill control is required, floors in indoor locations and similar surfaces in outdoor locations shall be constructed to contain a spill from the largest single vessel by one of the following methods:

- (1) Liquidtight sloped or recessed floors in indoor locations or similar areas in outdoor locations
- (2) Liquidtight floors in indoor locations or similar areas in outdoor locations provided with liquidtight raised or recessed sills or dikes
- (3) Sumps and collection systems
[5000:34.3.2.8.2.2]

6.3.1.4.1.2 Except for surfacing, the floors, sills, dikes, sumps, and collection systems shall be constructed of noncombustible material, and the liquidtight seal shall be compatible with the material stored. [5000:34.3.2.8.2.3]

6.3.1.4.1.3 Where liquidtight sills or dikes are provided, they shall not be required at perimeter openings that are provided with an open-grate trench across the opening that connects to an approved collection system. [5000:34.3.2.8.2.4]

6.3.1.4.2 Secondary Containment. Where secondary containment is specifically required in 6.3.2 or 6.3.3, such systems shall be in accordance with 6.3.1.4.2.1 through 6.3.1.4.2.10.

6.3.1.4.2.1 Buildings, or portions thereof, containing only hazardous materials in listed secondary containment tanks or systems shall not be required to comply with 6.3.1.4.2. [5000:34.3.2.8.3.2]

6.3.1.4.2.2 Secondary containment shall be achieved by means of drainage control where required by NFPA 30. [5000:34.3.2.8.3.4]

6.3.1.4.2.3 The building, room, or area shall contain or drain the hazardous materials and fire protection water through the use of one of the following methods:

- (1) Liquidtight sloped or recessed floors in indoor locations or similar areas in outdoor locations
- (2) Liquidtight floors in indoor locations or similar areas in outdoor locations provided with liquidtight raised or recessed sills or dikes
- (3) Sumps and collection systems
- (4) Drainage systems leading to an approved location
[5000:34.3.2.8.3.5]

6.3.1.4.2.4 Where incompatible materials are present in open containers or systems, such materials shall be separated from each other in the secondary containment system. [5000:34.3.2.8.3.6]

6.3.1.4.2.5 Secondary containment for indoor storage areas shall be designed to contain a spill from the largest vessel plus the design flow volume of fire protection water calculated to discharge from the fire-extinguishing system over the minimum required system design area, or area of the room or area in which the storage is located, whichever is smaller, for a period of 20 minutes. [5000:34.3.2.8.3.7]

6.3.1.4.2.6 A monitoring method shall be provided to detect hazardous materials in the secondary containment system. [5000:34.3.2.8.3.8]

6.3.1.4.2.7 The monitoring method shall be permitted to be visual inspection of the primary or secondary containment, or other approved means. [5000:34.3.2.8.3.9]

6.3.1.4.2.8 Where secondary containment is subject to the intrusion of water, a monitoring method for detecting water shall be provided. [5000:34.3.2.8.3.10]

6.3.1.4.2.9 Where monitoring devices are provided, they shall be connected to distinct visual or audible alarms. [5000:34.3.2.8.3.11]

6.3.1.4.2.10 Where remote containment systems are provided, drainage systems shall be in accordance with the *Uniform Mechanical Code*, and the following provisions also shall be met:

- (1) The slope of floors in indoor locations to drains or similar areas in outdoor locations shall be not less than 1 percent.
- (2) Drains from indoor storage areas shall be sized to carry the volume of the fire protection water, as determined by the design density discharged from the automatic fire-extinguishing system over the minimum required system design area, or area of the room or area in which the storage is located, whichever is smaller.
- (3) Materials of construction for drainage systems shall be compatible with the materials stored.
- (4) Separate drainage systems shall be provided to avoid mixing incompatible materials where such materials are present in an open-use condition.
- (5) Drains shall terminate in an approved location away from buildings, valves, means of egress, fire access roadways, adjoining property, and storm drains.

6.3.1.5 Lighting. Lighting by natural or artificial means shall be provided, and artificial lighting, where provided, shall be in accordance with nationally recognized standards.

6.3.1.6 System Design.

6.3.1.6.1 Systems shall be suitable for the use intended and shall be designed by persons competent in such design.

6.3.1.6.2 Where nationally recognized good practices or standards have been established for the processes employed, they shall be followed in the design.

6.3.1.6.3 Controls shall be designed to prevent materials from entering or leaving process or reaction systems at other than the intended time, rate, or path.

6.3.1.6.4 Where automatic controls are provided, they shall be designed to be fail-safe.

6.3.1.7 Liquid Transfer.

6.3.1.7.1 Approved containers shall be used where liquids are dispensed from containers.

6.3.1.7.2 Liquids having a hazard ranking of 3 when exceeding 5.3 gal (20 L), or liquids having a hazard ranking of 4 when exceeding 1.1 gal (4 L), shall be transferred by one of the following methods:

- (1) From safety cans
- (2) Through an approved closed-piping system

- (3) From containers or tanks by an approved pump taking suction through an opening in the top of the container or tank
- (4) For other than highly toxic liquids, from containers or tanks by gravity through an approved self-closing or automatic-closing valve where the container or tank and dispensing operations are provided with spill control and secondary containment complying with 6.3.1.4.1 through 6.3.1.4.2.10
- (5) By the use of approved engineered liquid transfer systems

6.3.1.8 Supervision of Alarm, Detection, and Automatic Fire-Extinguishing Systems. Alarm, detection, and automatic fire-extinguishing systems required by Section 6.3 shall be supervised by an approved central, proprietary, or remote station service or shall initiate an audible and visual signal at a constantly attended on-site location.

6.3.2 Indoor Dispensing and Use.

6.3.2.1 General Indoor Requirements.

6.3.2.1.1 Fire Protection Systems.

6.3.2.1.1.1 General. Indoor dispensing and use areas shall be provided with approved fire protection systems in accordance with 6.2.1.1.

6.3.2.1.1.2 Fire-Extinguishing System for Laboratory Fume Hoods and Spray Booths. In addition to the requirements of 6.2.1.1, laboratory fume hoods and spray booths where flammable materials are dispensed or used shall be protected by an automatic fire-extinguishing system.

6.3.2.1.2 Protection Level 1 through Protection Level 4. Buildings and structures required to comply with Protection Level 1, Protection Level 2, Protection Level 3, or Protection Level 4 controls shall be constructed in accordance with the specific protection level controls of Section 6.2 and the requirements of *NFPA 5000*.

6.3.2.1.2.1 Building Height Exception. The height of a one-story building, or portion thereof, containing only tanks or industrial process equipment shall not be limited based on the type of construction. [5000:34.3.2.2]

6.3.2.1.2.2 Separation of Occupancies Having High Hazards. The separation of areas containing high-hazard contents from each other and from other use areas shall be as required by Table 6.2.1.3 and shall not be permitted to be reduced with the installation of fire protection systems as required by 6.3.2.1.1. [5000:34.3.2.3]

6.3.2.1.2.3 Egress. Egress from areas required to comply with Protection Level 1, Protection Level 2, Protection Level 3, or Protection Level 4 shall comply with 6.2.1.4 and Chapter 14 of *NFPA 1*.

6.3.2.1.3 Ventilation.

6.3.2.1.3.1 General. Indoor dispensing and use areas shall be provided with exhaust ventilation in accordance with 6.2.1.5. [5000:34.3.2.5]

6.3.2.1.3.2 Exceptions to Ventilation Requirement. Exhaust ventilation required by 6.3.2.1.3.1 shall not be required for dispensing and use of flammable solids other than those with finely divided particles.

6.3.2.1.3.3 Standby and Emergency Power. Standby or emergency power shall be provided in accordance with 6.2.1.8.

6.3.2.1.4 Explosion Control.

6.3.2.1.4.1 General. Explosion control shall be provided in accordance with 6.2.1.6 where an explosive environment can occur because of the characteristics or nature of the hazardous materials dispensed or used, or as a result of the dispensing or use process, unless process vessels comply with 6.3.2.1.4.2.

6.3.2.1.4.2 Process Vessels. Additional explosion control shall not be required for materials and processes that are located in process vessels designed to fully contain or vent the worst-case explosion anticipated within the vessel under process conditions considering the most likely failure. When deflagration venting from process vessels is provided, the discharge from venting systems shall be in accordance with *NFPA 68* and arranged so that overpressures produced will not endanger personnel or damage the building, structure, or surrounding buildings or structures in which the process is located.

6.3.2.2 Indoor — Open Systems.

6.3.2.2.1 General. Dispensing and use of hazardous materials in open containers or systems in amounts exceeding the MAQ specified in Section 5.2 shall be in accordance with 6.3.2.2.2 through 6.3.2.2.4.2.

6.3.2.2.2 Ventilation. In addition to the requirements of 6.3.2.1.3, where liquids or solids having a health, instability, or flammability hazard ranking of Class 3 or Class 4 in accordance with *NFPA 704* are dispensed or used, mechanical exhaust ventilation shall be provided to capture fumes, mists, or vapors at the point of generation, unless such liquids or solids can be demonstrated as not creating harmful fumes, mists, or vapors.

6.3.2.2.3 Floor Construction. Except for surfacing, floors of areas where liquid or solid hazardous materials are dispensed or used in open systems shall be of noncombustible, liquidtight construction.

6.3.2.2.4 Spill Control and Secondary Containment for Hazardous Materials Liquids.

6.3.2.2.4.1 Spill Control. Buildings, or portions thereof, used for any of the following shall be provided with spill control in accordance with 6.3.1.4.1 to prevent the flow of liquids to adjoining areas:

- (1) Dispensing of hazardous materials liquids into vessels exceeding a 1.1 gal (4 L) capacity
- (2) Open use of hazardous materials liquids in vessels or systems exceeding a 5.3 gal (20 L) capacity

6.3.2.2.4.2 Secondary Containment.

△ (A) Where required by Table 6.3.2.2.4.2(A), buildings, or portions thereof, used for either of the following shall be provided with secondary containment in accordance with 6.3.1.4.2.1 through 6.3.1.4.2.10:

- (1) Open use of liquids where the capacity of an individual vessel or system exceeds 1.1 gal (4 L)
- (2) Open use of liquids where the capacity of multiple vessels or systems exceeds 5.3 gal (20 L)

△ (B) Buildings, or portions thereof, containing only hazardous materials in listed secondary containment tanks or systems shall not be required to comply with 6.3.2.2.4.2(A).

Table 6.3.2.2.4.2(A) Required Secondary Containment — Hazardous Materials Liquids Use

Material	Class	Indoor Use	Outdoor Use	
Physical Hazard Materials				
Organic peroxide liquids	I	R	R	
	II	R	R	
	III	R	R	
	IV	R	R	
Oxidizer liquids	4	R	R	
	3	R	R	
	2	R	R	
Pyrophoric liquids		R	R	
	Unstable (reactive) liquids	4	R	R
		3	R	R
		2	R	R
	1	NR	R	
Water-reactive liquids	3	R	R	
	2	R	R	
	1	NR	R	
Health Hazard Materials				
Corrosive liquids		R	R	
Highly toxic liquids		R	R	
Toxic liquids		R	R	

R: required. NR: Not required.

6.3.2.3 Indoor — Closed Systems.

6.3.2.3.1 General. Dispensing and use of hazardous materials in closed containers or systems in amounts exceeding the MAQ specified in Chapter 5 shall be in accordance with 6.3.2.3.1 through 6.3.2.3.3.2.

6.3.2.3.2 Ventilation. If closed systems are designed to be opened as part of normal operations, ventilation shall be provided in accordance with 6.3.2.1.3.1.

6.3.2.3.3 Spill Control and Secondary Containment for Hazardous Materials Liquids.

Δ 6.3.2.3.3.1 Spill Control. Buildings, or portions thereof, where hazardous materials liquids are used in individual closed vessels exceeding a 55 gal (208.2 L) capacity shall be provided with spill control in accordance with 6.3.1.4.1 through 6.3.1.4.1.3 to prevent the flow of liquids to adjoining areas.

6.3.2.3.3.2 Secondary Containment. Where required by Table 6.3.2.2.4.2(A), buildings, or portions thereof, used for either of the following shall be provided with secondary containment in accordance with 6.3.1.4.2.1 through 6.3.1.4.2.10:

- (1) Closed-use capacity of an individual vessel or system exceeds 55 gal (208 L)
- (2) Closed-use aggregate capacity of multiple vessels or systems exceeds 1000 gal (3785 L)

6.3.3 Outdoor Dispensing and Use.

6.3.3.1 General.

6.3.3.1.1 Location. Outdoor dispensing and use areas shall be located as required for outdoor storage of hazardous materials in quantities exceeding the MAQ.

Δ 6.3.3.1.2 Clearance from Combustibles. Clearance from combustibles shall be in accordance with 6.1.15(2).

6.3.3.1.3 Weather Protection. Weather protection, when provided, shall comply with 6.2.7.2.

6.3.3.2 Outdoor — Open Systems.

6.3.3.2.1 General. In addition to the requirements set forth in 6.3.3.1 through 6.3.3.1.3, dispensing and use of hazardous materials in open containers or systems in amounts exceeding the MAQ specified in Chapter 5 shall be in accordance with 6.3.3.2.1 through 6.3.3.2.2.2.

6.3.3.2.2 Spill Control and Secondary Containment for Hazardous Materials Liquids.

6.3.3.2.2.1 Spill Control. Outdoor areas used for either of the following shall be provided with spill control in accordance with 6.3.1.4.1 through 6.3.1.4.1.3 to prevent the flow of liquids to adjoining areas:

- (1) Dispensing of hazardous materials liquids into vessels exceeding a 1.1 gal (4 L) capacity
- (2) Open use of hazardous materials liquids in vessels or systems exceeding a 5.3 gal (20 L) capacity

6.3.3.2.2.2 Secondary Containment.

(A) Where Required. Where required by Table 6.3.2.2.4.2(A), outdoor areas used for either of the following shall be provided with secondary containment in accordance with 6.3.1.4.2.1 through 6.3.1.4.2.10:

- (1) Open use of liquids where the capacity of an individual vessel or system exceeds 1.1 gal (4 L)
- (2) Open use of liquids where the capacity of multiple vessels or systems exceeds 5.3 gal (20 L)

Δ (B) Incompatible Materials. Incompatible materials used in open systems shall be separated from each other in the secondary containment system.

6.3.3.3 Outdoor — Closed Systems.

6.3.3.3.1 General. In addition to the requirements set forth in 6.3.3.1 through 6.3.3.1.3, dispensing and use of hazardous materials in closed containers or systems in amounts exceeding the MAQ specified in Chapter 5 shall be in accordance with 6.3.3.3.1 through 6.3.3.3.2.2.

6.3.3.3.2 Spill Control and Secondary Containment for Hazardous Materials Liquids.

6.3.3.3.2.1 Spill Control. Outdoor areas where hazardous materials liquids are used in individual closed vessels exceeding a 55 gal (208 L) capacity shall be provided with spill control in accordance with 6.3.1.4.1 through 6.3.1.4.1.3 to prevent the flow of liquids to adjoining areas.

6.3.3.3.2.2 Secondary Containment. Where required by Table 6.3.2.2.4.2(A), outdoor areas used for either of the following shall be provided with secondary containment in accordance with 6.3.1.4.2.1 through 6.3.1.4.2.10:

- (1) Closed-use capacity of an individual vessel or system exceeds 55 gal (208 L)
- (2) Closed-use aggregate capacity of multiple vessels or systems exceeds 1000 gal (3785 L)

6.3.4 Handling.

6.3.4.1 General. The handling and transportation of hazardous materials in exit access corridors or exit enclosures shall be in accordance with 6.3.4.2 through 6.3.4.4.2.

6.3.4.2 Carts and Trucks Required. Liquids in containers exceeding 5 gal (19 L) in an exit access corridor or exit enclosure shall be transported on a cart or truck.

6.3.4.2.1 Containers of hazardous materials having a hazard ranking of 3 or 4 in accordance with NFPA 704 and transported within corridors or exit enclosures shall be on a cart or truck.

6.3.4.2.2 Where carts and trucks are required for transporting hazardous materials, they shall be in accordance with 6.3.4.3, except for the following:

- (1) Two hazardous material liquid containers that are hand carried in safety carriers
- (2) Not more than four drums not exceeding 55 gal (208 L) each that are transported by drum trucks
- (3) Solid hazardous materials not exceeding 100 lb (45 kg) that are transported by hand trucks
- (4) Single container not exceeding 50 lb (23 kg) that is hand carried

6.3.4.3 Carts and Trucks. Carts and trucks required by 6.3.4.2 to be used to transport hazardous materials shall be in accordance with 6.3.4.3.1 through 6.3.4.3.6.

6.3.4.3.1 Design. Carts and trucks used to transport hazardous materials shall be designed to provide a stable base for the commodities to be transported and shall have a means of restraining containers to prevent accidental dislodgement.

6.3.4.3.2 Speed-Control Devices. Carts and trucks shall be provided with a device that will enable the operator to control movement safely by providing stops or speed-reduction devices.

6.3.4.3.3 Construction. Construction materials for hazardous material carts or trucks shall be compatible with the material transported.

6.3.4.3.4 Spill Control. Carts and trucks transporting liquids shall be capable of containing a spill from the largest single container transported.

6.3.4.3.5 Attendance. Carts and trucks used to transport materials shall not obstruct or be left unattended within any part of a means of egress.

6.3.4.3.6 Incompatible Materials. Incompatible materials shall not be transported on the same cart or truck.

6.3.4.4 Emergency Alarm for Transportation of Hazardous Materials in Corridors or Exit Enclosures.

6.3.4.4.1 When hazardous materials having a hazard ranking of 3 or 4 in accordance with NFPA 704 are transported through corridors or exit enclosures, there shall be an emergency telephone system, a local manual alarm station, or an approved alarm-initiating device at not more than 150 ft (46 m) intervals and at each exit throughout the transport route.

6.3.4.4.2 The signal shall be relayed to an approved central, proprietary, or remote station service or constantly attended on-site location and shall also initiate a local audible alarm.

Chapter 7 Emergency Planning, Fire Risk Control, and Chemical Hazard Requirements for Industrial Processes

7.1* General. This chapter shall apply to emergency planning, fire risk control, and chemical hazard requirements associated with industrial processes consisting of interconnected equipment or vessels when required by 7.1.1.

7.1.1 Applicability. Except as provided in 7.1.2, the requirements of this chapter shall be applicable to facilities with the following materials, where the quantities of materials in use in an industrial process require compliance with Protection Level 1, Protection Level 2, Protection Level 3, or Protection Level 4:

- (1) Unpackaged organic peroxide formulations that are capable of explosive decomposition in their unpackaged state
- (2) Oxidizer Class 3 and Class 4: solids and liquids
- (3) Pyrophoric solids, liquids, and gases
- (4) Unstable reactive Class 3 and Class 4: solids, liquids, and gases
- (5) Highly toxic solids, liquids, and gases
- (6) Water-reactive liquids, Class 3

7.1.2 Analysis of Upset Conditions.

7.1.2.1 Chapter 7 shall not apply when a qualified design professional documents that the unmitigated consequences of a process upset condition will not result in the following:

- (1) Explosion with blast overpressure exceeding 1 psi (6.9 kPa) at 60 ft (20 m) or at the property line, whichever is less
- (2) Fire with radiant energy exceeding 1500 Btu/hr/ft² (4.73 kW/m²) over 15 seconds duration at 60 ft (20 m) (flux value) or at the property line, whichever is less
- (3)* Maximum airborne concentration from a release of material that, with a 1-hour exposure, would cause irreversible or other serious health effects or symptoms that could impair an individual's ability to take protective action at a distance of 60 ft (20 m) from the process or at the property line, whichever is less

7.1.2.2 Mitigation to reduce the potential risk of an unintended upset to levels below those specified in 7.1.2.1(1) through 7.1.2.1(3) shall be subject to approval by the AHJ in accordance with 7.1.3.

7.1.3 Substantiating Documentation. When required by the AHJ, a technical report substantiating a determination by the process engineer or process designer to not apply Chapter 7 shall be submitted to the AHJ for review and approval in accordance with Section 1.14.

7.2 Process Review and Plan Preparation.

7.2.1* General. Industrial processes shall be reviewed and written plans prepared by qualified personnel to ensure that fire and explosion and chemical hazards resulting from loss of containment or potential chemical interaction are prevented.

7.2.2 Fire Risk Controls.

7.2.2.1 The extent of fire risk controls provided shall be determined by means of an evaluation of the process and application of fire protection and process engineering principles.

7.2.2.2 The evaluation specified in 7.2.2.1 shall include, but shall not be limited to, an analysis of the following:

- (1) Fire and chemical hazards of the process relevant to the chemicals and conditions being used
- (2) Emergency relief from process vessels relevant to the properties of the materials used and the fire protection and control measures taken
- (3) Effluent-handling systems for emergency relief venting
- (4) Facility and equipment design, handling, and transfer requirements specified in Chapter 6 and Chapters 11 through 21, as applicable
- (5) Emergency response capabilities of the local emergency services
- (6) Local conditions, such as exposure to and from adjacent properties and exposure to floods, earthquakes, and severe weather conditions

7.2.3 Emergency Action Planning.

7.2.3.1 Written Emergency Action Plan. A written emergency action plan that is consistent with the personnel and equipment employed shall be developed and implemented.

7.2.3.2 Provisions Within the Emergency Action Plan. The emergency action plan shall include the following procedures in the event of a chemical emergency, fire, or explosion:

- (1) Procedures for sounding the alarm
- (2) Procedures for notifying and coordinating with the fire department, governmental agencies, or other emergency responders or contacts, as required
- (3) Procedures for evacuating and accounting for personnel, as applicable
- (4) Procedures for establishing requirements for rescue and medical duties for those requiring or performing these duties
- (5) Procedures and schedules for conducting drills
- (6) Procedures for shutting down and isolating equipment under emergency conditions to include the assignment of personnel responsible for maintaining critical plant functions or for shutdown of process operations
- (7) Appointment and training of personnel to carry out assigned duties, including steps to be taken at the time of initial assignment, as responsibilities or response actions change, and at the time anticipated duties change
- (8) Alternative measures for occupant safety, when applicable
- (9) Aisles designated as necessary for movement of personnel and emergency response
- (10) Maintenance of fire protection equipment
- (11) Safe procedures for startup to be taken following the abatement of an emergency

7.2.3.2.1 When an on-site emergency response team is provided in accordance with 6.1.4.4.3, the emergency action plan shall include the following in addition to the requirements of 7.2.3.2:

- (1) Procedures for controlling fire, explosion, or chemical hazards resulting from loss of containment
- (2) Procedures for mitigating unintended chemical interactions

7.2.3.3 Plan Access. Emergency action plans shall be kept on site and accessible to affected personnel.

7.2.3.4 Plan Review. The emergency action plan shall be reviewed at least annually.

7.2.3.5 Plan Updating. The emergency action plan and related procedures shall be updated and communicated to affected personnel when conditions involving the process(es) or facilities affecting the process(es) are modified or changed in a manner that affects the plan.

7.3 Operating and Maintenance Procedures.

7.3.1 Operating Procedures.

7.3.1.1 General.

7.3.1.1.1 Operating procedures shall be developed for processes regulated by this chapter and implemented in accordance with Section 7.3.

7.3.1.1.2 Operating procedures shall be authorized and approved by personnel designated by the process owner/operator.

7.3.1.2* Contents. Operating procedures shall address the following:

- (1) Each operating phase including, but not limited to, startup, operation, shutdown, and startup after unscheduled shutdown
- (2) Operating limits
- (3) Safety and health controls
- (4) Safety systems

7.3.1.3 Review. The operating procedures shall be reviewed annually by the authorized individual per 7.3.1.1 and updated as necessary to ensure that the information is accurate and represents the manner in which the process is operated.

7.3.2 Maintenance Procedures.

7.3.2.1 General. Maintenance procedures shall be developed and implemented in accordance with Section 7.3.

7.3.2.2* Contents. Maintenance procedures shall address a schedule for inspecting and testing alarms, interlocks, and controls in accordance with one of the following frequencies:

- (1) At least annually
- (2) In accordance with the manufacturer's requirements
- (3) In accordance with approved recognized industry standards
- (4) In accordance with an approved schedule

7.4* Safety Reviews. When there are changes in chemicals, equipment, processes, or procedures, the hazards of the process shall be evaluated in accordance with the requirements of 7.2.2 prior to startup of the modified equipment or process.

7.5 Incident Investigation Plan.

7.5.1* General. An investigation of a chemical incident regulated by Chapter 7 shall be conducted when the following occurs:

- (1) An incident results in a fire, explosion, or unintended release.
- (2) An event does not result in a fire, explosion, or unintended release but has the potential to do so.

7.5.2 Documentation. The results of the investigation shall be documented and made available to the AHJ upon written request.

7.6 Document Retention. Documentation required by this chapter shall be retained for a period of not less than 5 years.

Chapter 8 Reserved

Chapter 9 Security for Hazardous Materials

9.1 General. The storage, dispensing, use, and handling areas shall be secured against unauthorized entry and safeguarded with such protective facilities as public safety requires.

9.1.1 Applicability. The requirements of 9.1.2 shall apply to facilities with the following materials where the quantities of materials in use in an industrial process require compliance with Protection Level 1, Protection Level 2, Protection Level 3, or Protection Level 4:

- (1) Unpackaged organic peroxide formulations that are capable of explosive decomposition in their unpackaged state
- (2) Oxidizer Class 3 and Class 4: solids and liquids
- (3) Pyrophoric solids, liquids, and gases
- (4) Unstable reactive Class 3 and Class 4: solids, liquids, and gases
- (5) Highly toxic solids, liquids, and gases
- (6) Water-reactive liquids, Class 3

9.1.2* Security Plan. Where required by the AHJ, a security plan to restrict unauthorized access to facilities subject to Section 9.1 shall be developed.

Chapter 10 Performance-Based Option

10.1* General.

10.1.1* Application. The requirements of this chapter shall apply to facilities designed to the performance-based option permitted by Chapter 4 of NFPA 1.

10.1.2* Goals and Objectives. The performance-based design shall meet the goals and objectives of this code in accordance with Chapter 4 of NFPA 1.

10.1.3* Approved Qualifications. The performance-based design shall be prepared by a person with qualifications acceptable to the AHJ.

10.1.4* Plan Submittal Documentation. When a performance-based design is submitted to the AHJ for review and approval, the owner shall document, in an approved format, each performance objective and applicable scenario, including any calculation methods or models used in establishing the proposed design's fire and life safety performance.

10.1.5* Independent Review. The AHJ shall be permitted to require an approved, independent third party to review the proposed design and provide an evaluation of the design to the AHJ at the expense of the owner.

10.1.6 Sources of Data. Data sources shall be identified and documented for each input data requirement that is required to be met using a source other than a required design scenario, an assumption, or a facility design specification.

10.1.6.1 The degree of conservatism reflected in such data shall be specified, and a justification for the source shall be provided.

10.1.6.2 Copies of all references relied upon by the performance-based design to support assumptions, design features, or any other part of the design shall be made available to the AHJ if requested.

10.1.7 Final Determination. The AHJ shall make the final determination as to whether the performance objectives have been met.

10.1.8* Operations and Maintenance (O&M) Manual. An approved operations and maintenance manual shall be provided by the owner to the AHJ and the fire department for review, and shall be maintained at the facility in an approved location.

10.1.9* Information Transfer to the Fire Service. Where a performance-based design is approved and used, the designer shall ensure that information regarding the operating procedures of the performance-based designed fire protection system is transferred to the owner and to the local fire service for inclusion in the prefire plan.

10.1.10* Design Feature Maintenance.

10.1.10.1 The design features required for the facility to meet the performance goals and objectives shall be maintained by the owner and be readily accessible to the AHJ for the life of the facility.

10.1.10.2 The facility shall be maintained in accordance with all documented assumptions and design specifications.

10.1.10.2.1 Any proposed changes or variations from the approved design shall be approved by the AHJ prior to the actual change.

10.1.10.2.2 Any approved changes to the original design shall be maintained in the same manner as the original design.

10.1.11* Annual Certification. Where a performance-based design is approved and used, the property owner shall annually certify that the design features and systems have been maintained in accordance with the approved original performance-based design and assumptions and any subsequent approved changes or modifications to the original performance-based design.

10.1.12 Hazardous Materials.

10.1.12.1 Performance-based designs for facilities containing high-hazard contents shall identify the properties of hazardous materials to be stored, used, or handled and shall provide adequate and reliable safeguards to accomplish the following objectives, considering both normal operations and possible abnormal conditions:

- (1) Minimize the potential occurrence of unwanted releases, fire, or other emergency incidents resulting from the storage, use, or handling of hazardous materials
- (2) Minimize the potential failure of buildings, equipment, or processes involving hazardous materials by ensuring that such buildings, equipment, or processes are reliably designed and are suitable for the hazards present
- (3) Minimize the potential exposure of people or property to unsafe conditions or events involving an unintended reaction or release of hazardous materials
- (4) Minimize the potential for an unintentional reaction that results in a fire, explosion, or other dangerous condition
- (5) Provide a means to contain, treat, neutralize, or otherwise handle plausible releases of hazardous materials to minimize the potential for adverse impacts to persons or property outside of the immediate area of a release

- (6) Provide appropriate safeguards to minimize the risk of and limit damage and injury that might result from an explosion involving hazardous materials that present explosion hazards
- (7) Detect hazardous levels of gases or vapors that are dangerous to health and alert appropriate persons or mitigate the hazard when the physiological warning properties for such gases or vapors are inadequate to warn of danger prior to personal injury
- (8) Maintain power to provide for continued operation of safeguards and important systems that are relied upon to prevent or control an emergency condition involving hazardous materials
- (9) Maintain ventilation where ventilation is relied upon to minimize the risk of emergency conditions involving hazardous materials
- (10) Minimize the potential for exposing combustible hazardous materials to unintended sources of ignition and for exposing any hazardous material to fire or physical damage that can lead to endangerment of people or property

10.1.12.2 A process hazard analysis and off-site consequence analysis shall be conducted when required by the AHJ to ensure that people and property are satisfactorily protected from potentially dangerous conditions involving hazardous materials. The results of such analyses shall be considered when determining active and passive mitigation measures used in accomplishing the objectives of NFPA 101 and the applicable fire prevention code.

10.1.12.3 Written procedures for pre-startup safety reviews, normal and emergency operations, management of change, emergency response, and accident investigation shall be developed prior to beginning operations at a facility. Such procedures shall be developed with the participation of employees.

10.1.13 Special Definitions. A list of special terms used in this chapter shall be as follows:

- (1) Design Fire Scenario (*See 3.4.8.1.*)
- (2) Design Specifications (*See 3.4.4.*)
- (3) Design Team (*See 3.4.5.*)
- (4) Exposure Fire (*See 3.4.6.*)
- (5) Fire Model (*See 3.4.7.*)
- (6) Fire Scenario (*See 3.4.8.*)
- (7) Fuel Load (*See 3.4.9.*)
- (8) Input Data Specification (*See 3.4.10.*)
- (9) Occupant Characteristics (*See 3.4.11.*)
- (10) Performance Criteria (*See 3.4.12.*)
- (11) Proposed Design (*See 3.4.13.*)
- (12) Safety Factor (*See 3.4.15.*)
- (13) Safety Margin (*See 3.4.16.*)
- (14) Sensitivity Analysis (*See 3.4.1.1.*)
- (15) Stakeholder (*See 3.4.19.*)
- (16) Uncertainty Analysis (*See 3.4.1.2.*)
- (17) Verification Method (*See 3.4.21.*)

[1:5.1.13]

10.2 Performance Criteria.

10.2.1 General. A design shall meet the objectives specified in Section 10.1 if, for each required design scenario, assumption, and design specification, the performance criteria of 10.2.2 are met.

10.2.2* Specific Performance Criteria.

10.2.2.1* Fire Conditions. No occupant who is not intimate with ignition shall be exposed to instantaneous or cumulative untenable conditions.

10.2.2.2* Explosion Conditions. The facility design shall provide an acceptable level of safety for occupants and for individuals immediately adjacent to the property from the effects of unintentional detonation or deflagration.

10.2.2.3* Hazardous Materials Exposure. The facility design shall provide an acceptable level of safety for occupants and for individuals immediately adjacent to the property from the effects of an unauthorized release of hazardous materials or the unintentional reaction of hazardous materials.

10.2.2.4* Property Protection. The facility design shall limit the effects of all required design scenarios from causing an unacceptable level of property damage.

10.2.2.5* Public Welfare. For facilities that serve a public welfare role, the facility design shall limit the effects of all required design scenarios from causing an unacceptable interruption of the facility's mission.

10.2.2.6 Occupant Protection from Untenable Conditions. Means shall be provided to evacuate, relocate, or defend in place occupants not intimate with ignition for sufficient time so that they are not exposed to instantaneous or cumulative untenable conditions from smoke, heat, or flames.

10.2.2.7 Emergency Responder Protection. Buildings shall be designed and constructed to reasonably prevent structural failure under fire conditions for sufficient time to enable fire fighters and emergency responders to conduct search and rescue operations.

10.2.2.8 Occupant Protection from Structural Failure. Buildings shall be designed and constructed to reasonably prevent structural failure under fire conditions for sufficient time to protect the occupants.

10.3 Retained Prescriptive Requirements.

10.3.1 Systems and Features. All fire protection systems and features of the building shall comply with applicable NFPA standards or the fire prevention code for those systems and features.

10.3.2* Electrical Systems. Electrical systems shall comply with applicable NFPA standards for those systems.

10.3.3 General. The design shall comply with the following requirements in addition to the performance criteria of Section 10.2 and the methods of Sections 10.4 through 10.7 or the fire prevention code:

- (1) Fundamental requirements
- (2) Fire drills
- (3) Smoking
- (4) Open outdoor fires, incinerators, and outdoor fireplaces
- (5) Fire department access
- (6) Access to structures
- (7) Fire protection markings
- (8) Vacant buildings and premises
- (9) Combustible vegetation
- (10) Safeguards during building construction, alteration, and demolition operations

10.3.4* Means of Egress. The design shall comply with the following NFPA 101 requirements in addition to the performance criteria of Section 10.2 and the methods of Sections 10.4 through 10.7:

- (1) Changes in level in means of egress: 7.1.7 of NFPA 101
- (2) Guards: 7.1.8 of NFPA 101
- (3) Doors: 7.2.1 of NFPA 101
- (4) Stairs: 7.2.2 of NFPA 101

Exception: The provisions of 7.2.2.5.1, 7.2.2.5.2, 7.2.2.6.2, 7.2.2.6.3, and 7.2.2.6.4 of NFPA 101 shall be exempted.

- (5) Ramps: 7.2.5 of NFPA 101

Exception: The provisions of 7.2.5.3.1, 7.2.5.5, and 7.2.5.6.1 of NFPA 101 shall be exempted.

- (6) Fire escape ladders: 7.2.9 of NFPA 101
- (7) Alternating tread devices: 7.2.11 of NFPA 101
- (8) Capacity of means of egress: Section 7.3 of NFPA 101

Exception: The provisions of 7.3.3 and 7.3.4 of NFPA 101 shall be exempted.

- (9) Impediments to egress: 7.5.2 of NFPA 101
- (10) Illumination of means of egress: Section 7.8 of NFPA 101
- (11) Emergency lighting: Section 7.9 of NFPA 101
- (12) Marking of means of egress: Section 7.10 of NFPA 101

10.3.5 Equivalency. Equivalent designs for the features covered in the retained prescriptive requirements mandated by 10.3.1 through 10.3.4 shall be addressed in accordance with the equivalency provisions of Section 1.5.

10.4* Design Scenarios.

10.4.1 General.

10.4.1.1 The proposed design shall be considered to meet the goals and objectives if it achieves the performance criteria for each required design scenario. The AHJ shall approve the parameters involved with required design scenarios.

10.4.1.2* Design scenarios shall be evaluated for each required scenario using a method acceptable to the AHJ and appropriate for the conditions. Each scenario shall be as challenging and realistic as any that could realistically occur in the building.

10.4.1.3* Scenarios selected as design scenarios shall include, but not be limited to, those specified in 10.4.2 through 10.4.5.

10.4.1.3.1 Design fire scenarios demonstrated by the design team to the satisfaction of the AHJ as inappropriate for the building use and conditions shall not be required to be evaluated fully.

10.4.1.3.2 Fire Design Scenario 8 (*see 10.4.2.8*) shall not be required to be applied to fire protection systems or features for which both the level of reliability and the design performance in the absence of the system or feature are acceptable to the AHJ.

10.4.1.4 Each design scenario used in the performance-based design proposal shall be translated into input data specifications, as appropriate for the calculation method or model.

10.4.1.5 Any design scenario specifications that the design analyses do not explicitly address or incorporate and that are, therefore, omitted from input data specifications shall be identified, and a sensitivity analysis of the consequences of that omission shall be performed.

10.4.1.6 Any design scenario specifications modified in input data specifications, because of limitations in test methods or other data generation procedures, shall be identified, and a sensitivity analysis of the consequences of the modification shall be performed.

10.4.2 Required Design Scenarios — Fire.

10.4.2.1* Fire Design Scenario 1. Fire Design Scenario 1 involves an occupancy-specific design scenario representative of a typical fire for the occupancy.

10.4.2.1.1 This design scenario shall explicitly account for the following:

- (1) Occupant activities
- (2) Number and location
- (3) Room size
- (4) Furnishings and contents
- (5) Fuel properties and ignition sources
- (6) Ventilation conditions

10.4.2.1.2 The first item ignited and its location shall be explicitly defined.

10.4.2.2* Fire Design Scenario 2. Fire Design Scenario 2 involves an ultrafast-developing fire in the primary means of egress with interior doors open at the start of the fire. This design scenario shall address the concern regarding a reduction in the number of available means of egress.

10.4.2.3* Fire Design Scenario 3. Fire Design Scenario 3 involves a fire that starts in a normally unoccupied room that can potentially endanger a large number of occupants in a large room or other area. This design scenario shall address the concern regarding a fire starting in a normally unoccupied room and migrating into the space that can, potentially, hold the greatest number of occupants in the building.

10.4.2.4* Fire Design Scenario 4. Fire Design Scenario 4 involves a fire that originates in a concealed wall- or ceiling-space adjacent to a large occupied room. This design scenario shall address the concern regarding a fire originating in a concealed space that does not have either a detection system or suppression system and then spreading into the room within the building that can, potentially, hold the greatest number of occupants.

10.4.2.5* Fire Design Scenario 5. Fire Design Scenario 5 involves a slowly developing fire, shielded from fire protection systems, in close proximity to a high occupancy area. This design scenario shall address the concern regarding a relatively small ignition source causing a significant fire.

10.4.2.6* Fire Design Scenario 6. Fire Design Scenario 6 involves the most severe fire resulting from the largest possible fuel load characteristic of the normal operation of the building. This design scenario shall address the concern regarding a rapidly developing fire with occupants present.

10.4.2.7* Fire Design Scenario 7. Fire Design Scenario 7 involves an outside exposure fire. This design scenario shall address the concern regarding a fire starting at a location remote from the area of concern and either spreading into the area, blocking escape from the area, or developing untenable conditions within the area.

10.4.2.8* Fire Design Scenario 8. Fire Design Scenario 8 involves a fire originating in ordinary combustibles in a room or area with each passive or active fire protection system or

feature independently rendered ineffective. This set of design scenarios shall address concerns regarding each fire protection system or fire protection feature, considered individually, being unreliable or becoming unavailable. This scenario shall not be required to be applied to fire protection systems or features for which both the level of reliability and the design performance in the absence of the system are acceptable to the AHJ.

10.4.3 Required Design Scenarios — Explosion.

10.4.3.1* Explosion Design Scenario 1.

10.4.3.1.1 Explosion Design Scenario 1 is the detonation or deflagration of explosive materials being manufactured, stored, handled, or used in a facility.

10.4.3.1.2 Explosion Design Scenario 1 shall address the concern regarding safety of individuals not intimate with the explosion and property protection of adjacent properties and buildings.

10.4.4* Required Design Scenarios — Hazardous Materials.

10.4.4.1 Hazardous Materials Design Scenario 1. Hazardous Materials Design Scenario 1 involves an unauthorized release of hazardous materials from a single control area. This design scenario shall address the concern regarding the spread of hazardous conditions from the point of release.

10.4.4.2 Hazardous Materials Design Scenario 2. Hazardous Materials Design Scenario 2 involves an exposure fire on a location where hazardous materials are stored, used, handled, or dispensed. This design scenario shall address the concern regarding how a fire in a facility affects the safe storage, handling, or use of hazardous materials.

10.4.4.3 Hazardous Materials Design Scenario 3. Hazardous Materials Design Scenario 3 involves the application of an external factor to the hazardous material that is likely to result in a fire, explosion, toxic release, or other unsafe condition. This design scenario shall address the concern regarding the initiation of a hazardous materials event by the application of heat, shock, impact, or water onto a hazardous material being stored, used, handled, or dispensed in the facility.

10.4.4.4 Hazardous Materials Design Scenario 4.

10.4.4.4.1 Hazardous Materials Design Scenario 4 involves an unauthorized discharge with each protection system independently rendered ineffective. This set of design hazardous materials scenarios shall address concern regarding each protection system or protection feature, considered individually, being unreliable or becoming unavailable.

10.4.4.4.2* Hazardous Materials Design Scenario 4 shall not be required to be applied to protection systems or features for which both the level of reliability and the design performance in the absence of the system are acceptable to the AHJ.

10.4.5 Required Design Scenarios — Safety During Building Use.

10.4.5.1* Building Use Design Scenario 1. Building Use Design Scenario 1 involves an event in which the maximum occupant load is in the assembly building and an emergency event occurs, blocking the principal exit/entrance to the building. This design scenario shall address the concern of occupants having to take alternative exit routes under crowded conditions.

10.4.5.2 Building Use Design Scenario 2. Building Use Design Scenario 2 involves a fire in an area of a building undergoing construction or demolition while the remainder of the building is occupied. The normal fire suppression system in the area undergoing construction or demolition has been taken out of service. This design scenario shall address the concern regarding the inoperability of certain building fire safety features during construction and demolition in a partially occupied building.

10.5 Evaluation of Proposed Designs.

10.5.1 General.

10.5.1.1 A proposed design's performance shall be assessed relative to each performance objective in the fire prevention code and each applicable scenario in Section 10.4, with the assessment conducted through the use of appropriate calculation methods.

10.5.1.2 The choice of assessment methods shall require the approval of the AHJ.

10.5.2 Use. The design professional shall use the assessment methods to demonstrate that the proposed design will achieve the goals and objectives, as measured by the performance criteria in light of the safety margins and uncertainty analysis, for each scenario, given the assumptions.

10.5.3 Input Data.

10.5.3.1 Data.

10.5.3.1.1 Input data for computer fire models shall be obtained in accordance with ASTM E1591, *Standard Guide for Obtaining Data for Deterministic Fire Models*.

10.5.3.1.2 Data for use in analytical models that are not computer-based fire models shall be obtained using appropriate measurement, recording, and storage techniques to ensure the applicability of the data to the analytical method being used.

10.5.3.2 Data Requirements. A complete listing of input data requirements for all models, engineering methods, and other calculation or verification methods required or proposed as part of the performance-based design shall be provided.

10.5.3.3 Uncertainty and Conservatism of Data. Uncertainty in input data shall be analyzed and, as determined appropriate by the AHJ, addressed through the use of conservative values.

10.5.4 Output Data. The assessment methods used shall accurately and appropriately produce the required output data from input data based on the design specifications, assumptions, and scenarios.

10.5.5 Validity. Evidence shall be provided confirming that the assessment methods are valid and appropriate for the proposed facility, use, and conditions.

10.6* Safety Factors. Approved safety factors shall be included in the design methods and calculations to reflect uncertainty in the assumptions, data, and other factors associated with the performance-based design.

10.7 Documentation Requirements.

10.7.1* General.

10.7.1.1 All aspects of the design, including those described in 10.7.2 through 10.7.14, shall be documented.

10.7.1.2 The format and content of the documentation shall be acceptable to the AHJ.

10.7.2* Technical References and Resources.

10.7.2.1 The AHJ shall be provided with sufficient documentation to support the validity, accuracy, relevance, and precision of the proposed methods.

10.7.2.2 The engineering standards, calculation methods, and other forms of scientific information provided shall be appropriate for the particular application and methodologies used.

10.7.3 Facility Design Specifications. All details of the proposed facility design that affect the ability of the facility to meet the stated goals and objectives shall be documented.

10.7.4 Performance Criteria. Performance criteria, with sources, shall be documented.

10.7.5 Occupant Characteristics. Assumptions about occupant characteristics shall be documented.

10.7.6 Design Scenarios. Descriptions of design hazards scenarios shall be documented.

10.7.7 Input Data. Input data to models and assessment methods, including sensitivity analysis, shall be documented.

10.7.8 Output Data. Output data from models and assessment methods, including sensitivity analysis, shall be documented.

10.7.9 Safety Factors. Safety factors utilized shall be documented.

10.7.10 Prescriptive Requirements. Retained prescriptive requirements shall be documented.

10.7.11* Modeling Features.

10.7.11.1 Assumptions made by the model user, and descriptions of models and methods used, including known limitations, shall be documented.

10.7.11.2 Documentation shall be provided that the assessment methods have been used validly and appropriately to address the design specifications, assumptions, and scenarios.

10.7.12 Evidence of Modeler Capability. The design team's relevant experience with the models, test methods, databases, and other assessment methods used in the performance-based design proposal shall be documented.

10.7.13 Performance Evaluation. The performance evaluation summary shall be documented.

10.7.14 Use of Performance-Based Design Option. Design proposals shall include documentation that provides anyone involved in ownership or management of the facility with all of the following notification:

- (1) The facility was approved as a performance-based design with certain specified design criteria and assumptions.
- (2) Any remodeling, modification, renovation, change in use, or change in the established assumptions will require a re-evaluation and re-approval.

Chapter 11 Ammonium Nitrate Solids and Liquids

11.1 General. See also Annex E.

11.1.1* Scope. The requirements of this chapter shall apply to the storage, use, and handling of solid or liquid ammonium nitrate in quantities greater than 1,000 lb.

11.1.1.1 The storage, use, and handling of ammonium nitrate shall comply with the requirements of Chapters 1 and 4.

11.1.1.1.1 Chapters 6 through 10 shall apply unless otherwise indicated in this chapter.

11.1.1.2 This chapter shall apply to solid ammonium nitrate in the form of crystals, flakes, grains or prills, including fertilizer grade and industrial grade or other mixtures containing 60 percent or more by weight of ammonium nitrate.

11.1.1.3 This chapter shall apply to liquid ammonium nitrate solutions containing 70 percent or more by weight of ammonium nitrate.

11.1.1.4 This chapter shall not apply to liquid ammonium nitrate solutions used as fertilizers unless classified as a hazardous material by the U.S. Department of Transportation (DOT).

11.1.1.5* This chapter shall not apply to ammonium nitrate and ammonium nitrate mixtures that are DOT Hazard Class 1 explosives.

11.1.1.6* The agricultural application of ammonium nitrate and ammonium nitrate-based fertilizers in outdoor agricultural uses is not regulated by this code.

11.1.1.7 Where Chapter 11 is applicable, Chapter 15 and Chapter 19 shall not apply.

11.1.2 Sources of Ignition. Open flames and smoking shall be prohibited in buildings that store, use, and handle ammonium nitrate.

11.1.3 General Requirements for Storage. The quantity and arrangement limits in this chapter shall not apply to the transient storage of ammonium nitrate in process areas at plants where ammonium nitrate is manufactured.

11.1.4 Construction Requirements. Buildings, or portions thereof, in which ammonium nitrate is stored, used, or handled shall be constructed in accordance with the building code.

11.1.4.1 Buildings used for the storage and handling of ammonium nitrate in bulk, bags, or other combustible containers shall be of noncombustible (Type I or II) construction.

11.1.4.2 Bins or compartments used for the storage of bulk ammonium nitrate shall be constructed of noncombustible materials that are compatible with ammonium nitrate. (*See 11.3.2.3.2.*)

11.1.4.3 Storage buildings shall not have basements unless the basements are open on at least one side.

11.1.4.3.1 Buildings over one story in height shall not be used for storage, unless approved for such use.

11.1.4.4 The exterior wall on the exposed side of a storage building within 50 ft (15.2 m) of a combustible building, a forest, combustible materials, and/or exposure hazards by ordinary combustible materials shall be a fire barrier wall with a

minimum fire resistance rating of 2 hours in accordance with the building code.

11.1.4.5 In lieu of the fire barrier wall specified in 11.1.4.4, a means of exposure protection, such as a freestanding fire barrier wall, shall be permitted to be used where approved by the AHJ.

11.1.4.6 Buildings and structures shall be dry and free from water intrusion through the roof, walls, and floors.

11.1.4.7 Any heating source, including electric lamps, shall be located or guarded so as to preclude contact with bags or other combustible materials.

11.1.4.8 Bulk storage structures shall not exceed a height of 40 ft (12.2 m).

11.1.4.8.1 Where bulk storage structures are constructed of noncombustible material or facilities for fighting a roof fire are provided, the height of the storage building shall only be limited by the building construction type as specified in the building code adopted by the jurisdiction.

11.1.4.9 Floors shall be in accordance with 6.2.1.10.

11.1.4.9.1* All flooring in storage and handling areas shall be without open drains, traps, tunnels, pits, or pockets.

11.1.4.9.2* The noncombustible floor of the ammonium nitrate storage area shall be sloped in a manner that promotes a positive drainage of liquids, whether water or molten material in the case of a fire, away from the storage area to an open, unconfined area free from incompatible materials. (See 11.2.16.1 for a list of incompatibles.)

11.1.4.9.3 The floor shall be at least a 1 percent slope [$\frac{1}{8}$ in. (3.2 mm) for every linear foot of floor] to obtain this positive drainage.

11.1.4.9.4 Floors where ammonium nitrate solids or liquids are dispensed or used in open systems shall be in accordance with 6.3.2.2.3.

Δ 11.1.5* Retroactivity. Subsections 11.2.5, 11.2.6, 11.2.7, and 11.2.8 shall apply retroactively.

11.2 General Requirements for Storage.

11.2.1* Spill Control. Spill control for ammonium nitrate solids shall be in accordance with 11.2.1.1 and 11.2.1.2 and not 6.2.1.9.2.

11.2.1.1 If the contents of broken bags are uncontaminated, they shall be permitted to be salvaged by placing the damaged bag inside a clean, new slipover bag and closing it to prevent the discharge of contents.

11.2.1.2 Contaminated spilled materials and containers that cannot be used as originally intended shall be managed in accordance with applicable state and/or federal environmental requirements.

11.2.2 Drainage and Secondary Containment.

11.2.2.1 Drainage and secondary containment that promotes a positive drainage of liquids, whether water or molten material, away from the storage area to an open, unconfined area free from incompatible materials shall be provided for ammonium nitrate in accordance with 6.2.1.9.3.4(4). (See 11.2.16.1 for a list of incompatibles.)

11.2.3* Ventilation. Ventilation in accordance with 6.2.1.5 shall not be required.

11.2.4 Treatment Systems. Treatment systems are not required for ammonium nitrate.

11.2.5* Fire Protection Systems. An automatic fire sprinkler system shall be provided in all buildings of Type III construction, Type IV construction, Type V construction, or any construction type with combustible content, including, but not limited to, all of the materials listed in 11.2.16.1.1 in accordance with NFPA 13 for a minimum extra hazard (Group 1).

N 11.2.5.1* The requirements of 11.2.5, 11.2.6, 11.2.7, and 11.2.8 shall apply retroactively to existing buildings of Type III construction, Type IV construction, Type V construction, or any construction type with combustible content.

N 11.2.5.2 Bulk ammonium nitrate shall be classified as a noncombustible material.

Δ 11.2.5.3* Only water-based suppression systems shall be permitted. Alternative automatic fire extinguishing systems using foam, dry-chemical or gaseous agents, or steam shall not be allowed.

Δ 11.2.6 Fire Detection Systems. Buildings shall be equipped throughout with an approved fire detection system, including, but not limited to, a smoke or heat detection system.

N 11.2.6.1 Supervision. The fire detection system shall be supervised in accordance with 6.2.1.11.

11.2.6.2 Audible and Visual Alarm. Any activation of the fire detection system shall also automatically initiate activation of a local audible and visual alarm system to notify occupants.

N 11.2.7 Public Notification/Siren System. An approved public notification/siren system capable of notifying individuals located within 1 mi (1609 m) of the facility of the need to evacuate shall be provided by the facility's owner in all new and existing buildings of Type III construction, Type IV construction, Type V construction, or any construction type with combustible content.

N 11.2.7.1 The siren shall be located in a location on- or off-site that is not susceptible to damage by the potential event and is approved by the AHJ.

N 11.2.7.2* The public notification siren system shall be capable of being remotely activated by the local emergency communication center at the direction of an authorized first responder upon arriving at the scene and evaluating the situation.

N 11.2.8 Monitoring/Supervision. Supervision shall be provided for the alarm, detection, and automatic fire extinguishing system in all new and existing buildings of Type III construction, Type IV construction, Type V construction, or any building construction type with combustible content in accordance with 6.2.1.11.

11.2.9 Extinguishing Devices.

11.2.9.1 Portable extinguishers shall be provided throughout the storage, use, and handling areas in accordance with the fire prevention code adopted by the jurisdiction and NFPA 10.

11.2.9.1.1 Only water-based portable fire extinguishers shall be used on incipient fires involving ammonium nitrate.

11.2.9.1.2 All other types of extinguishers except dry-chemical extinguishers per 11.2.9.1.3 shall be prohibited from the ammonium nitrate building.

11.2.9.1.3 Where required by NFPA 10 for protection of combustibles, dry-chemical extinguishers shall be permitted for use on incipient fires that do not involve ammonium nitrate.

N 11.2.9.2 Portable fire extinguishers shall be inspected and maintained in accordance with NFPA 10.

11.2.10 Fire Protection Water Supplies.

11.2.10.1 Water supplies shall be provided for the protection of the ammonium nitrate storage by hose streams and automatic sprinklers in accordance with the fire code adopted by the AHJ.

11.2.10.2 The duration of the water supply shall be a minimum of 2 hours.

11.2.11* Explosion Control. The requirements of 6.2.1.6 shall not apply.

11.2.12 Emergency and Standby Power. Standby power shall be provided where required by 6.2.1.8.

11.2.13 Limit Controls. Limit controls, where required, shall be in accordance with 6.2.1.7.

11.2.14 Alarms.

11.2.14.1 A fire alarm system shall be provided to monitor the fire sprinkler system and provide notification in accordance with 6.2.1.1.3 and *NFPA 72*.

11.2.15 Monitoring/Supervision. Supervision shall be provided for the alarm, detection, and automatic fire extinguishing system in accordance with 6.2.1.11.

11.2.16 Special Requirements.

11.2.16.1 Separation.

11.2.16.1.1* Ammonium nitrate shall be isolated in a separate room by fire barrier walls constructed of concrete block having a minimum fire resistance rating of one hour and extending from the floor to the underside of the roof above or located in a separate building from the storage of any of the following:

- (1) Organic chemicals, acids, or other corrosive materials
- (2) Compressed flammable gases
- (3) Pyrophoric materials
- (4) Combustible materials
- (5) Flammable and combustible liquids
- (6) Other contaminating substances, including the following:
 - (a) Wood chips
 - (b) Organic materials
 - (c) Chlorides
 - (d) Phosphorus
 - (e) Finely divided metals
 - (f) Charcoals
 - (g) Diesel fuels and oils
 - (h) Animal fats
 - (i) Baled cotton
 - (j) Baled rags
 - (k) Baled scrap paper
 - (l) Bleaching powder
 - (m) Burlap or cotton bags
 - (n) Caustic soda

- (o) Coal
- (p) Coke
- (q) Charcoal
- (r) Cork
- (s) Camphor
- (t) Excelsior
- (u) Fibers of any kind
- (v) Fish oils
- (w) Fish meal
- (x) Foam rubber
- (y) Hay
- (z) Lubricating oil
- (aa) Linseed oil or other oxidizable or drying oils
- (ab) Naphthalene
- (ac) Oakum
- (ad) Oiled clothing
- (ae) Oiled paper
- (af) Oiled textiles
- (ag) Paint
- (ah) Straw
- (ai) Sawdust
- (aj) Wood shavings
- (ak) Vegetable oil

11.2.16.2 Prohibited Articles.

11.2.16.2.1 Sulfur, materials that require blasting during processing or handling, and finely divided metals shall not be stored in the same building with ammonium nitrate unless such storage conforms to NFPA 495.

11.2.16.2.2 Explosives and blasting agents shall not be stored in the same building with ammonium nitrate unless otherwise permitted by NFPA 495.

11.2.16.2.3 Explosives and blasting agents shall be permitted to be stored in the same building with ammonium nitrate on the premises of makers, distributors, and users/compounders of explosives or blasting agents.

11.2.16.2.4 Where explosives or blasting agents are stored in separate buildings, other than on the premises of makers, distributors, and users/compounders of explosives or blasting agents, they shall be separated from the ammonium nitrate by the distances or barricades specified in NFPA 495.

11.2.16.2.5 Storage or operations on the premises of makers, distributors, and users/compounders of explosives or blasting agents shall conform to NFPA 495.

11.2.16.3 Lightning. In areas where lightning storms are prevalent, lightning protection shall be provided in accordance with NFPA 780.

11.2.16.4 Security (Control of Access). Provisions shall be made to prevent unauthorized personnel from entering the ammonium nitrate storage area.

11.2.17* Emergency Planning.

11.2.17.1 Emergency Action Plans. Emergency action plans for facilities that store, use, or handle ammonium nitrate shall comply with the requirements of Chapter 7, and 11.2.17.1.1 through 11.2.17.1.4.

11.2.17.1.1 The emergency action plan shall clearly state that fires potentially affecting ammonium nitrate storage beyond the initial (incipient) stage shall not be approached by facility personnel.

11.2.17.1.2 The emergency action plan shall state whether the ammonium nitrate storage building has an automatic sprinkler system and if the building storing ammonium nitrate is of combustible construction.

11.2.17.1.3* The emergency action plan shall establish a safe evacuation distance based on an approved analysis of the permitted quantity and configuration of ammonium nitrate. Where no such analysis exists, a distance of at least 1 mile (1609 m) shall be used.

11.2.17.1.4 The emergency action plan shall be approved by the AHJ and updated and re-approved at least annually or if conditions change.

11.2.18* Signage. In addition to the NFPA 704 placards required in 6.1.8.2.1, signs shall be conspicuously posted on the ammonium nitrate storage building stating: DO NOT FIGHT FIRE. EXPLOSION HAZARD. The signs shall be visible from 100 ft (30 m) and shall have 6 in. (15 cm) red block lettering on a white reflective background.

11.3 Indoor Storage.

11.3.1 Housekeeping. Storage shall be arranged to facilitate manual access and handling, to maintain pile stability, to minimize breakage and spillage, and to promote good housekeeping.

11.3.1.1 All personnel that handle ammonium nitrate shall be trained on the general safety, regulatory controls, and industry standards on how to safely store, use, and handle ammonium nitrate.

11.3.1.2* Good housekeeping shall be maintained at all times where ammonium nitrate is stored, used, or handled and the following housekeeping rules shall be followed:

- (1) Floors and storage areas shall be free of any clutter and debris.
- (2) All spills shall be contained and properly disposed of immediately.
- (3) Any damaged container and/or waste shall be immediately and properly removed from the area to a safe location.
- (4) Policy, procedures, and practice shall be in place to ensure separation of incompatible materials is maintained at all times.
- (5) Storage of combustibles shall be prohibited in or around ammonium nitrate storage areas.

11.3.2 Storage Conditions/Arrangement. Storage arrangement shall be in accordance with 11.3.2.1 through 11.3.2.3.

11.3.2.1 Containers. Bags and containers used for ammonium nitrate shall comply with the specifications and standards established by the DOT.

11.3.2.2 Piles of Bags, Drums, or Other Containers.

11.3.2.2.1 Solid ammonium nitrate shall not be placed into containers where the temperature of the ammonium nitrate exceeds 140°F (60°C).

11.3.2.2.2 Bags of ammonium nitrate shall not be stored within 30 in. (76 cm) of the walls and partitions of the storage building.

11.3.2.2.3 Piles shall comply with the following dimensions:

- (1) The height of piles shall not exceed 20 ft (6.1 m).

- (2) The width of piles shall not exceed 20 ft (6.1 m).
- (3) The length of piles shall not exceed 50 ft (15.2 m), unless otherwise permitted by 11.3.2.2.3(4).
- (4) Where the building is of noncombustible construction, or is protected by automatic sprinklers, the length of piles shall not be limited.

11.3.2.2.4 In no case shall the ammonium nitrate be stacked closer than 3 ft (0.9 m) below the roof or its supporting overhead structure.

▲ 11.3.2.2.5 Aisles shall be provided to separate piles by a clear space of not less than 3 ft (0.9 m) in width, with at least one aisle in the storage area not less than 4 ft (1.2 m) in width.

11.3.2.3 Piles and Compartments for Bulk Solid Storage.

11.3.2.3.1* Bins shall be of noncombustible construction.

11.3.2.3.2 Bins shall be clean and free of materials that can contaminate ammonium nitrate.

11.3.2.3.3 Bins shall be designed so that in the event of an external fire or self-accelerated decomposition, molten ammonium nitrate can flow away from the storage area to an open, unconfined area free from contamination with incompatible materials. (See 11.2.16.1.1 for a list of incompatibles.)

11.3.2.3.4* Due to the corrosive and reactive properties of ammonium nitrate, and to avoid contamination, galvanized iron, copper, alloys of copper, lead, and zinc shall not be used in bin construction, except where such bins are protected against contact with the ammonium nitrate.

11.3.2.3.5* Uncoated aluminum bins shall not be permitted.

11.3.2.3.6 The warehouse shall be permitted to be subdivided into any desired number of ammonium nitrate storage compartments or bins provided the design does not allow molten ammonium nitrate to accumulate in the storage area and become confined.

11.3.2.3.7 Each ammonium nitrate storage bin or pile inside buildings shall be clearly identified by a sign reading AMMONIUM NITRATE with letters at least 2 in. (5 cm) high.

11.3.2.3.8 Piles or bins shall be sized and arranged so that all material is accessible to a mechanical means to minimize caking of the stored ammonium nitrate.

11.3.2.3.9* The height or depth of piles shall be limited by the caking tendency of the product; however, in no case shall the ammonium nitrate be piled higher at any point than 3 ft (0.9 m) below the roof or its supporting and overhead structure.

11.3.2.3.10 Ammonium nitrate shall not be placed into storage where the temperature of the product exceeds 140°F (60°C).

11.3.2.3.11 Explosives and blasting agents shall not be used to break up or loosen caked ammonium nitrate.

11.3.3 Detached Storage. The requirements of 6.2.3.4 shall apply.

11.4 Outdoor Storage.

11.4.1 Clearance from Combustibles.

11.4.1.1 Outdoor storage and use areas and the surrounding area shall be kept clear of weeds, debris, and common combustibles.

tible materials not necessary to the storage or use of hazardous materials for a minimum distance of 30 ft (9.0 m).

11.4.1.2 Outdoor storage and use areas for ammonium nitrate shall be located not closer than 30 ft (9 m) from a property line that can be built upon, a street, an alley, or a public way, except that a 2-hour fire barrier wall, without openings and extending no less than 30 in. (762 mm) above and to the sides of the storage area, shall be permitted in lieu of such distance.

11.4.2 Weather Protection. Where provided, weather protection shall be in accordance with 6.2.7.2.

11.4.3 Outdoor Storage in Enclosed Hoppers or Bins. In addition to the other requirements of Section 11.4, this section applies to outdoor storage of ammonium nitrate in quantities exceeding 1000 lb (453 kg).

11.4.3.1 All hoppers and bins in which bulk ammonium nitrate is stored shall be constructed of noncombustible materials.

11.4.3.2 Enclosed hoppers or bins shall be provided with a venting device to enable the discharge of gases generated in the event of a fire.

11.4.3.3* Parking of any vehicles or industrial trucks shall be prohibited within 30 ft (9.1 m) of the hoppers/bins.

N 11.4.4 Storage in Railcars. Ammonium nitrate in railcars delivered to a private track or private siding shall be considered to be in non-transportation-regulated storage.

N 11.4.4.1 Intra-plant movements to reposition railcars for the convenience of site operations shall not constitute a change of status from storage to transportation in commerce.

N 11.4.4.2 Precautions shall be taken to minimize the risk of fire near ammonium nitrate railcars.

N 11.4.4.3 Railcars being used to store ammonium nitrate shall be separated from combustible materials, including, but not limited to, those identified in 11.2.16.1.1, for not less than 30 ft (9 m) in all directions.

11.4.5* Special Requirements — Outdoor Storage.

11.5 General Requirements for Use.

11.5.1 Spill Control. Spill control shall be provided for ammonium nitrate liquids in accordance with 11.2.1.

11.5.1.1 Spilled ammonium nitrate and leaking or broken containers shall be removed immediately by a competent individual to a safe, secure, dry outside area or to a location designated by the competent individual to await disposal in conformance with applicable regulations.

11.5.2 Drainage.

11.5.2.1 Drainage shall be provided for ammonium nitrate liquids in accordance with 6.3.1.4.2.10.

11.5.2.2 For ammonium nitrate solids, the requirements of 6.3.1.4.2.10 shall not apply.

11.5.3 Secondary Containment.

11.5.3.1 Secondary containment shall be provided for ammonium nitrate solids or liquids in accordance with 6.3.1.4.2.

11.5.3.2 For ammonium nitrate solids, the requirements of 6.3.1.4.2 shall not apply.

11.5.4 Ventilation. The requirements of 6.3.2.1.3 shall apply.

11.5.5 Fire Protection Systems. An automatic fire sprinkler system shall be provided in accordance with 11.2.6.

11.5.5.1* Alternative automatic fire extinguishing systems using foam, dry-chemical or gaseous agents, or steam extinguishing systems shall not be allowed. Only water-based suppression systems shall be permitted.

11.5.5.2 Portable extinguishers shall be provided in accordance with 11.2.10.

11.5.6 Explosion Control. The requirements of 6.3.2.1.4 shall not apply.

11.5.7 Emergency and Standby Power. The requirements of 6.3.2.1.3.3 shall apply.

11.5.8 Limit Controls. Limit controls shall be provided in accordance with 6.3.1.2.

11.5.9 Alarms. Alarms shall be provided in accordance with 11.2.15.

11.5.10 Monitoring/Supervision. Supervision shall be provided in accordance with 6.3.1.8.

11.5.11 System Design. System design shall be in accordance with 6.3.1.6.

11.5.12 Liquid Transfer. Liquid transfer shall be in accordance with 6.3.1.7.

11.6 Indoor Use.

11.6.1 Open Systems.

11.6.1.1 Ventilation. The requirements of 6.3.2.1.3 shall apply.

11.6.1.2 Explosion Control. The requirements of 6.3.2.1.4 shall not apply.

11.6.1.3 Spill Control, Drainage, and Containment. Secondary containment shall be provided for ammonium nitrate liquids in accordance with 6.3.2.2.4.

11.7 Outdoor Use.

11.7.1 Open Systems.

11.7.1.1 Location. Outdoor use and dispensing shall be located in accordance with 6.3.3.1.1.

11.7.1.2 Spill Control, Drainage, and Containment. Spill control and secondary containment shall be provided for ammonium nitrate liquids in accordance with 6.3.3.2.2.

11.7.1.3 Clearance from Combustibles. For outdoor use the requirements of 11.4.1 shall apply.

11.8 Handling.

11.8.1 Handling. Handling shall be in accordance with 6.3.4 and 11.8.1.

11.8.1.1 Vehicles and Lift Trucks.

11.8.1.1.1* Powered vehicles of any type shall not be stored or left unattended in a building storing ammonium nitrate.

11.8.1.1.2 Powered vehicles used in ammonium nitrate storage facilities shall not be refueled within 50 ft (15 m) of the facility.

11.8.1.1.3 Fork trucks, tractors, platform lift trucks, and other specialized industrial trucks used within the warehouse shall be maintained so that fuels or hydraulic fluids do not contaminate the ammonium nitrate.

11.8.1.2* Handling Equipment. Hollow spaces in nitrate-handling equipment, where nitrate is able to collect and be confined to become a source of explosion in the event of fire, shall be avoided.

Chapter 12 Corrosive Solids and Liquids

12.1 General. The requirements of this chapter shall apply to the storage, use, and handling of corrosive solids or liquids when the amount of corrosive solids or liquids exceeds the MAQs as set forth in Chapter 5. The storage, use, and handling of corrosive solids or liquids in any quantity shall also comply with the requirements of Chapters 1 through 4 and the applicable requirements of Chapters 5 through 10.

12.1.1 Construction Requirements. Buildings, or portions thereof, in which corrosive solids or liquids are stored, handled, or used shall be constructed in accordance with the building code.

12.2 General Requirements for Storage.

12.2.1 Spill Control. Spill control shall be provided for corrosive liquids in accordance with 6.2.1.9.2.

12.2.2 Drainage. When provided, drainage shall be in accordance with 6.2.1.9.3.11.

12.2.3 Secondary Containment. Secondary containment shall be provided for corrosive liquids in accordance with 6.2.1.9.3.

12.2.4 Ventilation. Ventilation shall be provided for open containers in accordance with 6.2.1.5.

12.2.5 Fire Protection Systems. An automatic fire sprinkler system shall be provided in accordance with 6.2.1.1.

12.2.6 Explosion Control. The requirements of 6.2.1.6 shall not apply.

12.2.7 Emergency and Standby Power. Standby power shall be provided when required by 6.2.1.8.

12.2.8 Limit Controls. Limit controls shall be provided when required by 6.2.1.7.

12.2.9 Monitoring/Supervision. Supervision shall be provided in accordance with 6.2.1.11.

12.3 Indoor Storage.

12.3.1 Floors. Floors shall be in accordance with 6.2.1.10.

12.3.2 Detached Storage. The requirements of 6.2.2.2, 6.2.3.4, 6.2.4.4, or 6.2.4.5 shall not apply.

12.4 Outdoor Storage.

12.4.1 Exposures. Outdoor storage of corrosive solids or liquids shall be separated from exposure hazards in accordance with 12.4.1.

12.4.1.1 Clearance from Combustibles. Clearance from combustible corrosives shall be in accordance with 6.2.7.1.

12.4.1.2 Location. Outdoors storage of corrosive solids or liquids shall not be within 20 ft (6.1 m) of property lines,

streets, alleys, public ways, means of egress to a public way, or buildings not used exclusively for the storage, distribution, or manufacturing of such corrosive, except as provided in 12.4.1.3.

12.4.1.3 Distance Reduction. An unpierced 2-hour fire-resistant wall extending not less than 30 in. (762 mm) above and to the side of the storage area shall be permitted in lieu of the distance specified in 12.4.1.2.

12.4.2 Weather Protection. When provided, weather protection shall be in accordance with 5.1.2 and 6.2.7.2.

12.5 General Requirements for Use.

12.5.1 Spill Control. Spill control shall be provided for corrosive liquids in accordance with 6.3.1.4.

12.5.2 Drainage. When provided, drainage shall be in accordance with 6.3.1.4.2.10.

12.5.3 Secondary Containment. Secondary containment shall be provided for corrosive liquids in accordance with 6.3.1.4.2.

12.5.4 Ventilation. Ventilation shall be provided for open containers in accordance with 6.3.2.1.3 and 6.3.2.2.2.

12.5.5 Fire Protection System. An automatic fire sprinkler system shall be provided in accordance with 6.3.2.1.1.

12.5.6 Explosion Control. The requirements of 6.3.2.1.4 shall not apply.

12.5.7 Emergency and Standby Power. Standby power shall be provided when required by 6.3.1.3.

12.5.8 Limit Controls. Limit controls shall be provided in accordance with 6.3.1.2.

12.5.9 Monitoring/Supervision. Supervision shall be provided in accordance with 6.3.1.8.

12.5.10 Clearance from Combustibles. Clearance from combustible corrosives shall be in accordance with 6.2.7.1.

12.5.11 Floors. Floors where corrosive solids or liquids are dispensed or used in open systems shall be in accordance with 6.3.2.2.3.

12.5.12 System Design. System design shall be in accordance with 6.3.1.6.

12.5.13 Liquid Transfer. Liquid transfer shall be in accordance with 6.3.1.7.

12.6 Indoor Use.

12.6.1 Open Systems.

12.6.1.1 Ventilation. Ventilation shall be provided in accordance with 6.3.2.2.2.

12.6.1.2 Explosion Control. The requirements of 6.3.2.1.4 shall not apply.

12.6.1.3 Spill Control, Drainage, and Containment. Secondary containment shall be provided for corrosive liquids in accordance with 6.3.2.2.4.

12.6.2 Closed Systems.

12.6.2.1 Ventilation. Ventilation shall be provided in accordance with 6.3.2.3.2.

12.6.2.2 Explosion Control. The requirements of 6.3.2.1.4 shall not apply.

12.6.2.3 Spill Control, Drainage, and Containment. Spill control and secondary containment shall be provided for corrosive liquids in accordance with 6.3.2.3.3.

12.7 Outdoor Use.

12.7.1 Open Systems.

12.7.1.1 Location. Outdoor use and dispensing shall be located in accordance with 6.3.3.1.1.

12.7.1.2 Spill Control, Drainage, and Containment. Spill control and secondary containment shall be provided for corrosive liquids in accordance with 6.3.3.2.2.

12.7.1.3 Clearance from Combustibles. Clearance from combustible materials shall be in accordance with 6.3.3.1.2.

12.7.2 Closed Systems.

12.7.2.1 Location. Outdoor use and dispensing shall be located in accordance with 6.3.3.1.1.

12.7.2.2 Spill Control, Drainage, and Containment. Spill control and secondary containment shall be provided for corrosive liquids in accordance with 6.3.3.3.2.

12.7.2.3 Clearance from Combustibles. Clearance from combustible materials shall be provided in accordance with 6.3.3.1.2.

12.8 Handling. Handling of corrosive solids and liquids in indoor and outdoor areas shall be in accordance with 6.3.4.

Chapter 13 Flammable Solids

13.1 General. The requirements of this chapter shall apply to the storage, use, and handling of flammable solids when the amount of flammable solids exceeds the MAQ as set forth in Chapter 5. The storage, use, and handling of flammable solids in any quantity shall also comply with the requirements of Chapters 1 through 4 and the applicable requirements of Chapters 5 through 10.

13.1.1 Construction Requirements. Buildings, or portions thereof, in which flammable solids are stored, handled, or used shall be constructed in accordance with the building code.

13.2 General Requirements for Storage.

13.2.1 Spill Control. The requirements of 6.2.1.9.2 shall not apply.

13.2.2 Drainage. The requirements of 6.2.1.9.3.11 shall not apply.

13.2.3 Secondary Containment. The requirements of 6.2.1.9.3 shall not apply.

13.2.4 Ventilation. The requirements of 6.2.1.5 shall not apply.

13.2.5 Fire Protection Systems. An automatic fire sprinkler system shall be provided in accordance with 6.2.1.1.

13.2.6 Explosion Control. The requirements of 6.2.1.6 shall not apply.

13.2.7 Emergency and Standby Power. Standby power shall be provided when required by 6.2.1.8.

13.2.8 Limit Controls. Limit controls shall be provided when required by 6.2.1.7.

13.2.9 Monitoring/Supervision. Supervision shall be provided in accordance with 6.2.1.11.

13.3 Indoor Storage.

13.3.1 Floors. The requirements of 6.2.1.10 shall not apply.

13.3.2 Detached Storage. The requirements of 6.2.2.2, 6.2.3.4, 6.2.4.4, or 6.2.4.5 shall not apply.

13.4 Outdoor Storage.

13.4.1 Exposures. Outdoor storage of flammable solids shall be separated from exposure hazards in accordance with 13.4.1.

13.4.1.1 Clearance from Combustibles. Clearance from combustible materials shall be in accordance with 6.2.7.1.

13.4.1.2 Location. Outdoor storage of flammable solids shall not be within 20 ft (6.1 m) of property lines, streets, alleys, public ways, means of egress to a public way, or buildings not used exclusively for the storage, distribution, or manufacturing of such material, except as provided in 13.4.1.3.

13.4.1.3 Distance Reduction. An unpierced 2-hour fire-resistant wall extending not less than 30 in. (762 mm) above and to the side of the storage area shall be permitted in lieu of the distance specified in 13.4.1.2.

13.4.2 Weather Protection. When provided, weather protection shall be in accordance with 5.1.2 and 6.2.7.2.

13.4.3 Special Requirements.

13.4.3.1 Pile Size Limit. Flammable solids stored outdoors shall be separated into piles not larger than 5000 ft³ (141 m³).

13.4.3.2 Aisles. Aisle widths between piles shall not be less than one-half the height of the piles or 10 ft (3 m), whichever is greater.

13.5 General Requirements for Use.

13.5.1 Spill Control. The requirements of 6.3.1.4 shall not apply.

13.5.2 Drainage. The requirements of 6.3.1.4.2.10 shall not apply.

13.5.3 Secondary Containment. The requirements of 6.3.1.4.2 shall not apply.

13.5.4 Ventilation. Ventilation shall be provided for finely divided particles in open containers in accordance with 6.3.2.1.3 and 6.3.2.2.2.

13.5.5 Fire Protection System. An automatic fire sprinkler system shall be provided in accordance with 6.3.2.1.1.

13.5.6 Explosion Control. The requirements of 6.3.2.1.4 shall not apply.

13.5.7 Emergency and Standby Power. Standby power shall be provided when required by 6.3.1.3.

13.5.8 Limit Controls. Limit controls shall be provided in accordance with 6.3.1.2.

13.5.9 Monitoring/Supervision. Supervision shall be provided in accordance with 6.3.1.8.

13.5.10 Clearance from Combustibles. Clearance from combustible materials shall be in accordance with 6.2.7.1.

13.5.11 Floors. Floors where flammable solids are dispensed or used in open systems shall be in accordance with 6.3.2.2.3.

13.5.12 System Design. System design shall be in accordance with 6.3.1.6.

13.6 Indoor Use.

13.6.1 Open Systems.

13.6.1.1 Ventilation. Ventilation shall be provided in accordance with 6.3.2.2.2.

13.6.1.2 Explosion Control. The requirements of 6.3.2.1.4 shall not apply.

13.6.1.3 Spill Control, Drainage, and Containment. The requirements of 6.3.2.2.4 shall not apply.

13.6.2 Closed Systems.

13.6.2.1 Ventilation. Ventilation shall be provided in accordance with 6.3.2.3.2.

13.6.2.2 Explosion Control. The requirements of 6.3.3.2.2 shall not apply.

13.6.2.3 Spill Control, Drainage, and Containment. The requirements of 6.3.2.3.3 shall not apply.

13.7 Outdoor Use.

13.7.1 Open Systems.

13.7.1.1 Location. Outdoor use and dispensing shall be located in accordance with 6.3.3.1.1.

13.7.1.2 Spill Control, Drainage, and Containment. The requirements of 6.3.3.2.2 shall not apply.

13.7.1.3 Clearance from Combustibles. Clearance from combustible materials shall be in accordance with 6.3.3.1.2.

13.7.2 Closed Systems.

13.7.2.1 Location. Outdoor use and dispensing shall be located in accordance with 6.3.3.1.1.

13.7.2.2 Spill Control, Drainage, and Containment. The requirements of 6.3.3.3.2 shall not apply.

13.7.2.3 Clearance from Combustibles. Clearance from combustible materials shall be provided in accordance with 6.3.3.1.2.

13.8 Handling. Handling of flammable solids in indoor and outdoor areas shall be in accordance with Section 13.8.

13.8.1 Handling. Handling shall be in accordance with 6.3.4.

Chapter 14 Organic Peroxide Formulations

14.1 General.

14.1.1* The requirements of this chapter shall apply to the storage, use, and handling of classified solid or liquid organic peroxide formulations when the amount of organic peroxide solids or liquids exceeds the MAQ as set forth in Chapter 5.

The storage, use, and handling of solid or liquid organic peroxide formulations classified in classes I, II, III, and IV in any quantity shall also comply with the requirements of Chapters 1 through 4 and the applicable requirements of Chapters 5 through 10.

14.1.2* Construction Requirements. Buildings, or portions thereof, in which solid or liquid organic peroxide formulations are stored, handled, or used shall be constructed in accordance with the building code.

14.2 General Requirements for Storage.

14.2.1 Spill Control. Spill control shall be provided for organic peroxide liquid formulations in accordance with 6.2.1.9.2.

14.2.2 Drainage. When provided, drainage shall be in accordance with 6.2.1.9.3.11.

14.2.3 Secondary Containment. Secondary containment shall be provided for solid and liquid organic peroxide formulations in accordance with 6.2.1.9.3.

14.2.4* Ventilation. Ventilation shall be provided for open containers in accordance with 6.2.1.5.

14.2.5 Fire Protection Systems. An automatic fire sprinkler system shall be provided in accordance with 14.2.5 and 6.2.1.1.

14.2.5.1* Where required by other provisions of this code, automatic sprinklers and water spray systems shall be designed and installed according to the requirements of NFPA 13 and NFPA 15 and shall provide the following discharge densities:

- (1) Class I — 0.50 gpm/ft² (20.4 L/min/m²)
- (2) Class II — 0.40 gpm/ft² (16.3 L/min/m²)
- (3) Class III — 0.30 gpm/ft² (12.2 L/min/m²)
- (4) Class IV — 0.25 gpm/ft² (10.2 L/min/m²)

Δ 14.2.5.2 The system shall be designed as follows:

- (1) The system shall provide the required density over the hydraulically most remote 3000 ft² (280 m²) area for areas protected by a wet pipe sprinkler system or single-interlock preaction sprinkler system.
- (2) Buildings using a dry pipe sprinkler system shall be provided with a required density over the hydraulically most remote 3900 ft² (360 m²) design area and, if used, the clearance between the sprinkler deflector and the top of any stored organic peroxide formulation shall not exceed 6 ft (1.8 m).
- (3) The entire area of any building of less than 3000 ft² (280 m²) shall be used as the area of application.

14.2.5.3 Where required for detached storage buildings containing Class I organic peroxide formulations in quantities exceeding 2000 lb (907 kg), automatic sprinkler protection shall be open-head deluge-type, designed and installed in accordance with NFPA 13.

N 14.2.5.4* Dry pipe and double-interlock preaction (DIPA) sprinkler systems shall not be permitted for protection of buildings or areas containing organic peroxide formulations except as provided for in 14.2.5.4.1 and 14.2.5.4.2.

N 14.2.5.4.1 Dry pipe and DIPA sprinkler systems shall be permitted for protection of Class I through Class III organic peroxide formulations in detached storage in Type I and Type II construction, as specified in the building code.

N 14.2.5.4.2 Dry pipe and DIPA sprinkler systems shall be permitted for protection of Class IV and Class V organic peroxide formulations in Type I through Type IV building construction, as specified in the building code.

14.2.6 Explosion Control. Explosion control shall be provided for liquid or solid organic peroxide formulations when required by 6.2.1.6.

14.2.7 Emergency and Standby Power. Standby power shall be provided when required by 6.2.1.8.

14.2.7.1 Standby power for temperature control shall be permitted to be replaced by alternative methods of temperature control.

14.2.8 Limit Controls. Limit controls shall be provided when required by 6.2.1.7.

14.2.9 Monitoring/Supervision. Supervision shall be provided in accordance with 6.2.1.11.

14.2.10 Special Requirements.

14.2.10.1 All areas containing organic peroxide formulations shall be conspicuously identified by means of a sign containing the words ORGANIC PEROXIDES and by the organic peroxide class and NFPA 704 identification.

14.2.10.1.1 Different Classifications. When organic peroxide formulations having different classifications as defined by Section 4.1 are located in the same area, the NFPA 704 designations indicated for the area shall be appropriate for the most severe class present.

14.2.10.2 Packaging Marking. Original DOT shipping containers containing organic peroxide formulations shall be individually marked with the chemical name of the organic peroxide or with other pertinent information to indicate classification as required by this code.

14.2.10.3 Temperature Markings. Packages containing organic peroxide formulations that require temperature control shall be marked with the recommended temperature range.

14.2.10.4 Maintenance Operations. Maintenance operations in organic peroxide storage or use areas shall be subject to prior review by, and approval of, supervisory personnel.

14.2.10.5 Cutting and Welding.

14.2.10.5.1 Cutting and welding operations in organic peroxide storage or use areas shall not be conducted until all organic peroxide formulations have been removed from the area of storage or use.

14.2.10.5.1.1 Cutting and welding operations shall be conducted in accordance with the requirements of NFPA 51B.

14.2.10.6 Electrical. In addition to the requirements of 6.1.10, the following shall apply to the interior of any refrigerator or freezer cabinet used for the storage of Class I, Class II, or Class III organic peroxide formulations:

- (1) The cabinet shall be considered a Class I, Group D, Division 1 location, as defined in Article 500 of *NFPA 70*.
- (2) Any electrical equipment installed in the interior of such cabinets shall be approved for such use and shall be installed according to the requirements of Article 501 of *NFPA 70*.

14.2.10.6.1 Where the storage cabinet is ventilated, the following shall apply:

- (1) The electrical equipment shall be considered a Class I, Division 2 location, as defined in Article 500 of *NFPA 70*.
- (2) Mechanical ventilation systems shall provide at least 1 ft³/min/ft² (0.09 m³/min/0.03 m²) of floor area.

14.2.10.7 Combustible Waste. Accumulation of combustible waste in organic peroxide storage or use areas shall be prohibited.

14.2.10.8* Damaged Containers. Spilled material and leaking or damaged containers and packages shall immediately be removed for recovery or disposal away from the stored product or other combustibles.

14.2.10.9 Specific Disposal Procedures. Specific disposal procedures shall be established for all organic peroxide areas.

14.2.10.10 Heating and Cooling.

14.2.10.10.1 Temperature Range. Storage areas shall be maintained within the recommended storage temperature range for the materials requiring refrigerated storage.

14.2.10.10.2 Outside of Ambient Temperature. Where the required storage temperature range extends beyond normal ambient temperatures, the following criteria shall be met:

- (1) High- or low-temperature limit switches, or both, as applicable, shall be installed and maintained in addition to the normal temperature controls.
- (2) The limit switches shall actuate an alarm arranged to ensure prompt response.

14.2.10.10.3 Cooling Systems. Cooling systems shall not utilize direct expansion of a flammable gas.

14.2.10.10.4 Heating Systems. Heating systems shall use hot water, low pressure [a gauge pressure less than 15 psi (103 kPa)] steam, or indirectly heated warm air.

14.2.10.10.5 Container Contact. Heating coils, radiators, air diffusers, cooling coils, piping, and ducts shall be installed so as to prevent direct contact with containers and to prevent overheating or overcooling of the materials stored.

14.2.10.11 The following shall apply to any floors or open spaces located below the organic peroxide storage area:

- (1) The floor of the storage area shall be made watertight and shall be provided with drainage that leads to a safe location.
- (2) Every means shall be taken to ensure that spilled material cannot run down into areas below the organic peroxide storage area.

14.3 Indoor Storage.

14.3.1 Detection Systems. A detection system that detects smoke, temperature, or rate of temperature rise shall be provided in storage areas used for the storage of liquid and solid organic peroxide formulations.

14.3.2* Storage Conditions/Arrangement. Storage arrangement shall be in accordance with 14.3.2.

14.3.2.1 Storage Limitations. The MAQs of organic peroxide formulations that can be stored in a single area or building shall depend on the classification of the formulations, the clas-

sification of the storage facility, and sprinkler protection, as set forth in Table 14.3.2.1(a) and Table 14.3.2.1(b).

14.3.2.2 The quantity of Class III organic peroxide formulations as it appears in Table 14.3.2.1(a) in cutoff storage shall be permitted to be increased to 20,000 lb (9070 kg) if the walls or partitions providing the cutoff have a fire resistance rating of at least 4 hours.

14.3.2.3 Class I organic peroxide formulation cutoff storage as it appears in Table 14.3.2.1(b) shall have interior walls with a blast resistance of 432 psf (0.2 bar).

14.3.2.4* Class I organic peroxide formulation cutoff storage as it appears in Table 14.3.2.1(b) shall have deflagration venting provided for exterior walls.

14.3.2.5* Where two or more different classes of organic peroxide formulations are stored in the same area, the following shall apply:

- (1) The maximum quantity permitted shall be limited to the sum of the proportional amounts that each class bears to the maximum permitted for that class.
- (2) The total of the proportional amounts shall not exceed 100 percent.

14.3.2.6 Where the storage area is protected by a specially engineered fire protection system acceptable to the AHJ, the quantity of organic peroxide formulations shall be permitted to be increased.

14.3.2.7 Organic peroxide formulations sensitive to shock shall not be stored where they can be exposed to the shock effects of explosive materials.

14.3.2.8 Storage Arrangements.

14.3.2.8.1 Storage shall be arranged to facilitate manual access and handling, to maintain pile stability, to minimize breakage and spillage, and to promote good housekeeping.

14.3.2.8.2 A clear space of at least 2 ft (0.6 m) shall be maintained between organic peroxide storage and uninsulated metal walls.

14.3.2.9 Separation Distance. The following shall apply to separation distances:

- (1) Incompatible materials and flammable or combustible liquids shall not be stored within 25 ft (7.6 m) of organic peroxide formulations.
- (2) The effective separation distance shall be maintained by floor slope, drains, or dikes to prevent liquid leakage from encroaching on the organic peroxide formulation storage area.
- (3) Organic peroxide formulations that can also be classified as flammable or combustible liquids by their flash point shall be permitted to be stored with other organic peroxide formulations, and the more restrictive requirements of NFPA 30 or this code shall apply.

▲ **14.3.2.9.1** As an alternative to the 25 ft (7.6 m) separation distance of 14.3.2.9(1), a 1-hour liquidtight fire barrier shall be permitted.

▲ **Table 14.3.2.1(a) Maximum Quantity of Organic Formulations in Nonsprinklered Buildings**

Class of Organic Peroxide Formulation	Detached Storage Minimum Separation*					
	50 ft (15 m)		100 ft (30.5 m)		150 ft (46 m)	
	lb	kg	lb	kg	lb	kg
I	1,000	454	4,000	1,810	10,000	4,540
IIA	20,000	9,070	80,000	36,300	500,000	227,000
IIB	55,000	24,948	160,000	72,575	600,000	272,158
III	70,000	31,800	200,000	90,700	750,000	340,000
IV	300,000	136,000	500,000	227,000	1,000,000	454,000
V	UNL	UNL	UNL	UNL	UNL	UNL

*Minimum separation means the distance from the line of property that is or can be built upon, including the opposite side of a public way, or the distance from the nearest important building on the same property.

NA: Not applicable; UNL: Unlimited.

▲ **Table 14.3.2.1(b) Maximum Quantity of Organic Peroxide Formulations in Sprinklered Buildings**

Class of Organic Peroxide Formulation	Detached Storage Minimum Separation*					
	50 ft (15 m)		100 ft (30.5 m)		150 ft (46 m)	
	lb	kg	lb	kg	lb	kg
I	2,000	907	20,000	9,070	175,000	79,400
IIA	100,000	45,400	200,000	90,700	UNL	UNL
IIB	175,000	79,379	UNL	UNL	UNL	UNL
III	200,000	90,700	UNL	UNL	UNL	UNL
IV	UNL	UNL	UNL	UNL	UNL	UNL
V	UNL	UNL	UNL	UNL	UNL	UNL

*Minimum separation means the distance from the line of property that is or can be built upon, including the opposite side of a public way, or the distance from the nearest important building on the same property.

NA: Not applicable; UNL: Unlimited.

14.3.2.9.2 Only closed containers and packages shall be permitted in storage areas.

△ 14.3.2.9.3 Storage of bags, drums, and other containers and packages of organic peroxide formulations shall be in accordance with Table 14.3.2.9.3.

14.3.2.9.4* Storage of 55 gal (208 L) drums of Class IIB or Class III organic peroxide formulations shall be stored only one drum high.

14.3.2.9.4.1 Class I organic peroxide formulations shall not be stored in containers greater than 8 gal (30.3 L).

14.3.2.9.5 Storage of Class V organic peroxide formulations shall meet the requirements of NFPA 1 as applicable.

14.3.3 Floors. The requirements of 6.2.1.10 shall apply.

14.3.4 Detached Storage.

14.3.4.1 General. The requirements of 6.2.2.2, 6.2.3.4, 6.2.4.4, or 6.2.4.5 shall not apply.

14.3.4.2 Building Location.

14.3.4.2.1 For Class I organic peroxide formulations, detached storage buildings shall be separated from each other in accordance with Table 14.3.4.2.1.

14.3.4.2.2 For Class II, III, and IV organic peroxide formulations, detached storage buildings separated by less than 50 ft (15.3 m) shall be considered to be a single area when applying the limits for Table 14.3.2.1(a) and Table 14.3.2.1(b).

14.3.4.3 Building Construction.

14.3.4.3.1* Detached storage buildings shall be single story, without a basement or crawl space.

14.3.4.3.2 Nonsprinklered buildings for storing more than 5000 lb (2270 kg) of Class I, Class II, or any refrigerated organic peroxide formulation that gives off flammable gases

upon decomposition shall be built of noncombustible construction.

14.3.4.3.3* Buildings of combustible construction employing sun shields shall be permitted to be used for detached storage buildings storing less than 5000 lb (2270 kg) of organic peroxide formulations.

14.4 Outdoor Storage.

14.4.1 Exposures. Outdoor storage of solid or liquid organic peroxide formulations shall be separated from exposure hazards in accordance with 14.4.1.

14.4.1.1 Clearance from Combustibles. Clearance from combustible organic peroxide formulations shall be in accordance with 6.2.7.1.

14.4.1.2 Location. Outdoor storage of solid or liquid organic peroxide formulations shall not be within 20 ft (6.1 m) of property lines, streets, alleys, public ways, means of egress to a public way, or buildings not used exclusively for the storage, distribution, or manufacturing of such organic peroxide formulations, except as provided in 14.4.1.3.

14.4.1.3 Distance Reduction. An unpierced 2-hour fire-resistant wall extending not less than 30 in. (762 mm) above and to the side of the storage area shall be permitted in lieu of the distance specified in 14.4.1.2.

14.4.2 Weather Protection. Where provided, weather protection shall be in accordance with 5.1.2 and 6.2.7.2.

14.5 General Requirements for Use.

14.5.1 Spill Control. Spill control shall be provided for organic peroxide formulations liquids in accordance with 6.3.1.4.

14.5.2 Drainage. Where provided, drainage shall be in accordance with 6.3.1.4.2.10.

△ Table 14.3.2.9.3 Provisions for Storage Arrangement by Class of Organic Peroxide Formulation

Class of Organic Peroxide Formulation	Maximum Pile Height		Maximum Pile Width		Minimum Aisle Width		Minimum Access Aisle Width	
	ft	m	ft	m	ft	m	ft	m
I*	6	1.8	4	1.2	8	2.4	4	1.2
IIA*	8	2.4	8	2.4	6	1.8	4	1.2
IIB*	8	2.4	8	2.4	6	1.8	4	1.2
III*	8	2.4	8	2.4	6	1.8	4	1.2
IV	10	3.0	16	4.9	4	1.2	3	0.9
V	See 14.3.2.9.5							

*See 14.3.2.9.4.

Table 14.3.4.2.1 Separation of Individual Storage Buildings

Nonsprinklered				Automatic Sprinklered			
Quantity		Distance		Quantity		Distance	
lb	kg	ft	m	lb	kg	ft	m
1,000	454	20	6	2,000	907	20	6
4,000	1,810	75	23	20,000	9,070	75	23
10,000	4,540	100	30	175,000	79,400	100	30

14.5.3 Secondary Containment. Secondary containment shall be provided for organic peroxide formulations solids or liquids in accordance with 6.3.1.4.2.

14.5.4 Ventilation. Ventilation shall be provided for open containers in accordance with 6.3.2.1.3 and 6.3.2.2.2.

14.5.5 Fire Protection System. An automatic fire sprinkler system shall be provided in accordance with 6.3.2.1.1 and 14.2.5.

14.5.6 Explosion Control. Explosion control shall be provided for liquid and solid organic peroxide formulations when required by 6.3.2.1.4.

14.5.7* Emergency and Standby Power. Standby power shall be provided when required by 6.3.1.3.

14.5.8 Limit Controls. Limit controls shall be provided in accordance with 6.3.1.2.

14.5.9 Monitoring/Supervision. Supervision shall be provided in accordance with 6.3.1.8.

14.5.10 Clearance from Combustibles. Clearance from combustible organic peroxide formulations shall be in accordance with 6.2.7.1.

14.5.11 Floors. Floors where solid or liquid organic peroxide formulations are dispensed or used in open systems shall be in accordance with 6.3.2.2.3.

14.5.12 System Design. System design shall be in accordance with 6.3.1.6.

14.5.13 Liquid Transfer. Liquid transfer shall be in accordance with 6.3.1.7.

14.5.14 Special Requirements.

14.5.14.1 Storage directly related to the manufacturing formulation in process areas shall meet the requirements of 14.2.10 and be treated as a process area as addressed in this chapter.

14.5.14.2 Maintenance operations in organic peroxide process areas shall be subject to prior review by, and approval of, supervisory personnel.

14.5.14.3* Waste Disposal. Hazardous materials shall be disposed of in accordance with applicable federal, state, or local governing regulations.

14.6 Indoor Use.

14.6.1 Open Systems.

14.6.1.1 Ventilation. Ventilation shall be provided in accordance with 6.3.2.2.2.

14.6.1.2 Explosion Control. Explosion control shall be provided for liquid and solid organic peroxide formulations when required by 6.3.2.1.4.

14.6.1.3 Spill Control, Drainage, and Containment. Secondary containment shall be provided for organic peroxide formulations in accordance with 6.3.2.2.4.

14.6.2 Closed Systems.

14.6.2.1 Ventilation. Ventilation shall be provided in accordance with 6.3.2.3.2.

14.6.2.2 Explosion Control. Explosion control shall be provided for liquid and solid organic peroxide formulations when required by 6.3.2.1.4.

14.6.2.3 Spill Control, Drainage, and Containment. Spill control and secondary containment shall be provided for liquid organic peroxide formulations in accordance with 6.3.2.3.3.

14.7 Outdoor Use.

14.7.1 Open Systems.

14.7.1.1 Location. Outdoor use and dispensing shall be located in accordance with 6.3.3.1.1.

14.7.1.2 Spill Control, Drainage, and Containment. Spill control and secondary containment shall be provided for organic peroxide formulations liquids in accordance with 6.3.3.2.2.

14.7.1.3 Clearance from Combustibles. Clearance from combustible organic peroxide formulations shall be in accordance with 6.3.3.1.2.

14.7.2 Closed Systems.

14.7.2.1 Location. Outdoor use and dispensing shall be located in accordance with 6.3.3.1.1.

14.7.2.2 Spill Control, Drainage, and Containment. Spill control and secondary containment shall be provided for liquid organic peroxide formulations in accordance with 6.3.3.3.2.

14.7.2.3 Clearance from Combustibles. Clearance from combustible materials shall be provided in accordance with 6.3.3.1.2.

14.8 Handling. Handling of organic peroxide formulations in indoor and outdoor areas shall be in accordance with Section 14.8.

14.8.1 Handling. Handling shall be in accordance with 6.3.4.

Chapter 15 Oxidizer Solids and Liquids

15.1 General.

15.1.1 The requirements of this chapter shall apply to the storage, use, and handling of oxidizer solids or liquids when the amount of oxidizer solids or liquids exceeds the MAQ as set forth in Chapter 5 except as set forth in 15.1.1.1 and 15.1.1.2.

15.1.1.1 The requirements of 15.3.2.1 shall apply to storage of Class 1 oxidizers where stored in quantities in excess of 4000 lb (1814.4 kg), irrespective of whether the amount of oxidizer solids or liquids exceeds the MAQs permitted in control areas.

15.1.1.2 The requirements of 15.3.5 shall apply to the display and storage, of Class 1 through Class 3 oxidizers in mercantile, storage, or industrial occupancies where the general public has access to the material for sale and to the storage of oxidizing materials in such occupancies in areas that are not accessible to the public.

15.1.2 The storage, use, and handling of oxidizer solids or liquids in any quantity shall also comply with the requirements of Chapters 1 through 4 and the applicable requirements of Chapters 5 through 10.

15.1.3 Construction Requirements. Buildings, or portions thereof, in which oxidizing liquids and solids are stored, handled, or used shall be constructed in accordance with the building code.

15.1.4* The quantity and arrangement limits in this code shall not apply to the transient storage of oxidizers in process areas at plants where oxidizers are manufactured.

15.1.5 The construction requirements of this code shall not apply retroactively to the storage of solid and liquid oxidizers in existing buildings used for the storage of oxidizers at manufacturing plants.

15.1.6 Each class of oxidizer shall be considered independent of the others, and a facility shall be permitted to carry up to the maximum quantity for each class of material.

15.2 General Requirements for Storage.

15.2.1 Spill Control. Spill control shall be provided for oxidizer liquids in accordance with 6.2.1.9.2.

15.2.1.1* Where Class 2, Class 3, or Class 4 liquid oxidizers are stored, means shall be provided to prevent the liquid oxidizer from flowing out of a storage area into an area containing incompatible materials.

15.2.1.2* Spilled oxidizers, reacting oxidizers, and leaking or broken containers shall be removed immediately by a competent individual to a safe, secure, dry outside area or to a location designated by the competent individual to await disposal, in conformance with applicable regulations and manufacturer's and processor's instructions.

15.2.1.3 Spilled materials shall be placed in a clean, separate container and shall not be returned to the original container.

15.2.1.4 The disposal of spilled materials shall not be combined with that of ordinary trash.

15.2.2 Drainage. Where provided, drainage shall be in accordance with 6.2.1.9.3.11.

15.2.3 Secondary Containment. Secondary containment shall be provided for oxidizer solids and liquids in accordance with 6.2.1.9.3.

15.2.4 Ventilation. Ventilation shall be provided for Class 4 oxidizers in open containers in accordance with 6.2.1.5.

15.2.5* Fire Protection Systems. An automatic fire sprinkler system shall be provided in accordance with 6.2.1.1, 15.3.2, and 15.3.5.

15.2.5.1* Dry Pipe and Preaction Sprinkler Systems.

15.2.5.1.1 Dry pipe and double-interlock preaction (DIPA) sprinkler systems shall not be permitted for protection of buildings or areas containing oxidizers except as provided for in 15.2.5.1.2 through 15.2.5.1.4.

15.2.5.1.2 Dry pipe and DIPA systems shall be permitted for protection of Class 1 oxidizers in Type I through Type IV building construction and Class 2 and Class 3 oxidizers in detached storage in Type I and Type II construction, as specified in the building code.

15.2.5.1.3 Dry pipe and DIPA sprinkler systems shall be permitted in mercantile occupancies when the oxidizers are

stored in open-air environments, such as retail garden centers and buildings without exterior walls.

15.2.5.1.4 For Class 3 oxidizers, the location of dry pipe and DIPA sprinkler systems shall be approved by the AHJ.

15.2.5.2 Fire Protection Water Supplies.

15.2.5.2.1* Water supplies shall be adequate for the protection of the oxidizer storage by hose streams and automatic sprinklers.

15.2.5.2.2 The water system shall be capable of providing not less than 750 gpm (2840 L/min) where protection is by means of hose streams, or 500 gpm (1890 L/min) for hose streams in excess of the automatic sprinkler water demand.

15.2.5.2.3 The duration of the water supply shall be a minimum of 2 hours.

15.2.5.3 Portable Extinguishers.

15.2.5.3.1* Dry Chemical and CO₂ Extinguishers. The placement and use of carbon dioxide (CO₂) or dry chemical extinguishers containing ammonium compounds (Class A:B:C) shall be prohibited in areas where oxidizers that can release chlorine or bromine are stored.

15.2.5.3.2* Halon Extinguishers. Halon extinguishers shall not be used in areas where oxidizers are stored.

15.2.5.3.3* Halocarbon Clean Agent Extinguishers. Halocarbon clean agent extinguishers shall not be used in areas where oxidizers are stored, unless they have been tested to the satisfaction of the AHJ.

15.2.6 Explosion Control. The requirements of 6.2.1.6 shall not apply.

15.2.7 Emergency and Standby Power. Standby power shall be provided when required by 6.2.1.8.

15.2.8 Limit Controls. Limit controls shall be provided when required by 6.2.1.7.

15.2.8.1 Oxidizers shall be separated from sources of heat, such as heating units, piping, or ducts, so that they cannot be heated to within 25°F (14°C) of their decomposition temperature or to 125°F (52°C), whichever is lower and in accordance with the manufacturer's recommendations.

15.2.8.2 Oxidizers shall be stored so that the storage temperature cannot be within 25°F (14°C) of their decomposition temperature or 125°F (52°C), whichever is lower and in accordance with the manufacturer's recommendations.

15.2.9 Monitoring/Supervision. Supervision shall be provided in accordance with 6.2.1.11.

15.2.10 Detection Systems.

15.2.10.1 A fire detection system shall be provided in accordance with Section 6.2 and 15.3.1 in indoor storage areas for liquid and solid oxidizers.

15.2.10.2 A fire detection system shall not be required for detached storage buildings protected by an automatic sprinkler system.

15.2.11* Special Requirements. This subsection contains specific requirements not found in Chapter 6.

15.2.11.1 Solid oxidizers shall not be stored directly beneath liquids.

15.2.11.2 Hydrogen peroxide (Class 2 through Class 4) stored in drums shall not be stored on wooden pallets.

15.2.11.3 At least one side of each pile of oxidizer shall be on an aisle.

15.2.11.4 Accumulation of combustible waste in oxidizer storage areas shall be prohibited.

15.2.11.5 Used, empty, combustible containers that previously contained oxidizers shall be stored in a detached or sprinklered area.

15.2.11.6 Storage shall be managed to prevent excessive dust accumulation.

15.2.11.7 Personnel Training and Procedures. Training and procedures shall be in accordance with 6.1.4.

15.2.11.8 Storage Containers, Tanks, and Bins.

15.2.11.8.1 Shipping Containers. Where a storage container for solid and liquid oxidizers also functions as the shipping container, the container shall meet the requirements of the U.S. Department of Transportation, 49 CFR 100–199, or the *Canadian Ministry of Transport Regulations* (Transport Canada).

15.2.11.8.2 Tanks and Bins. Tanks for the storage of bulk liquid oxidizers and bins for the storage of bulk solid oxidizers shall meet the following requirements:

- (1) Materials of construction shall be compatible with the oxidizer being stored.
- (2) Tanks and bins shall be designed and constructed in accordance with federal, state, and local regulations or, as a minimum, in accordance with nationally recognized engineering practices [e.g., American Society of Mechanical Engineers (ASME), American Petroleum Institute (API)].
- (3) Tanks and bins shall be equipped with a vent or other relief device to prevent overpressurization due to decomposition or fire exposure.

15.2.11.9 Materials Not Included. Incompatible materials shall not include approved packaging materials, pallets, or other dunnage.

15.2.11.10* Contact with Water. Oxidizers shall be stored to prevent contact with water, which can affect either container integrity or product stability.

15.2.11.11* Absorptive combustible packing materials used to contain water-soluble oxidizers that have become wet during either fire or nonfire conditions, and wooden pallets that are exposed to water solutions of an oxidizer, shall be relocated to a safe outside area and shall be disposed of properly.

15.2.11.12 Mercantile Signage for Different Classifications. Where oxidizers having different classifications are stored in the same area, the area shall be marked for the most severe hazard class present.

15.2.11.13 Clearance from Combustibles. Clearance from combustible materials shall be in accordance with 6.1.15.

15.2.11.13.1 The following shall apply where oxidizers are in segregated storage with flammable and combustible liquids:

- (1) The oxidizer containers and flammable and combustible liquid containers shall be separated by at least 25 ft (7.6 m).
- (2) The separation shall be maintained by dikes, drains, or floor slopes to prevent flammable liquid leakage from encroaching on the separation.

15.3 Indoor Storage.

15.3.1 Detection Systems.

15.3.1.1 A fire detection system shall be provided in indoor storage areas for liquid and solid oxidizers.

15.3.1.2 A fire detection system shall not be required for detached storage buildings protected by an automatic sprinkler system.

15.3.2 Storage Conditions/Arrangement. Storage conditions and storage arrangements, when required, shall be in accordance with 15.3.2.

15.3.2.1 Bulk Storage of Class 1 Oxidizers.

15.3.2.1.1* Combustible Building Materials. Bulk storage in combustible buildings shall not come into contact with combustible building members, unless the members are protected by a compatible coating to prevent their impregnation by the oxidizer.

15.3.2.1.2 Bulk Storage Separation. Bulk storage, either in permanent bins or in piles, shall be separated from all other materials.

15.3.2.1.3 Bins. Bins shall be of noncombustible construction.

15.3.2.1.4 Wooden Bins. Wooden bins shall be permitted to be protected with a compatible coating to prevent impregnation of the combustible material by the oxidizer.

15.3.2.1.5 The MAQs of oxidizer shall not be limited when the building is protected by an approved fire sprinkler system in accordance with NFPA 1 Section 13.3 of NFPA 1.

15.3.2.2 Storage Arrangements of Class 1 Oxidizers.

15.3.2.2.1 Nonsprinklered Buildings. For Class 1 oxidizers stored in nonsprinklered buildings, the minimum aisle width shall be equal to the pile height.

15.3.2.2.2 Class 1 Oxidizers.

15.3.2.2.2.1 Application. Paragraph 15.3.2.2 shall apply to storage of Class 1 oxidizers where stored in quantities in excess of 4000 lb (1814 kg), irrespective of whether the amount of oxidizer solids or liquids exceeds the MAQ.

15.3.2.2.2.2 Storage Arrangements. Storage in quantities identified in Table 5.2.1.1.3, Table 5.2.1.2.1 through Table 5.2.1.8, Table 5.2.1.10.1, Table 5.2.1.5.3(a), and Table 15.3.2.2.2(A)(a) shall be permitted in nonsprinklered buildings.

Δ (A)* Storage of Class 1 Oxidizers. Storage of Class 1 oxidizers shall be in accordance with Table 15.3.2.2.2(A)(a) when stored in nonsprinklered or detached unprotected buildings or in accordance with Table 15.3.2.2.2(A)(b) when stored in sprinklered buildings.

(B) For Class 1 oxidizers stored in nonsprinklered buildings, the minimum aisle width shall be equal to the pile height.

(C) For Class 1 oxidizers stored in sprinklered buildings, the minimum aisle width shall be equal to the pile height, but the aisle width shall be not less than 4 ft (1.2 m) and is not required to be greater than 8 ft (2.4 m).

(D) There shall be no minimum distance from the pile to a wall for amounts less than 9000 lb (4082 kg).

(E) Class 1 oxidizers shall be permitted to be separated from ordinary combustible and incompatible materials by a solid noncombustible barrier or by a horizontal distance in accordance with Table 15.3.2.2.2.2(A) (a) or Table 15.3.2.2.2.2(A) (b).

15.3.2.2.3* Sprinkler Protection — Class 1. For applying the requirements of NFPA 13 Class 1 oxidizers shall be designated as follows:

- (1) Class 1 oxidizers in noncombustible or combustible containers (paper bags or noncombustible containers with removable combustible liners) shall be designated as a Class I commodity.
- (2) Class 1 oxidizers contained in fiber drums, wooden or fiber boxes or barrels, or noncombustible containers in combustible packaging shall be designated as a Class II commodity.

- (3) Class 1 liquid oxidizers contained in 5 gal (18.9 L) or smaller plastic containers shall be designated as a Class I commodity.
- (4) Class 1 liquid oxidizers contained in plastic containers larger than 5 gal (18.9 L) shall be designated as a Class II commodity.
- (5) Class 1 solid oxidizers contained in 1 gal (3.8 L) or smaller plastic containers shall be designated as a Class IV commodity.
- (6) Class 1 solid oxidizers contained in plastic containers larger than 1 gal (3.8 L) shall be designated as an unexpanded plastic commodity.

15.3.2.2.4 Class 1 Detached Storage.

15.3.2.2.4.1 To be considered detached, a building for storage of Class 1 oxidizers shall be separated from the following:

- (1) Flammable or combustible liquid storage
- (2) Flammable gas storage
- (3) Combustible material in the open
- (4) Any building, passenger railroad, public highway, or other tanks

15.3.2.2.4.2 The minimum separation distance shall be 25 ft (7.6 m).

15.3.2.3 Class 2 Oxidizers.

15.3.2.3.1 Paragraph 15.3.2.3 shall apply to Class 2 oxidizers where stored in quantities in excess of the MAQ permitted in control areas.

15.3.2.3.2 Storage Arrangements of Class 2 Oxidizers. Class 2 oxidizers shall be permitted to be separated from ordinary combustible and incompatible materials by a solid noncombustible barrier or by a horizontal distance in accordance with Table 15.3.2.3.2.3(a) when stored in detached, unprotected buildings in accordance with the building code, or in accordance with Table 15.3.2.3.2.3(b).

15.3.2.3.2.1 The storage of Class 2 oxidizers shall be detached unless in a control area or at the appropriate protection level.

15.3.2.3.2.2 Walls shall have a fire resistance rating as required by the building code.

15.3.2.3.2.3 Storage of Class 2 Oxidizers. Storage of Class 2 oxidizers shall be in accordance with Table 15.3.2.3.2.3(a) when stored in nonsprinklered or detached, unprotected buildings or in accordance with Table 15.3.2.3.2.3(b) when stored in sprinklered buildings.

15.3.2.3.2.4 For Class 2 oxidizers stored in nonsprinklered buildings, the minimum aisle width shall be equal to the pile height.

15.3.2.3.2.5 For Class 2 oxidizers stored in sprinklered buildings, the minimum aisle width shall be equal to the pile height, but the aisle width shall be not less than 4 ft (1.2 m) and is not required to be greater than 8 ft (2.4 m).

15.3.2.3.2.6 For protection-level storage or detached storage under 4500 lb (2041 kg), there shall be no minimum separation distance between the pile and any wall.

15.3.2.3.2.7* The building limit shall be permitted to be four times the quantities shown in Table 15.3.2.3.2.3(b) for protection level storage if noncombustible containers are used and

Table 15.3.2.2.2(A)(a) Storage of Class 1 Oxidizers in a Nonsprinklered or Detached Unprotected Building

Storage Configurations and Allowable Distances	Detached Storage	
	U.S. Units	Metric Units
Building limit	NL	NL
Pile limit	20 tons	18 met ton
Storage limit	8 ft	2.4 m
Pile width	16 ft	4.9 m
Maximum distance from any container to an aisle	8 ft	2.4 m
Distance to next pile	See 15.3.2.2.2.2(C).	See 15.3.2.2.2.2(C).
Distance to wall*	4 ft	1.2 m
Distance to incompatible materials and combustible commodities	NP	NP

NL: Not limited. NP: Not permitted.

*See 15.3.2.2.2.2(D).

Table 15.3.2.2.2(A)(b) Storage of Class 1 Oxidizers in a Sprinklered Building

Storage Configurations and Allowable Distances	U.S. Units	Metric Units
	Building limit	NL
Pile limit	200 tons	181 met ton
Storage height	20 ft	6.1 m
Pile width	24 ft	7.3 m
Maximum distance from any container to an aisle	12 ft	3.7 m
Distance to next pile	See 15.3.2.2.2.2(C).	See 15.3.2.2.2.2(C).
Distance to wall*	2 ft	0.6 m
Distance to incompatible materials and combustible commodities greater than NFPA 13 Class III	8 ft	2.4 m

NL: Not limited.

Note: If the storage is to be considered sprinklered, see Section 5.3.

*See 15.3.2.2.2.2(D).

▲ Table 15.3.2.3.2.3(a) Storage of Class 2 Oxidizers in a Nonsprinklered or Detached Unprotected Building

Storage Configurations and Allowable Distances	Control Area Storage		Protection Level Storage		Detached Storage	
	U.S. Units	Metric Units	U.S. Units	Metric Units	U.S. Units	Metric Units
Building limit	2,250 lb	1,022 kg	9,000 lb	4,086 kg	100,000 lb	45,400 kg
Pile limit					20,000 lb	9,080 kg
Storage height	6 ft	1.8 m	8 ft	2.4 m	8 ft	2.4 m
Pile width	8 ft	2.4 m	12 ft	3.7 m	16 ft	4.9 m
Maximum distance from any container to an aisle	4 ft	1.2 m	6 ft	1.8 m	8 ft	2.4 m
Distance to next pile*						
Distance to wall	4 ft	1.2 m	4 ft	1.2 m	4 ft	1.2 m
Distance to incompatible materials and combustible commodities	12 ft	3.7 m	NP	NP	NP	NP

NP: Not permitted.

*See 15.3.2.3.2.4.

▲ Table 15.3.2.3.2.3(b) Storage of Class 2 Oxidizers in a Sprinklered Building

Storage Configurations and Allowable Distances	Control Area Storage		Protection Level Storage		Detached Storage	
	U.S. Units	Metric Units	U.S. Units	Metric Units	U.S. Units	Metric Units
Building limit	MAQ	MAQ	2000 tons	1814 met ton	NL	NL
Pile limit	NA	NA	100 tons	91 met ton	200 tons	181 met ton
Storage height ^a						
Pile width	16 ft	4.9 m	25 ft	7.6 m	25 ft	7.6 m
Maximum distance from any container to an aisle	8 ft	2.4 m	12 ft	3.7 m	12 ft	3.7 m
Distance to next pile ^b						
Distance to wall ^c	2 ft	0.6 m	2 ft	0.6 m	2 ft	0.6 m
Distance to incompatible materials and combustible commodities	12 ft	3.7 m	NP	NP	NP	NP

MAQ: Maximum allowable quantity. NL: Not limited. NA: Not applicable. NP: Not permitted.

Note: If the storage is considered to be sprinklered, see 15.3.2.3.4.

^aSee 15.3.2.3.2.10(A) and Table 15.3.2.3.2.10(B).

^bSee 15.3.2.3.2.5.

^cSee 15.3.2.3.2.6.

buildings are of Type I or Type II construction as specified in the building code.

15.3.2.3.2.8 Storage in glass carboys shall not be more than two carboys high.

15.3.2.3.2.9 Basement Storage.

(A) Storage in basements shall be prohibited.

(B) Where the oxidizer is stored in stationary tanks, storage in basements shall be permitted.

15.3.2.3.2.10 Maximum Height of Storage.

(A) Maximum storage height for nonsprinklered buildings shall be in accordance with Table 15.3.2.3.2.3(a).

(B) Maximum storage height for sprinklered buildings shall be in accordance with Table 15.3.2.3.2.10(B).

15.3.2.3.3 Building Construction.

15.3.2.3.3.1 Construction materials that can come into contact with oxidizers shall be noncombustible.

▲ Table 15.3.2.3.2.10(B) Ceiling Sprinkler Protection for Class 2 Oxidizers in Palletized or Bulk and Rack Storage Areas

Type of Storage	Ceiling Sprinklers				Area of Application		In-Rack Sprinklers
	Storage Height		Density		ft ²	m ²	
	ft	m	gpm/ft ²	L/min/m ²			
Palletized or bulk	8	2.4	0.20	8	3750	348	—
Palletized or bulk	12	3.7	0.35	14	3750	348	—
Rack	12	3.7	0.20	8	3750	348	One line above each level of storage, except the top level
Rack	16	4.9	0.30	12	2000	186	One line above each level of storage, except the top level

15.3.2.3.3.2 All construction materials used in stories or basements below the storage of liquid oxidizers shall be noncombustible.

15.3.2.3.4 Sprinkler Protection.

15.3.2.3.4.1 Sprinkler protection for Class 2 oxidizers shall be designed in accordance with Table 15.3.2.3.2.10(B).

15.3.2.3.4.2 Ceiling sprinklers shall be high-temperature sprinklers.

15.3.2.3.4.3 Storage Protection with In-Rack Sprinklers.

(A) In-rack sprinklers shall be quick-response sprinklers with an ordinary-temperature rating and have a K-factor of not less than $K = 8.0$.

(B) In-rack sprinklers shall be designed to provide 25 psi (172 kPa) for the six most hydraulically remote sprinklers on each level.

(C) The in-rack sprinklers shall be 8 ft to 10 ft (2.4 m to 3.0 m) spacings in the longitudinal flue space at the intersection of the transverse flue spaces.

15.3.2.3.5 Detached Storage.

15.3.2.3.5.1 To be considered detached, a building for storage of Class 2 oxidizers shall be separated from the following:

- (1) Flammable or combustible liquid storage
- (2) Flammable gas storage
- (3) Combustible material in the open
- (4) Any building, passenger railroad, public highway, or other tanks

15.3.2.3.5.2 The minimum separation distance shall be in accordance with *NFPA 5000*.

15.3.2.4 Class 3 Oxidizers.

15.3.2.4.1 Paragraph 15.3.2.4 shall apply to Class 3 oxidizers where stored in quantities in excess of the MAQ permitted in control areas.

▲ 15.3.2.4.2 Type of Storage. The storage of Class 3 oxidizers shall be **detached unless** in a control area or at the appropriate protection level.

15.3.2.4.3 Class 3 oxidizer storage shall be located on the ground floor only.

15.3.2.4.4 Protection level walls shall have a fire resistance rating as required by the building code.

15.3.2.4.5 Storage of Class 3 Oxidizers. Storage of Class 3 oxidizers shall be in accordance with Table 15.3.2.4.5(a) when stored in nonsprinklered or detached unprotected buildings or in accordance with Table 15.3.2.4.5(b) when stored in sprinklered buildings.

15.3.2.4.6 For Class 3 oxidizers stored in nonsprinklered buildings, the minimum aisle width shall be equal to the storage height, but the aisle width shall be not less than 4 ft (1.2 m) and **is not required to be greater than 8 ft (2.4 m)**.

15.3.2.4.7 For protection-level storage or detached storage, no minimum separation distance shall be required between oxidizer storage of less than 2700 lb (1225 kg) (total weight in the storage area) and any wall.

▲ Table 15.3.2.4.5(a) Storage of Class 3 Oxidizers in a Nonsprinklered or Detached Unprotected Building

Storage Limit	U.S. Units	Metric Units
Building limit	40,000 lb	18,160 kg
Pile limit	10,000 lb	4,540 kg
Storage height	6 ft	1.8 m
Pile width	12 ft	3.7 m
Maximum distance from any container to an aisle	8 ft	2.4 m
Distance to next pile*		
Distance to wall	4 ft	1.2 m
Distance to incompatible materials and combustible commodities	NP	NP

*See 15.3.2.4.6.

15.3.2.4.8 Class 3 oxidizers shall be permitted to be separated from ordinary combustible and incompatible materials by a solid noncombustible barrier or by a horizontal distance in accordance with Table 15.3.2.4.5(a) or Table 15.3.2.4.5(b).

15.3.2.4.9 Storage in glass carboys shall be one carboy high.

15.3.2.4.10 Bulk storage in open bins or piles shall not be permitted.

15.3.2.4.11 Maximum Height of Storage.

15.3.2.4.11.1 Maximum storage height for nonsprinklered buildings shall be in accordance with Table 15.3.2.4.5(a).

15.3.2.4.11.2 Maximum storage height for sprinklered buildings shall be in accordance with Table 15.3.2.4.13.1(B).

15.3.2.4.12 Building Construction.

15.3.2.4.12.1 Buildings used for the storage of Class 3 liquid oxidizers shall not have basements.

15.3.2.4.12.2 Construction materials that can come into contact with oxidizers shall be noncombustible.

15.3.2.4.12.3 Storage of Class 3 oxidizers in excess of 30 tons (27.2 metric tons) shall be in buildings of Type I or Type II construction, as specified in the building code.

15.3.2.4.12.4 If Class 3 oxidizers are stored in accordance with rack storage requirements in Table 15.3.2.4.13.4(B), they shall be permitted to be in buildings of construction Type I through Type IV, as specified in the building code.

15.3.2.4.13 Sprinkler Criteria for Class 3 Oxidizers.

15.3.2.4.13.1 Class 3 Oxidizers Less Than 2700 lb (1225 kg).

(A) Sprinkler design criteria for buildings that require sprinkler protection and contain total quantities of Class 3 oxidizers less than 2700 lb (1225 kg) shall be in accordance with the requirements of 15.3.2.4.13.1(B).

▲ (B) Facilities that require sprinkler protection and contain total quantities of Class 3 oxidizers greater than 200 lb (91 kg), but less than 2700 lb (1225 kg), shall follow the sprinkler design criteria in Table 15.3.2.4.13.1(B).

15.3.2.4.13.2 Ceiling sprinklers shall be high-temperature sprinklers.

Table 15.3.2.4.5(b) Storage of Class 3 Oxidizers in a Sprinklered Building

Storage Limit	Control Area Storage		Protection Level Storage		Detached Storage	
	U.S. Units	Metric Units	U.S. Units	Metric Units	U.S. Units	Metric Units
Building limit	MAQ	MAQ	1200 tons	1090 met ton	NL	NL
Pile limit	NA	NA	30 tons	27 met ton	100 tons	91 met ton
Storage height ^a						
Pile width	12 ft	3.7 m	16 ft	4.9 m	20 ft	6.1 m
Maximum distance from any container to an aisle	8 ft	2.4 m	10 ft	3 m	10 ft	3 m
Distance to next pile ^b						
Distance to wall ^c	2 ft	0.6 m	2 ft	0.6 m	2 ft	0.6 m
Distance to incompatible materials and combustible commodities	12 ft	3.7 m	NP	NP	NP	NP

MAQ: Maximum allowable quantity. NA: Not applicable. NP: Not permitted. NL: Not limited.

Note: If the storage is considered to be sprinklered, see the sprinkler system design requirements of 15.3.2.4.

^aSee 15.3.2.4.11, Table 15.3.2.4.13.1(B), and Table 15.3.2.4.13.4(B).

^bSee Table 15.3.2.4.13.1(b) and Table 15.3.2.4.13.4(b).

^cSee 15.3.2.4.7.

Table 15.3.2.4.13.1(B) Sprinkler Protection of Class 3 Oxidizers Stored in Total Quantities Greater Than 200 lb (91 kg) but Less Than 2700 lb (1225 kg)

Storage Parameters	Shelf	Bulk or Pile	Bulk or Pile	Rack
Maximum storage height	6 ft (1.8 m)	5 ft (1.5 m)	10 ft (3 m)	10 ft (3 m)
Maximum ceiling height	25 ft (7.6 m)	25 ft (7.6 m)	25 ft (7.6 m)	NA
Aisles — pile separation	4 ft (1.2 m) min. aisles	4 ft (1.2 m) min. aisles	8 ft (2.4 m) min. aisles	8 ft (2.4 m) min. aisles
Ceiling design criteria	0.45 gpm/ft ² /2000 ft ²	0.35 gpm/ft ² /or 5000 ft ² or 0.6 gpm/2000 ft ²	0.65 gpm/ft ² /5000 ft ²	0.35 gpm/ft ² /or 5000 ft ² or 0.6 gpm/ft ² /2000 ft ²
In-rack sprinklers	NP	NP	NA	See 15.3.2.4.13.3.
Hose stream demand	500 gpm	500 gpm	500 gpm	500 gpm
Duration	120 minutes	120 minutes	120 minutes	120 minutes

For SI units, 1 gal = 3.79 L. NA: Not applicable. NP: Not permitted.

15.3.2.4.13.3 In-Rack Sprinkler Criteria.

(A) Where required by Table 15.3.2.4.13.1(B), in-rack sprinkler protection shall be as follows:

- (1) In-rack sprinklers shall be installed above every level of oxidizer storage.
- (2) In-rack sprinklers shall be spaced at maximum 4 ft (1.2 m) intervals to provide one sprinkler in each flue space.
- (3) In-rack sprinklers shall be quick-response sprinklers with an ordinary-temperature rating and have a K-factor of not less than K = 8.0.
- (4) In-rack sprinklers shall be designed to provide 25 psi (172 kPa) for the six most hydraulically remote sprinklers on each level.

(B) Class 3 oxidizers in racks meeting the requirements of 15.3.2.4.13.1(B) shall be permitted to be protected in accordance with 15.3.2.4.13.3.

15.3.2.4.13.4 Class 3 Oxidizers Greater Than or Equal to 2700 lb (1225 kg).

(A) Facilities containing total quantities of Class 3 oxidizers equal to or greater than the threshold limits of 15.3.2.4.13.4 shall be protected in accordance with the requirements of 15.3.2.4.13.5(B).

(B) The sprinkler protection required by 15.3.2.4.13.4 shall be in accordance with Table 15.3.2.4.13.4(B).

15.3.2.4.13.5 Special In-Rack Sprinkler Protection for Class 3 Oxidizers Stored in Total Quantities Greater Than or Equal to 2700 lb (1225 kg).

(A) Where required by Table 15.3.2.4.13.4(B), special in-rack sprinkler protection, which is required by 15.3.2.4.13.5(L), shall be as shown in Figure 15.3.2.4.13.5(A).

(B) Racks shall be arranged in accordance with 15.3.2.4.13.5(C) through 15.3.2.4.13.5(K).

(C) Racks shall be of steel construction.

(D) Racks shall have vertical supports spaced no more than 10 ft (3.1 m) apart.

(E) Horizontal rack members shall be spaced not more than 6 ft (1.8 m) apart vertically.

(F) Display or storage shall be limited in height to two protected tiers.

(G) Horizontal barriers constructed of plywood at least 3/8 in. (9.5 mm) thick shall be provided above each level of oxidizing material storage, and the following criteria also shall be met:

Table 15.3.2.4.13.4(B) Sprinkler Protection of Class 3 Oxidizers Stored in Total Quantities of Greater Than or Equal to 2700 lb (1225 kg)

Storage Parameters	Bulk or Pile	Bulk or Pile	Rack
Maximum storage height	5 ft (1.5 m)	10 ft (3 m)	10 ft (3 m)
Maximum ceiling height	25 ft (7.6 m)	25 ft (7.6 m)	NA
Aisles — pile separation	8 ft (2.4 m) min. aisles	8 ft (2.4 m) min. aisles	8 ft (2.4 m) min. aisles
Ceiling design criteria	0.35 gpm/ft ² /5000 ft ² (1.32 L/min/m ² /464.5 m ²)	0.65 gpm/ft ² /5000 ft ² (5.3 L/min/m ² /1000 m ²)	Predominant for other commodities but not less than ordinary hazard Group II
In-rack sprinklers	NP	NP	See 15.3.2.4.13.5(L)
Hose stream demand	500 gpm (1893 L/min)	500 gpm (1893 L/min)	500 gpm (1893 L/min)
Duration	120 minutes	120 minutes	120 minutes

NA: Not applicable.

NP: Not permitted.

(1) The barriers shall extend from rack face to rack face and shall be tight to the vertical barriers described in 15.3.2.4.13.5(H) and 15.3.2.4.13.5(I).

(2) The barriers shall be supported by horizontal rack members.

(H) Transverse vertical barriers constructed of plywood at least 3/8 in. (9.5 mm) thick shall be provided at the rack uprights extending from rack face to rack face.

(I) For double-row racks, longitudinal vertical barriers constructed of plywood at least 3/8 in. (9.5 mm) thick shall be provided at the rack uprights in the center of the rack.

(J) If intermediate shelves are used between the horizontal barriers, the shelves shall be constructed of open wire mesh or steel grating.

(K) Pallets, if used, shall be of the solid-deck type.

(L) In-rack automatic sprinklers shall be provided under each horizontal barrier and arranged in accordance with 15.3.2.4.13.5(M) through 15.3.2.4.13.5(T).

(M) For double-row racks, two lines of in-rack sprinklers shall be provided between the face of the rack and the longitudinal vertical barrier located in the center of the rack.

(N) For single-row racks, two lines of in-rack sprinklers shall be provided between each rack face.

(O) Three in-rack sprinklers shall be provided on each in-rack sprinkler line as follows:

- (1) Two sprinklers on each line shall be spaced approximately 1 1/2 in. (38.1 mm) from each transverse vertical barrier.
- (2) One in-rack sprinkler on each in-rack sprinkler line shall be located approximately equidistant between the transverse vertical barriers.

(P) In-rack sprinklers shall be of the upright or pendent type, with the fusible element located no more than 6 in. (152.4 mm) from the horizontal barrier.

(Q) The stock shall be maintained at least 6 in. (152.4 mm) below the sprinkler deflector.

(R) In-rack sprinklers shall be K = 8.0, quick-response, ordinary-temperature-rated sprinklers.

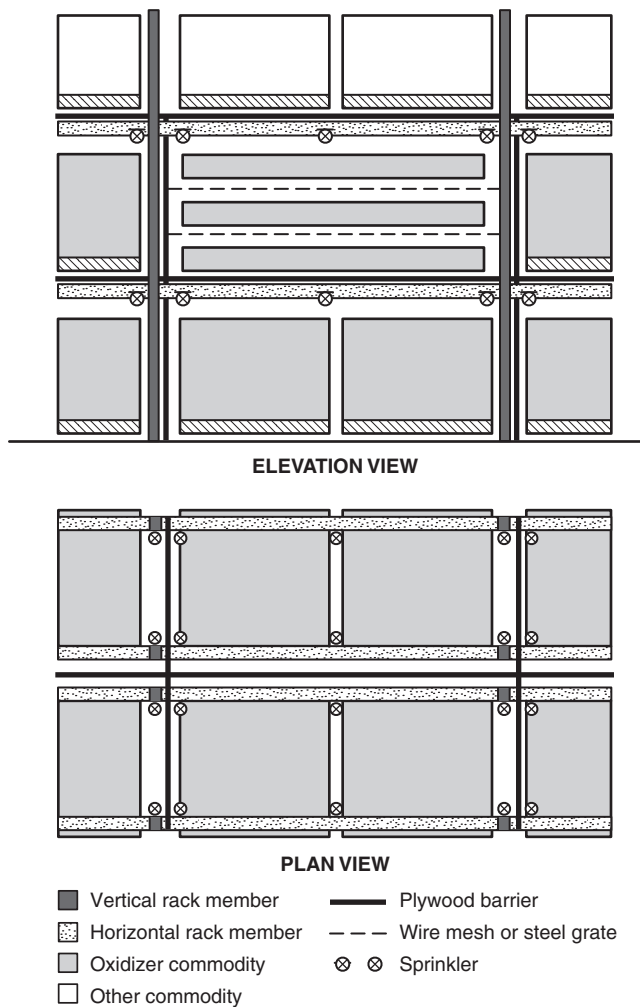


Figure 15.3.2.4.13.5(A) Arrangement of Barriers and In-Rack Sprinklers for Special Fire Protection Provisions.

(S) The in-rack sprinkler system shall be designed to supply 6 sprinklers on each line, with a total of 12 sprinklers operating at gauge pressure of 25 psi (172 kPa).

(T) The design of the in-rack sprinkler system shall be independent of, and shall not be required to be balanced with, ceiling sprinkler systems.

15.3.2.4.14 Detached Storage.

15.3.2.4.14.1 To be considered detached, a building for storage of Class 3 oxidizers shall be separated from the following:

- (1) Flammable or combustible liquid storage
- (2) Flammable gas storage
- (3) Combustible material in the open
- (4) Any building, passenger railroad, public highway, or other tanks

15.3.2.4.14.2 The minimum separation distance shall be in accordance with the building code.

15.3.2.5 Class 4 Oxidizers.

15.3.2.5.1 Paragraph 15.3.2.5 shall apply to Class 4 oxidizers where stored in quantities in excess of the MAQ permitted in control areas.

15.3.2.5.2 Outdoor container storage shall meet the requirements of nonsprinklered buildings.

15.3.2.5.3 Storage Arrangements.

15.3.2.5.3.1 The storage of Class 4 oxidizers shall be detached.

15.3.2.5.3.2 Storage in glass carboys shall be one carboy high.

15.3.2.5.3.3 Storage in drums, containers, or cases shall not exceed the limits outlined in Table 15.3.2.5.3.3.

15.3.2.5.3.4 Bulk storage in piles or fixed bins shall not be permitted.

15.3.2.5.4 Building Construction and Location.

15.3.2.5.4.1 Buildings shall be constructed as one story without basement.

15.3.2.5.4.2 Construction materials that could come into contact with oxidizers shall be noncombustible.

15.3.2.5.4.3 Storage areas shall be provided with means to vent fumes in an emergency.

15.3.2.5.4.4 A storage building or storage tank shall be located not less than the minimum distance provided in Table 15.3.2.5.4.4 from the following:

- (1) Flammable liquid storage
- (2) Combustible material in the open
- (3) Any inhabited building, passenger railroad, public highway, property line, or tank other than oxidizer storage

15.3.2.5.4.5* Where tanks are not separated from each other by 10 percent of the distance specified in Table 15.3.2.5.4.4 for the largest tank, the total contents of all tanks shall be used when applying Table 15.3.2.5.4.4.

15.3.2.5.4.6 Sprinkler Protection.

(A) Sprinkler protection for Class 4 oxidizers shall be installed on a deluge sprinkler system to provide water density of 0.35 gpm/ft² (14.4 L/min/m²) over the entire storage area.

(B) Sprinkler protection shall be installed in accordance with NFPA 13.

15.3.3 Floors. Floors shall be in accordance with 6.2.1.10.

15.3.4 Detached Storage. Detached storage shall be provided for oxidizer solids or liquids when required by 15.3.2 and 6.2.2.2, 6.2.3.4, 6.2.4.4, or 6.2.4.5.

15.3.5 Special Requirements. This subsection contains specific requirements not found in Chapter 6.

15.3.5.1 Application for Mercantile, Storage, or Industrial Occupancies. Section 15.3.5 applies to the display and storage of Class 1 through Class 3 oxidizers in mercantile, storage, or industrial occupancies where the general public has access to the materials for sale and also applies to the storage of additional oxidizing materials in such occupancies in areas that are not accessible to the public.

15.3.5.2 General Requirements. Oxidizing materials that are displayed or stored in areas accessible to the general public shall meet the requirements of 15.3.5.2.1 through 15.3.5.2.13.2.

15.3.5.2.1* Oxidizing materials shall be separated from ordinary combustible and incompatible materials by a solid noncombustible barrier or by a horizontal distance of not less than 4 ft (1.2 m).

15.3.5.2.1.1 Ordinary combustibles shall not include approved packaging materials, pallets, or other dunnage used for the oxidizers.

15.3.5.2.1.2 Separation from ordinary combustible materials shall not be required for Class 1 oxidizers.

15.3.5.2.2 Solid oxidizing materials shall not be displayed directly beneath liquids.

Δ Table 15.3.2.5.3.3 Storage of Class 4 Oxidizers in Drums, Containers, and Cases in a Sprinklered Building

Storage Configurations and Quantities	U.S. Units	Metric Units
Piles		
Length	10 ft	3.1 m
Width	4 ft	1.2 m
Height	8 ft	2.4 m
Distance to next pile	8 ft	2.4 m
Quantity limit per building	NL	NL

NL: Not limited.

Table 15.3.2.5.4.4 Separation of Buildings from Tanks Containing Class 4 Oxidizers

Weight of Class 4 Oxidizer		Distance	
lb	kg	ft	m
10–100	4.5–45.4	75	23
101–500	45.4–227	100	30
501–1,000	227–454	125	38
1,001–3,000	454–1,361	200	61
3,001–5,000	1,361–2,268	300	91
5,001–10,000	2,268–4,536	400	122
> 10,000	> 4,536	Subject to approval by the AHJ	

15.3.5.2.3 For sprinklered mercantile occupancies and storage occupancies, storage heights and sprinkler protection criteria shall be in accordance with 15.3.2.2 through 15.3.3.

15.3.5.2.4 Storage and display of solids shall not exceed 200 lb/ft² (978 kg/m²) of floor area actually occupied by solid merchandise.

15.3.5.2.5 Storage and display of liquids shall not exceed 20 gal/ft² (76 L/m²) of floor area actually occupied by liquid merchandise.

15.3.5.2.6 Racks and shelves used for storage or display shall be of substantial construction and adequately braced and anchored.

15.3.5.2.7 Containers shall be approved for their intended use.

15.3.5.2.8 Individual containers in mercantile occupancies shall not exceed 100 lb (45.4 kg) capacity for solids or 10 gal (38 L) capacity for liquids.

15.3.5.2.9 Aisles 4 ft (1.2 m) in width shall be maintained on three sides of the storage or display area.

15.3.5.2.10 Hazard identification signs shall be provided in accordance with NFPA 1.

15.3.5.2.11 Storage Arrangements in Nonsprinklered Mercantile, Storage, or Industrial Occupancies.

15.3.5.2.11.1 Storage and display of Class 2 and Class 3 oxidizing materials shall extend not higher than 6 ft (1.8 m) from the floor to the top of the uppermost container.

15.3.5.2.11.2 The storage and display of Class 2 and Class 3 oxidizers shall not exceed 4 ft (1.2 m) in depth.

15.3.5.2.12 Containers. Individual containers less than 5 gal (19 L), or less than 25 lb (11 kg), shall be stored or displayed on pallets, racks, or shelves.

15.3.5.2.13 Quantity Limitations.

15.3.5.2.13.1 The quantity of oxidizing materials permitted in a mercantile, storage, or industrial occupancy shall not exceed the quantities given in Table 5.2.1.5.3(a) for either a nonsprinklered or sprinklered area, whichever is applicable.

15.3.5.2.13.2 Facilities that require sprinkler protection having total quantities of Class 3 oxidizers greater than 200 lb (91 kg), but less than 2700 lb (1225 kg), shall comply with 15.3.2.4.13.1(B).

15.4 Outdoor Storage.

15.4.1 Exposures. Outdoor storage of oxidizer solids or liquids shall be separated from exposure hazards in accordance with 15.4.1.

15.4.1.1 Clearance from Combustibles. Clearance from combustible materials shall be in accordance with 6.2.7.1.

15.4.1.2 Location. Outdoor storage of oxidizer solids or liquids shall not be within 20 ft (6.1 m) of property lines, streets, alleys, public ways, means of egress to a public way, or buildings not used exclusively for the storage, distribution, or manufacturing of such material, except as provided in 15.4.1.3.

15.4.1.3 Distance Reduction. An unpierced 2-hour fire-resistive wall extending not less than 30 in. (762 mm) above

and to the side of the storage area shall be permitted in lieu of the distance specified in 15.4.1.2.

15.4.2 Weather Protection. When provided, weather protection shall be in accordance with 5.1.2 and 6.2.7.2.

15.4.3 Special Requirements. This subsection contains specific requirements not found in Chapter 6.

15.4.3.1 The size of outside storage tanks for Class 1, Class 2, and Class 3 oxidizers shall not be limited by this code.

15.4.3.2 The size of outside storage tanks for Class 4 oxidizers shall be limited in accordance with this code.

15.5 General Requirements for Use.

15.5.1 Spill Control. Spill control shall be provided for oxidizer liquids in accordance with 6.3.1.4.

15.5.2 Drainage. When provided, drainage shall be in accordance with 6.3.1.4.2.10.

15.5.3 Secondary Containment. Secondary containment shall be provided for oxidizer solids or liquids in accordance with 6.3.1.4.2.

15.5.4 Ventilation. Ventilation shall be provided for Class 4 oxidizers in open containers in accordance with 6.3.2.1.3 and 6.3.2.2.2.

15.5.5 Fire Protection System. An automatic fire sprinkler system shall be provided in accordance with 6.3.2.1.1.

15.5.5.1 Portable Extinguishers.

15.5.5.1.1 Dry Chemical and CO₂ Extinguishers. The placement and use of carbon dioxide (CO₂) or dry chemical extinguishers containing ammonium compounds (Class A:B:C) shall be prohibited in areas where oxidizers that can release chlorine or bromine are stored.

15.5.5.1.2 Halon Extinguishers. Halon extinguishers shall not be used in areas where oxidizers are stored.

15.5.5.1.3 Halocarbon Clean Agent Extinguishers. Halocarbon clean agent extinguishers shall not be used in areas where oxidizers are stored, unless they have been tested to the satisfaction of the AHJ.

15.5.6 Explosion Control. The requirements of 6.3.2.1.4 shall not apply.

15.5.7 Emergency and Standby Power. Standby power shall be provided when required by 6.3.1.3.

15.5.8 Limit Controls. Limit controls shall be provided in accordance with 6.3.1.2.

15.5.9 Monitoring/Supervision. Supervision shall be provided in accordance with 6.3.1.8.

15.5.10 Alarms. A fire detection system shall be required in accordance with Section 6.2 and 15.6.2 for indoor use.

15.5.11 Clearance from Combustibles. Clearance from combustible materials shall be in accordance with 6.2.7.1.

15.5.12 Floors. Floors where oxidizer solids or liquids are dispensed or used in open systems shall be in accordance with 6.3.2.2.3.

15.5.13 System Design. System design shall be in accordance with 6.3.1.6.

15.5.14 Liquid Transfer. Liquid transfer shall be in accordance with 6.3.1.7.

15.6 Indoor Use.

15.6.1 Open Systems.

15.6.1.1 Ventilation. Ventilation shall be provided for Class 4 oxidizers in open containers in accordance with 6.3.2.2.2.

15.6.1.2 Explosion Control. The requirements of 6.3.2.1.4 shall not apply.

15.6.1.3 Spill Control, Drainage, and Containment. Secondary containment shall be provided for oxidizer liquids in accordance with 6.3.2.2.4.

15.6.2 Detection Systems. A fire detection system shall be required for indoor use.

15.6.3 Closed Systems.

15.6.3.1 Ventilation. The requirements of 6.3.2.3.2 shall not apply.

15.6.3.2 Explosion Control. The requirements of 6.3.2.1.4 shall not apply.

15.6.3.3 Spill Control, Drainage, and Containment. Spill control and secondary containment shall be provided for oxidizer liquids in accordance with 6.3.2.3.3.

15.7 Outdoor Use.

15.7.1 Open Systems.

15.7.1.1 Location. Outdoor use and dispensing shall be located in accordance with 6.3.3.1.1.

15.7.1.2 Spill Control, Drainage, and Containment. Spill control and secondary containment shall be provided for oxidizer liquids in accordance with 6.3.3.2.2.

15.7.1.3 Clearance from Combustibles. Clearance from combustible materials shall be in accordance with 6.3.3.1.2.

15.7.2 Closed Systems.

15.7.2.1 Location. Outdoor use and dispensing shall be located in accordance with 6.3.3.1.1.

15.7.2.2 Spill Control, Drainage, and Containment. Spill control and secondary containment shall be provided for liquids in accordance with 6.3.3.2.2.

15.7.2.3 Clearance from Combustibles. Clearance from combustible materials shall be provided in accordance with 6.3.3.1.2.

15.8 Handling. Handling of oxidizers in indoor and outdoor areas shall be in accordance with Section 15.8.

15.8.1 Handling. Handling shall be in accordance with 6.3.4.

Chapter 16 Reserved

Chapter 17 Pyrophoric Solids and Liquids

17.1 General. The requirements of this chapter shall apply to the storage, use, and handling of pyrophoric solids or liquids when the amount of pyrophoric solids or liquids exceeds the MAQ as set forth in Chapter 5. The storage, use, and handling of pyrophoric solids or liquids in any quantity shall also comply with the requirements of Chapters 1 through 4 and the applicable requirements of Chapters 5 through 10.

17.1.1 Construction Requirements. Buildings, or portions thereof, in which pyrophoric solids or liquids are stored, handled, or used shall be constructed in accordance with the building code.

17.2 General Requirements for Storage.

17.2.1 Spill Control. Spill control shall be provided for pyrophoric liquids in accordance with 6.2.1.9.2.

17.2.1.1* Liquid spills shall be directed away from tanks and containers.

17.2.2 Drainage. When provided, drainage shall be in accordance with 6.2.1.9.3.1.1.

17.2.3 Secondary Containment. Secondary containment shall be provided for pyrophoric liquids in accordance with 6.2.1.9.3.

17.2.3.1 Secondary containment shall be designed to prevent spilled liquids from accumulating under process vessels, storage tanks, and containers.

17.2.4 Ventilation. Ventilation shall be provided for open containers in accordance with 6.2.1.5.

17.2.5* Fire Protection Systems. An approved fire protection system shall be provided in accordance with 6.2.1.1.

17.2.6 Explosion Control. The requirements of 6.2.1.6 shall not apply.

17.2.7 Emergency and Standby Power. Standby power shall be provided when required by 6.2.1.8.

17.2.8 Limit Controls. Limit controls shall be provided when required by 6.2.1.7.

17.2.9 Monitoring/Supervision. Supervision shall be provided in accordance with 6.2.1.11.

17.3 Indoor Storage.

17.3.1 Storage Conditions/Arrangement. Storage arrangement shall be in accordance with 17.3.1.

17.3.2 Floors. Floors shall be in accordance with 6.2.1.10.

17.3.3 Detached Storage. The requirements of 6.2.2.2, 6.2.3.4, 6.2.4.4, or 6.2.4.5 shall not apply.

17.4 Outdoor Storage.

17.4.1 Exposures. Outdoor storage of pyrophoric solids or liquids shall be separated from exposure hazards in accordance with 17.4.1.

17.4.1.1 Clearance from Combustibles. Clearance from combustible materials shall be in accordance with 6.2.7.1.

17.4.1.2* Location. The separation of pyrophoric solids and liquids from buildings, property lines, streets, alleys, public ways, or means of egress to a public way shall be twice the separation required by NFPA 30 for an equivalent volume of Class I-B flammable liquid.

17.4.1.3 Distance Reduction. An unpierced 2-hour fire-resistant wall extending not less than 30 in. (762 mm) above and to the side of the storage area shall be permitted in lieu of the distance specified in 17.4.1.2.

17.4.2 Weather Protection. When provided, weather protection shall be in accordance with 5.1.2 and 6.2.7.2.

17.4.3 Special Requirements.

17.4.3.1* Storage Arrangement. The quantities, arrangement, and spacing for pyrophoric liquids and solids in tanks, portable tanks, and containers shall be in accordance with NFPA 30 as required for Class I-B flammable liquids.

17.5 General Requirements for Use.

17.5.1 Spill Control. Spill control shall be provided for pyrophoric liquids in accordance with 6.3.1.4. Spills shall be directed away from storage containers and equipment.

17.5.2 Drainage. When provided, drainage shall be in accordance with 6.3.1.4.2.10.

17.5.3 Secondary Containment. Secondary containment shall be provided for pyrophoric solids or liquids in accordance with 6.3.1.4.2.

17.5.4 Ventilation. The requirements of 6.3.2.1.3 and 6.3.2.2.2 shall not apply.

17.5.5 Fire Protection System. An automatic fire sprinkler system shall be provided in accordance with 6.3.2.1.1.

17.5.6 Explosion Control. The requirements of 6.3.2.1.4 shall not apply.

17.5.7 Emergency and Standby Power. Standby power shall be provided when required by 6.3.1.3.

17.5.8 Limit Controls. Limit controls shall be provided in accordance with 6.3.1.2.

17.5.9 Monitoring/Supervision. Supervision shall be provided in accordance with 6.3.1.8.

17.5.10 Clearance from Combustibles. Clearance from combustible materials shall be in accordance with 6.2.7.1.

17.5.11 Floors. Floors where pyrophoric solids or liquids are dispensed or used in open systems shall be in accordance with 6.3.2.2.3.

17.5.12 System Design. System design shall be in accordance with 6.3.1.6.

17.5.13 Liquid Transfer. Liquid transfer shall be in accordance with 6.3.1.7.

17.6 Indoor Use.

17.6.1 Open Systems.

17.6.1.1 Ventilation. The requirements of 6.3.2.2.2 shall not apply.

17.6.1.2 Explosion Control. The requirements of 6.3.2.1.4 shall not apply.

17.6.1.3* Spill Control, Drainage, and Containment. Secondary containment for areas used to contain pyrophoric liquids shall be designed to separate or drain spilled liquids from the area containing tanks and containers.

17.6.2 Closed Systems.

17.6.2.1 Ventilation. The requirements of 6.3.2.2.2 shall not apply.

17.6.2.2 Explosion Control. The requirements of 6.3.3.2.2 shall not apply.

17.6.2.3 Spill Control, Drainage, and Containment. Spill control and secondary containment shall be provided for pyrophoric liquids in accordance with 6.3.2.3.3.

17.6.2.3.1* Secondary containment for areas used to contain pyrophoric liquids shall be designed to separate or drain spilled liquids from the area containing tanks and containers.

17.7 Outdoor Use.

17.7.1 Open Systems.

17.7.1.1 Location. Outdoor use and dispensing shall be located in accordance with 6.3.3.1.1.

17.7.1.2* Spill Control, Drainage, and Containment. Secondary containment for areas used to contain pyrophoric liquids shall be designed to separate or drain spilled liquids from the area containing tanks and containers.

17.7.1.3 Clearance from Combustibles. Clearance from combustible materials shall be in accordance with 6.3.3.1.2.

17.7.2 Closed Systems.

17.7.2.1 Location. Outdoor use and dispensing shall be located in accordance with 6.3.3.1.1.

17.7.2.2 Spill Control, Drainage, and Containment. Spill control and secondary containment shall be provided for pyrophoric liquids in accordance with 6.3.3.3.2.

17.7.2.2.1* Secondary containment for areas used to contain pyrophoric liquids shall be designed to separate or drain spilled liquids from the area containing tanks and containers.

17.7.2.3 Clearance from Combustibles. Clearance from combustible materials shall be provided in accordance with 6.3.3.1.2.

17.8 Handling. Handling of pyrophoric liquids in indoor and outdoor areas shall be in accordance with Section 17.8.

17.8.1 Handling. Handling shall be in accordance with 6.3.4.

Chapter 18 Toxic or Highly Toxic Solids and Liquids

18.1 General. The requirements of this chapter shall apply to the storage, use, and handling of toxic or highly toxic solids or liquids when the amount of toxic or highly toxic solids or liquids exceeds the MAQ as set forth in Chapter 5. The storage, use, and handling of toxic or highly toxic solids or liquids in any quantity shall also comply with the requirements of Chapters 1 through 4 and the applicable requirements of Chapters 5 through 10.

18.1.1 Construction Requirements. Buildings, or portions thereof, in which toxic or highly toxic solids or liquids are stored, handled, or used shall be constructed in accordance with the building code.

18.2 General Requirements for Storage.

18.2.1 Spill Control. Spill control shall be provided for toxic or highly toxic liquids in accordance with 6.2.1.9.2.

18.2.2 Drainage. When provided, drainage shall be in accordance with 6.2.1.9.3.11.

18.2.3 Secondary Containment. Secondary containment shall be provided for toxic or highly toxic solids or liquids in accordance with 6.2.1.9.3.

18.2.4 Ventilation. Ventilation shall be provided for open containers of highly toxic solids or liquids in accordance with 6.2.1.5.

18.2.5 Treatment Systems. The storage area for highly toxic liquids that liberate highly toxic vapors in the event of a spill or other accidental discharge shall not be located outside of a building unless effective collection and treatment systems are provided.

18.2.5.1 The treatment system shall comply with 21.3.9.3 for highly toxic gases.

18.2.6 Fire Protection Systems. An automatic fire sprinkler system shall be provided in accordance with 6.2.1.1.

18.2.7 Explosion Control. The requirements of 6.2.1.6 shall not apply.

18.2.8 Emergency and Standby Power. Standby power shall be provided when required by 6.2.1.8.

18.2.9 Limit Controls. Limit controls shall be provided when required by 6.2.1.7.

18.2.10 Monitoring/Supervision. Supervision shall be provided in accordance with 6.2.1.11.

18.3 Indoor Storage.

18.3.1 Floors. Floors shall be in accordance with 6.2.1.10.

18.3.2 Detached Storage. The requirements of 6.2.2.2 shall not apply.

18.3.3 Special Requirements.

18.3.3.1 Highly toxic solids and liquids not stored in approved hazardous materials storage cabinets shall be isolated from other hazardous materials storage by a 1-hour-rated fire barrier.

18.4 Outdoor Storage.

18.4.1 Exposures. Outdoor storage of toxic or highly toxic solids or liquids shall be separated from exposure hazards in accordance with 18.4.1.

18.4.1.1 Clearance from Combustibles. Clearance from combustible materials shall be in accordance with 6.2.7.1.

18.4.1.2 Location. Outdoors storage of toxic or highly toxic solids or liquids shall not be within 20 ft (6.1 m) of property lines, streets, alleys, public ways, means of egress to a public way, or buildings not used exclusively for the storage, distribution, or manufacturing of such material, except as provided in 18.4.1.3.

18.4.1.3 Distance Reduction. An unpierced 2-hour fire-resistive wall extending not less than 30 in. (762 mm) above and to the side of the storage area shall be permitted in lieu of the distance specified in 18.4.1.2.

18.4.2 Weather Protection. Where provided, weather protection shall be in accordance with 5.1.2 and 6.2.7.2.

18.4.3 Special Requirements.

18.4.3.1 Fire-Extinguishing Systems. The outdoor storage area for highly toxic solids and liquids shall consist of fire-resistive containers or shall comply with one of the following:

- (1) The storage area shall be protected by an automatic, open head, deluge fire sprinkler system in accordance with NFPA 13.
- (2) Storage shall be located under a noncombustible weather protection structure in accordance with 18.4.2, with the canopied area protected by an automatic fire sprinkler system in accordance with NFPA 13.

18.4.3.2 Storage Arrangement.

18.4.3.2.1 Pile Size Limit. Highly toxic solids and liquids stored outdoors shall be separated into piles, each not larger than 2500 ft³ (70.8 m³).

18.4.3.2.2 Aisles. Aisle widths between piles shall not be less than one-half the height of the pile or 10 ft (3 m), whichever is greater.

18.4.3.3 Treatment System.

18.4.3.3.1 The storage area for highly toxic liquids that liberate highly toxic vapors in the event of a spill or other accidental discharge shall not be located outside of a building unless effective collection and treatment systems are provided.

18.4.3.3.2 The treatment system shall comply with the design requirements of Chapter 21 for highly toxic gases.

18.5 General Requirements for Use.

18.5.1 Spill Control. Spill control shall be provided for toxic or highly toxic liquids in accordance with 6.3.1.4.

18.5.2 Drainage. When provided, drainage shall be in accordance with 6.3.1.4.2.10.

18.5.3 Secondary Containment. Secondary containment shall be provided for toxic or highly toxic solids or liquids in accordance with 6.3.1.4.2.

18.5.4 Ventilation. Ventilation shall be provided for open containers of highly toxic solids or liquids in accordance with 6.3.2.1.3 and 6.3.2.2.2.

18.5.5 Treatment Systems. Exhaust scrubbers or other systems for processing vapors of highly toxic liquids shall be provided where a spill or accidental release of such liquids can be expected to release highly toxic vapors at normal temperature and pressure. Treatment systems and other processing systems shall be installed in accordance with the mechanical code adopted by the jurisdiction.

18.5.5.1 The treatment system shall comply with the design requirements of Chapter 21 for highly toxic gases.

18.5.6 Fire Protection System. An automatic fire sprinkler system shall be provided in accordance with 6.3.2.1.1.

18.5.7 Explosion Control. The requirements of 6.3.2.1.4 shall not apply.

18.5.8 Emergency and Standby Power. Standby power shall be provided when required by 6.3.1.3.

18.5.9 Limit Controls. Limit controls shall be provided in accordance with 6.3.1.2.

18.5.10 Monitoring/Supervision. Supervision shall be provided in accordance with 6.3.1.8.

18.5.11 Clearance from Combustibles. Clearance from combustible materials shall be in accordance with 6.2.7.1.

18.5.12 Floors. Floors where toxic or highly toxic solids or liquids are dispensed or used in open systems shall be in accordance with 6.3.2.2.3.

18.5.13 System Design. System design shall be in accordance with 6.3.1.6.

18.5.14 Liquid Transfer. Liquid transfer shall be in accordance with 6.3.1.7.

18.6 Indoor Use.

18.6.1 Open Systems.

18.6.1.1 Ventilation. Ventilation shall be provided in accordance with 6.3.2.3.2.

18.6.1.2 Explosion Control. The requirements of 6.3.2.1.4 shall not apply.

18.6.1.3 Spill Control, Drainage, and Containment. Secondary containment shall be provided for toxic or highly toxic liquids in accordance with 6.3.2.2.4.

18.6.2 Closed Systems.

18.6.2.1 Ventilation. Ventilation shall be provided in accordance with 6.3.2.3.2.

18.6.2.2 Explosion Control. The requirements of 6.3.2.1.4 shall not apply.

18.6.2.3 Spill Control, Drainage, and Containment. Spill control and secondary containment shall be provided for toxic or highly toxic liquids in accordance with 6.3.2.3.3.

18.7 Outdoor Use.

18.7.1 Open Systems.

18.7.1.1 Location. Outdoor use and dispensing shall be located in accordance with 6.3.3.1.1.

18.7.1.2 Spill Control, Drainage, and Containment. Spill control and secondary containment shall be provided for toxic or highly toxic liquids in accordance with 6.3.3.2.2.

18.7.1.3 Clearance from Combustibles. Clearance from combustible materials shall be in accordance with 6.3.3.1.2.

18.7.2 Closed Systems.

18.7.2.1 Location. Outdoor use and dispensing shall be located in accordance with 6.3.3.1.1.

18.7.2.2 Spill Control, Drainage, and Containment. Spill control and secondary containment shall be provided for toxic or highly toxic liquids in accordance with 6.3.3.3.2.

18.7.2.3 Clearance from Combustibles. Clearance from combustibles shall be provided in accordance with 6.3.3.1.2.

18.8 Handling. Handling of toxic or highly toxic solids or liquids in indoor and outdoor areas shall be in accordance with Section 18.8.

18.8.1 Handling. Handling shall be in accordance with 6.3.4.

Chapter 19 Unstable (Reactive) Solids and Liquids

19.1 General. The requirements of this chapter shall apply to the storage, use, and handling of unstable (reactive) solids or liquids when the amount of unstable (reactive) solids or liquids exceeds the MAQ as set forth in Chapter 5. The storage, use, and handling of unstable (reactive) solids or liquids in any quantity shall also comply with the requirements of Chapters 1 through 4 and the applicable requirements of Chapters 5 through 10.

19.1.1 Construction Requirements. Buildings, or portions thereof, in which unstable (reactive) solids or liquids are stored, handled, or used shall be constructed in accordance with the building code.

19.2 General Requirements for Storage.

19.2.1 Spill Control. Spill control shall be provided for unstable (reactive) liquids in accordance with 6.2.1.9.2.

19.2.2 Drainage. When provided, drainage shall be in accordance with 6.2.1.9.3.11.

19.2.3 Secondary Containment. Secondary containment shall be provided for unstable (reactive) solids or liquids in accordance with 6.2.1.9.3.

19.2.4 Ventilation. The requirements of 6.2.1.5 shall not apply.

19.2.5 Fire Protection Systems. An automatic fire sprinkler system shall be provided in accordance with 6.2.1.1.

19.2.6 Explosion Control. Explosion control shall be provided for Class 3 or 4 unstable (reactive) solids or liquids when required by 6.2.1.6.

19.2.7 Emergency and Standby Power. Standby power shall be provided when required by 6.2.1.8.

19.2.8 Limit Controls. Limit controls shall be provided when required by 6.2.1.7.

19.2.9 Monitoring/Supervision. Supervision shall be provided in accordance with 6.2.1.11.

19.2.10 Special Requirements. Unstable (reactive) materials that are required to be stored under refrigeration to prevent a hazardous reaction shall be stored under refrigeration in accordance with the manufacturer's recommendations.

19.3 Indoor Storage.

19.3.1 Floors. Floors shall be in accordance with 6.2.1.10.

19.3.2 Detached Storage. Detached storage shall be provided for Class 2, 3, or 4 unstable (reactive) solids or liquids when required by 6.2.2.2, 6.2.3.4, 6.2.4.4, or 6.2.4.5.

19.3.3 Special Requirements. Unstable (reactive) materials that are required to be stored under refrigeration to prevent a

hazardous reaction shall be stored under refrigeration in accordance with the manufacturer's recommendations.

19.4 Outdoor Storage.

19.4.1 Exposures. Outdoor storage of unstable (reactive) solids or liquids shall be separated from exposure hazards in accordance with 19.4.1.

19.4.1.1 Clearance from Combustibles. Clearance from combustible materials shall be in accordance with 6.2.7.1.

19.4.1.2 Location.

19.4.1.2.1 Nondeflagrating Material. Outdoor storage of (Class 1 or 2) (nondeflagrating) unstable (reactive) solids or liquids shall not be within 20 ft (6.1 m) of property lines, streets, alleys, public ways, means of egress to a public way, or buildings not used exclusively for the storage, distribution, or manufacturing of such material, except as provided in 19.4.1.3.

19.4.1.2.2 Deflagrating Material. The outdoor storage area for (Class 3 nondetonable) unstable (reactive) solids and liquids (that can deflagrate) shall not be within 75 ft (23 m) of buildings, property lines, streets, alleys, public ways, or means of egress to a public way.

19.4.1.2.3 Detonable Material. Outdoor storage of Class 3 detonable or Class 4 unstable (reactive) solids and liquids shall be located in accordance with the requirements of NFPA 495 for Division 1.1 Explosive Materials.

19.4.1.3 Distance Reduction. An unpierced 2-hour fire-resistive wall extending not less than 30 in. (762 mm) above and to the side of the storage area shall be permitted in lieu of the distance specified in 19.4.1.2.1.

19.4.1.3.1 Nondeflagrating Materials. An unpierced 2-hour fire-resistive wall extending not less than 30 in. (762 mm) above and to the side of the storage area shall be permitted in lieu of the distance specified in 19.4.1.2.1 for (Class 1 and Class 2) (nondeflagrating) materials.

19.4.2 Weather Protection. When provided, weather protection shall be in accordance with 5.1.2 and 6.2.7.2.

19.4.3 Special Requirements. Unstable (reactive) materials that are required to be stored under refrigeration to prevent a hazardous reaction shall be stored under refrigeration in accordance with the manufacturer's recommendations.

19.4.3.1 Storage Arrangement.

19.4.3.1.1 Pile Size Limit. Unstable (reactive) solids and liquids stored outdoors shall be separated into piles, each not larger than 1000 ft³ (28.3 m³).

19.4.3.1.2 Aisles. Aisle widths between piles shall not be less than one-half the height of the pile or 10 ft (3 m), whichever is greater.

19.5 General Requirements for Use.

19.5.1 Spill Control. Spill control shall be provided for unstable (reactive) liquids in accordance with 6.3.1.4.

19.5.2 Drainage. When provided, drainage shall be in accordance with 6.3.1.4.2.10.

19.5.3 Secondary Containment. Secondary containment shall be provided for unstable (reactive) solids or liquids in accordance with 6.3.1.4.2.

19.5.4 Ventilation. The requirements of 6.3.2.1.3 and 6.3.2.2.2 shall not apply.

19.5.5 Fire Protection System. An automatic fire sprinkler system shall be provided in accordance with 6.3.2.1.1.

19.5.6 Explosion Control. Explosion control shall be provided for Class 3 and Class 4 unstable (reactive) solids and liquids when required by 6.3.2.1.4.

19.5.7 Emergency and Standby Power. Standby power shall be provided when required by 6.3.1.3.

19.5.8 Limit Controls. Limit controls shall be provided in accordance with 6.3.1.2.

19.5.9 Monitoring/Supervision. Supervision shall be provided in accordance with 6.3.1.8.

19.5.10 Clearance from Combustibles. Clearance from combustible materials shall be in accordance with 6.2.7.1.

19.5.11 Floors. Floors where unstable (reactive) solids or liquids are dispensed or used in open systems shall be in accordance with 6.3.2.2.3.

19.5.12 System Design. System design shall be in accordance with 6.3.1.6.

19.5.13 Liquid Transfer. Liquid transfer shall be in accordance with 6.3.1.7.

19.5.14 Special Requirements. Unstable (reactive) materials that are required to be stored under refrigeration to prevent a hazardous reaction shall be stored under refrigeration in accordance with the manufacturer's recommendations.

19.6 Indoor Use.

19.6.1 Open Systems.

19.6.1.1 Ventilation. The requirements of 6.3.2.1.3 and 6.3.2.2.2 shall not apply.

19.6.1.2 Explosion Control. Explosion control shall be provided for Class 3 and Class 4 unstable (reactive) solids or liquids when required by 6.3.2.1.4.

19.6.1.3 Spill Control, Drainage, and Containment. Secondary containment shall be provided for unstable (reactive) liquids in accordance with 6.3.2.2.4.

19.6.1.4 Special Requirements. Unstable (reactive) materials that are required to be stored under refrigeration to prevent a hazardous reaction shall be stored under refrigeration in accordance with the manufacturer's recommendations.

19.6.2 Closed Systems.

19.6.2.1 Ventilation. The requirements of 6.3.2.1.3 and 6.3.2.2.2 shall not apply.

19.6.2.2 Explosion Control. Explosion control shall be provided for Class 3 and Class 4 unstable (reactive) solids or liquids when required by 6.3.2.1.4.

19.6.2.3 Spill Control, Drainage, and Containment. Spill control and secondary containment shall be provided for unstable (reactive) liquids in accordance with 6.3.2.3.3.

19.6.2.4 Special Requirements. Unstable (reactive) materials that are required to be stored under refrigeration to prevent a

hazardous reaction shall be stored under refrigeration in accordance with the manufacturer's recommendations.

19.7 Outdoor Use.

19.7.1 Open Systems.

19.7.1.1 Location. Outdoor use and dispensing shall be located in accordance with 6.3.3.1.1.

19.7.1.2 Spill Control, Drainage, and Containment. Spill control and secondary containment shall be provided for unstable (reactive) liquids in accordance with 6.3.3.2.2.

19.7.1.3 Clearance from Combustibles. Clearance from combustible materials shall be in accordance with 6.3.3.1.2.

19.7.1.4 Special Requirements. Unstable (reactive) materials that are required to be stored under refrigeration to prevent a hazardous reaction shall be stored under refrigeration in accordance with the manufacturer's recommendations.

19.7.2 Closed Systems.

19.7.2.1 Location. Outdoor use and dispensing shall be located in accordance with 6.3.3.1.1.

19.7.2.2 Spill Control, Drainage, and Containment. Spill control and secondary containment shall be provided for unstable (reactive) liquids in accordance with 6.3.3.2.2.

19.7.2.3 Clearance from Combustibles. Clearance from combustibles shall be provided in accordance with 6.3.3.1.2.

19.8 Handling. Handling of unstable (reactive) solids or liquids in indoor and outdoor areas shall be in accordance with Section 19.8.

19.8.1 Handling. Handling shall be in accordance with 6.3.4.

19.8.2 Special Requirements. Unstable (reactive) materials that are required to be stored under refrigeration to prevent a hazardous reaction shall be stored under refrigeration in accordance with the manufacturer's recommendations.

Chapter 20 Water-Reactive Solids and Liquids

20.1 General. The requirements of this chapter shall apply to the storage, use, and handling of water-reactive solids or liquids when the amount of water-reactive solids or liquids exceeds the MAQ as set forth in Chapter 5. The storage, use, and handling of water-reactive solids or liquids in any quantity shall also comply with the requirements of Chapters 1 through 4 and the applicable requirements of Chapters 5 through 10.

20.1.1 Construction Requirements. Buildings, or portions thereof, in which water-reactive solids or liquids are stored, handled, or used shall be constructed in accordance with the building code.

20.2 General Requirements for Storage.

20.2.1 Spill Control. Spill control shall be provided for water-reactive liquids in accordance with 6.2.1.9.2.

20.2.2 Drainage. When provided, drainage shall be in accordance with 6.2.1.9.3.11.

20.2.3 Secondary Containment. Secondary containment shall be provided for water-reactive solids or liquids in accordance with 6.2.1.9.3.

20.2.4 Ventilation. Ventilation shall be provided for open containers in accordance with 6.2.1.5.

20.2.5 Fire Protection Systems. An automatic fire sprinkler system shall be provided in accordance with 6.2.1.1.

20.2.6 Explosion Control. Explosion control shall be provided for Class 3 and Class 2, deflagrating water-reactives in accordance with 6.2.1.6.

20.2.7 Emergency and Standby Power. Standby power shall be provided when required by 6.2.1.8.

20.2.8 Limit Controls. Limit controls shall be provided when required by 6.2.1.7.

20.2.9 Monitoring/Supervision. Supervision shall be provided in accordance with 6.2.1.11.

20.3 Indoor Storage.

20.3.1 Floors. Floors shall be in accordance with 6.2.1.10.

20.3.2 Detached Storage. Detached storage shall be provided for Class 3 and Class 2, deflagrating water-reactive solids and liquids when required by 6.2.2.2, 6.2.3.4, 6.2.4.4, or 6.2.4.5.

20.4 Outdoor Storage.

20.4.1 Exposures. Outdoor storage of water-reactive solids or liquids shall be separated from exposure hazards in accordance with 20.4.1.

20.4.1.1 Clearance from Combustibles. Clearance from combustible materials shall be in accordance with 6.2.7.1.

20.4.1.2 Location. The outdoor storage area for Class 3 water-reactive solids and liquids shall not be within 75 ft (23 m) of buildings, property lines, streets, alleys, public ways, or means of egress to a public way.

20.4.1.2.1 Class 1 and 2 Materials. The outdoor storage area for Class 1 and Class 2 water-reactive solids and liquids shall not be within 20 ft (6.1 m) of buildings, property lines, streets, alleys, public ways, or means of egress to a public way, except as provided in 20.4.1.3.

20.4.1.3 Distance Reduction. An unpierced 2-hour fire-resistant wall extending not less than 30 in. (762 mm) above and to the side of the storage area shall be permitted in lieu of the distance specified in 20.4.1.2.

20.4.2 Weather Protection. When provided, weather protection shall be in accordance with 5.1.2 and 6.2.7.2.

20.4.3 Special Requirements.

20.4.3.1 Pile Size Limits. Pile sizes for water-reactive solids and liquids shall be limited as follows:

- (1) Class 3 water-reactive solids and liquids shall be limited to piles not greater than 100 ft³ (2.83 m³).
- (2) Class 1 or Class 2 water-reactive solids and liquids shall be limited to piles not greater than 1000 ft³ (28.3 m³).

20.4.3.2 Aisles. Aisle widths between piles shall not be less than one-half the height of the pile or 10 ft (3 m), whichever is greater.

20.5 General Requirements for Use.

20.5.1 Spill Control. Spill control shall be provided for water-reactive liquids in accordance with 6.3.1.4.

20.5.2 Drainage. When provided, drainage shall be in accordance with 6.3.1.4.2.10.

20.5.3 Secondary Containment. Secondary containment shall be provided for water-reactive solids or liquids in accordance with 6.3.1.4.2.

20.5.3.1 Secondary containment areas in outdoor areas subject to rainfall shall be designed with a means to prevent water from entering the area of containment or otherwise limited to prevent an uncontrolled reaction with water-reactive materials that might enter the area of containment.

20.5.4 Ventilation. Ventilation shall be provided for open containers in accordance with 6.3.2.1.3 and 6.3.2.2.2.

20.5.5 Fire Protection System. An automatic fire sprinkler system shall be provided in accordance with 6.3.2.1.4.

20.5.6 Explosion Control. Explosion control shall be provided for Class 3 and Class 2, deflagrating water-reactives in accordance with 6.3.2.1.4.

20.5.7 Emergency and Standby Power. Standby power shall be provided when required by 6.3.1.3.

20.5.8 Limit Controls. Limit controls shall be provided in accordance with 6.3.1.2.

20.5.9 Monitoring/Supervision. Supervision shall be provided in accordance with 6.3.1.8.

20.5.10 Clearance from Combustibles. Clearance from combustible materials shall be in accordance with 6.2.7.1.

20.5.11 Floors. Floors where water-reactive solids or liquids are dispensed or used in open systems shall be in accordance with 6.3.2.2.3.

20.5.12 System Design. System design shall be in accordance with 6.3.1.6.

20.5.13 Liquid Transfer. Liquid transfer shall be in accordance with 6.3.1.7.

20.6 Indoor Use.

20.6.1 Open Systems.

20.6.1.1 Ventilation. Ventilation shall be provided in accordance with 6.3.2.2.2.

20.6.1.2 Explosion Control. Explosion control shall be provided for Class 3 and Class 2, deflagrating water-reactives in accordance with 6.3.2.1.4.

20.6.1.3 Spill Control, Drainage, and Containment. Secondary containment shall be provided for water-reactive liquids in accordance with 6.3.2.2.4.

20.6.1.3.1* Secondary containment used for Class 2 or Class 3 water-reactive solids and liquids in outdoor areas subject to rainfall shall be designed to prevent water from accumulating in the area of containment.

20.6.2 Closed Systems.

20.6.2.1 Ventilation. The requirements of 6.3.2.3.2 shall not apply.

20.6.2.2 Explosion Control. Explosion control shall be provided for Class 3 and Class 2, deflagrating water-reactives in accordance with 6.3.2.1.4.

20.6.2.3 Spill Control, Drainage, and Containment. Spill control and secondary containment shall be provided for water-reactive liquids in accordance with 6.3.2.2.4.

20.6.2.3.1* Secondary containment used for Class 2 or Class 3 water-reactive solids and liquids in outdoor areas subject to rainfall shall be designed to prevent water from accumulating in the area of containment.

20.7 Outdoor Use.

20.7.1 Open Systems.

20.7.1.1 Location. Outdoor use and dispensing shall be located in accordance with 6.3.3.1.1.

20.7.1.2 Spill Control, Drainage, and Containment. Spill control and secondary containment shall be provided for water-reactive liquids in accordance with 6.3.3.1.2.

20.7.1.2.1* Secondary containment used for Class 2 or Class 3 water-reactive solids and liquids in outdoor areas subject to rainfall shall be designed to prevent water from accumulating in the area of containment.

20.7.1.3 Clearance from Combustibles. Clearance from combustible materials shall be in accordance with 6.3.3.1.2.

20.7.2 Closed Systems.

20.7.2.1 Location. Outdoor use and dispensing shall be located in accordance with 6.3.3.1.1.

20.7.2.2 Spill Control, Drainage, and Containment. Spill control and secondary containment shall be provided for water-reactive liquids in accordance with 6.3.3.3.2.

20.7.2.3 Clearance from Combustibles. Clearance from combustible material shall be provided in accordance with 6.3.3.1.2.

20.8 Handling. Handling of water-reactive solids or liquids in indoor and outdoor areas shall be in accordance with Section 20.8.

20.8.1 Handling. Handling shall be in accordance with 6.3.4.

Chapter 21 Storage, Use, and Handling of Compressed Gases and Cryogenic Fluids

21.1 General Provisions.

21.1.1 Applicability. This chapter shall apply to the installation, storage, use, and handling of compressed gases and cryogenic fluids in portable and stationary cylinders, containers, equipment, and tanks in all occupancies. [55:1.1.1]

21.1.1.1 The requirements in this chapter shall apply to users, producers, distributors, and others who are involved with the storage, use, or handling of compressed gases or cryogenic fluids. [55:1.3]

21.1.1.2 Specific Applications.

21.1.1.2.1 This chapter shall not apply to the following:

- (1)* Off-site transportation of [compressed gases or cryogenic fluids]
- (2) Storage, use, and handling of radioactive gases in accordance with NFPA 801

- (3)* Use and handling of medical compressed gases at health care facilities in accordance with NFPA 99
- (4) Systems consisting of cylinders of oxygen and cylinders of fuel gas used for welding and cutting in accordance with NFPA 51
- (5)* Flammable gases used as a vehicle fuel when stored on a vehicle
- (6)* Storage, use, and handling of liquefied and nonliquefied compressed gases in laboratory work areas that are in accordance with NFPA 45
- (7) Storage, use, and handling of liquefied petroleum gases in accordance with NFPA 58
- (8) Storage, use, and handling of compressed gases within closed-cycle refrigeration systems complying with the mechanical code
- (9) Liquefied natural gas (LNG) storage at utility plants under NFPA 59A
- (10) Compressed natural gas (CNG) and liquefied natural gas (LNG) utilized as a vehicle fuel in accordance with NFPA 52
- (11)* Compressed hydrogen gas (GH₂), or liquefied hydrogen gas (LH₂) generated, installed, stored, piped, used, or handled in accordance with NFPA 2 when there are no specific or applicable requirements in NFPA 55
- (12) Nonflammable mixtures of ethylene oxide with other chemicals
- (13) Ethylene oxide in chambers 10 scf (0.283 Nm³) or less in volume, or for containers holding 7.05 oz (200 g) of ethylene oxide or less
[55:1.1.2]

21.1.2 Hazardous Materials Classification.

21.1.2.1 Hazard Classification Pure Gases. Compressed gases and cryogenic fluids shall be classified according to hazard categories in accordance with Section 4.1.

21.1.2.2 Other Hazards. Although it is possible that there are other known hazards, the classification of such gases is not within the scope of this code and they shall be handled, stored, or used as an *other gas*. [55:5.1.2]

21.1.2.3 Mixtures. Mixtures shall be classified in accordance with the hazards of the mixture as a whole. [55:5.1.3]

21.1.2.4 Responsibility for Classification. Classification shall be performed by an approved organization, individual, or testing laboratory. [55:5.1.4]

21.1.2.5 Toxicity. The toxicity of gas mixtures shall be classified in accordance with CGA P-20, *Standard for the Classification of Toxic Gas Mixtures*, or by testing in accordance with the requirements of 29 CFR 1910.1000 or DOT 49 CFR 173 or ISO 10298, *Determination of toxicity of a gas or gas mixture*. [55:5.1.4.1]

21.1.2.6 Flammability of Gas Mixtures. For gas mixtures other than those containing ammonia and nonflammable gases, flammability of gas mixtures shall be classified in accordance with CGA P-23, *Standard for Categorizing Gas Mixtures Containing Flammable and Nonflammable Components*; or by physical testing in accordance with ASTM E681, *Standard Test Method for Concentration Limits of Flammability of Chemicals (Vapors and Gases)*; or ISO 10156, *Gases and gas mixtures — determination of fire potential and oxidizing ability for the selection of cylinder valve outlets*. [55:5.1.4.2]

21.2 Building-Related Controls.

21.2.1 General.

21.2.1.1 Occupancy. Occupancies containing compressed gases and cryogenic fluids shall comply with this chapter in addition to other applicable requirements of this code. [55:6.1.1.1]

21.2.1.1.1 Occupancy Classification. The occupancy of a building or structure, or portion of a building or structure, shall be classified in accordance with 1.1.1.1. [55:6.1.1.2]

21.2.1.2 Flammable and Oxidizing Gases. [55:6.3.1.6]

21.2.1.2.1 Flammable and oxidizing gases shall not be stored or used in other than industrial and storage occupancies. [55:6.3.1.6.1]

21.2.1.2.2 Cylinders, containers, or tanks not exceeding 250 scf (7.1 Nm³) content at normal temperature and pressure (NTP) and used for maintenance purposes, patient care, or operation of equipment shall be permitted. [55:6.3.1.6.2]

21.2.1.3 Toxic and Highly Toxic Compressed Gases. Except for containers or cylinders not exceeding 20 scf (0.6 Nm³) content at NTP stored or used within gas cabinets or exhausted enclosures of educational occupancies, toxic or highly toxic compressed gases shall not be stored or used in other than industrial and storage occupancies. [55:6.3.1.7]

21.2.2 Control Areas.

21.2.2.1 Construction. Control areas shall be separated from each other by fire barriers in accordance with Table 5.2.2.1. [55:6.2.1]

21.2.2.2 Number. The number of control areas in buildings or portions of buildings shall be in accordance with 5.2.2.1.

Δ 21.2.2.3 Quantities Less than or Equal to the MAQ. Building-related controls in areas with compressed gases or cryogenic fluids stored or used within an indoor control area in quantities less than or equal to those shown in Table 5.2.1.2.1 shall be in accordance with 21.2.1.2, 21.2.1.3, 21.2.7, 21.2.8, 21.2.12, 21.2.15, and 21.2.16.

21.2.3 Occupancy Protection Levels.

21.2.3.1 Quantity Thresholds for Compressed Gases and Cryogenic Fluids Requiring Special Provisions. Where the quantities of compressed gases or cryogenic fluids stored or used within an indoor control area exceed those shown in Table 5.2.1.1.3 and Table 5.2.1.2.1, the area shall meet the requirements for Protection Levels 1 through 5 in accordance with the building code, based on the requirements of 21.2.3.2. [55:6.3.1.1]

21.2.3.1.1 Quantities Greater than the MAQ. Building-related controls in areas with compressed gases or cryogenic fluids stored or used within an indoor area in quantities greater than those shown in Table 5.2.1.1.3 and Table 5.2.1.2.1 shall be in accordance with Section 21.2.

21.2.3.1.2 Incompatible Materials. When the classification of materials in individual containers requires the area to be placed in more than one protection level, the separation of protection levels shall not be required, provided the area is constructed to meet the requirements of the most restrictive

protection level and that the incompatible materials are separated as required by 21.3.1.7.2. [55:6.3.1.4]

21.2.3.1.3 Multiple Hazards. Where a compressed gas or cryogenic fluid has multiple hazards, all hazards shall be addressed and controlled in accordance with the provisions for the protection level for which the threshold quantity is exceeded. [55:6.3.1.5]

21.2.3.2 Classification of Protection Levels. The protection level required shall be based on the hazard class of the material involved as indicated in 21.2.3.2.1 through 21.2.3.2.4. [55:6.3.2]

21.2.3.2.1 Protection Level 1. Occupancies used for the storage or use of unstable reactive Class 4 and unstable reactive Class 3 detonable compressed gases in quantities that exceed the quantity thresholds for gases requiring special provisions shall be classified Protection Level 1. [55:6.3.2.1]

21.2.3.2.2 Protection Level 2. Occupancies used for the storage or use of flammable, pyrophoric, and nondetonable, unstable reactive Class 3 compressed gases or cryogenic fluids in quantities that exceed the quantity thresholds for gases requiring special provisions shall be classified as Protection Level 2. [55:6.3.2.2]

21.2.3.2.3 Protection Level 3. Occupancies used for the storage or use of oxidizing, and unstable reactive Class 2 compressed gases or cryogenic fluids in quantities that exceed the quantity thresholds for gases requiring special provisions shall be classified as Protection Level 3. [55:6.3.2.3]

21.2.3.2.4 Protection Level 4. Occupancies used for the storage or use of toxic, highly toxic, and corrosive compressed gases in quantities that exceed the quantity thresholds for gases requiring special provisions shall be classified as Protection Level 4. [55:6.3.2.4]

21.2.3.2.5 Protection Level 5. Buildings and portions thereof used for fabrication of semiconductors or semiconductor research and development and containing quantities of hazardous materials exceeding the maximum allowable quantities of high-hazard level 5 contents permitted in control areas shall be classified as Protection Level 5. [55:6.3.2.5]

21.2.4 Gas Rooms. Where a gas room is used to increase the threshold quantity for a gas requiring special provisions or where otherwise required by the material or application-specific requirements of Chapters 7 through 15 of NFPA 55, the room shall meet the requirements of 21.2.4.1 through 21.2.4.5. [55:6.4]

21.2.4.1 Pressure Control. Gas rooms shall operate at a negative pressure in relationship to the surrounding area. [55:6.4.1]

21.2.4.2 Exhaust Ventilation. Gas rooms shall be provided with an exhaust ventilation system. [55:6.4.2]

21.2.4.3 Construction. Gas rooms shall be constructed in accordance with the building code. [55:6.4.3]

21.2.4.4 Separation. Gas rooms shall be separated from other occupancies by a minimum of 1-hour fire resistance. [55:6.4.4]

21.2.4.5 Limitation on Contents. The function of compressed gas rooms shall be limited to storage and use of compressed gases and associated equipment and supplies. [55:6.4.5]

21.2.5* Detached Buildings. Occupancies used for the storage or use of compressed gases, including individual bulk hydrogen compressed gas systems in quantities exceeding those specified in Table 21.2.5, shall be in detached buildings constructed in accordance with the provisions of the building code. [55:6.5]

21.2.6 Weather Protection. [55:6.6]

21.2.6.1 For other than explosive materials and hazardous materials presenting a detonation hazard, a weather protection structure shall be permitted to be used for sheltering outdoor storage or use areas, without requiring such areas to be classified as indoor storage or use. [55:6.6.1]

21.2.6.1.1 Weather protection shall be constructed in accordance with 6.2.7.2.

21.2.7 Electrical Equipment. Electrical wiring and equipment shall be in accordance with 21.2.7 and NFPA 70. [55:6.7]

21.2.7.1 Standby Power.

21.2.7.1.1 Where the following systems are required by this code for the storage or use of compressed gases or cryogenic fluids that exceed the quantity thresholds for gases requiring special provisions, such systems shall be connected to a standby power system in accordance with NFPA 70:

- (1) Mechanical ventilation
- (2) Treatment systems
- (3) Temperature controls
- (4) Alarms
- (5) Detection systems
- (6) Other electrically operated systems

[55:6.7.1, 6.7.1.1]

21.2.7.1.2 The requirements of 21.2.7.1 shall not apply where emergency power is provided in accordance with 21.2.7.2 and NFPA 70. [55:6.7.1.2]

21.2.7.2 Emergency Power. When emergency power is required, the system shall meet the requirements for a Level 2 system in accordance with NFPA 110. [55:6.7.2]

21.2.8* Employee Alarm System. Where required by government regulations, an employee alarm system shall be provided to allow warning for necessary emergency action as called for in

Table 21.2.5 Detached Buildings Required Where Quantity of Material Exceeds Amount Shown

Gas Hazard	Class	Quantity of Material	
		scf	Nm ³
Individual bulk hydrogen compressed gas systems	NA	15,000	425
Unstable reactive (detonable)	4 or 3	Quantity thresholds for gases requiring special provisions*	
Unstable reactive (nondetonable)	3	2,000	57
Unstable reactive (nondetonable)	2	10,000	283
Pyrophoric gas	NA	2,000	57

NA: Not applicable.

*See Table 6.3.1.1 of NFPA 55.

[55:Table 6.5]

the emergency action plan required by 1.10.1, or for reaction time for safe egress of employees from the workplace or the immediate work area, or both. [55:6.8]

21.2.9* Explosion Control. Explosion control shall be provided as required by Table 21.2.9 in accordance with NFPA 68 or NFPA 69 where amounts of compressed gases in storage or use exceed the quantity thresholds requiring special provisions. [55:6.9]

21.2.10* Fire Protection Systems. Except as provided in 21.2.10.1, buildings or portions thereof required to comply with Protection Levels 1 through 5 shall be protected by an approved automatic fire sprinkler system complying with NFPA 13. [55:6.10]

21.2.10.1 Rooms or areas that are of noncombustible construction with wholly noncombustible contents shall not be required to be protected by an automatic fire sprinkler system. [55:6.10.1]

21.2.10.2 Sprinkler System Design. Where sprinkler protection is required, the area in which compressed gases or cryogenic fluids are stored or used shall be protected with a sprinkler system designed to be not less than that required by 11.2.3.1.1 of NFPA 13 for the Ordinary Hazard Group 2 density/area curve. [55:6.10.2.1]

21.2.10.2.1 Where sprinkler protection is required, the area in which the flammable or pyrophoric compressed gases or cryogenic fluids are stored or used shall be protected with a sprinkler system designed to be not less than that required by 11.2.3.1.1 of NFPA 13 for the Extra Hazard Group 1 density/area curve. [55:6.10.2.2]

21.2.11 Lighting. Approved lighting by natural or artificial means shall be provided for areas of storage or use. [55:6.11]

21.2.12 Hazard Identification Signs. [55:6.12]

21.2.12.1 Hazard identification signs shall be placed at all entrances to locations where compressed gases are produced, stored, used, or handled in accordance with NFPA 704. [55:6.12.1]

21.2.12.1.1 Ratings shall be assigned in accordance with NFPA 704. [55:6.12.1.1]

21.2.12.1.2 Identification of Gas Rooms and Cabinets. Rooms or cabinets containing compressed gases shall be conspicuously labeled as follows:

COMPRESSED GAS [55:4.10.2.3]

21.2.12.1.3 The authority having jurisdiction shall be permitted to waive 21.2.12.1 where consistent with safety. [55:6.12.1.2]

21.2.12.2 Signs. Signs shall not be obscured or removed. [55:6.12.2.1]

21.2.12.3 No Smoking. Signs prohibiting smoking or open flames within 25 ft (7.6 m) of area perimeters shall be provided in areas where toxic, highly toxic, corrosive, unstable reactive, flammable, oxidizing, or pyrophoric gases are produced, stored, or used. [55:6.12.2.2]

21.2.13 Spill Control, Drainage, and Secondary Containment. Spill control, drainage, and secondary containment shall not be required for compressed gases. [55:6.13]

21.2.14 Shelving. [55:6.14]

21.2.14.1 Shelves used for the storage of cylinders, containers, and tanks shall be of noncombustible construction and designed to support the weight of the materials stored. [55:6.14.1]

21.2.14.2 In seismically active areas, shelves and containers shall be secured from overturning. [55:6.14.2]

21.2.15 Vent Pipe Termination. The termination point for piped vent systems serving cylinders, containers, tanks, and gas systems used for the purpose of operational or emergency venting shall be located to prevent impingement exposure on the system served and to minimize the effects of high temperature thermal radiation or the effects of contact with the gas from the escaping plume to the supply system, personnel, adjacent structures, and ignition sources. [55:6.15]

21.2.16 Ventilation. Indoor storage and use areas and storage buildings for compressed gases and cryogenic fluids shall be provided with mechanical exhaust ventilation or fixed natural ventilation, where natural ventilation is shown to be acceptable for the material as stored. [55:6.16]

21.2.16.1 Compressed Air. The requirements of 21.2.16 shall not apply to cylinders, containers, and tanks containing compressed air. [55:6.16.2]

21.2.16.2 Mechanical Exhaust Ventilation. Where mechanical exhaust ventilation is provided, the system shall be operational during the time the building or space is occupied. [55:6.16.3]

21.2.16.2.1 Ventilation Rate. Mechanical exhaust or fixed natural ventilation shall be provided at a rate of not less than 1 scf/min/ft² (0.3048 Nm³/min/m²) of floor area over the area of storage or use. [55:6.16.3.2]

△ Table 21.2.9 Explosion Control Requirements

Material	Class	Explosion Control Methods	
		Barricade Construction	Explosion Venting or Prevention Systems
Flammable cryogenic fluid	—	Not required	Required
Flammable gas	Nonliquefied	Not required	Required
	Liquefied	Not required	Required
Pyrophoric gas	—	Not required	Required
Unstable reactive gas	4	Required	Not required
	3 (detonable)	Required	Not required
	3 (nondetonable)	Not required	Required

[55:Table 6.9]

21.2.16.2.2 Continuous Operation. When operation of ventilation systems is required, systems shall operate continuously unless an alternative design is approved by the AHJ. [55:6.16.3.1]

21.2.16.2.3 Shutoff Controls. Where powered ventilation is provided, a manual shutoff switch shall be provided outside of the room in a position adjacent to the principal access door to the room or in an approved location. [55:6.16.3.3]

21.2.16.2.4 Manual Shutoff Switch. The switch shall be the breakglass or equivalent type and shall be labeled as follows:

WARNING:
VENTILATION SYSTEM EMERGENCY SHUTOFF
[55:6.16.3.3.1]

21.2.16.3 Inlets to the Exhaust System. [55:6.16.4]

21.2.16.3.1 The exhaust ventilation system design shall take into account the density of the potential gases released. [55:6.16.4.1]

21.2.16.3.2 For gases that are heavier than air, exhaust shall be taken from a point within 12 in. (305 mm) of the floor. The use of supplemental inlets shall be allowed to be installed at points above the 12 in. (305 mm) threshold level. [55:6.16.4.2]

21.2.16.3.3 For gases that are lighter than air, exhaust shall be taken from a point within 12 in. (305 mm) of the ceiling. The use of supplemental inlets shall be allowed to be installed at points below the 12 in. (305 mm) threshold level. [55:6.16.4.3]

21.2.16.3.4 The location of both the exhaust and inlet air openings shall be designed to provide air movement across all portions of the floor or ceiling of the room or area to prevent the accumulation of vapors within the ventilated space. [55:6.16.4.4]

21.2.16.4 Recirculation of Exhaust. Exhaust ventilation shall not be recirculated. [55:6.16.5]

21.2.16.5 Ventilation Discharge. Ventilation discharge systems shall terminate at a point not less than 50 ft (15 m) from intakes of air-handling systems, air-conditioning equipment, and air compressors. [55:6.16.6]

21.2.16.6 Air Intakes. Storage and use of compressed gases shall be located not less than 50 ft (15 m) from air intakes. For material-specific requirements, see 21.3.4 through 21.3.10. [55:6.16.7]

21.2.17 Gas Cabinets. Where a gas cabinet is required, is used to provide separation of gas hazards, or is used to increase the threshold quantity for a gas requiring special provisions, the gas cabinet shall be in accordance with 21.2.17.1 through 21.2.17.5. [55:6.17]

21.2.17.1 Construction. [55:6.17.1]

21.2.17.1.1 Materials of Construction. The gas cabinet shall be constructed of not less than 0.097 in. (2.46 mm) (12 gauge) steel. [55:6.17.1.1]

21.2.17.1.2 Access to Controls. The gas cabinet shall be provided with self-closing limited access ports or noncombustible windows to give access to equipment controls. [55:6.17.1.2]

21.2.17.1.3 Self-Closing Doors. The gas cabinet shall be provided with self-closing doors. [55:6.17.1.3]

21.2.17.2 Ventilation Requirements. [55:6.17.2]

21.2.17.2.1 The gas cabinet shall be provided with an exhaust ventilation system designed to operate at a negative pressure relative to the surrounding area. [55:6.17.2.1]

21.2.17.2.2 Where toxic; highly toxic; pyrophoric; unstable, reactive Class 3 or Class 4; or corrosive gases are contained, the velocity at the face of access ports or windows, with the access port or window open, shall not be less than 200 ft/min (61 m/min) average, with not less than 150 ft/min (46 m/min) at any single point. [55:6.17.2.2]

21.2.17.3 Fire Protection. Gas cabinets used to contain toxic, highly toxic, or pyrophoric gases shall be internally sprinklered. [55:6.17.3]

21.2.17.4 Quantity Limits. Gas cabinets shall contain not more than three cylinders, containers, or tanks. [55:6.17.4]

21.2.17.5 Separation of Incompatibles. Incompatible gases, as defined by Table 21.3.1.7.2, shall be stored or used within separate gas cabinets. [55:6.17.5]

21.2.18 Exhausted Enclosures. [55:6.18]

21.2.18.1 Ventilation Requirements. Where an exhausted enclosure is required or used to increase the threshold quantity for a gas requiring special provisions, the exhausted enclosure shall be provided with an exhaust ventilation system designed to operate at a negative pressure in relationship to the surrounding area. [55:6.18.1]

21.2.18.1.1 Control Velocity at Access Openings. Where toxic; highly toxic; pyrophoric; unstable, reactive Class 3 or Class 4; or corrosive gases are contained, the velocity at the face openings providing access shall be not less than 200 ft/min (61 m/min) average, with not less than 150 ft/min (46 m/min) at any single point. [55:6.18.1.1]

21.2.18.1.2 Separation of Incompatible Gases Within Enclosures. Cylinders, containers, and tanks within enclosures shall be separated in accordance with Table 21.3.1.7.2. [55:6.18.1.2]

21.2.18.1.3 Fire Protection. Exhausted enclosures shall be internally sprinklered. [55:6.18.1.3]

21.2.18.1.4 Separation. Incompatible gases, as defined by Table 21.3.1.7.2, shall be stored or used within separate exhausted enclosures. [55:6.18.2]

21.2.19 Source Valve. Bulk gas systems shall be provided with a source valve. [55:6.19]

21.2.19.1 The source valve shall be marked. [55:6.19.1]

21.2.19.2 The source valve shall be designated on the design drawings for the installation. [55:6.19.2]

21.3 Compressed Gases.

21.3.1 General. The storage, use, and handling of compressed gases in containers, cylinders, and tanks shall be in accordance with Sections 21.1, 21.3, and 21.6 as applicable.

21.3.1.1 Compressed Gas Systems. [55:7.1.2]

21.3.1.1.1 Design. Compressed gas systems shall be designed for the intended use and shall be designed by persons competent in such design. [55:7.1.2.1]

21.3.1.1.2 Installation. Installation of bulk compressed gas systems shall be supervised by personnel knowledgeable in the application of the standards for their construction and use. [55:7.1.2.2]

21.3.1.2 Cylinders, Containers, and Tanks. [55:7.1.5]

21.3.1.2.1 Design and Construction. Cylinders, containers, and tanks shall be designed, fabricated, tested, and marked (stamped) in accordance with regulations of DOT, Transport Canada (TC) *Transportation of Dangerous Goods Regulations*, or the ASME *Boiler and Pressure Vessel Code*, "Rules for the Construction of Unfired Pressure Vessels," Section VIII. [55:7.1.5.1]

21.3.1.2.2 Defective Cylinders, Containers, and Tanks. [55:7.1.5.2]

21.3.1.2.2.1 Defective cylinders, containers, and tanks shall be returned to the supplier. [55:7.1.5.2.1]

21.3.1.2.2.2 Suppliers shall repair the cylinders, containers, and tanks, remove them from service, or dispose of them in an approved manner. [55:7.1.7.2.2]

21.3.1.2.2.3 Suppliers shall ensure that defective cylinders, containers, and tanks that have been repaired are evaluated by qualified individuals to verify that the needed repairs and any required testing has been performed and that those repaired or tested are in a serviceable condition before returning them to service. [55:7.1.5.3]

21.3.1.2.3 Supports. Stationary cylinders, containers, and tanks shall be provided with engineered supports of noncombustible material on noncombustible foundations. [55:7.1.5.3]

21.3.1.2.4 Cylinders, Containers, and Tanks Containing Residual Gas. Compressed gas cylinders, containers, and tanks containing residual product shall be treated as full except when being examined, serviced, or refilled by a gas manufacturer, authorized cylinder requalifier, or distributor. [55:7.1.5.4]

21.3.1.2.5 Pressure Relief Devices. [55:7.1.5.5]

21.3.1.2.5.1 When required by 21.3.1.2.5.2, pressure relief devices shall be provided to protect containers and systems containing compressed gases from rupture in the event of overpressure from thermal exposure. [55:7.1.5.5.1]

21.3.1.2.5.2 Pressure relief devices to protect containers shall be designed and provided in accordance with CGA S-1.1, *Pressure Relief Device Standards — Part 1 — Cylinders for Compressed Gases*, for cylinders; CGA S-1.2, *Pressure Relief Device Standards — Part 2 — Cargo and Portable Tanks for Compressed Gases*, for portable tanks; and CGA S-1.3, *Pressure Relief Device Standards — Part 3 — Stationary Storage Containers for Compressed Gases*, for stationary tanks or applicable equivalent requirements in the country of use. [55:7.1.5.5.2]

21.3.1.2.5.3 Pressure relief devices shall be sized in accordance with the specifications to which the container was fabricated. [55:7.1.5.5.3]

21.3.1.2.5.4 The pressure relief device shall have the capacity to prevent the maximum design pressure of the container or system from being exceeded. [55:7.1.5.5.4]

21.3.1.2.5.5 Pressure relief devices shall be arranged to discharge unobstructed to the open air in such a manner as to prevent any impingement of escaping gas upon the container, adjacent structures, or personnel. This requirement shall not

apply to DOT specification containers having an internal volume of 2.0 ft³scf (0.057 Nm³) or less. [55:7.1.5.5.5]

21.3.1.2.5.6 Pressure relief devices or vent piping shall be designed or located so that moisture cannot collect and freeze in a manner that would interfere with operation of the device. [55:7.1.5.5.6]

21.3.1.3 Cathodic Protection. Where required, cathodic protection shall be in accordance with 21.3.1.3. [55:7.1.6]

21.3.1.3.1 Operation. Where installed, cathodic protection systems shall be operated and maintained to continuously provide corrosion protection. [55:7.1.6.1]

21.3.1.3.2 Inspection. Container systems equipped with cathodic protection shall be inspected for the intended operation by a cathodic protection tester. [55:7.1.6.2]

21.3.1.3.2.1 The frequency of inspection shall be determined by the designer of the cathodic protection system. [55:7.1.6.2.1]

21.3.1.3.2.2 The cathodic protection tester shall be certified as being qualified by the National Association of Corrosion Engineers, International (NACE). [55:7.1.6.2.1]

21.3.1.3.3 Impressed Current Systems. Systems equipped with impressed current cathodic protection systems shall be inspected in accordance with the requirements of design and 21.3.1.3.1.12. [55:7.1.6.3]

21.3.1.3.3.1 The design limits of the cathodic protection system shall be available to the AHJ upon request. [55:7.1.6.3.1]

21.3.1.3.3.2 The system owner shall maintain the following records to demonstrate that the cathodic protection is in conformance with the requirements of the design:

- (1) The results of inspections of the system
- (2) The results of testing that has been completed [55:7.1.6.3.2]

21.3.1.3.4 Corrosion Expert.

21.3.1.3.4.1 Repairs, maintenance, or replacement of a cathodic protection system shall be under the supervision of a corrosion expert certified by NACE. [55:7.1.6.4]

21.3.1.3.4.2 The corrosion expert shall be certified by NACE as a senior corrosion technologist, a cathodic protection specialist, or a corrosion specialist or shall be a registered engineer with registration in a field that includes education and experience in corrosion control. [55:7.1.6.4.1]

21.3.1.4 Labeling Requirements. [55:7.1.7]

21.3.1.4.1 Containers. Individual compressed gas cylinders, containers, and tanks shall be marked or labeled in accordance with DOT requirements or those of the applicable regulatory agency. [55:7.1.7.1]

21.3.1.4.2 Label Maintenance. The labels applied by the gas manufacturer to identify the liquefied or nonliquefied compressed gas cylinder contents shall not be altered or removed by the user. [55:7.1.7.2]

21.3.1.4.3 Stationary Compressed Gas Cylinders, Containers, and Tanks. [55:7.1.7.3]

21.3.1.4.3.1 Stationary compressed gas cylinders, containers, and tanks shall be marked in accordance with NFPA 704. [55:7.1.7.3.1]

21.3.1.4.3.2 Markings shall be visible from any direction of approach. [55:7.1.7.3.2]

21.3.1.4.4 Piping Systems. [55:7.1.7.4]

21.3.1.4.4.1 Except as provided in 21.3.1.4.4.2, piping systems shall be marked in accordance with ASME A13.1, *Scheme for the Identification of Piping Systems*, or other applicable approved standards as follows:

- (1) Marking shall include the name of the gas and a direction-of-flow arrow.
- (2) Piping that is used to convey more than one gas at various times shall be marked to provide clear identification and warning of the hazard.
- (3) Markings for piping systems shall be provided at the following locations:
 - (a) At each critical process control valve
 - (b) At wall, floor, or ceiling penetrations
 - (c) At each change of direction
 - (d) At a minimum of every 20 ft (6.1 m) or fraction thereof throughout the piping run

[55:7.1.7.4.1]

21.3.1.4.4.2 Piping within gas manufacturing plants, gas processing plants, refineries, and similar occupancies shall be marked in an approved manner. [55:7.1.7.4.2]

21.3.1.5 Security. [55:7.1.8]

21.3.1.5.1 General. Compressed gas cylinders, containers, tanks, and systems shall be secured against accidental dislodgement and against access by unauthorized personnel. [55:7.1.8.1]

21.3.1.5.2 Security of Areas. Storage, use, and handling areas shall be secured against unauthorized entry. [55:7.1.8.2]

21.3.1.5.3 Physical Protection. [55:7.1.8.3]

21.3.1.5.3.1 Compressed gas cylinders, containers, tanks, and systems that could be exposed to physical damage shall be protected. [55:7.1.8.3.1]

21.3.1.5.3.2 Guard posts or other means shall be provided to protect compressed gas cylinders, containers, tanks, and systems indoors and outdoors from vehicular damage. (*See Section 4.11 of NFPA 55.*) [55:7.1.8.3.2]

21.3.1.5.4 Securing Compressed Gas Cylinders, Containers, and Tanks. Compressed gas cylinders, containers, and tanks in use or in storage shall be secured to prevent them from falling or being knocked over by corralling them and securing them to a cart, framework, or fixed object by use of a restraint, unless otherwise permitted by 21.3.1.5.4.1 and 21.3.1.5.4.2. [55:7.1.8.4]

21.3.1.5.4.1 Compressed gas cylinders, containers, and tanks in the process of examination, servicing, and refilling shall not be required to be secured. [55:7.1.8.4.1]

21.3.1.5.4.2 At cylinder-filling plants, authorized cylinder refueller's facilities, and distributors' warehouses, the nesting of cylinders shall be permitted as a means to secure cylinders. [55:7.1.8.4.2]

21.3.1.6 Valve Protection. [55:7.1.9]

21.3.1.6.1 General. Compressed gas cylinder, container, and tank valves shall be protected from physical damage by means of protective caps, collars, or similar devices. [55:7.1.9.1]

21.3.1.6.1.1 Valve protection of individual valves shall not be required to be installed on individual cylinders, containers, or tanks installed on tube trailers or similar transportable bulk gas systems equipped with manifolds that are provided with a means of physical protection that will protect the valves from physical damage when the equipment is in use. Protective systems required by DOT for over the road transport shall provide an acceptable means of protection. [55:7.1.9.1.1]

21.3.1.6.1.2 Valve protection of individual valves shall not be required on cylinders, containers, or tanks that comprise bulk or non-bulk gas systems where the containers are stationary, or portable equipped with manifolds, that are provided with physical protection in accordance with Section 4.11 and 7.1.8.3 of NFPA 55 or other approved means. Protective systems required by DOT for over the road transport shall provide an acceptable means of protection. [55:7.1.9.1.1.1]

21.3.1.6.2 Valve-Protective Caps. Where compressed gas cylinders, containers, and tanks are designed to accept valve-protective caps, the user shall keep such caps on the compressed gas cylinders, containers, and tanks at all times, except when empty, being processed, or connected for use. [55:7.1.9.2]

21.3.1.6.3 Valve Outlet Caps or Plugs. [55:7.1.9.3]

21.3.1.6.3.1 Gastight valve outlet caps or plugs shall be provided and in place for all full or partially full cylinders, containers, and tanks containing toxic, highly toxic, pyrophoric, or unstable reactive Class 3 or Class 4 gases that are in storage. [55:7.1.9.3.1]

21.3.1.6.3.2 Valve outlet caps and plugs shall be designed and rated for the container service pressure. [55:7.1.9.3.2]

21.3.1.7 Separation from Hazardous Conditions. [55:7.1.10]

21.3.1.7.1 General. [55:7.1.10.1]

21.3.1.7.1.1 Compressed gas cylinders, containers, tanks, and systems in storage or use shall be separated from materials and conditions that present exposure hazards to or from each other. [55:7.1.10.1]

21.3.1.7.2* Incompatible Materials. Gas cylinders, containers, and tanks shall be separated in accordance with Table 21.3.1.7.2. [55:7.1.10.2]

21.3.1.7.2.1 Subparagraph 21.3.1.7.2 shall not apply to gases contained within closed piping systems. [55:7.1.10.2.1]

21.3.1.7.2.2 The distances shown in Table 21.3.1.7.2 shall be permitted to be reduced without limit when compressed gas cylinders, tanks, and containers are separated by a barrier of noncombustible construction that has a fire resistance rating of at least 0.5 hour and interrupts the line of sight between the containers. [55:7.1.10.2.2]

21.3.1.7.2.3 The 20 ft (6.1 m) distance shall be permitted to be reduced to 5 ft (1.5 m) where one of the gases is enclosed in a gas cabinet or without limit where both gases are enclosed in gas cabinets. [55:7.1.10.2.3]

Table 21.3.1.7.2 Separation of Gas Cylinders, Containers, and Tanks by Hazard Class

Gas Category	Other Gas	Unstable Reactive Class 2, Class 3, or Class 4		Corrosive		Oxidizing		Flammable		Pyrophoric		Toxic or Highly Toxic	
		ft	m	ft	m	ft	m	ft	m	ft	m	ft	m
Toxic or highly toxic	NR	20	6.1	20	6.1	20	6.1	20	6.1	20	6.1	20	6.1
Pyrophoric	NR	20	6.1	20	6.1	20	6.1	20	6.1	20	6.1	20	6.1
Flammable	NR	20	6.1	20	6.1	20	6.1	20	6.1	20	6.1	20	6.1
Oxidizing	NR	20	6.1	20	6.1	—	—	—	—	—	—	—	—
Corrosive	NR	20	6.1	—	—	20	6.1	20	6.1	20	6.1	20	6.1
Unstable reactive Class 2, Class 3, or Class 4	NR	—	—	20	6.1	20	6.1	20	6.1	20	6.1	20	6.1
Other gas	—	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR	NR

NR: No separation required.

[55: Table 7.1.10.2]

21.3.1.7.2.4 Cylinders without pressure relief devices shall not be stored without separation from flammable and pyrophoric gases with pressure relief devices. [55:7.1.10.2.4]

21.3.1.7.2.5 Spatial separation shall not be required between cylinders deemed to be incompatible in gas production facilities where cylinders are connected to manifolds for the purposes of filling, analysis of compressed gases, or manufacturing procedures, assuming the prescribed controls for the manufacture of gas mixtures are in place. [55:7.1.10.2.5]

21.3.1.7.3* Clearance from Combustibles and Vegetation. Combustible waste, vegetation, and similar materials shall be kept a minimum of 10 ft (3.1 m) from compressed gas cylinders, containers, tanks, and systems. [55:7.1.10.3]

21.3.1.7.3.1 A noncombustible partition without openings or penetrations and extending sides not less than 18 in. (457 mm) above and to the sides of the storage area shall be permitted in lieu of the minimum distance. [55:7.1.10.3.1]

21.3.1.7.3.2 The noncombustible partition shall either be an independent structure or the exterior wall of the building adjacent to the storage area. [55:7.1.10.3.2]

21.3.1.7.4 Ledges, Platforms, and Elevators. Compressed gas cylinders, containers, and tanks shall not be placed near elevators, unprotected platform ledges, or other areas where compressed gas cylinders, containers, or tanks could fall for distances exceeding one-half the height of the cylinder, container, or tank. [55:7.1.10.4]

21.3.1.7.5 Temperature Extremes. Compressed gas cylinders, containers, and tanks, whether full or partially full, shall not be exposed to temperatures exceeding 125°F (52°C) or subambient (low) temperatures unless designed for use under such exposure. [55:7.1.10.5]

21.3.1.7.6 Falling Objects. Compressed gas cylinders, containers, and tanks shall not be placed in areas where they are capable of being damaged by falling objects. [55:7.1.10.6]

21.3.1.7.7 Heating. Compressed gas cylinders, containers, and tanks, whether full or partially full, shall not be heated by devices that could raise the surface temperature of the cylinder, container, or tank to above 125°F (52°C). [55:7.1.10.7]

21.3.1.7.7.1 Electrically Powered Heating Devices. Electrical heating devices shall be in accordance with *NFPA 70*. [55:7.1.10.7.1]

21.3.1.7.7.2 Fail-Safe Design. Devices designed to maintain individual compressed gas cylinders, containers, and tanks at constant temperature shall be designed to be fail-safe. [55:7.1.10.7.2]

21.3.1.7.8 Sources of Ignition. Open flames and high-temperature devices shall not be used in a manner that creates a hazardous condition. [55:7.1.10.8]

21.3.1.7.9 Exposure to Chemicals. Compressed gas cylinders, containers, and tanks shall not be exposed to corrosive chemicals or fumes that could damage cylinders, containers, tanks, or valve-protective caps. [55:7.1.10.9]

21.3.1.7.10 Exposure to Electrical Circuits. Compressed gas cylinders, containers, and tanks shall not be placed where they could become a part of an electrical circuit. [55:7.1.10.10]

21.3.1.8 Service and Repair. Service, repair, modification, or removal of valves, pressure relief devices, or other compressed gas cylinder, container, or tank appurtenances shall be performed by trained personnel and with the permission of the container owner. [55:7.1.11]

21.3.1.9 Unauthorized Use. Compressed gas cylinders, containers, and tanks shall not be used for any purpose other than to serve as a vessel for containing the product for which it was designed. [55:7.1.12]

21.3.1.10 Cylinders, Containers, and Tanks Exposed to Fire. Compressed gas cylinders, containers, and tanks exposed to fire shall not be used or shipped while full or partially full until they are requalified in accordance with the pressure vessel code under which they were manufactured. [55:7.1.13]

21.3.1.11 Leaks, Damage, or Corrosion. [55:7.1.14]

21.3.1.11.1 Removal from Service. Leaking, damaged, or corroded compressed gas cylinders, containers, and tanks shall be removed from service. [55:7.1.14.1]

21.3.1.11.2 Replacement and Repair. Leaking, damaged, or corroded compressed gas systems shall be replaced or repaired. [55:7.1.14.2]

21.3.1.11.3* Handling of Cylinders, Containers, and Tanks Removed from Service. Compressed gas cylinders, containers, and tanks that have been removed from service shall be handled in an approved manner. [55:7.1.14.3]

21.3.1.11.4 Leaking Systems. Compressed gas systems that are determined to be leaking, damaged, or corroded shall be repaired to a serviceable condition or shall be removed from service. [55:7.1.14.4]

21.3.1.12 Surfaces. [55:7.1.15]

21.3.1.12.1 To prevent bottom corrosion, cylinders, containers, and tanks shall be protected from direct contact with soil or surfaces where water might accumulate. [55:7.1.15.1]

21.3.1.12.2 Surfaces shall be graded to prevent accumulation of water. [55:7.1.15.2]

21.3.1.13 Storage Area Temperature. [55:7.1.16]

21.3.1.13.1 Compressed Gas Containers. Storage area temperatures shall not exceed 125°F (52°C). [55:7.1.16.1]

21.3.1.14 Underground Piping. [55:7.1.17]

21.3.1.14.1 Underground piping shall be of welded construction without valves, unwelded mechanical joints, or connections installed underground. [55:7.1.17.1]

21.3.1.14.1.1 Valves or connections located in boxes or enclosures shall be permitted to be installed underground when such boxes or enclosures are accessible from above ground and where the valves or connections contained are isolated from direct contact with earth or fill. [55:7.1.17.1.1]

21.3.1.14.1.2 Valve boxes or enclosures installed in areas subject to vehicular traffic shall be constructed to resist uniformly distributed and concentrated live loads in accordance with the building code, for areas designated as vehicular driveways and yards, subject to trucking. [55:7.1.17.1.1.1]

21.3.1.14.1.3* Piping installed in trench systems located below grade where the trench is open to above shall not be considered to be underground. [55:7.1.17.1.2]

21.3.1.14.2 Gas piping in contact with earth or other material that could corrode the piping shall be protected against corrosion in an approved manner. [55:7.1.17.2]

21.3.1.14.2.1 When cathodic protection is provided, it shall be in accordance with 21.3.1.3. [55:7.1.17.2.1]

21.3.1.14.3 Underground piping shall be installed on a bedding of at least 6 in. (150 mm) of well-compacted backfill material. [55:7.1.17.3]

21.3.1.14.4 In areas subject to vehicle traffic, the pipe trench shall be of sufficient depth to permit a cover of at least 18 in. (450 mm) of well-compacted backfill material and pavement. [55:7.1.17.4]

21.3.1.14.5 In paved areas where a minimum 2 in. (50 mm) of asphalt is used, backfill between the pipe and the asphalt shall be permitted to be reduced to 8 in. (200 mm) minimum. [55:7.1.17.5]

21.3.1.14.6 In paved areas where a minimum 4 in. (100 mm) of reinforced concrete is used, backfill between the pipe and the asphalt shall be permitted to be reduced to 4 in. (100 mm) minimum. [55:7.1.17.6]

21.3.1.14.7 In areas not subject to vehicle traffic, the pipe trench shall be of sufficient depth to permit a cover of at least 12 in. (300 mm) of well-compacted backfill material. [55:7.1.17.7]

21.3.1.14.8 A greater burial depth shall be provided when required by the manufacturer's instructions or where frost conditions are present. [55:7.1.17.8]

21.3.1.14.9 Piping within the same trench shall be separated by two pipe diameters. Piping shall not need to be separated horizontally by more than 9 in. (230 mm). [55:7.1.17.9]

21.3.1.14.10 Two or more levels of piping within the same trench shall be separated vertically by a minimum 6 in. (150 mm) of well-compacted backfill. [55:7.1.17.10]

21.3.2 Storage. [55:7.2]

21.3.2.1 General. [55:7.2.1]

21.3.2.1.1 Applicability. The storage of compressed gas cylinders, containers, and tanks shall be in accordance with 21.3.2.1. [55:7.2.1.1]

21.3.2.1.2 Upright Storage Flammable Gas in Solution and Liquefied Flammable Gas. Cylinders, containers, and tanks containing liquefied flammable gases and flammable gases in solution shall be positioned in the upright position. [55:7.2.1.2]

21.3.2.1.2.1 Cylinders and Containers of 1.3 Gal (5 L) or Less. Containers with a capacity of 1.3 gal (5 L) or less shall be permitted to be stored in a horizontal position. [55:7.2.1.2.1]

21.3.2.1.2.2 Cylinders, Containers, and Tanks Designed for Horizontal Use. Cylinders, containers, and tanks designed for use in a horizontal position shall be permitted to be stored in a horizontal position. [55:7.2.1.2.2]

21.3.2.1.2.3 Palletized Cylinders, Containers, and Tanks. Cylinders, containers, and tanks, with the exception of those containing flammable liquefied compressed gases, that are palletized for transportation purposes shall be permitted to be stored in a horizontal position. [55:7.2.1.2.3]

21.3.2.1.3 Classification of Weather Protection as an Indoor Versus Outdoor Area. For other than explosive materials and hazardous materials presenting a detonation hazard, a weather protection structure shall be permitted to be used for sheltering outdoor storage or use areas, without requiring such areas to be classified as indoor storage. [55:7.2.1.3]

21.3.2.2 Material-Specific Regulations. [55:7.2.2]

21.3.2.2.1 Indoor Storage. Indoor storage of compressed gases shall be in accordance with the material-specific provisions of 21.3.4 through 21.3.10. [55:7.2.2.1]

21.3.2.2.2 Exterior Storage. [55:7.2.2.2]

21.3.2.2.2.1 General. Exterior storage of compressed gases shall be in accordance with the material-specific provisions of 21.3.4 through 21.3.10. [55:7.2.2.2.1]

21.3.2.2.2.2 Separation. Distances from property lines, buildings, and exposures shall be in accordance with the material-specific provisions of 21.3.4 through 21.3.10. [55:7.2.2.2.2]

21.3.3 Use and Handling. [55:7.3]

21.3.3.1 General. [55:7.3.1]

21.3.3.1.1 Applicability. The use and handling of compressed gas cylinders, containers, tanks, and systems shall be in accordance with 21.3.3.1. [55:7.3.1.1]

21.3.3.1.2 Controls. [55:7.3.1.2]

21.3.3.1.2.1 Compressed gas system controls shall be designed to prevent materials from entering or leaving the process at an unintended time, rate, or path. [55:7.3.1.2.1]

21.3.3.1.2.2 Automatic controls shall be designed to be fail-safe. [55:7.3.1.2.2]

21.3.3.1.3 Piping Systems. Piping, tubing, fittings, and related components shall be designed, fabricated, and tested in accordance with the requirements of the applicable parts of ASME B31.3, *Process Piping*, or other approved standards. [55:7.3.1.3]

21.3.3.1.3.1 Integrity. Piping, tubing, pressure regulators, valves, and other apparatus shall be kept gastight to prevent leakage. [55:7.3.1.3.1]

21.3.3.1.3.2 Backflow Prevention. Backflow prevention or check valves shall be provided when the backflow of hazardous materials could create a hazardous condition or cause the unauthorized discharge of hazardous materials. [55:7.3.1.3.2]

21.3.3.1.4 Valves. [55:7.3.1.4]

21.3.3.1.4.1 Valves utilized on compressed gas systems shall be designed for the gas or gases and pressure intended and shall be accessible. [55:7.3.1.4.1]

21.3.3.1.4.2 Valve handles or operators for required shutoff valves shall not be removed or otherwise altered to prevent access. [55:7.3.1.4.2]

21.3.3.1.5 Vent Pipe Termination. [55:7.3.1.5]

21.3.3.1.5.1 Venting of gases shall be directed to an approved location. [55:7.3.1.5.1]

21.3.3.1.5.2 The termination point for piped vent systems serving cylinders, containers, tanks, and gas systems used for the purpose of operational or emergency venting shall be in accordance with 21.2.15. [55:7.3.1.5.2]

21.3.3.1.6 Upright Use. [55:7.3.1.6]

21.3.3.1.6.1 Compressed gas cylinders, containers, and tanks containing flammable liquefied gas, except those designed for use in a horizontal position and those compressed gas cylinders, containers, and tanks containing nonliquefied gases, shall be used in a "valve end up" upright position. [55:7.3.1.6.1]

21.3.3.1.6.2 An upright position shall include a position in which the cylinder, container, or tank axis is inclined as much as 45 degrees from the vertical and in which the relief device is always in direct communication with the gas phase. [55:7.3.1.6.2]

21.3.3.1.7 Inverted Use. Cylinders, containers, and tanks containing nonflammable liquefied gases shall be permitted to be used in the inverted position when the liquid phase is used. [55:7.3.1.7]

21.3.3.1.7.1 Flammable liquefied gases at processing plants shall be permitted to use this inverted position method while transfilling. [55:7.3.1.7.1]

21.3.3.1.7.2 The cylinder, container, or tank shall be secured, and the dispensing apparatus shall be designed for use with liquefied gas. [55:7.3.1.7.2]

21.3.3.1.8 Cylinders and Containers of 5 L (1.3 Gal) or Less. Cylinders or containers with a water volume of 1.3 gal (5 L) or less shall be permitted to be used in a horizontal position. [55:7.3.1.8]

21.3.3.1.9 Transfer. Transfer of gases between cylinders, containers, and tanks shall be performed by qualified personnel using equipment and operating procedures in accordance with CGA P-1, *Safe Handling of Compressed Gases in Containers*. [55:7.3.1.9]

21.3.3.1.10 Use of Compressed Gases for Inflation. Inflatable equipment, devices, or balloons shall only be pressurized or filled with compressed air or inert gases. [55:7.3.1.10]

21.3.3.1.11 Emergency Shutoff Valves. [55:7.3.1.11]

21.3.3.1.11.1 Accessible manual or automatic emergency shutoff valves shall be provided to shut off the flow of gas in case of emergency. [55:7.3.1.11.1]

(A)* Manual emergency shutoff valves or the device that activates an automatic emergency shutoff valve on a bulk source or piping system serving the bulk supply shall be identified by means of a sign. [55:7.3.1.11.1.1]

21.3.3.1.11.2 Emergency shutoffs shall be located at the point of use and at the tank, cylinder, or bulk source, and at the point where the system piping enters the building. [55:7.3.1.11.2]

21.3.3.1.12 Emergency Isolation. [55:7.3.1.12]

21.3.3.1.12.1* Where compressed gases having a hazard ranking in one or more of the following hazard classes in accordance with NFPA 704 are carried in pressurized piping above a gauge pressure of 15 psi (103 kPa), an approved method of emergency isolation shall be provided:

- (1) Health hazard Class 3 or Class 4
- (2) Flammability Class 4
- (3) Instability Class 3 or Class 4

[55:7.3.1.12.1]

21.3.3.1.12.2 Approved means of meeting the requirements for emergency isolation shall include any of the following:

- (1) Automatic shutoff valves located as close to the bulk source as practical, tied to leak detection systems
- (2) Attended control stations where trained personnel can monitor alarms or supervisory signals and can trigger emergency responses
- (3) A constantly monitored control station with an alarm and remote shutoff of the gas supply system
- (4) Excess flow valves at the bulk source

[55:7.3.1.12.2]

Δ 21.3.3.1.12.3 The requirements of 21.3.3.1.12 shall not be required for the following:

- (1) Piping for inlet connections designed to prevent backflow at the source
- (2) Piping for pressure relief devices
- (3) Where the source of the gas is not in excess of the quantity threshold indicated in Table 5.2.1.2.1

[55:7.3.1.12.3]

21.3.3.1.12.4 Location Exemptions. The requirements of 21.3.3.1.12 shall not apply to the following:

- (1) Piping for inlet connections designed to prevent backflow
- (2) Piping for pressure-relief devices
- (3) Systems containing 450 scf (12.7 Nm³) or less of flammable gas

[55:7.3.1.12.4]

21.3.3.2 Material-Specific Regulations. [55:7.3.2]

21.3.3.2.1 Indoor Use. Indoor use of compressed gases shall be in accordance with 21.3.4 through 21.3.10. [55:7.3.2.1]

21.3.3.2.2 Exterior Use. [55:7.3.2.2]

21.3.3.2.2.1 General. Exterior use of compressed gases shall be in accordance with 21.3.4 through 21.3.10. [55:7.3.2.2.1]

21.3.3.2.2.2 Separation. Distances from property lines, buildings, and exposure hazards shall be in accordance with the material-specific provisions of 21.3.4 through 21.3.10. [55:7.3.2.2.2]

21.3.3.3 Handling. [55:7.3.3]

21.3.3.3.1 Applicability. The handling of compressed gas cylinders, containers, and tanks shall be in accordance with 21.3.3.3. [55:7.3.3.1]

21.3.3.3.2 Carts and Trucks. [55:7.3.3.2]

21.3.3.3.2.1 Cylinders, containers, and tanks shall be moved using an approved method. [55:7.3.3.2.1]

21.3.3.3.2.2 Where cylinders, containers, or tanks are moved by hand cart, hand truck, or other mobile device, such carts, trucks, or devices shall be designed for the secure movement of cylinders, containers, or tanks. [55:7.3.3.2.2]

21.3.3.3.3 Lifting Devices. Ropes, chains, or slings shall not be used to suspend compressed gas cylinders, containers, and tanks unless provisions at time of manufacture have been made on the cylinder, container, or tank for appropriate lifting attachments, such as lugs. [55:7.3.3.3]

21.3.4 Medical Gas Systems. Medical gas systems for health care shall be in accordance with NFPA 99. [55:7.4]

21.3.5 Corrosive Gases. [55:7.5]

21.3.5.1 General. The storage or use of corrosive compressed gases exceeding the quantity thresholds for gases requiring special provisions as specified in Table 5.2.1.1.3 and Table 5.2.1.2.1 shall be in accordance with Sections 21.1 and 21.2, 21.3.1 through 21.3.3, and 21.3.5. [55:7.5.1]

21.3.5.2 Distance to Exposures.

21.3.5.2.1 The outdoor storage or use of corrosive compressed gas shall not be within 20 ft (6.1 m) of buildings not associated with the manufacture or distribution of corrosive gases, lot lines, streets, alleys, public ways, or means of egress. [55:7.5.2]

21.3.5.2.2 A 2-hour fire barrier wall without openings or penetrations, and extending not less than 30 in. (762 mm) (above and to the sides of the storage or use area, shall be permitted in lieu of the 20 ft (6.1 m) distance. [55:7.5.2.1]

21.3.5.2.2.1* When a fire barrier is used to protect compressed gas systems, the system shall terminate downstream of the source valve. [55:7.5.2.1.1]

21.3.5.2.2.2 The fire barrier wall shall be either an independent structure or the exterior wall of the building adjacent to the storage or use area. [55:7.5.2.1.2]

21.3.5.2.2.3 The 2-hour fire barrier shall be located at least 5 ft (1.5 m) from any exposure. [55:7.5.2.1.3]

21.3.5.2.2.4 The 2-hour fire barrier shall not have more than two sides at approximately 90 degree (1.57 rad) directions, or not more than three sides with connecting angles of approximately 135 degrees (2.36 rad). [55:7.5.2.1.4]

21.3.5.3 Indoor Use. The indoor use of corrosive gases shall be provided with a gas cabinet, exhausted enclosure, or gas room. [55:7.5.3]

21.3.5.3.1 Gas Cabinets. Gas cabinets shall be in accordance with 21.2.17. [55:7.5.3.1]

21.3.5.3.2 Exhausted Enclosures. Exhausted enclosures shall be in accordance with 21.2.18. [55:7.5.3.2]

21.3.5.3.3 Gas Rooms. Gas rooms shall be in accordance with 21.2.4. [55:7.5.3.3]

21.3.5.3.4 Treatment Systems. Treatment systems, except as provided for in 21.3.5.3.4.1, gas cabinets, exhausted enclosures, and gas rooms containing corrosive gases in use shall be provided with exhaust ventilation, with all exhaust directed to a treatment system designed to process the accidental release of gas. [55:7.5.3.4]

21.3.5.3.4.1 Treatment systems shall not be required for corrosive gases in use where provided with the following:

- (1) Gas detection in accordance with 21.3.9.3.2.1
- (2) Fail-safe automatic closing valves in accordance with 21.3.9.3.2.2

[55:7.5.3.4.1]

21.3.5.3.4.2 Treatment systems shall be capable of diluting, adsorbing, absorbing, containing, neutralizing, burning, or otherwise processing the release of corrosive gas in accordance with 21.3.9.3.4.1. [55:7.5.3.4.2]

21.3.5.3.4.3 Treatment system sizing shall be in accordance with 21.3.9.3.4. [55:7.5.3.4.3]

21.3.6 Flammable Gases. [55:7.6]

21.3.6.1 Storage, Use, and Handling. [55:7.6.1]

21.3.6.1.1 The storage or use of flammable gases exceeding the quantity thresholds for gases requiring special provisions as specified in Table 5.2.1.1.3 and Table 5.2.1.2.1 shall be in accordance with Sections 21.1 and 21.2, 21.3.1 through 21.3.3, and 21.3.6. [55:7.6.1.1]

21.3.6.1.2 Storage, use, and handling of gaseous hydrogen shall be in accordance with 21.3.6.1 and Section 21.6. [55:7.6.1.2]

21.3.6.2 Distance to Exposures. The outdoor storage or use of non-bulk flammable compressed gas shall be located from lot lines, public streets, public alleys, public ways, or buildings not associated with the manufacture or distribution of such gases in accordance with Table 21.3.6.2. [55:7.6.2]

21.3.6.2.1 Bulk gas systems for flammable gases other than hydrogen shall be in accordance with Table 10.3.2.1(a), Table 10.3.2.1(b), or Table 3.2.1(c) of NFPA 55 where the quantity of

Table 21.3.6.2 Distance to Exposures for Non-Bulk Flammable Gases^a

Maximum Amount per Storage Area (ft ³)	Minimum Distance Between Storage Areas (ft)	Minimum Distance to Lot Lines of Property That Can Be Built Upon (ft)	Minimum Distance to Public Streets, Public Alleys, or Public Ways (ft)	Minimum Distance to Buildings on the Same Property		
				Less than 2-Hour Construction	2-Hour Construction	4-Hour Construction
0–4,225	5	5	5	5	0	0
4,226–21,125	10	10	10	10	5	0
21,126–50,700	10	15	15	20	5	0
50,701–84,500	10	20	20	20	5	0
84,501–200,000	20	25	25	20	5	0

For SI, 1 ft = 304.8 mm; 1 ft³ = 0.0283 m³.

^aThe minimum required distances shall not apply where fire barriers without openings or penetrations having a minimum fire resistive rating of 2 hours interrupt the line of sight between the storage and the exposure. The configuration of the fire barriers shall be designed to allow natural ventilation to prevent the accumulation of hazardous gas concentrations.

[55:Table 7.6.2]

flammable compressed gas exceeds 5000 scf (141.6 Nm³). [55:7.6.2.2]

21.3.6.2.1.1 Where fire barriers are used as a means of distance reduction, fire barriers shall be in accordance with 10.3.2.4 of NFPA 55. [55:7.6.2.2.1]

21.3.6.2.1.2 Mobile acetylene trailer systems (MATS) shall be located in accordance with 15.2.3 of NFPA 55. [55:7.6.2.2.2]

21.3.6.2.2 The configuration of the protective structure shall be designed to allow natural ventilation to prevent the accumulation of hazardous gas concentrations. [55:7.6.2.3]

21.3.6.2.3 Storage and use of flammable compressed gases shall not be located within 50 ft (15.2 m) of air intakes. [55:7.6.2.4]

21.3.6.2.4 Storage and use of flammable gases outside of buildings shall also be separated from building openings by 25 ft (7.6 m). Fire barriers shall be permitted to be used as a means to separate storage areas from openings or a means of egress used to access the public way. [55:7.6.2.5]

21.3.6.3 Ignition Source Control. Ignition sources in areas containing flammable gases shall be in accordance with 21.3.6.3. [55:7.6.4]

21.3.6.3.1 Static-Producing Equipment. Static-producing equipment located in flammable gas areas shall be grounded. [55:7.6.4.1]

21.3.6.3.2 No Smoking or Open Flame. Signs shall be posted in areas containing flammable gases communicating that smoking or the use of open flame, or both, is prohibited within 25 ft (7.6 m) of the storage or use area perimeter. [55:7.6.4.2]

21.3.6.3.3 Heating. Heating, where provided, shall be by indirect means. Equipment used for heating applications in rooms or areas where flammable gases are stored or used shall be listed and labeled for use in hazardous environments established by the gases present and shall be installed in accordance with the conditions of the listing and the manufacturer's installation instructions. [55:7.6.4.3]

21.3.6.4 Electrical. Areas in which the storage or use of compressed gases exceeds the quantity thresholds for gases

requiring special provisions shall be in accordance with NFPA 70. [55:7.6.5]

21.3.6.5 Maintenance of Piping Systems. Maintenance of flammable gas system piping and components shall be performed annually by a qualified representative of the equipment owner. This shall include inspection for physical damage, leak tightness, ground system integrity, vent system operation, equipment identification, warning signs, operator information and training records, scheduled maintenance and retest records, alarm operation, and other safety related features. Scheduled maintenance and retest activities shall be formally documented and records shall be maintained a minimum of three years. [55:7.6.6.1; 55:7.6.6.2; 55:7.6.6.3]

21.3.7 Oxidizing Gases. [55:7.7]

21.3.7.1 General. The storage or use of oxidizing compressed gases exceeding the quantity thresholds for gases requiring special provisions as specified in Table 5.2.1.1.3 and Table 5.2.1.2.1 shall be in accordance with Sections 21.1 and 21.2, 21.3.1 through 21.3.3, and 21.3.7. [55:7.7.1]

21.3.7.2 Distance to Exposures. The outdoor storage or use of oxidizing compressed gas shall be in accordance with Table 21.3.7.2. [55:7.7.2]

Table 21.3.7.2 Distance to Exposures for Oxidizing Gases Table

Quantity of Gas Stored (at NTP)		Distance to a Building Not Associated with the Manufacture or Distribution of Oxidizing Gases or to a Public Way or Property Line		Minimum Distance Between Storage Area	
		ft	m	ft	m
0–50,000	0–1416	5	1.5	5	1.5
50,001–100,000	1417–2832	10	3.0	10	3.0
≥ 100,001	≥ 2833	15	4.6	15	4.6

[55:Table 7.7.2]

21.3.7.2.1 The distances shall not apply where fire barriers having a minimum fire resistance of 2 hours interrupt the line of sight between the container and the exposure. [55:7.7.2.1]

21.3.7.2.1.1* Where a fire barrier is used to protect compressed gas systems, the system shall terminate downstream of the source valve. [55:7.7.2.1.1]

21.3.7.2.1.2 The fire barrier wall shall be either an independent structure or the exterior wall of the building adjacent to the storage or use area. [55:7.7.2.1.2]

21.3.7.2.2 The fire barrier shall be at least 5 ft (1.5 m) from the storage or use area perimeter. [55:7.7.2.2]

21.3.7.2.3 The configuration of the fire barrier shall allow natural ventilation to prevent the accumulation of hazardous gas concentrations. [55:7.7.2.3]

21.3.8 Pyrophoric Gases. [55:7.8]

21.3.8.1 General. Pyrophoric compressed gases exceeding the quantity thresholds for gases requiring special provisions as specified in Table 5.2.1.1.3 and Table 5.2.1.2.1 shall be stored and used in accordance with Sections 21.1 and 21.2, 21.3.1 through 21.3.3, and 21.3.8. [55:7.8.1]

21.3.8.2 Silane and Silane Mixtures. Silane and silane mixtures shall be stored, used, and handled in accordance with the provisions of ANSI/CGA G-13, *Storage and Handling of Silane and Silane Mixtures*. [55:7.8.2]

21.3.8.3 Distance to Exposures. The outdoor storage or use of pyrophoric compressed gas shall be in accordance with Table 21.3.8.3. [55:7.8.3]

21.3.8.3.1 The distances shall be allowed to be reduced to 5 ft (1.5 m) when fire barriers having a minimum fire resistance of 2 hours interrupt the line of sight between the container and the exposure. [55:7.8.3.1]

21.3.8.3.1.1* When a fire barrier is used to protect compressed gas systems, the system shall terminate downstream of the source valve. [55:7.8.3.1.1]

21.3.8.3.1.2 The fire barrier shall be either an independent structure or the exterior wall of the building adjacent to the storage or use area. [55:7.8.3.1.2]

21.3.8.3.2 The fire barrier shall be at least 5 ft (1.5 m) from the storage or use area perimeter. [55:7.8.3.1.3]

21.3.8.3.3 The configuration of the fire barrier shall allow natural ventilation to prevent the accumulation of hazardous gas concentrations. [55:7.8.3.1.4]

21.3.9 Toxic and Highly Toxic Gases. [55:7.9]

21.3.9.1 General. The storage or use of toxic or highly toxic gases exceeding the quantity thresholds for gases that require special provisions as specified in Table 5.2.1.1.3 and Table 5.2.1.2.1 shall be in accordance with Sections 21.1 and 21.2, 21.3.1 through 21.3.3, and 21.3.9. [55:7.9.1]

21.3.9.2 Ventilation and Arrangement. [55:7.9.2]

21.3.9.2.1 Indoors. The indoor storage or use of highly toxic gases or toxic gases shall be provided with a gas cabinet, exhausted enclosure, or gas room. [55:7.9.2.1]

21.3.9.2.1.1 Gas cabinets shall be in accordance with 21.2.17. [55:7.9.2.1.1]

21.3.9.2.1.2 Exhausted enclosures shall be in accordance with 21.2.18. [55:7.9.2.1.2]

21.3.9.2.1.3 Gas rooms shall be in accordance with 21.2.4. [55:7.9.2.1.3]

21.3.9.2.2 Distance to Exposures. The outdoor storage or use of toxic or highly toxic compressed gases shall not be within 75 ft (23 m) of lot lines, streets, alleys, public ways or means of egress, or buildings not associated with such storage or use. [55:7.9.2.2]

21.3.9.2.2.1 A 2-hour fire barrier wall without openings or penetrations, and extending not less than 30 in. (762 mm) above and to the sides of the storage or use area, that interrupts the line of sight between the storage or use and the exposure, shall be permitted in lieu of the 75 ft (23 m) distance. [55:7.9.2.2.1]

(A) Where a fire barrier is used to protect compressed gas systems the system shall terminate downstream of the source valve. [55:7.9.2.2.1.1]

(B) The fire barrier wall shall be either an independent structure or the exterior wall of the building adjacent to the storage or use area. [55:7.9.2.2.1.2]

(C) The 2-hour fire barrier shall be located at least 1.5 m (5 ft) from any exposure. [55:7.9.2.2.1.3]

(D) The 2-hour fire barrier shall not have more than two sides at approximately 90 degree (1.5 rad) directions, or more than

△ Table 21.3.8.3 Distance to Exposures for Pyrophoric Gases

Maximum Amount per Storage Area		Minimum Distance to Buildings on the Same Property											
		Minimum Distance Between Storage Areas		Minimum Distance to Property Lines		Minimum Distance to Public Ways		Nonrated or Openings Within 7.6 m (25 ft)		2 Hour and No Openings Within 7.6 m (25 ft)		4 Hour and No Openings Within 7.6 m (25 ft)	
ft ³	m ³	ft	m	ft	m	ft	m	ft	m	ft	m	ft	m
250	7.1	5	1.5	25	7.6	5	1.5	5	1.5	0	0	0	0
2500	71.0	10	3.0	50	15.2	10	3.0	10	3.0	5	1.5	0	0
7500	212.4	20	6.0	100	30.5	20	6.0	20	6.0	10	3.0	0	0

[55:Table 7.8.3]

three sides with connecting angles of approximately 135 degrees (2.36 rad). [55:7.9.2.2.1.4]

21.3.9.2.2.2 Where the storage or use area is located closer than 23 m (75 ft) to a building not associated with the manufacture or distribution of toxic or highly toxic compressed gases, openings in the building other than for piping shall not be permitted above the height of the top of the 2-hour fire barrier wall or within 50 ft (15 m) horizontally from the storage area, regardless of whether the openings are shielded by a fire barrier. [55:7.9.2.2.2]

21.3.9.2.3 Air Intakes. Storage and use of toxic or highly toxic compressed gases shall not be located within 75 ft (23 m) of air intakes. [55:7.9.2.3]

21.3.9.3 Treatment Systems. Except as provided in 21.3.9.3.1 and 21.3.9.3.2, gas cabinets, exhausted enclosures, and gas rooms containing toxic or highly toxic gases shall be provided with exhaust ventilation, with all exhaust directed to a treatment system designed to process accidental release of gas. [55:7.9.3]

21.3.9.3.1 Storage of Toxic or Highly Toxic Gases. Treatment systems shall not be required for toxic or highly toxic gases in storage where cylinders, containers, and tanks are provided with the controls specified in 21.3.9.3.1.1 through 21.3.9.3.1.3. [55:7.9.3.1]

21.3.9.3.1.1 Valve Outlets Protected. Valve outlets shall be equipped with outlet plugs or caps, or both, rated for the container service pressure. [55:7.9.3.1.1]

21.3.9.3.1.2 Handwheels Secured. Where provided, handwheel-operated valves shall be secured to prevent movement. [55:7.9.3.1.2]

21.3.9.3.1.3 Containment Devices Provided. Approved cylinder containment vessels or cylinder containment systems shall be provided at an approved location. [55:7.9.3.1.3]

21.3.9.3.2 Use of Toxic Gases. Treatment systems shall not be required for toxic gases in use where containers, cylinders, and tanks are provided with the controls specified in 21.3.9.3.2.1 and 21.3.9.3.2.2. [55:7.9.3.2]

21.3.9.3.2.1 Gas Detection. [55:7.9.3.2.1]

(A) A gas detection system with a sensing interval not exceeding 5 minutes shall be provided. [55:7.9.3.2.1.1]

(B) The gas detection system shall monitor the exhaust system at the point of discharge from the gas cabinet, exhausted enclosure, or gas room. [55:7.9.3.2.1.2]

21.3.9.3.2.2 Fail-Safe Automatic Closing Valve. An approved automatic-closing fail-safe valve shall be located on or immediately adjacent to and downstream of active cylinder, container, or tank valves. [55:7.9.3.2.2]

(A) The fail-safe valve shall close when gas is detected at the permissible exposure limit, short-term exposure limit (STEL), or ceiling limit by the gas detection system. [55:7.9.3.2.2.1]

(B) For attended operations, a manual closing valve shall be permitted when in accordance 21.3.9.3.4.3. [55:7.9.3.2.2.2]

(C) For gases used at unattended operations for the protection of public health, such as chlorine at water or wastewater treatment sites, the automatic valve shall close if the concentra-

tion of gas detected by a gas detection system reaches one-half of the IDLH. [55:7.9.3.2.2.3]

(D) The gas detection system shall also alert persons on-site and a responsible person off-site when the gas concentration in the storage/use area reaches the OSHA PEL, OSHA ceiling limit, or STEL for the gas employed. [55:7.9.3.2.2.4]

21.3.9.3.3 Treatment System Design and Performance. Treatment systems shall be capable of diluting, adsorbing, absorbing, containing, neutralizing, burning, or otherwise processing stored or used toxic or highly toxic gas, or both. [55:7.9.3.3]

21.3.9.3.3.1 Where a total containment system is used, the system shall be designed to handle the maximum anticipated pressure of release to the system when it reaches equilibrium. [55:7.9.3.3.1]

21.3.9.3.3.2 Treatment systems shall be capable of reducing the allowable discharge concentrations to one-half the IDLH threshold at the point of discharge. [55:7.9.3.3.2]

21.3.9.3.4 Treatment System Sizing. [55:7.9.3.4]

21.3.9.3.4.1 Worst-Case Release of Gas. Treatment systems shall be sized to process the maximum worst-case release of gas based on the maximum flow rate of release from the largest vessel utilized in accordance with 21.3.9.3.4.2. [55:7.9.3.4.1]

21.3.9.3.4.2 Largest Compressed Gas Vessel. The entire contents of the single largest compressed gas vessel shall be considered. [55:7.9.3.4.2]

21.3.9.3.4.3 Attended Operations — Alternative Method of System Sizing. [55:7.9.3.4.3]

(A)* Where source cylinders, containers, and tanks are used in attended process operations, with an operator present at the enclosure where the activity occurs, the volume of the release shall be limited to the estimated amount released from the process piping system within a period not to exceed 5 minutes. [55:7.9.3.4.3.1]

(B) The process piping systems shall comply with 21.3.9.3.4.3(B)(1) through 21.3.9.3.4.3(B)(5).

(1) *Local Exhaust.* All gas transfer operations shall be conducted within a zone of local exhaust that is connected to a treatment system.

(2) *Gas Detection.* Gas detection shall be used to provide a warning to alert the operators to emission of gas into the zone of local exhaust, and the following requirements also shall apply:

(a) The system shall be capable of detecting gas at the permissible exposure limit or ceiling limit for the gas being processed.

(b) Activation of the gas detection system shall provide a local alarm.

(3) *Process Shutdown.* Operations involving the gas detected shall be shut down and leaks repaired.

(4) *Piping System Construction.* Piping systems used to convey gases shall be of all-welded construction throughout, with the exception of fittings used to connect containers, cylinders, or tanks, or any combination thereof, to the process system.

(5) *Piping System Accessibility.* Piping systems shall be designed to provide for readily accessible manual shutdown controls.

[55:7.9.3.4.3.2]

21.3.9.3.5 Rate of Release. The time release shall be in accordance with Table 21.3.9.3.5 for the type of container indicated. [55:7.9.3.5]

21.3.9.3.6* Maximum Flow Rate of Release. [55:7.9.3.6]

21.3.9.3.6.1 For portable containers, cylinders, and tanks, the maximum flow rate of release shall be calculated based on assuming the total release from the cylinder or tank within the time specified. [55:7.9.3.6.1]

21.3.9.3.6.2* When portable containers, cylinders, or tanks are equipped with reduced flow orifices, the worst-case rate of release shall be determined by the maximum achievable flow from the valve determined based on the following formula:

$$CFM = (767 \times A \times P) \left(\frac{28.96 / MW}{60} \right)^{1/2} \quad [21.3.9.3.6.2]$$

where:

CFM = standard cubic feet per minute of gas of concern under flow conditions

A = area of orifice in square inches (See Table A, 21.3.9.3.6 for areas of typical restricted flow orifices.)

P = supply pressure of gas at NTP in pounds per square inch absolute

MW = molecular weight
[55:7.9.3.6.2]

21.3.9.3.6.3 For mixtures, the average of molecular weights shall be used. [55:7.9.3.6.3]

Δ 21.3.9.4 Leaking Containers, Cylinders, and Tanks. When cylinders, containers, or tanks are used outdoors in excess of the quantities specified in Table 5.2.1.2.1 in the column for un-sprinklered areas (unprotected by gas cabinets or exhausted enclosures), a gas cabinet, exhausted enclosure, or containment vessel or system shall be provided to control leaks from leaking cylinders, containers, and tanks in accordance with 21.3.9.4.1 through 21.3.9.4.2.3. [55:7.9.4]

21.3.9.4.1 Gas Cabinets or Exhausted Enclosures. Where gas cabinets or exhausted enclosures are provided to handle leaks from containers, cylinders, or tanks, exhaust ventilation shall be provided that is directed to a treatment system in accordance with the provisions of 21.3.9.3. [55:7.9.4.1]

Δ Table 21.3.9.3.5 Rate of Release

Container Type	Nonliquefied Gases (min)	Liquefied Gases (min)
Cylinders without restrictive flow orifices	5	30
Portable tanks without restrictive flow orifices	40	240
All others	Based on peak flow from maximum valve orifice	Based on peak flow from maximum valve orifice

[55:7.9.3.5]

21.3.9.4.2 Containment Vessels or Systems. Where containment vessels or containment systems are provided, they shall comply with 21.3.9.4.2.1 through 21.3.9.4.2.3. [55:7.9.4.2]

21.3.9.4.2.1 Performance. Containment vessels or containment systems shall be capable of fully containing or terminating a release. [55:7.9.4.2.1]

21.3.9.4.2.2 Personnel. Trained personnel capable of operating the containment vessel or containment system shall be available at an approved location. [55:7.9.4.2.2]

21.3.9.4.2.3 Location. Containment vessels or systems shall be capable of being transported to the leaking cylinder, container, or tank. [55:7.9.4.2.3]

21.3.9.5 Emergency Power. [55:7.9.5]

21.3.9.5.1 General. Emergency power shall comply with 21.3.9.5 in accordance with *NFPA 70*. [55:7.9.5.1]

21.3.9.5.2 Alternative to Emergency Power. Emergency power shall not be required where fail-safe engineering is provided for mechanical exhaust ventilation, treatment systems, and temperature control, and standby power is provided to alternative systems that utilize electrical energy. [55:7.9.5.2]

21.3.9.5.3 Where Required. Emergency power shall be provided for the following systems:

- (1) Exhaust ventilation
 - (2) Treatment system
 - (3) Gas detection system
 - (4) Temperature control system
 - (5) Required alarm systems
- [55:7.9.5.3]

21.3.9.5.4 Level. Emergency power systems shall comply with the requirements for a Level 2 system in accordance with *NFPA 110*. [55:7.9.5.4]

21.3.9.6 Gas Detection. Except as provided in 21.3.9.6.1, a continuous gas detection system in accordance with 21.3.9.6.2 through 21.3.9.6.6 shall be provided for the indoor storage or use of toxic or highly toxic compressed gases. [55:7.9.6]

21.3.9.6.1 Where Gas Detection Is Not Required. A gas detection system shall not be required for toxic gases where the physiological warning properties for the gas are at a level below the accepted permissible exposure limit or ceiling limit for the gas. [55:7.9.6.1]

21.3.9.6.2 Local Alarm. The gas detection system shall initiate a local alarm that is both audible and visible. [55:7.9.6.2]

21.3.9.6.3 Alarm Monitored. The gas detection system shall transmit a signal to a constantly attended control station for quantities exceeding one toxic or highly toxic compressed gas cylinder. [55:7.9.6.3]

21.3.9.6.4 Automatic Shutdown. [55:7.9.6.4]

21.3.9.6.4.1 Activation of the gas detection system shall automatically shut off the flow of gas related to the system being monitored. [55:7.9.6.4.1]

21.3.9.6.4.2 An automatic shutdown shall not be required for reactors utilized for the production of toxic or highly toxic gases when such reactors are operated at pressures less than gauge pressure of 15 psi (103.4 kPa), constantly attended, and

provided with readily accessible emergency shutoff valves. [55:7.9.6.4.2]

21.3.9.6.5 Detection Points. Detection shall be provided at the locations specified in 21.3.9.6.5.1 through 21.3.9.6.5.4. [55:7.9.6.5]

21.3.9.6.5.1 Treatment System Discharge. Detection shall be provided at the discharge from the treatment system. [55:7.9.6.5.1]

21.3.9.6.5.2 Point of Use. Detection shall be provided in the room or area in which the gas is used. [55:7.9.6.5.2]

21.3.9.6.5.3 Source. Detection shall be provided at the source container, cylinder, or tank used for delivery of the gas to the point of use. [55:7.9.6.5.3]

21.3.9.6.5.4 Storage. Detection shall be provided in the room or area in which the gas is stored. [55:7.9.6.5.4]

21.3.9.6.6 Level of Detection. The gas detection system shall detect the presence of gas at or below the permissible exposure limit or ceiling limit of the gas for those points identified in 21.3.9.6.5.2 and 21.3.9.6.5.3, and at not less than one-half the IDLH level for points identified in 21.3.9.6.5.1. [55:7.9.6.6]

21.3.9.7 Automatic Smoke Detection System. An automatic smoke detection system shall be provided for the indoor storage or use of highly toxic compressed gases in accordance with *NFPA 72*. [55:7.9.7]

21.3.10 Unstable Reactive Gases (Nondetonable). The storage or use of unstable reactive (nondetonable) gases exceeding the quantity thresholds for gases requiring special provisions as specified in Table 5.2.1.1.3 and Table 5.2.1.2.1 shall be in accordance with Sections 21.1 and 21.2, 21.3.1 through 21.3.3, and 21.3.10. [55:7.10]

21.3.10.1 Distances to Exposures for Class 2. [55:7.10.1]

21.3.10.1.1 The outdoor storage or use of unstable reactive Class 2 compressed gas shall not be within 20 ft (6 m) of buildings, lot lines, streets, alleys, or public ways or means of egress. [55:7.10.1.1]

21.3.10.1.2 A 2-hour fire barrier wall without openings or penetrations shall be permitted in lieu of the 20 ft (6 m) distance required by 21.3.10.1.1. [55:7.10.1.2]

21.3.10.1.2.1* When a fire barrier is used to protect compressed gas systems, the system shall terminate downstream of the source valve. [55:7.10.1.2.1]

21.3.10.1.2.2 The fire barrier wall shall be either an independent structure or the exterior wall of the building. [55:7.10.1.2.2]

21.3.10.1.2.3 The 2-hour fire barrier shall be located at least 5 ft (1.5 m) from any exposure. [55:7.10.1.2.3]

21.3.10.1.2.4 The 2-hour fire barrier shall not have more than two sides at approximately 1.57 rad (90 degree) directions, or not more than three sides with connecting angles of approximately 135 degrees (2.36 rad). [55:7.10.1.2.4]

21.3.10.2 Distances to Exposures for Class 3. [55:7.10.2]

21.3.10.2.1 The outdoor storage or use of unstable reactive Class 3 (nondetonable) compressed gas shall not be within

75 ft (23 m) of buildings, lot lines, streets, alleys, or public ways or means of egress. [55:7.10.2.1]

21.3.10.2.2 A 2-hour fire barrier wall without openings or penetrations, and extending not less than 30 in. (762 mm) above and to the sides of the storage or use area, that interrupts the line of sight between the storage or use and the exposure shall be permitted in lieu of the 75 ft (23 m) distance specified in 21.3.10.2.1. [55:7.10.2.2]

21.3.10.2.2.1* When a fire barrier is used to protect compressed gas systems, the system shall terminate downstream of the source valve. [55:7.10.2.2.1]

21.3.10.2.2.2 The fire barrier wall shall be either an independent structure or the exterior wall of the building adjacent to the storage or use area. [55:7.10.2.2.2]

21.3.10.2.2.3 The 2-hour fire barrier shall be located at least 1.5 m (5 ft) from any exposure. [55:7.10.2.2.3]

21.3.10.2.2.4 The 2-hour fire barrier shall not have more than two sides at approximately 1.57 rad (90 degree) directions, or more than three sides with connecting angles of approximately 135 degrees (2.36 rad). [55:7.10.2.2.4]

21.3.10.3 Storage Configuration. [55:7.10.3]

21.3.10.3.1 Unstable reactive Class 3 compressed gases stored in cylinders, containers, or tanks shall be arranged to limit individual groups of cylinders, containers, or tanks to areas not exceeding 100 ft² (9.3 m²). [55:7.10.3.1]

21.3.10.3.2 Multiple areas shall be separated by aisles. [55:7.10.3.2]

21.3.10.3.3 Aisle widths shall not be less than the height of the cylinders, containers, or tanks or 4 ft (1.2 m), whichever is greater. [55:7.10.3.3]

21.3.10.4 Basements. Unstable reactive compressed gases shall not be stored in basements. [55:7.10.4]

21.3.10.5 Unstable Reactive Gases (Detonable). [55:7.10.5]

21.3.10.5.1 Storage or Use. The storage or use of unstable reactive (detonable) gases exceeding the quantity thresholds for gases requiring special provisions as specified in Table 5.2.1.1.3 and Table 5.2.1.2.1 shall be in accordance with Sections 21.1 and 21.2, 21.3.1 through 21.3.3, and 21.3.10.5. [55:7.10.5.1]

21.3.10.5.2 Location. The location of storage areas shall be determined based on the requirements of the building code for explosive materials. [55:7.10.5.2]

21.4 Cryogenic Fluids.

21.4.1 General. This section shall apply to all cryogenic fluids, including those fluids regulated elsewhere in this code, except that when specific requirements are provided in Sections 21.5 or 21.7, those specific requirements shall apply as applicable. [55:8.1]

21.4.1.1 Storage, use, and handling of cryogenic fluids shall be in accordance with Sections 21.1, 21.2, and 21.4 as applicable. [55:8.1.1]

21.4.1.2 Storage, use and handling of inert cryogenic fluids shall be in accordance with CGA P-18, *Standard for Bulk Inert Gas Systems*. [55:8.1.2]

21.4.2* Containers — Design, Construction, and Maintenance.

Containers employed for the storage or use of cryogenic fluids shall be designed, fabricated, tested, marked (stamped), and maintained in accordance with DOT regulations; Transport Canada (TC) *Transportation of Dangerous Goods Regulations*; the ASME *Boiler and Pressure Vessel Code*, “Rules for the Construction of Unfired Pressure Vessels”; or regulations of other administering agencies. [55:8.2]

21.4.2.1 Aboveground Tanks. Aboveground tanks for the storage of cryogenic fluids shall be in accordance with 21.4.2.1. [55:8.2.1]

21.4.2.1.1 Construction of the Inner Vessel. The inner vessel of storage tanks in cryogenic fluid service shall be designed and constructed in accordance with Section VIII, Division 1 of the ASME *Boiler and Pressure Vessel Code* and shall be vacuum jacketed in accordance with 21.4.2.1.2. [55:8.2.1.1]

21.4.2.1.2 Construction of the Vacuum Jacket (Outer Vessel). [55:8.2.1.2]

21.4.2.1.2.1 The vacuum jacket used as an outer vessel for storage tanks in cryogenic fluid service shall be of welded steel construction designed to withstand the maximum internal and external pressure to which it will be subjected under operating conditions to include conditions of emergency pressure relief of the annular space between the inner and outer vessel. [55:8.2.1.2.1]

21.4.2.1.2.2 The jacket shall be designed to withstand a minimum collapsing pressure differential of 30 psi (207 kPa). [55:8.2.1.2.2]

21.4.2.1.2.3 Vacuum Level Monitoring. [55:8.2.1.2.3]

(A) A connection shall be provided on the exterior of the vacuum jacket to allow measurement of the pressure within the annular space between the inner and outer vessel. [55:8.2.1.2.3.1]

(B) The connection shall be fitted with a bellows-sealed or diaphragm-type valve equipped with a vacuum gauge tube that is shielded to protect against damage from impact. [55:8.2.1.2.3.2]

21.4.2.2 Nonstandard Containers. [55:8.2.2]

21.4.2.2.1 Containers, equipment, and devices that are not in compliance with recognized standards for design and construction shall be permitted if approved by the authority having jurisdiction upon presentation of evidence that they are designed and constructed for safe operation. [55:8.2.2.1]

21.4.2.2.2 The following data shall be submitted to the authority having jurisdiction with reference to the deviation from the code with the application for approval:

- (1) Type and use of container, equipment, or device
 - (2) Material to be stored, used, or transported
 - (3) Description showing dimensions and materials used in construction
 - (4) Design pressure, maximum operating pressure, and test pressure
 - (5) Type, size, and setting of pressure-relief devices
- [55:8.2.2.2]

21.4.2.3 Foundations and Supports. Stationary tanks shall be provided with concrete or masonry foundations or structural

steel supports on firm concrete or masonry foundations, and 21.4.2.3.1 through 21.4.2.3.5 also shall apply. [55:8.2.3]

21.4.2.3.1 Excessive Loads. Stationary tanks shall be supported to prevent the concentration of excessive loads on the supporting portion of the shell. [55:8.2.3.1]

21.4.2.3.2 Expansion and Contraction. Foundations for horizontal containers shall be constructed to accommodate expansion and contraction of the container. [55:8.2.3.2]

21.4.2.3.3 Support of Ancillary Equipment. [55:8.2.3.3]

21.4.2.3.3.1* Foundations shall be provided to support the weight of vaporizers and/or heat exchangers. [55:8.2.3.3.1]

21.4.2.3.3.2 Foundations shall be designed to withstand soil and frost conditions as well as the anticipated seismic, snow, wind, and hydrostatic loading under operating conditions. [55:8.2.3.3.2]

21.4.2.3.4 Temperature Effects. Where drainage systems, terrain, or surfaces beneath stationary tanks are arranged in a manner that can subject stationary tank foundations or supports to temperatures below -130°F (-90°C), the foundations or supports shall be constructed of materials that are capable of withstanding the low-temperature effects of cryogenic fluid spillage. [55:8.2.3.4]

21.4.2.3.5 Corrosion Protection. Portions of stationary tanks in contact with foundations or saddles shall be painted to protect against corrosion. [55:8.2.3.5]

21.4.2.4 Pressure-Relief Devices. [55:8.2.4]

21.4.2.4.1 General. [55:8.2.4.1]

21.4.2.4.1.1 Pressure-relief devices shall be provided to protect containers and systems containing cryogenic fluids from rupture in the event of overpressure. [55:8.2.4.1.1]

21.4.2.4.1.2 Pressure-relief devices shall be designed in accordance with CGA S-1.1, *Pressure Relief Device Standards — Part 1 — Cylinders for Compressed Gases*, and CGA S-1.2, *Pressure Relief Device Standards — Part 2 — Cargo and Portable Tanks for Compressed Gases*, for portable tanks; and CGA S-1.3, *Pressure Relief Device Standards — Part 3 — Stationary Storage Containers for Compressed Gases*, for stationary tanks. [55:8.2.4.1.2]

21.4.2.4.2 Containers Open to the Atmosphere. Portable containers that are open to the atmosphere and are designed to contain cryogenic fluids at atmospheric pressure shall not be required to be equipped with pressure-relief devices. [55:8.2.4.2]

21.4.2.4.3 Equipment Other than Containers. Heat exchangers, vaporizers, insulation casings surrounding containers, vessels, and coaxial piping systems in which liquefied cryogenic fluids could be trapped due to leakage from the primary container shall be provided with a pressure relief device. [55:8.2.4.3]

21.4.2.4.4 Sizing. [55:8.2.4.4]

21.4.2.4.4.1 Pressure relief devices shall be sized in accordance with the specifications to which the container was fabricated. [55:8.2.4.4.1]

21.4.2.4.4.2 The pressure relief device shall have the capacity to prevent the maximum design pressure of the container or system from being exceeded. [55:8.2.4.4.2]

21.4.2.4.5 Accessibility. Pressure relief devices shall be located such that they are accessible for inspection and repair. [55:8.2.4.5]

21.4.2.4.5.1* ASME pressure relief valves shall be sealed to prevent adjusting the set pressure by other than authorized personnel. [55:8.2.4.5.1]

21.4.2.4.5.2 Non-ASME pressure relief valves shall not be field adjusted. [55:8.2.4.5.2]

21.4.2.4.6 Arrangement. [55:8.2.4.6]

21.4.2.4.6.1 Pressure Relief Devices. Pressure relief devices shall be arranged to discharge unobstructed to the open air in such a manner as to prevent impingement of escaping gas on personnel, containers, equipment, and adjacent structures or its entrance into enclosed spaces. [55:8.2.4.6.1]

21.4.2.4.6.2 Portable Containers with Volume Less than 2 ft³ (0.057 m³). [55:8.2.4.6.2]

(A) The arrangement of the discharge from pressure relief devices from DOT-specified containers with an internal water volume of 2.0 ft³ (0.057 m³) or less shall be incorporated in the design of the container. [55:8.2.4.6.2.1]

(B) Additional safeguards regarding placement or arrangement shall not be required. [55:8.2.4.6.2.2]

21.4.2.4.7 Shutoffs Between Pressure Relief Devices and Containers. [55:8.2.5.7]

21.4.2.4.7.1 General. Shutoff valves installed between pressure relief devices and containers shall be in accordance with 21.4.2.4.7. [55:8.2.5.7.1]

21.4.2.4.7.2 Location. Shutoff valves shall not be installed between pressure relief devices and containers unless the valves or their use meet 21.4.2.4.7.2(A) or 21.4.2.4.7.2(B). [55:8.2.5.7.2]

(A) **Security.** Shutoff valves shall be locked in the open position, and their use shall be limited to service-related work performed by the supplier under the requirements of the ASME *Boiler and Pressure Vessel Code*. [55:8.2.4.7.2.1]

(B) **Multiple Pressure Relief Devices.** Shutoff valves controlling multiple pressure relief devices on a container shall be installed so that either the type of valve installed or the arrangement provides the full required flow through the minimum number of required relief devices at all times. [55:8.2.4.7.2.2]

21.4.2.4.8 Temperature Limits. Pressure relief devices shall not be subjected to cryogenic fluid temperatures except when operating. [55:8.2.4.8]

21.4.3 Pressure Relief Vent Piping. [55:8.3]

21.4.3.1 General. Pressure relief vent piping systems shall be constructed and arranged to direct the flow of gas to a safe location and in accordance with 21.4.3. [55:8.3.1]

21.4.3.2 Sizing. Pressure relief device vent piping shall have a cross-sectional area not less than that of the pressure relief device vent opening and shall be arranged so as not to restrict the flow of escaping gas. [55:8.3.2]

21.4.3.3 Arrangement. Pressure relief device vent piping and drains in vent lines shall be arranged so that escaping gas discharges unobstructed to the open air and does not impinge on personnel, containers, equipment, and adjacent structures or enter enclosed spaces. [55:8.3.3]

21.4.3.4 Installation. Pressure relief device vent lines shall be installed in a manner that excludes or removes moisture and condensation to prevent malfunction of the pressure-relief device due to freezing or ice accumulation. [55:8.3.4]

21.4.3.5 Overfilling. Controls shall be provided to prevent overfilling of stationary containers. [55:8.3.5]

21.4.4 Marking. [55:8.4]

21.4.4.1 General. Cryogenic containers and systems shall be marked in accordance with nationally recognized standards and in accordance with 21.4.4. [55:8.4.1]

21.4.4.1.1 Portable Containers. [55:8.4.1.1]

21.4.4.1.1.1 Portable cryogenic containers shall be marked in accordance with CGA C-7, *Guide to Classification and Labeling of Compressed Gases*. [55:8.4.1.1.1]

21.4.4.1.1.2* All DOT-4L/TC-4LM liquid cylinders shall have product identification visible from all directions with minimum 2 in. (51 mm) high letters. [55:8.4.1.1.2]

21.4.4.1.2 Stationary Tanks. Stationary tanks shall be marked in accordance with NFPA 704. [55:8.4.1.2]

21.4.4.1.3 Identification Signs. Visible hazard identification signs shall be provided in accordance with NFPA 704 at entrances to buildings or areas in which cryogenic fluids are stored, handled, or used. [55:8.4.1.3]

21.4.4.2 Identification of Contents. Stationary containers shall be placarded with the identity of their contents to indicate the name of the material contained. [55:8.4.2]

21.4.4.3 Container Specification. Stationary containers shall be marked with the manufacturing specification and maximum allowable working pressure on a permanent nameplate. [55:8.4.3]

21.4.4.3.1 The nameplate shall be installed on the container in an accessible location. [55:8.4.3.1]

21.4.4.3.2 The nameplate shall be marked in accordance with nationally recognized standards. [55:8.4.3.2]

21.4.4.4 Identification of Container Connections. [55:8.4.4]

21.4.4.4.1 Container inlet and outlet connections, liquid-level limit controls, valves, and pressure gauges shall be identified using one of the following methods:

- (1) They shall be marked with a permanent tag or label identifying their function.
- (2) They shall be identified by a schematic drawing that indicates their function and designates whether they are connected to the vapor or liquid space of the container. [55:8.4.4.1; 55:8.4.4.1.1; 55:8.4.4.1.2]

21.4.4.4.2 When a schematic drawing is provided, it shall be attached to the container and maintained in a legible condition. [55:8.4.4.1.2.1]

21.4.4.5 Identification of Piping Systems. Piping systems shall be identified in accordance with ASME A13.1, *Scheme for the Identification of Piping Systems*. [55:8.4.5]

21.4.4.6 Identification of Emergency Shutoff Valves. Emergency shutoff valves on stationary containers shall be identified, visible, and indicated by means of a sign. [55:8.4.6]

21.4.5 Medical Cryogenic Systems. [55:8.5]

△ **21.4.5.1** Bulk cryogenic fluid systems in medical gas applications at health care facilities shall be in accordance with Section 21.4, 21.1.1.2.1(3), and the material-specific requirements of Section 21.5, as applicable. [55:8.5.1]

△ **21.4.5.1.1** Bulk cryogenic fluid systems shall be in accordance with the following provisions as applicable:

- (1) Where located in a court, systems shall be in accordance with 21.4.13.2.7.
- (2) Where located indoors, systems shall be in accordance with 21.4.13.1.
- (3) Systems shall be installed by personnel qualified in accordance with CGA M-1, *Guide for Medical Gas Supply Systems at Health Care Facilities*, or ANSI/ASSE/IAPMO 6015, *Bulk Medical Gas Systems Installers*.
- (4) Systems shall be installed in compliance with Food and Drug Administration Current Good Manufacturing Practices as found in 21 CFR 210 and 21 CFR 211

[55:8.5.1.1]

21.4.5.1.2 The following components of the bulk system shall be accessible and visible to delivery personnel during filling operations:

- (1) Fill connection
- (2) Top and bottom fill valves
- (3) Hose purge valve
- (4) Vent valve
- (5) Full trycock valve
- (6) Liquid level gauge
- (7) Tank pressure gauge

[55:8.5.1.2]

21.4.5.1.3 Bulk cryogenic fluid system shall be anchored with foundations in accordance with the provisions of CGA M-1, *Guide for Medical Gas Supply Systems at Health Care Facilities*. [55:8.5.1.3]

21.4.5.1.4 Bulk cryogenic fluid systems shall consist of the following:

- (1) One or more main supply vessel(s), whose capacity shall be determined after consideration of the customer usage requirements, delivery schedules, proximity of the facility to alternate supplies, and the emergency plan
- (2) A contents gauge on each of the main vessel(s)
- (3) A reserve supply sized for greater than an average day's supply, with the size of vessel or number of cylinders being determined after consideration of delivery schedules, proximity of the facility to alternate supplies, and the facility's emergency plan
- (4) At least two main vessel relief valves and rupture discs installed downstream of a three-way (three-port) valve
- (5) A check valve located in the primary supply piping upstream of the intersection with a secondary supply or reserve supply

[55:8.5.1.4]

21.4.5.1.5 Bulk cryogenic fluid reserve supply systems consisting of either a second cryogenic fluid source or a compressed gas source shall include the following:

- (1) When the reserve source is a compressed gas source, the reserve shall be equipped with the following:
 - (a) A cylinder manifold having not less than three gas cylinder connections or as otherwise required for an average of one day's gas supply
 - (b) A pressure switch to monitor the pressure in the cylinder manifold
- (2) When the reserve source is a second cryogenic fluid vessel, the reserve tank shall be equipped with the following:
 - (a) An actuating switch or sensor to monitor the internal tank pressure
 - (b) A contents gauge to monitor the liquid level
- (3) When the reserve source is either a cryogenic fluid or compressed gas source, a check valve shall be provided to prevent backflow into the reserve system

[55:8.5.1.5]

21.4.5.1.6 Bulk cryogenic fluid systems shall include a fill mechanism consisting of the following components:

- (1) A nonremovable product-specific fill connection in compliance with CGA V-6, *Standard Bulk Refrigerated Liquid Transfer Connections*
- (2) A means to cap and secure the fill connection inlet
- (3) A check valve to prevent product backflow from the fill inlet
- (4) A fill hose purge valve
- (5) Supports that hold the fill piping off the ground
- (6) A secure connection between the bulk tank and the fill piping
- (7) Supports as necessary to hold the fill line in position during all operations associated with the filling procedure

[55:8.5.1.6]

21.4.5.1.7 Where vaporizers are required to convert cryogenic liquid to the gaseous state, the vaporizer units shall conform to the following:

- (1) Be permitted to operate by either ambient heat transfer or external thermal source (e.g., electric heater, hot water, steam)
- (2) Be designed to provide capacity for the customer's peak and average flow rates under local conditions, seasonal conditions for weather and humidity, and structures that obstruct air circulation flow and sunlight
- (3) If switching is required as part of the system design, have piping and manual/automatic valving configured in such a manner that operating vaporizer(s) or sections of the vaporizer can be switched to non-operating vaporizer or section of the vaporizer to de-ice through a valving configuration that assures continuous flow to the facility through either or both vaporizers and/or sections of the vaporizer if valving switchover fails

[55:8.5.1.7]

21.4.5.1.8 Where a vaporizer requires an external thermal source, the flow from the source of supply shall be unaffected by the loss of the external thermal source through either of the following:

- (1) Reserve ambient heat transfer vaporizers capable of providing capacity for at least one day's average supply and piped so as to be unaffected by flow stoppage through the main vaporizer
- (2) A reserve non-cryogenic source capable of providing at least one day's average supply
- [55:8.5.1.8]

21.4.6 Security. [55:8.6]

21.4.6.1 General. Cryogenic containers and systems shall be secured against accidental dislodgement and against access by unauthorized personnel in accordance with 21.4.6. [55:8.6.1]

21.4.6.2 Security of Areas. Areas used for the storage of containers and systems shall be secured against unauthorized entry. [55:8.6.2]

21.4.6.3 Securing of Containers. Stationary containers shall be secured to foundations in accordance with the building code. [55:8.6.3]

21.4.6.3.1 Portable containers subject to shifting or upset shall be secured. [55:8.6.3.1]

21.4.6.3.2 Nesting shall be permitted as a means of securing portable containers. [55:8.6.3.2]

21.4.6.4 Securing of Vaporizers. Vaporizers, heat exchangers, and similar equipment shall be secured to foundations, and their connecting piping shall be designed and constructed to provide for the effects of expansion and contraction due to temperature changes. [55:8.6.4]

21.4.6.5 Physical Protection. Containers, piping, valves, pressure-relief devices, regulating equipment, and other appurtenances shall be protected against physical damage and tampering. [55:8.6.5]

21.4.7 Separation from Hazardous Conditions. [55:8.7]

21.4.7.1 General. Cryogenic containers and systems in storage or use shall be separated from materials and conditions that present exposure hazards to or from each other in accordance with 21.4.7. [55:8.7.1]

21.4.7.2* Stationary Cryogenic Containers. Stationary containers located outdoors shall be separated from exposure hazards in accordance with the minimum separation distances indicated in Table 21.4.7.2. [55:8.7.2]

21.4.7.2.1 Fire Barriers. A 2-hour fire barrier wall shall be permitted in lieu of the distances specified by Table 21.4.7.2, for items 1, 4, 7, 8, and 9, when in accordance with the provisions of 21.4.7.2.1.1 through 21.4.7.2.1.4. [55:8.7.2.1]

21.4.7.2.1.1 The fire barrier wall shall be without openings or penetrations with the exception of 21.4.7.2.1.2. [55:8.7.2.1.1]

21.4.7.2.1.2 Penetrations of the fire barrier wall by conduit or piping shall be permitted provided that the penetration is protected with a fire stop system in accordance with the building code. [55:8.7.2.1.1.1]

21.4.7.2.1.3 The fire barrier wall shall be either an independent structure or the exterior wall of the building adjacent to the storage system. [55:8.7.2.1.2]

21.4.7.2.1.4 The fire barrier wall shall be located not less than 5 ft (1.5 m) from any exposure. [55:8.7.2.1.3]

21.4.7.2.1.5 The fire barrier wall shall not have more than two sides at 90 degree (1.57 rad) directions, or not more than three sides with connecting angles of 135 degrees (2.36 rad). [55:8.7.2.1.4]

(A) The connecting angles between fire barrier walls shall be permitted to be reduced to less than 135 degrees (2.36 rad) for installations consisting of three walls when in accordance with 8.13.2.7.2 of NFPA 55. [55:8.7.2.1.4.1]

21.4.7.2.1.6 Where the requirement of 21.4.7.2.1.5 is met, the bulk system shall be a minimum distance of 1 ft (0.3 m) from the fire barrier wall. [55:8.7.2.1.5]

21.4.7.2.2 Point-of-Fill Connections. Point-of-fill connections points serving stationary containers filled by mobile transport equipment shall not be positioned closer to exposures than the minimum distances in Table 21.4.7.2. [55:8.7.2.2]

21.4.7.2.3 Surfaces Beneath Containers. The surface of the area on which stationary containers are placed, including the surface of the area located below the point at which connections are made for the purpose of filling such containers, shall be compatible with the fluid in the container. [55:8.7.2.4]

21.4.7.3 Portable Cryogenic Containers. Portable containers used for cryogenic fluids located outdoors shall be separated from exposure hazards in accordance with Table 21.4.7.3. [55:8.7.3]

Δ 21.4.7.3.1 Non-bulk portable containers of liquefied hydrogen shall be separated from exposure hazards in accordance with Table 21.4.7.3.1. [55:8.7.3.1]

21.4.7.3.2 Fire Barriers. A 2-hour fire barrier wall shall be permitted in lieu of the distances specified by Table 21.4.7.3 when in accordance with the provisions of 21.4.7.3.2.1 through 21.4.7.3.2.4. [55:8.7.3.2]

21.4.7.3.2.1 The fire barrier wall shall be without openings or penetrations with the exception of 21.4.7.3.2.2. [55:8.7.3.2.1]

21.4.7.3.2.2 Penetrations of the fire barrier wall by conduit or piping shall be permitted provided that the penetration is protected with a firestop system in accordance with the building code. [55:8.7.3.2.1.1]

Table 21.4.7.2 Minimum Separation Distance Between Stationary Cryogenic Containers and Exposures

Exposure	Minimum Distance	
	ft	m
(1) Buildings, regardless of construction type	1	0.3
(2) Wall openings	1	0.3
(3) Air intakes	10	3.1
(4) Property lines	5	1.5
(5) Places of public assembly (assembly occupancies)	50	15
(6) Nonambulatory patient areas	50	15
(7) Combustible materials, such as paper, leaves, weeds, dry grass, or debris	15	4.5
(8) Incompatible hazardous materials	20	6.1
(9) Building exits	10	3.1

[55:Table 8.7.2]

21.4.7.3.2.3 The fire barrier wall shall be either an independent structure or the exterior wall of the building adjacent to the storage system. [55:8.7.3.2.2]

21.4.7.3.2.4 The fire barrier wall shall be located not less than 5 ft (1.5 m) from any exposure. [55:8.7.3.2.3]

21.4.7.3.2.5 The fire barrier wall shall not have more than two sides at approximately 90 degree (1.57 rad) directions, or not more than three sides with connecting angles of approximately 135 degrees (2.36 rad). [55:8.7.3.2.4]

21.4.8 Electrical Wiring and Equipment. [55:8.8]

21.4.8.1 General. Electrical wiring and equipment shall be in accordance with *NFPA 70* and 21.4.8. [55:8.8.1]

21.4.8.2 Location. Containers and systems shall not be located where they could become part of an electrical circuit. [55:8.8.2]

21.4.8.3 Electrical Ground and Bonding. Containers and systems shall not be used for electrical grounding. [55:8.8.3]

21.4.8.3.1 When electrical grounding and bonding is required, the system shall be in accordance with *NFPA 70*. [55:8.8.3.1]

Table 21.4.7.3 Minimum Separation Distance Between Portable Cryogenic Containers and Exposures

Exposure	Minimum Distance	
	ft	m
Building exits	10	3.1
Wall openings	1	0.3
Air intakes	10	3.1
Property lines	5	1.5
Room or area exits	3	0.9
Combustible materials, such as paper, leaves, weeds, dry grass, or debris	15	4.5
Incompatible hazardous materials	20	6.1

[55:Table 8.7.3]

21.4.8.3.2 The grounding system shall be protected against corrosion, including corrosion caused by stray electrical currents. [55:8.8.3.2]

21.4.9 Service and Repair. Service, repair, modification, or removal of valves, pressure relief devices, or other container appurtenances shall be in accordance with nationally recognized codes and standards. [55:8.9]

21.4.9.1 Containers. Containers that have been removed from service shall be handled in an approved manner. [55:8.9.1]

21.4.9.1.1 Testing. Containers, out of service in excess of 1 year, shall be inspected and tested as required in 21.4.9.1.2. [55:8.9.1.1]

21.4.9.1.2 Pressure Relief Device Testing. The pressure relief devices shall be tested for operability and to determine if they are set at the relief pressure required by the tank design. [55:8.9.1.2]

21.4.9.1.3 Containers that have previously been used for flammable cryogenic fluids and have been removed from service shall be purged with an inert gas to remove residual flammable gas and stored with all valves closed and the valve outlets plugged. [55:8.9.1.3]

21.4.9.2 Systems. Service and repair of containers or systems shall be performed by trained personnel in accordance with nationally recognized standards and with the permission of the container owner. [55:8.9.2]

21.4.10 Unauthorized Use. Containers shall not be used for any purpose other than to serve as a vessel for containing the product for which it is designated. [55:8.10]

21.4.11 Leaks, Damage, and Corrosion. [55:8.11]

21.4.11.1 Leaking, damaged, or corroded containers shall be removed from service. [55:8.11.1]

21.4.11.2 Leaking, damaged, or corroded systems shall be replaced, repaired, or removed from service. [55:8.11.2]

21.4.12 Lighting. Where required by the authority having jurisdiction, lighting, including emergency lighting, shall be provided for fire appliances and operating facilities such as

Table 21.4.7.3.1 Distance to Exposures for Non-Bulk Liquefied Hydrogen (LH₂)

Maximum Amount per Storage Area (gal)	Minimum Distance Between Storage Areas (ft)	Minimum Distance to Lot Lines of Property That Can Be Built Upon (ft)	Minimum Distance to Public Streets, Public Alleys or Public Ways (ft)	Minimum Distance to Buildings on the Same Property		
				Less than 2-Hour Construction	2-Hour Construction	4-Hour Construction
0–39.7	5	5	5	5	0	0
39.8–186.9	10	10	10	10	5	0
187–448.7	10	15	15	20	5	0
448.8–747.8	10	20	20	20	5	0
>747.8	20	25	25	20	5	0

For SI units: 1 ft = 305 mm.

Notes:

(1) For requirements on minimum distance to air intakes, see 7.6.2.4.

(2) For requirements on minimum distance to building openings including exits, see 7.6.2.5.

(3) When 8.7.3.2 is used as a means of distance reduction, the configuration of the fire barriers should be designed to allow natural ventilation to prevent the accumulation of hazardous gas concentrations.

[55:Table 8.7.3.1]

walkways, control valves, and gates ancillary to stationary containers. [55:8.12]

21.4.13 Storage. [55:8.13]

21.4.13.1 Indoor Storage. [55:8.13.1]

21.4.13.1.1 Installation. Stationary containers indoors shall be installed in accordance with Sections 21.5 and 21.7 or ANSI/CGA P-18, *Standard for Bulk Inert Gas Systems*. [55:8.13.1.1]

21.4.13.1.2 Stationary Containers. Stationary containers shall be in accordance with 21.4.2. [55:8.13.1.2]

21.4.13.1.3 Cryogenic Fluids. Cryogenic fluids in stationary or portable containers stored indoors shall be stored in buildings, rooms, or areas constructed in accordance with the building code. [55:8.13.1.3]

21.4.13.1.4 Ventilation. Ventilation shall be in accordance with 21.2.16. [55:8.13.1.4]

21.4.13.2 Outdoor Storage. [55:8.13.2]

21.4.13.2.1 General. Cryogenic fluids in stationary or portable containers stored outdoors shall be in accordance with 21.4.13.2. [55:8.13.2.1]

21.4.13.2.2 Access. [55:8.13.2.2]

21.4.13.2.2.1 Stationary containers shall be located to provide access by mobile supply equipment and authorized personnel. [55:8.13.2.2]

21.4.13.2.2.2 Where exit access is provided to serve areas in which equipment is installed, the minimum width shall be not less than 28 in. (710 mm). [55:8.13.2.2.1]

21.4.13.2.3 Physical Protection. [55:8.13.2.3]

21.4.13.2.3.1 Cryogenic fluid cylinders, containers, tanks, and systems that could be exposed to physical damage shall be protected. [55:8.13.2.3]

21.4.13.2.3.2 Guard posts or other means shall be provided to protect cryogenic fluid cylinders, containers, tanks, and systems indoors and outdoors from vehicular damage. (*See 6.1.9.*) [55:8.13.2.3.1]

21.4.13.2.4 Diked Areas Containing Other Hazardous Materials. Containers of cryogenic fluids shall not be located within diked areas with other hazardous materials. [55:8.13.2.4]

21.4.13.2.5* Areas Subject to Flooding. Stationary containers located in flood hazard areas shall be anchored to prevent flotation during conditions of the design flood as designated by the building code. [55:8.13.2.5]

21.4.13.2.5.1 Elevated Tanks. Structures supporting elevated tanks to and tanks that are supported at a level above that designated in the design flood shall be anchored to resist lateral shifting due to flood and other hydrostatic effects. [55:8.13.2.5.1]

21.4.13.2.5.2 Underground Tanks. Underground tanks in flood hazard areas shall be anchored to prevent flotation, collapse, or lateral movement resulting from hydrostatic loads, including the effects of buoyancy, during conditions of the design flood. [55:8.13.2.5.2]

21.4.13.2.6 Drainage. [55:8.13.2.6]

21.4.13.2.6.1 The area surrounding stationary and portable containers shall be provided with a means to prevent accidental discharge of fluids from endangering personnel, containers, equipment, and adjacent structures and from entering enclosed spaces in accordance with NFPA 1. [55:8.13.2.6.1]

21.4.13.2.6.2 The stationary container shall not be placed where spilled or discharged fluids will be retained around the container. [55:8.13.2.6.2]

21.4.13.2.6.3 The provisions of 21.4.13.2.6.2 shall be permitted to be altered or waived where the authority having jurisdiction determines that the container does not constitute a hazard after consideration of special features such as the following:

- (1) Crushed rock utilized as a heat sink
- (2) Topographical conditions
- (3) Nature of occupancy
- (4) Proximity to structures on the same or adjacent property
- (5) Capacity and construction of containers and character of fluids to be stored

[55:8.13.2.6.3]

21.4.13.2.6.4 Grade. [55:8.13.2.6.4]

(A) The grade for a distance of not less than 50 ft (15.2 m) from where cryogenic fluid storage or delivery systems are installed shall be higher than the grade on which flammable or combustible liquids are stored or used. [55:8.13.2.6.4]

Δ (B)* Drainage Control.

- (1) When the grade differential between the storage or delivery system and the flammable or combustible liquids storage or use area is not in accordance with 21.4.13.2.6.4(A), diversion curbs or other means of drainage control shall be used to divert the flow of flammable or combustible liquids away from the cryogenic system. [55:8.13.2.6.4(A)]
- (2) The means of drainage control shall prevent the flow of flammable or combustible liquid to a distance not less than 50 ft (15.2 m) from all parts of the delivery system. [55:8.13.2.6.4(B)]

21.4.13.2.7 Outdoor Installations. [55:8.13.2.7]

21.4.13.2.7.1 Enclosed Courts. Stationary containers shall not be installed within enclosed courts. [55:8.13.2.7.1]

21.4.13.2.7.2* Courts. Stationary containers shall be sited so that they are open to the surrounding environment except that encroachment by building walls of unlimited height shall be permitted when in accordance with the distances specified by Table 21.4.7.2 or the material-specific tables in Sections 21.5 or 21.7. [55:8.13.2.7.2]

(A)* Where exterior building walls encroach on the system to form a court, the system shall be located at a distance not less than the height of the wall from at least two court walls. [55:8.13.2.7.2.1]

(B) The required distance between the exterior walls of the building forming the court and the container shall be determined independently without regard to fire barrier walls used to allow encroachment by fire exposure hazards. [55:8.13.2.7.2.2]

21.4.13.2.7.3 Fire Department Access. Fire department access roadways or other approved means shall be in accordance with NFPA 1. [55:8.13.2.7.3]

21.4.14 Use and Handling. [55:8.14]

21.4.14.1 General. Use and handling of containers and systems shall be in accordance with 21.4.14. [55:8.14.1]

21.4.14.1.1 Operating Instructions. Operating instructions shall be provided for installations that require the operation of equipment. [55:8.14.1.1]

21.4.14.1.2 Attended Delivery. A qualified person shall be in attendance at all times cryogenic fluid is transferred from mobile supply units to a storage system. [55:8.14.1.2]

21.4.14.1.3 Inspection. [55:8.14.1.3]

21.4.14.1.3.1 Cryogenic fluid storage systems shall be inspected and maintained by a qualified representative of the equipment owner as required by the material-specific requirements of Sections 21.5 and 21.7. [55:8.14.1.3.1]

(A)* The interval between inspections other than those specified by material-specific requirements shall be based on nationally recognized good practices or standards. [55:8.14.1.3.1.1]

21.4.14.1.3.2 A record of the inspection shall be prepared and provided to the user or the authority having jurisdiction upon request. [55:8.14.1.3.2]

21.4.14.1.4 Design. [55:8.14.1.4]

21.4.14.1.4.1 Nationally Recognized Good Practices. Where nationally recognized good practices or standards have been established for the process employed, such practices and standards shall be followed. [55:8.14.1.4.1]

21.4.14.1.4.2 Piping Systems. Piping, tubing, fittings, and related components shall be designed, fabricated, and tested in accordance with ASME B31.3, *Process Piping*, or other approved standards and shall be in accordance with 21.4.14.2. [55:8.14.1.4.2]

21.4.14.2 Piping and Appurtenances. [55:8.14.2]

21.4.14.2.1 Piping systems shall be designed for the use intended through the full range of pressure and temperature to which they will be subjected. [55:8.14.2.1]

21.4.14.2.2 Piping systems shall be designed and constructed to allow for expansion, contraction, vibration, settlement, and fire exposure. [55:8.14.2.2]

21.4.14.3 Joints. Joints in piping and tubing shall be in accordance with the requirements of ANSI/ASME B31.3, *Process Piping*, or other approved standards. [55:8.14.3]

21.4.14.4 Valves and Accessory Equipment. Valves and accessory equipment shall be acceptable for the intended use at the temperatures of the application and shall be designed and constructed to withstand the maximum pressure at the minimum temperature to which they will be subjected. [55:8.14.4]

21.4.14.5 Shutoff Valves on Containers. Shutoff valves shall be provided on all container connections, except for pressure-relief devices. [55:8.14.5]

21.4.14.5.1 Shutoff valves for containers with multiple pressure-relief devices shall be permitted in accordance with 21.4.2.4.7. [55:8.14.5.1]

21.4.14.5.2 Shutoff valves shall be accessible and located as close as practical to the container. [55:8.14.5.2]

21.4.14.6 Shutoff Valves on Piping. [55:8.14.6]

21.4.14.6.1 Shutoff valves shall be installed in piping containing cryogenic fluids where needed to limit the volume of liquid discharged in the event of piping or equipment failure. [55:8.14.6.1]

21.4.14.6.2 Pressure relief valves shall be installed where liquid or cold gas can be trapped between shutoff valves in the piping system. [55:8.14.6.2]

21.4.14.7 Physical Protection and Support. [55:8.14.7]

21.4.14.7.1 Aboveground piping systems shall be supported and protected from physical damage. [55:8.14.7.1]

21.4.14.7.2 Piping passing through walls shall be protected from mechanical damage. [55:8.14.7.2]

21.4.14.8 Corrosion Protection. [55:8.14.8]

21.4.14.8.1 Aboveground piping that is subject to corrosion shall be protected against corrosion. [55:8.14.8.1]

21.4.14.8.2 Belowground piping shall be protected against corrosion. [55:8.14.8.2]

21.4.14.9 Cathodic Protection. Where required, cathodic protection shall be in accordance with 21.4.14.9. [55:8.14.9]

21.4.14.9.1 Operation. Where installed, cathodic protection systems shall be operated and maintained to continuously provide corrosion protection. [55:8.14.9.1]

21.4.14.9.2 Inspection. [55:8.14.9.2]

21.4.14.9.2.1 Container systems equipped with cathodic protection shall be inspected for the intended operation by a cathodic protection tester. [55:8.14.9.2.1]

21.4.14.9.2.2 The cathodic protection tester shall be certified as being qualified by the National Association of Corrosion Engineers, International (NACE). [55:8.14.9.2.2]

21.4.14.9.3 Impressed Current Systems. [55:8.14.9.3]

21.4.14.9.3.1 Systems equipped with impressed current cathodic protection systems shall be inspected in accordance with the design and 21.4.14.9.2. [55:8.14.9.3.1]

21.4.14.9.3.2 The design limits shall be available to the AHJ upon request. [55:8.14.9.3.2]

21.4.14.9.3.3 The system owner shall maintain the following records to demonstrate that the cathodic protection is in conformance with the design:

- (1) The results of inspections of the system
- (2) The results of testing that has been completed [55:8.14.9.3.3]

21.4.14.9.4 Corrosion Expert.

21.4.14.9.4.1 Repairs, maintenance, or replacement of a cathodic protection system shall be under the supervision of a corrosion expert certified by NACE. [55:8.14.9.4.1]

21.4.14.9.4.2 The corrosion expert shall be certified by NACE as a senior corrosion technologist, a cathodic protection specialist, or a corrosion specialist or shall be a registered engineer with registration in a field that includes education and experience in corrosion control. [55:8.14.9.4.2]

21.4.14.10 Testing. [55:8.14.10]

21.4.14.10.1 Piping systems shall be tested and proven free of leaks after installation as required by the codes and standards to which they are designed and constructed. [55:8.14.10.1]

21.4.14.10.2 Test pressures shall not be less than 150 percent of the maximum allowable working pressure when hydraulic testing is conducted or 110 percent when testing is conducted pneumatically. [55:8.14.10.2]

21.4.14.11 Material-Specific Requirements. [55:8.14.11]

21.4.14.11.1 Indoor Use. Indoor use of cryogenic fluids shall be in accordance with the material-specific provisions of Sections 21.5 and 21.7 or with ANSI/CGA P-18, *Standard for Bulk Inert Gas Systems*, and 21.4.14.2. [55:8.14.11.1]

21.4.14.11.2 Outdoor Use. [55:8.14.11.2]

21.4.14.11.2.1 General. Outdoor use of cryogenic fluids shall be in accordance with the material-specific provisions of Sections 21.5 and 21.7 or with ANSI/CGA P-18, *Standard for Bulk Inert Gas Systems*, and 21.4.14.2. [55:8.14.11.2.1]

△ **21.4.14.11.2.2 Separation.** Distances from property lines, buildings, and exposure hazards shall be in accordance with Table 21.4.7.2 and Table 21.4.7.3 and the material-specific provisions of Sections 21.5 and 21.7 or with ANSI/CGA P-18, *Standard for Bulk Inert Gas Systems*. [55:8.14.11.2.2]

21.4.14.11.2.3* Emergency Shutoff Valves. Accessible manual or automatic emergency shutoff valves shall be provided to shut off the cryogenic fluid supply in case of emergency. [55:8.14.11.2.3]

(A) Manual emergency shutoff valves or the device that activates an automatic emergency shutoff valve on a bulk source or piping systems serving the bulk supply shall be identified by means of a sign. [55:8.14.11.2.3.1(A)]

(B) Emergency shutoff valves shall be located at the point of use, at the source of supply, and at the point where the system piping enters the building. [55:8.14.11.2.3.2]

21.4.14.11.3 Filling and Dispensing. [55:8.14.11.3]

21.4.14.11.3.1 General. Filling and dispensing of cryogenic fluids shall be in accordance with 21.4.14.1.2. [55:8.14.11.3.1]

21.4.14.11.3.2 Dispensing Areas. Dispensing of cryogenic fluids associated with physical or health hazards shall be conducted in approved locations. [55:8.14.11.3.2]

(A) **Indoor Dispensing Areas.** Dispensing indoors shall be conducted in areas constructed in accordance with the building code. [55:8.14.11.3.2.1]

△ (B) **Ventilation.** Indoor areas in which cryogenic fluids are dispensed shall be ventilated in accordance with 21.2.16 and the IAPMO *Uniform Mechanical Code*. [55:8.14.11.3.2.2]

△ (C) **Piping Systems.** Piping systems utilized for filling or dispensing of cryogenic fluids shall be designed and constructed in accordance with 21.4.14.2. [55:8.14.11.3.2.3]

21.4.14.11.3.3 Vehicle Loading and Unloading Areas. Loading or unloading areas shall be constructed in accordance with Section 21.5 for liquid oxygen and Section 21.7 for liquid hydrogen or ANSI/CGA P-18, *Standard for Bulk Inert Gas*

Systems, for inert cryogenic fluids, as applicable. [55:8.14.11.3.3]

△ **21.4.14.11.3.4*** A noncombustible, delivery vehicle spill pad shall be provided when required by the material-specific requirements of Chapter 9 of NFPA 55 for liquid oxygen, Chapter 11 of NFPA 55 for liquid hydrogen, or ANSI/CGA P-18, *Standard for Bulk Inert Gas Systems*. [55:8.14.11.3.4]

(A)* A noncombustible spill pad shall be provided for delivery areas where bulk liquid helium is transferred from delivery vehicles. [55:8.14.11.3.4.1]

21.4.14.11.3.5 Filling Controls. A pressure gauge and full trycock valve shall be provided and shall be visible from the delivery point to allow the delivery operator to monitor the internal pressure and liquid level of stationary containers during filling. [55:8.14.11.3.5]

(A) When the containers being filled are remote from the delivery point and pressure gauges or full trycock valves are not visible, redundant gauges and valves shall be installed at the filling connection. [55:8.14.11.3.5.1]

21.4.14.11.4 Handling. [55:8.14.11.4]

21.4.14.11.4.1 Applicability. Handling of cryogenic containers shall be in accordance with 21.4.14.11.4. [55:8.14.11.4.1]

21.4.14.11.4.2 Carts and Trucks. [55:8.14.11.4.2]

(A) Cryogenic containers shall be moved using an approved method. [55:8.14.11.4.2.1]

(B) Where cryogenic containers are moved by hand cart, hand truck, or other mobile device, that device shall be designed for the secure movement of the container. [55:8.14.11.4.2.2]

21.4.14.11.4.3 Design. Carts and trucks used to transport cryogenic containers shall be designed to provide a stable base for the commodities to be transported and shall have a means of restraining containers to prevent accidental dislodgement. [55:8.14.11.4.3]

21.4.14.11.4.4 Closed Containers. [55:8.14.11.4.4]

(A) Pressurized containers shall be closed while transported. [55:8.14.11.4.4.1]

(B) Containers designed for use at atmospheric conditions shall be transported with appropriate loose-fitting covers in place to prevent spillage. [55:8.14.11.4.4.2]

21.5 Bulk Oxygen Systems. Bulk oxygen systems shall comply with Chapter 9 of NFPA 55.

21.6 Hydrogen Compressed Gas Systems. Hydrogen compressed gas systems shall comply with Chapter 10 of NFPA 55.

21.7 Bulk Liquefied Hydrogen Systems. Bulk hydrogen liquefied gas systems shall comply with Chapter 11 of NFPA 55.

21.8 Gas Generation Systems. Gas generator systems shall comply with Chapter 12 of NFPA 55.

21.9 Insulated Liquid Carbon Dioxide Systems. Insulated liquid carbon dioxide systems shall comply with Chapter 13 of NFPA 55.

21.10 Storage, Handling, and Use of Ethylene Oxide for Sterilization and Fumigation. Storage, handling, and use of ethyl-

ene oxide for sterilization and fumigation shall comply with Chapter 14 of NFPA 55.

21.11 Acetylene Cylinder Charging Plants. Acetylene cylinder charging plants engaged in the generation and compression of acetylene and in the charging of acetylene cylinders, either as their sole operation or in conjunction with facilities for charging other compressed gas cylinders shall comply with Chapter 15 of NFPA 55.

21.12 Nitrous Oxide Systems. Nitrous oxide systems shall comply with Chapter 16 of NFPA 55.

Annex A Explanatory Material

Annex A is not a part of the requirements of this NFPA document but is included for informational purposes only. This annex contains explanatory material, numbered to correspond with the applicable text paragraphs.

▲ **A.1.1.1** Manufacturing operations are covered by this code when the manufacturing operation involves the storage or use of hazardous materials regulated by this code.

When quantities exceed Occupational Safety and Health Administration (OSHA) or Environmental Protection Agency (EPA) threshold quantities for hazardous materials (or classes of materials), additional federal requirements under the Process Safety Management (29 CFR 1910.119) and Risk Management Program (40 CFR 68) regulations might apply. These can be found at www.osha.gov and www.epa.gov.

A.1.1.1(10) It is not intended that NFPA 400 regulate compressed gases or cryogenic fluids outside of the scope of NFPA 55, including LPG as regulated by NFPA 58, fuel gas as regulated by NFPA 54, vehicular fuels as regulated by NFPA 52, or LNG as regulated by NFPA 59. Refer to the specific exemptions referred to in 21.1.1.2.

A.1.2 The term *handling* includes onsite transportation.

A.1.8 Permit applications might require submittal of a hazardous materials management plan and a hazardous materials inventory statement in accordance with Sections 1.11 and 1.12.

A.1.11.1 See Section C.3 for a model hazardous materials management Plan (HMMP).

A.1.12 See Section C.2 for a model hazardous materials inventory statement (HMIS).

A.3.1 The use of parenthetical terms (solid, liquid, gas, and flammable and combustible liquid) following definitions extracted from other NFPA hazardous materials codes and standards is intended to aid the user in understanding the application of specific terms. The parenthetical terms apply only to extracted definitions.

A.3.2.1 Approved. The National Fire Protection Association does not approve, inspect, or certify any installations, procedures, equipment, or materials; nor does it approve or evaluate testing laboratories. In determining the acceptability of installations, procedures, equipment, or materials, the authority having jurisdiction may base acceptance on compliance with NFPA or other appropriate standards. In the absence of such standards, said authority may require evidence of proper installation, procedure, or use. The authority having jurisdiction may also refer to the listings or labeling practices of an organization that is concerned with product evaluations and is thus in

a position to determine compliance with appropriate standards for the current production of listed items.

A.3.2.2 Authority Having Jurisdiction (AHJ). The phrase “authority having jurisdiction,” or its acronym AHJ, is used in NFPA documents in a broad manner, since jurisdictions and approval agencies vary, as do their responsibilities. Where public safety is primary, the authority having jurisdiction may be a federal, state, local, or other regional department or individual such as a fire chief; fire marshal; chief of a fire prevention bureau, labor department, or health department; building official; electrical inspector; or others having statutory authority. For insurance purposes, an insurance inspection department, rating bureau, or other insurance company representative may be the authority having jurisdiction. In many circumstances, the property owner or his or her designated agent assumes the role of the authority having jurisdiction; at government installations, the commanding officer or departmental official may be the authority having jurisdiction.

A.3.2.3 Code. The decision to designate a standard as a “code” is based on such factors as the size and scope of the document, its intended use and form of adoption, and whether it contains substantial enforcement and administrative provisions.

A.3.2.5 Listed. The means for identifying listed equipment may vary for each organization concerned with product evaluation; some organizations do not recognize equipment as listed unless it is also labeled. The authority having jurisdiction should utilize the system employed by the listing organization to identify a listed product.

A.3.3.1 Absolute Pressure [Gas]. Measured from this reference point, the standard atmospheric pressure at sea level is an absolute pressure of 14.7 psi (101.3 kPa). [55, 2016]

■ **A.3.3.2 Access Aisle.** Access aisles are used for instances including, but not limited to, inventory and leak checks. An access aisle can be used to define the boundary of the pile and is not considered part of the pile size. The term *access aisle* is used for what was previously referred to as an “additional aisle.”

■ **A.3.3.3 Aisle.** The aisle can be used to define the boundary of the pile and is not considered part of the pile size. The term *aisle* is used for what was previously referred to as a “main” aisle or “working” aisle.

A.3.3.11 Bulk Hydrogen Compressed Gas System [Gas]. The bulk system terminates at the source valve, which is the point where the gas supply, at service pressure, first enters the supply line, or at a piece of equipment that utilizes the hydrogen gas, such as a hydrogen dispenser. The containers are either stationary or movable, and the source gas for the system is stored as a compressed gas. [55, 2016]

Bulk hydrogen compressed gas systems can include a bulk storage source, transfer piping and manifold system, compression system, and other components. The gaseous source can include a tube trailer, tube bank, or other high-pressure storage vessels used to serve the piping system that transports hydrogen to the end user. Compressors can be installed downstream of the storage supply to boost the pressure of the source gas, and intermediate high-pressure storage might be present. This is done where the end use requires hydrogen at a pressure higher than that of the bulk supply. In these instances, there might be intermediate storage vessels used to store the gas at elevated pressures. It is not uncommon for the bulk supply as

delivered to be furnished at nominal gauge pressure of 3000 psi (20,684 kPa), and the intermediate high-pressure storage to be stored at gauge pressures up to 15,000 psi (103,421 kPa). [See Figure A.3.3.11(a) through Figure A.3.3.11(f)]. [55, 2016]

A.3.3.12 Bulk Inert Gas System. The bulk system terminates at the source valve, which is commonly the point where the gas supply, at service pressure, first enters the supply line or a piece of equipment that utilizes the gas or the liquid. The containers are either stationary or movable, and the source gas is stored as a compressed gas or cryogenic fluid. [55, 2016]

Bulk inert gas systems can be used to supply gas in either its compressed gaseous or liquefied form. Systems that can be used to supply both gaseous and liquid forms are referred to as hybrid systems. The following bulk inert gas systems are typical of those in use:

- (1) When the primary supply of the gas as stored is from a compressed gaseous source that is used in the compressed and gaseous form, the bulk inert gas system is said to be a bulk inert compressed gas system.
- (2) When the primary supply of the gas as stored is in a liquid form and the system is designed to transfer only liquid, the system is said to be a bulk liquefied inert gas system.
- (3) When the primary supply of the gas as stored is in a liquid form and the system is designed to transfer or store the gas in a compressed gaseous form, with or without a feature that can also allow the subsequent transfer and use of liquid, the bulk inert gas system is said to be a hybrid bulk inert gas system.

[55, 2016]

For the purposes of the application of the code, a hybrid system is viewed as a bulk liquefied inert gas system. [55, 2016]

A.3.3.13 Bulk Liquefied Hydrogen System [Gas]. The bulk system terminates at the source valve, which is commonly the point where the gas supply, at service pressure, first enters the supply line or a piece of equipment that utilizes the gas or the liquid, such as a hydrogen dispenser. The containers are either stationary or movable, and the source gas for the system is stored as a cryogenic fluid. [55, 2016]

A bulk liquefied hydrogen gas system can include a liquid source where the liquid is vaporized and subsequently compressed and transferred to storage in the compressed gaseous form. It is common for liquid hydrogen systems to be equipped with vaporizers that are used to gasify the cryogen for ultimate use in the compressed state; however, there are also systems that can be used to transfer liquid in the cryogenic state. Bulk liquefied hydrogen gas systems can be either in an all-liquid state or in a hybrid system that can consist of storage containers for gas in the liquid state and other containers for gas in the compressed state. For the purposes of the application of the code, a hybrid system is viewed as a bulk liquefied hydrogen gas system. [55, 2016]

A.3.3.14 Bulk Oxygen System. The bulk oxygen system terminates at the source valve, which is commonly the point where oxygen at service pressure first enters the supply line or a piece of equipment that utilizes the oxygen gas or liquid. The oxygen containers are either stationary or movable, and the oxygen is stored as a compressed gas or cryogenic fluid. [55, 2016]

Bulk oxygen systems can be used to supply gas in either its compressed gaseous or liquefied form. Systems that can be used to supply both gaseous and liquid forms are referred to as hybrid systems. The following bulk oxygen systems are typical of those in use:

- (1) When the primary supply of the gas as stored is from a compressed gaseous source that is used in the compressed and gaseous form, the bulk oxygen system is said to be a bulk compressed oxygen gas system.
- (2) When the primary supply of the gas as stored is in a liquid form and the system is designed to transfer only liquid, the system is said to be a bulk liquefied oxygen system.
- (3) When the primary supply of the gas as stored is in a liquid form and the system is designed to transfer or store the gas in a compressed gaseous form, with or without a feature that can also allow the subsequent transfer and use of liquid, the bulk oxygen system is said to be a hybrid bulk oxygen system.

[55, 2016]

For the purposes of the application of the code, a hybrid system is viewed as a bulk liquefied oxygen system. [55, 2016]

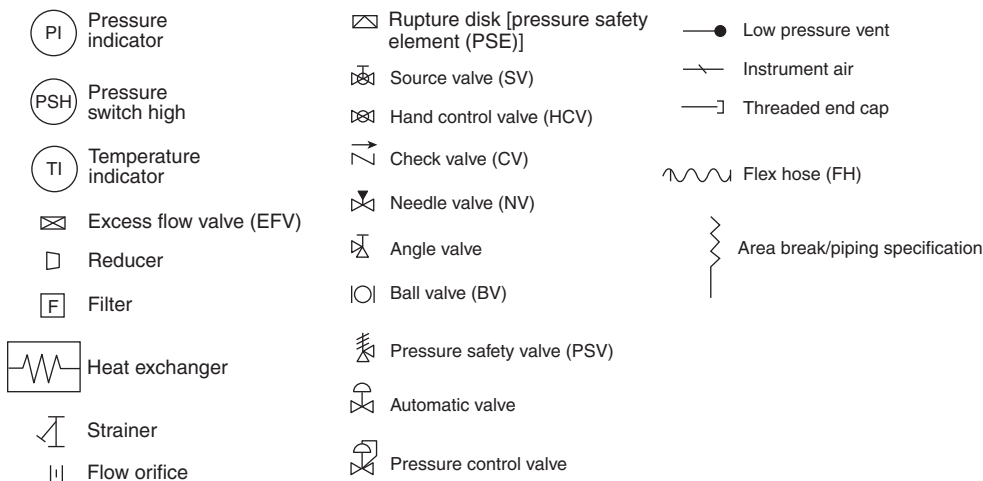


FIGURE A.3.3.11(a) Symbol Legend for Figures A.3.3.11(b) through A.3.3.11(f).

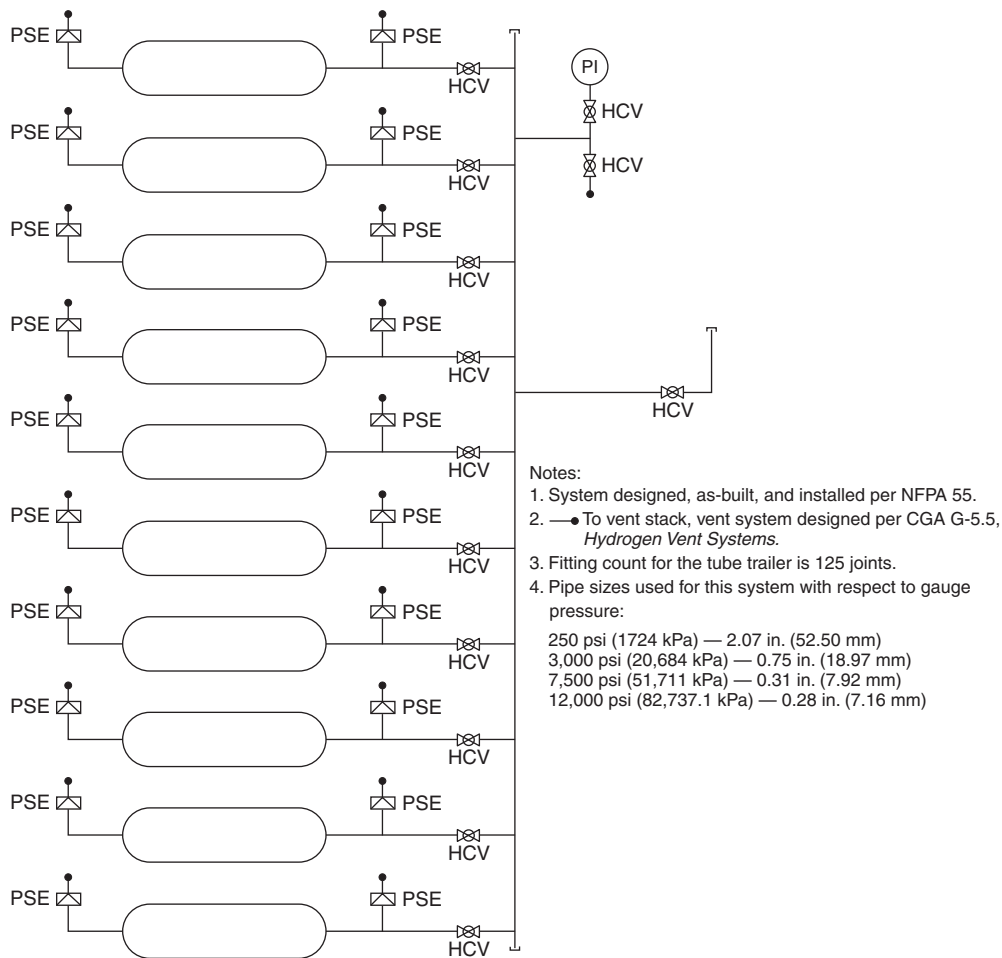


FIGURE A.3.3.11(b) Typical Tube Trailer.

△ A.3.3.18 Combustible Dust. Dusts traditionally were defined as material 420 μm or smaller (i.e., capable of passing through a U.S. No. 40 standard sieve). For consistency with other standards, 500 μm (i.e., capable of passing through a U.S. No. 35 standard sieve) is now considered an appropriate size criterion. Particle surface area-to-volume ratio is a key factor in determining the rate of combustion. Combustible particulate solids with a minimum dimension more than 500 μm generally have a surface-to-volume ratio that is too small to pose a deflagration hazard. Flat platelet-shaped particles, flakes, or fibers with lengths that are large compared to their diameter usually do not pass through a 500 μm sieve, yet could still pose a deflagration hazard. Many particulates accumulate electrostatic charge in handling, causing them to attract each other, forming agglomerates. Often, agglomerates behave as if they were larger particles, yet when they are dispersed they present a significant hazard. Therefore, it can be inferred that any particulate that has a minimum dimension less than or equal to 500 μm could behave as a combustible dust if suspended in air or the process specific oxidizer. If the minimum dimension of the particulate is greater than 500 μm , it is unlikely that the material would be a combustible dust, as determined by test. The determination of whether a sample of combustible material

presents a flash-fire or explosion hazard could be based on a screening test methodology such as provided in ASTM E1226, *Standard Test Method for Explosibility of Dust Clouds*. Alternatively, and a standardized test method such as ASTM E1515, *Standard Test Method for Minimum Explosible Concentration of Combustible Dusts*, could be used to determine dust explosibility. Chapter 5 of NFPA 652 has additional information on testing requirements. [652, 2019]

There is some possibility that a sample will result in a false positive in the 20 L sphere when tested by the ASTM E1226 screening test or the ASTM E1515 test. This is due to the high energy ignition source overdriving the test. When the lowest ignition energy allowed by either method still results in a positive result, the owner/operator can elect to determine whether the sample is a combustible dust with screening tests performed in a larger scale ($\geq 1 \text{ m}^3$) enclosure, which is less susceptible to overdriving and thus will provide more realistic results. [652, 2019]

This possibility for false positives has been known for quite some time and is attributed to “overdriven” conditions that exist in the 20 L chamber due to the use of strong pyrotechnic igniters. For that reason, the reference method for explosibility

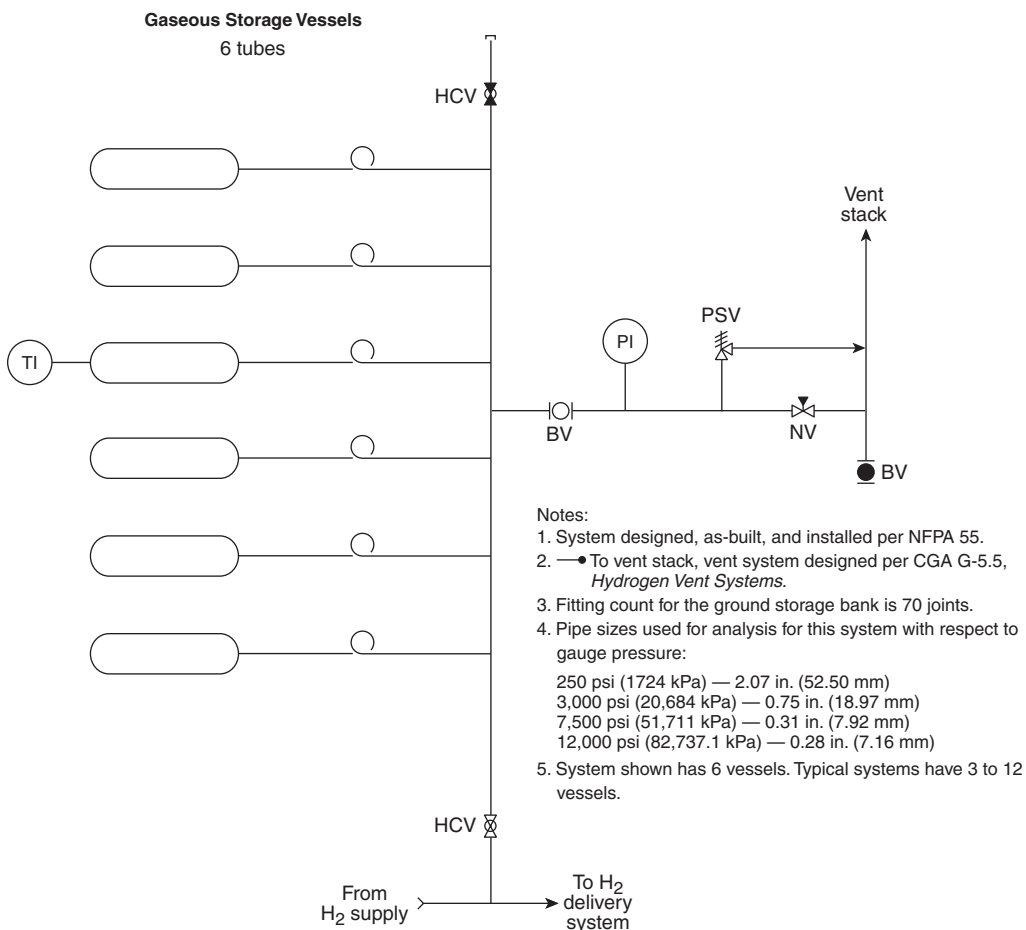


FIGURE A.3.3.11(c) Typical Bulk Compressed Gaseous Storage System.

testing is based on a 1 m³ chamber, and the 20 L chamber test method is calibrated to produce results comparable to those from the 1 m³ chamber for most dusts. In fact, the U.S. standard for 20 L testing (ASTM E1226) states, “The objective of this test method is to develop data that can be correlated to those from the 1 m³ chamber (described in ISO 6184-1 and VDI 3673)...” ASTM E1226 further states, “Because a number of factors (concentration, uniformity of dispersion, turbulence of ignition, sample age, etc.) can affect the test results, the test vessel to be used for routine work must be standardized using dust samples whose K_{St} and P_{max} parameters are known in the 1 m³ chamber.” [652, 2019]

NFPA 68 also recognizes this problem and addresses it stating that “the 20 L test apparatus is designed to simulate results of the 1 m³ chamber; however, the igniter discharge makes it problematic to determine K_{St} values less than 50 bar-m/sec. Where the material is expected to yield K_{St} values less than 50 bar-m/sec, testing in a 1 m³ chamber might yield lower values.” [652, 2019]

Any time a combustible dust is processed or handled, a potential for deflagration exists. The degree of deflagration hazard varies, depending on the type of combustible dust and the processing methods used. [652, 2019]

A dust deflagration has the following four requirements:

- (1) Combustible dust
- (2) Dust dispersion in air or other oxidant
- (3) Sufficient concentration at or exceeding the minimum explosible concentration (MEC)
- (4) Sufficiently powerful ignition source such as an electrostatic discharge, an electric current arc, a glowing ember, a hot surface, welding slag, frictional heat, or a flame [652, 2019]

If the deflagration is confined and produces a pressure sufficient to rupture the confining enclosure, the event is, by definition, an “explosion.” [652, 2019]

Evaluation of the hazard of a combustible dust should be determined by the means of actual test data. Each situation should be evaluated and applicable tests selected. The following list represents the factors that are sometimes used in determining the deflagration hazard of a dust:

- (1) MEC
- (2) MIE
- (3) Particle size distribution
- (4) Moisture content as received and as tested
- (5) Maximum explosion pressure at optimum concentration
- (6) Maximum rate of pressure rise at optimum concentration

Notes:

1. System designed, as-built, and installed per NFPA 55.
2. —●— To vent stack, vent system designed per CGA G-5.5, *Hydrogen Vent Systems*.
3. Fitting count for the pressure control manifold is 111 joints.
4. Fitting count for the stanchion is 29 joints.
5. Pipe sizes used for analysis for this system with respect to gauge pressure:
 - 250 psi (1724 kPa) — 2.07 in. (52.50 mm)
 - 3,000 psi (20,684 kPa) — 0.75 in. (18.97 mm)
 - 7,500 psi (51,711 kPa) — 0.31 in. (7.92 mm)
 - 12,000 psi (82,737.1 kPa) — 0.28 in. (7.16 mm)

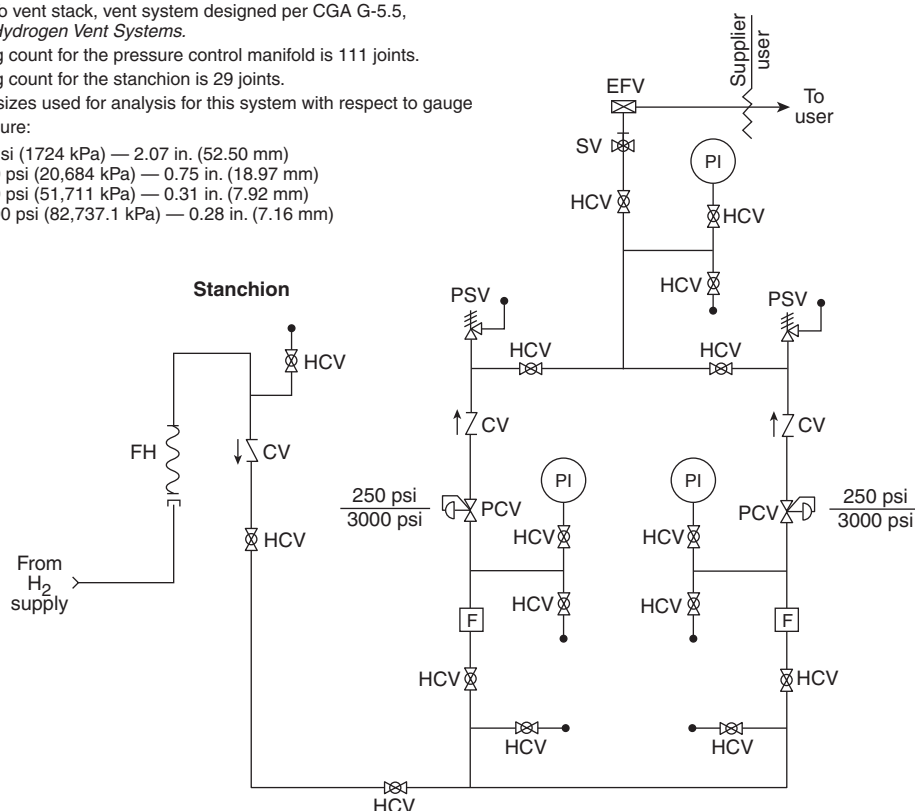


FIGURE A.3.3.11(d) Typical Tube Trailer Discharge Stanchion and Pressure Control Manifold.

- (7) K_{St} (normalized rate of pressure rise) as defined in ASTM E1226, *Standard Test Method for Explosibility of Dust Clouds*
- (8) Layer ignition temperature
- (9) Dust cloud ignition temperature
- (10) Limiting oxidant concentration (LOC) to prevent ignition
- (11) Electrical volume resistivity
- (12) Charge relaxation time
- (13) Chargeability

[652, 2019]

It is important to keep in mind that as a particulate is processed, handled, or transported, the particle size generally decreases due to particle attrition. Therefore, it is often necessary to evaluate the explosibility of the particulate at multiple points along the process. Where process conditions dictate the use of oxidizing media other than air, which is nominally taken as 21 percent oxygen and 79 percent nitrogen, the applicable tests should be conducted in the appropriate process-specific medium. [652, 2019]

A.3.3.20 Compressed Gas System. A compressed gas system can consist of a compressed gas container or containers, reactors, and appurtenances, including pumps, compressors, and connecting piping and tubing. [55, 2016]

A.3.3.21.2 Container [Flammable and Combustible Liquid]. The U.S. DOT defines *non-bulk packaging* as having up to 119 gal (450 L) capacity in 49 CFR 171.8. [30, 2018]

A.3.3.21.6 Nonmetallic Container [Solid, Flammable and Combustible Liquid]. Permissible nonmetallic containers for shipping Class I, Class II, and Class IIIA liquids are governed by the hazardous materials transportation regulations promulgated by the United Nations publication *Recommendations on the Transport of Dangerous Goods, Model Regulations*, and the U.S. Department of Transportation's Hazardous Materials Regulations, Title 49, Code of Federal Regulations. Small tanks for Class IIIB liquids are not governed by these regulations. Fiber portable tanks for Class IIIB liquids include composite designs consisting of a multi-ply cardboard box with a rigid or flexible plastic bladder. [30, 2018]

A.3.3.21.9.1 Stationary Tank [Gas]. A stationary tank does not include a cylinder having less than 1000 lb (453.5 kg) water capacity.

A.3.3.21.10.1 Atmospheric Tank [Flammable and Combustible Liquid]. Older-style flat roof tanks were designed to operate at pressures of atmospheric through a gauge pressure of 0.5 psi (3.5 kPa), measured at the top of the tank. This limitation was established to avoid continuous stress on the roof plates of the tank. [30, 2018]

A.3.3.21.11 Portable Tank [Flammable and Combustible Liquid]. The term *portable tank* does not include an intermedi-

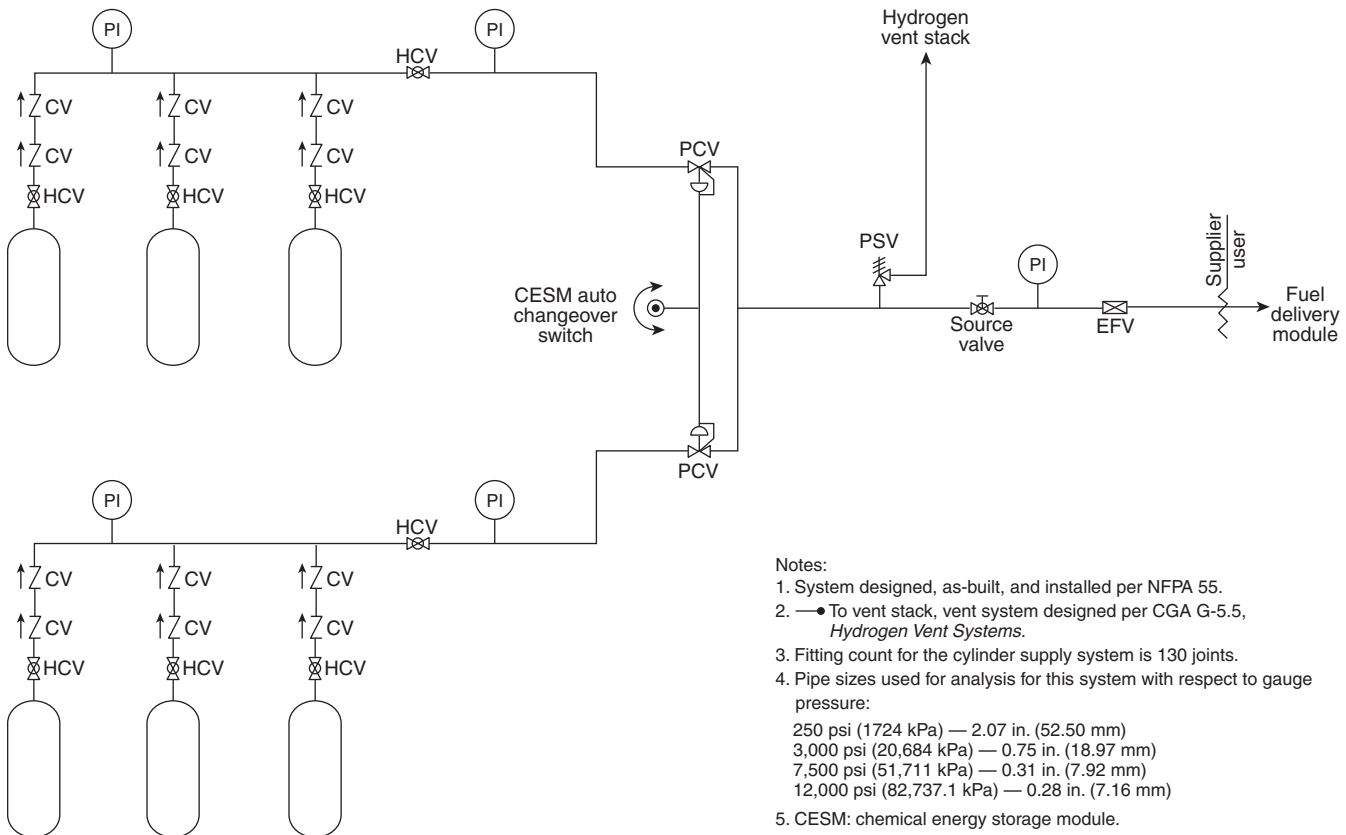


FIGURE A.3.3.11(e) Typical Chemical Energy Storage Model (CESM).

ate bulk container (IBC). The standards of construction for portable tanks are different from those used for the construction of containers and IBCs.

A.3.3.21.11.1 Portable Tank [Gas]. A portable tank (gas) does not include any cylinder having less than 1000 lb (453.5 kg) water capacity, cargo tank, tank car tank, or trailer carrying cylinders of over 1000 lb (453.5 kg) water capacity.

A.3.3.21.11.2 Nonmetallic Portable Tank [Flammable and Combustible Liquid]. Permissible nonmetallic portable tanks for shipping Class I, Class II, and Class IIIA liquids are governed by the hazardous materials transportation regulations promulgated by the United Nations (UN) and the U.S. Department of Transportation (DOT). Small tanks for Class IIIB liquids are not governed by either UN or DOT hazardous materials regulations. Fiber portable tanks for Class IIIB liquids include composite designs consisting of a multi-ply corrugated box with a rigid or flexible inner plastic bladder. [30, 2018]

A.3.3.21.12 Pressure Vessel. Pressure vessels of any type can be subject to additional regulations imposed by various states or other legal jurisdictions. Users should be aware that compliance with DOT or ASME requirements might not satisfy all of the required regulations for the location in which the vessel is to be installed or used. Pressure vessels may be constructed to meet requirements of other regulatory agencies, including regulations for Transport, Canada (TC) or various ANSI standards that may be applicable for specific uses. [55: A.8.2]

A.3.3.21.14.1 Tube Trailer [Gas]. The characteristic internal water volume of individual tubular cylinders ranges from 43 ft³ (1218 L) to 93 ft³ (2632 L) or a water capacity of 2686 lb (1218 kg) to 5803 lb (2632 kg).


A.3.3.21.15 ISO Module. The frame of an ISO container module and its corner casings are specifically designed and dimensioned to be used in multimodal transportation service on container ships, special highway chassis, and container on flatcar railroad equipment.

A.3.3.21.16 Safety Can [Liquid]. Safety cans listed to ANSI/UL 30, *Standard for Metal Safety Cans*, are limited to 5 U.S. gal (19 L). ANSI/UL 1313, *Standard for Nonmetallic Safety Cans or Petroleum Products*, allows for capacities up to 5 Imperial gal (23 L). [30, 2018]

A.3.3.25 Cylinder [Gas]. The term *cylinder (gas)* does not include a portable tank, multiunit tank car tank, cargo tank, or tank car.

A.3.3.28 Cylinder Pack [Gas]. *Six-packs* and *twelve-packs* are terms used to further define cylinder packs with a specific number of cylinders involved. The characteristic internal water volume of individual cylinders in a cylinder pack ranges from 1.52 scf to 1.76 scf (43 L to 50 L) or a water capacity of from 95 lb to 110 lb (43 kg to 50 kg). [55, 2016]

▲ A.3.3.38 Exhausted Enclosure [Gas]. Such enclosures include laboratory hoods, exhaust fume hoods, and similar appliances and equipment used to retain and exhaust locally the gases, fumes, vapors, and mists that could be released. Rooms or areas

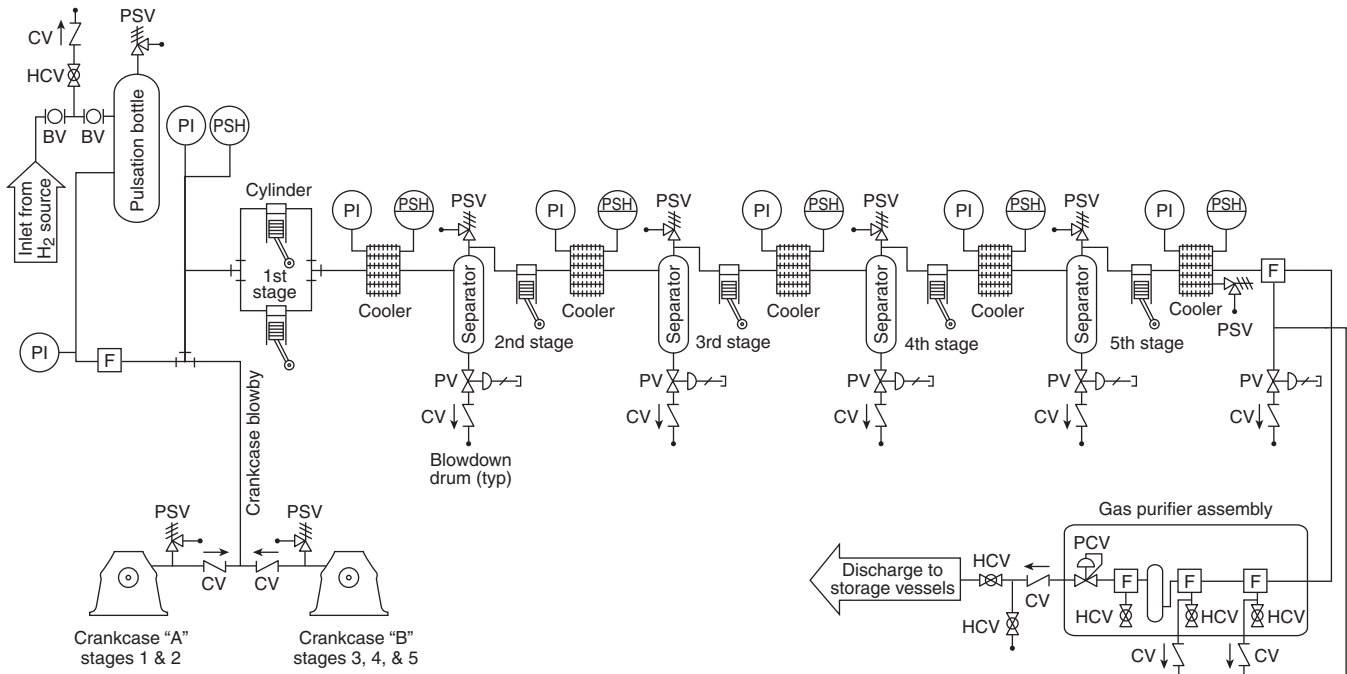

Notes:

1. System designed, as-built, and installed per NFPA 55.
2. —●— To vent stack, vent system designed per CGA G-5.5, *Hydrogen Vent Systems*.
3. Fitting count for the compression system is 225 joints.
4. Pipe sizes used for analysis for this system with respect to gauge pressure:
 - 250 psi (1724 kPa) — 2.07 in. (52.50 mm)
 - 3,000 psi (20,684 kPa) — 0.75 in. (18.97 mm)
 - 7,500 psi (51,711 kPa) — 0.31 in. (7.92 mm)
 - 12,000 psi (82,737.1 kPa) — 0.28 in. (7.16 mm)

FIGURE A.3.3.11(f) Typical Compressor Module.

provided with general ventilation, in and of themselves, are not exhausted enclosures. [55, 2016]

A.3.3.39 Explosion Control [Gas]. NFPA 68 provides guidance on the use of deflagration venting systems for use in buildings and other enclosures. The primary purpose of a venting system is to relieve the overpressure produced in an explosion to limit the potential damage to the building where the explosion occurs. Although some structural damage can be anticipated, the use of relief venting is expected to prevent massive building failure and collapse. In cases where detonation is probable, venting is often used in conjunction with barricade construction where the pressure-resistant portions of the building have been constructed to resist the pressures anticipated should an explosive event occur. Design of barricade systems is highly specialized, and the subject of military standards applicable to the subject. NFPA 69 provides guidance on the use of suppression, ventilation systems, and the limiting of oxidants as a means to prevent the occurrence of an explosion. When relief vents are to be used as a means to provide explosion relief, the fundamental requirements of the building code for structural elements including snow, wind, and seismic events should be considered. In some instances, the requirements for wind resistance can impose more rigorous requirements on the relief vents than required by the engineering analysis used to determine the relief pressure. In such cases, users must demonstrate that the relief vents will not become

airborne or release in such a manner as to create secondary hazards within or external to the building in which they are installed. Specific designs might require approval by the AHJ. [55, 2016]

▲ A.3.3.41 Explosive. Explosives in Class 1 are divided into six divisions as follows:

- (1) Division 1.1 consists of explosives that have a mass explosion hazard. A mass explosion is one that affects almost the entire load instantaneously.
- (2) Division 1.2 consists of explosives that have a projection hazard but not a mass explosion hazard.
- (3) Division 1.3 consists of explosives that have a fire hazard and either a minor blast hazard or a minor projection hazard, or both, but not a mass explosion hazard.
- (4) Division 1.4 consists of explosives that present a minor explosion hazard. The explosive effects are largely confined to the package, and no projection of fragments of appreciable size or range is to be expected. An external fire must not cause virtually instantaneous explosion of almost the entire contents of the package.
- (5) Division 1.5 consists of very insensitive explosives. (The probability of transition from burning to detonation is greater when large quantities are transported in a vessel.) This division is comprised of substances that have a mass explosion hazard but are so insensitive that there is very

little probability of initiation or of transition from burning to detonation under normal conditions of transport.

- (6) Division 1.6 consists of extremely insensitive articles that do not have a mass explosion hazard. (The risk from articles of Division 1.6 is limited to the explosion of a single device.) This division is comprised of articles that contain only extremely insensitive detonating substances and that demonstrate a negligible probability of accidental initiation or propagation.

A list of explosives determined to be within the scope of 18 USC 40, "Importation, Manufacture, Distribution and Storage of Explosive Materials," is published at least annually by the Bureau of Alcohol, Tobacco, Firearms and Explosives (ATF), U.S. Department of Justice. The classification of explosives described in 49 CFR 171–180, "Hazardous Materials Regulations," is provided in Annex E. These regulations were revised in 1991. The term includes, but is not limited to, dynamite, black powder, pellet powder, initiating explosives, detonators, safety fuses, squibs, detonating cord, igniter cord, and igniters. The term includes any material determined to be within the scope of 18 USC 40, and also includes any material classified as an explosive by 49 CFR 100–199, "Pipeline and Hazardous Materials Safety Administration, Department of Transportation."

A.3.3.42 Explosive Decomposition. The term includes both deflagration and detonation.

A.3.3.43 Explosive Reaction. For further information on venting explosive reactions, see NFPA 68.

A.3.3.46 Flammable Liquid (Class I). Flammable liquids do not include compressed gases or cryogenic fluids. Flammable liquids are further categorized into a group known as Class I liquids. The Class I category is subdivided as follows:

- (1) Class I-A liquids are those having a flash point below 73°F (22.8°C) and a boiling point below 100°F (37.8°C).
- (2) Class I-B liquids are those having a flash point below 73°F (22.8°C) and a boiling point at or above 100°F (37.8°C).
- (3) Class I-C liquids are those having a flash point at or above 73°F (22.8°C) and below 100°F (37.8°C).

A.3.3.47 Flammable Solid. Flammable solids include finely divided solid materials that, when dispersed in air as a cloud, could be ignited and cause an explosion.

A.3.3.49.1 Compressed Gas [Gas]. The states of a compressed gas are categorized as follows:

- (1) Nonliquefied compressed gases are gases, other than those in solution, that are in a packaging under the charged pressure and are entirely gaseous at a temperature of 20°C (68°F).
- (2) Liquefied compressed gases are gases that, in a packaging under the charged pressure, are partially liquid at a temperature of 20°C (68°F). Cryogenic fluids represent a transient state of a gas that is created through the use of refrigeration. Cryogenic fluids cannot exist in the liquid form or partial liquid form at temperatures of 20°C (68°F), hence, they are not "compressed gases" as defined.
- (3) Compressed gases in solution are nonliquefied gases that are dissolved in a solvent.
- (4) Compressed gas mixtures consist of a mixture of two or more compressed gases contained in a packaging, the

hazard properties of which are represented by the properties of the mixture as a whole.

[55, 2016]

A.3.3.49.7 Irritant Gas [Gas]. A chemical is a skin irritant if, when tested on the intact skin of albino rabbits by the methods of 16 CFR 1500.41, for an exposure of 4 or more hours or by other appropriate techniques, it results in an empirical score of 5 or more. A chemical is classified as an eye irritant if so determined under the procedure listed in 16 CFR 1500.42, or other appropriate techniques.

A.3.3.49.9 Other Gas [Gas]. A gas classified as an "other gas" might be a nonflammable gas or an inert gas. [55, 2016]

A.3.3.49.13 Unstable Reactive Gas [Gas]. Unstable reactive materials are subdivided into five classifications. Class 4 materials are materials that in themselves are readily capable of detonation or explosive decomposition or explosive reaction at normal temperatures and pressures. They include the following:

- (1) Materials that are sensitive to localized thermal or mechanical shock at normal temperatures and pressures
- (2) Materials that have an instantaneous power density (product of heat of reaction and reaction rate) at 482°F (250°C) of 1000 W/mL or greater

[55, 2016]

Class 3 materials are materials that in themselves are capable of detonation or explosive decomposition or explosive reaction but require a strong initiating source or heat under confinement before initiation. [55, 2016]

Class 3 materials include the following:

- (1) Materials that have an instantaneous power density (product of heat of reaction and reaction rate) at 482°F (250°C) at or above 100 W/mL and below 1000 W/mL
- (2) Materials that are sensitive to thermal or mechanical shock at elevated temperatures and pressures
- (3) Materials that react explosively with water without requiring heat or confinement

[55, 2016]

Class 2 materials are materials that readily undergo violent chemical change at elevated temperatures and pressures, including the following:

- (1) Materials that have an instantaneous power density (product of heat of reaction and reaction rate) at 482°F (250°C) at or above 10 W/mL and below 100 W/mL
- (2) Materials that react violently with water or form potentially explosive mixtures with water

[55, 2016]

Class 1 materials are materials that in themselves are normally stable but that can become unstable at elevated temperatures and pressures, including the following:

- (1) Materials that have an instantaneous power density (product of heat of reaction and reaction rate) at 482°F (250°C) at or above 0.01 W/mL and below 10 W/mL
- (2) Materials that react vigorously with water, but not violently
- (3) Materials that change or decompose on exposure to air, light, or moisture

[55, 2016]

Class 0 materials are materials that in themselves are normally stable, even under fire conditions, including the following:

- (1) Materials that have an instantaneous power density (product of heat of reaction and reaction rate) at 482°F (250°C) below 0.01 W/mL
- (2) Materials that do not react with water
- (3) Materials that do not exhibit an exotherm at temperatures less than or equal to 932°F (500°C) when tested by differential scanning calorimetry

[55, 2016]

A.3.3.50 Gas Cabinet [Gas]. Doors and access ports for exchanging cylinders and accessing pressure-regulating controls are permitted to be included as part of a gas cabinet. [55, 2016]

A.3.3.52 Gas Room [Gas]. Gas rooms must be constructed and utilized in accordance with 21.2.4.

A.3.3.53 Gaseous Hydrogen (GH₂) System. The system includes stationary or portable containers, pressure regulators, pressure relief devices, manifolds, interconnecting piping, and controls as required. [55, 2016]

A.3.3.57 Immediately Dangerous to Life and Health (IDLH) [Gas]. This level is established by the National Institute for Occupational Safety and Health (NIOSH). If adequate data do not exist for precise establishment of IDLH, an independent certified industrial hygienist, industrial toxicologist, or appropriate regulatory agency should make such determination. [55, 2016]

A.3.3.58 ISO Module [Gas]. The characteristic internal water volume of individual tubular cylinders is 43 scf (1218 L) or a water capacity of 2686 lb (1218 kg). The frame of an ISO container module and its corner castings are specially designed and dimensioned to be used in multi-modal transportation service on container ships, special highway chassis, and container-on-flatcar railroad equipment. [55, 2016]

A.3.3.59.2 Permissible Exposure Limit (PEL) [Gas]. The maximum permitted time-weighted average exposures to be utilized are those published in 29 CFR 1910.1000. [55, 2016]

A.3.3.59.3 Short-Term Exposure Limit (STEL) [Gas]. STEL limits are published in 29 CFR 1910.1000. [55, 2016]

▲ **A.3.3.62.2 Corrosive Material.** A chemical is considered to be corrosive if it destroys or irreversibly changes the structure of the tissue at the site of contact within a specified period of time using one of the *in vivo* or *in vitro* OECD test methods authorized in 49 CFR 173.137. For purposes of this code, this term does not refer to action on inanimate surfaces (e.g., steel or aluminum). Available testing data produced prior to September 30, 1995 from the test method in Appendix A to 49 CFR 173 in effect on October 1, 1994 can also be used to determine the corrosivity of a material.

A.3.3.62.4 Hazardous Material. Hazardous wastes might or might not be classified as hazardous materials. Management and disposal of hazardous waste is regulated by the EPA under the Resource Conservation and Recovery Act (RCRA). EPA requires wastes identified as hazardous to be handled, stored, treated, and disposed of according to the stipulations of the RCRA hazardous waste program in 40 CFR 260–299, “Solid Wastes.”

A.3.3.62.5 Incompatible Material. Information on incompatible materials can be found in safety data sheets (SDS) or manufacturers’ product bulletins.

A.3.3.62.7 Noncombustible Material. A material that is reported as complying with the pass/fail criteria of ASTM E136, *Standard Test Method for Behavior of Materials in a Vertical Tube Furnace at 750°C*, when tested in accordance with the test method and procedure in ASTM E2652, *Standard Test Method for Behavior of Materials in a Tube Furnace with a Cone-shaped Airflow Stabilizer, at 750°C*, is considered a noncombustible material. (See 4.6.1 for additional information on noncombustible material.) [5000, 2018]

For the purposes of this code, noncombustible construction and limited-combustible construction are both considered to be noncombustible.

A.3.3.62.9 Toxic Material. While categorization is basically simple in application, the degree of hazard depends on many variables that should be carefully considered individually and in combination. Some examples include the following:

- (1) Materials wherein the toxic component or mixtures thereof are inextricably bound and cannot be released so there is little or no potential for exposure
- (2) Nonfriable solid hazardous materials existing in product forms and in the demonstrated absence of inhalable particles that might not present the same inhalation hazard as the chemical components existing in a friable state
- (3) Mixtures of toxic materials with ordinary materials, such as water, that might not warrant classification as toxic

Any hazard evaluation that is required for the precise categorization of toxic material is required to be performed by experienced, technically competent persons.

A.3.3.62.9.1 Highly Toxic Material. While categorization is basically simple in application, the degree of hazard depends on many variables that should be carefully considered individually and in combination. Some examples include the following:

- (1) Materials wherein the highly toxic component or mixtures thereof are inextricably bound and cannot be released so there is little or no potential for exposure
- (2) Nonfriable solid hazardous materials existing in product forms and in the demonstrated absence of inhalable particles that might not present the same inhalation hazard as the chemical components existing in a friable state
- (3) Mixtures of highly toxic materials with ordinary materials, such as water, that might not warrant classification as highly toxic

Any hazard evaluation that is required for the precise categorization of highly toxic material is required to be performed by experienced, technically competent persons.

A.3.3.62.10 Unstable [Reactive] Material. Unstable (reactive) material is classified as follows:

- (1) Class 4 unstable (reactive) materials are those that, in themselves, are readily capable of detonation, explosive decomposition, or explosive reaction at normal temperatures and pressures and include, among others, materials that are sensitive to localized thermal or mechanical shock at normal temperatures and pressures.

- (2) Class 3 unstable (reactive) materials are those that, in themselves, are capable of detonation, explosive decomposition, or explosive reaction, but that require a strong initiating source or that must be heated under confinement before initiation, and include, among others, materials that are sensitive to thermal or mechanical shock at elevated temperatures and pressures.
- (3) Class 2 unstable (reactive) materials are those that readily undergo violent chemical change at elevated temperatures and pressures and include, among others, materials that exhibit an exotherm at temperatures less than or equal to 30°F (−1°C) when tested by differential scanning calorimetry.
- (4) Class 1 unstable (reactive) materials are those that, in themselves, are normally stable, but that can become unstable at elevated temperatures and pressures and include among others, materials that change or decompose on exposure to air, light, or moisture and that exhibit an exotherm at temperatures greater than 30°F (−1°C), but less than or equal to 57°F (14°C), when tested by differential scanning calorimetry.

A.3.3.62.10.1 Class 1 Unstable [Reactive]. Materials that have an instantaneous power density (product of heat of reaction and reaction rate) at 482°F (250°C) at or above 0.01 W/mL and below 10 W/mL. [704:Table 7.2]

A.3.3.62.10.2 Class 2 Unstable [Reactive]. Materials that have an instantaneous power density (product of heat of reaction and reaction rate) at 482°F (250°C) at or above 10 W/mL and below 100 w/mL. [704:Table 7.2]

A.3.3.62.10.3 Class 3 Unstable [Reactive]. Materials that are sensitive to thermal and mechanical shock elevated temperatures and pressures. Materials that have an instantaneous power density (product of heat of reaction and reaction rate) at 482°F (250°C) at or above 100 W/mL and below 1000 W/mL. [704:Table 7.2]

A.3.3.62.10.4 Class 4 Unstable [Reactive]. Materials that are sensitive to localized thermal or mechanical shock at normal temperatures and pressures. Materials that have an instantaneous power density (product of heat of reaction and reaction rate) at 482°F (250°C) of 1000 W/mL or greater.

A.3.3.62.11 Water-Reactive Material. Class 1 water-reactive materials are materials whose heat of mixing is at or above 30 cal/g and less than 100 cal/g. Class 2 water-reactive materials are materials whose heat of mixing is at or above 100 cal/g and less than 600 cal/g. Class 3 water-reactive materials are materials whose heat of mixing is greater or equal to 600 cal/g.

A.3.3.63 Maximum Allowable Quantity Per Control Area (MAQ). See A.5.1.

A.3.3.65 Mobile Supply Unit [Gas]. Examples include ISO modules, tube trailers, and cylinder packs. [55, 2016]

A.3.3.66 Nesting [Gas]. A wall or a railing could be used to provide a means of solid support.

A.3.3.67 Nonbulk Flammable Gas System. Nonbulk systems can have more than 5000 scf (141.6 Nm³) as long as the volume of any individual container or connected system is less than 5000 scf (141.6 Nm³). Table 21.3.6.2 shows exposure distances for nonbulk flammable gases with a total storage up to 200,000 scf (5660 Nm³). [55, 2016]

A.3.3.68 Normal Temperature and Pressure (NTP) [Gas]. There are different definitions of normal conditions. The normal conditions defined here are the ones most commonly used in the compressed gas and cryogenic fluid industry. [55, 2016]

A.3.3.69.1 Assembly Occupancy. Assembly occupancies might include the following:

- (1) Armories
- (2) Assembly halls
- (3) Auditoriums
- (4) Bowling lanes
- (5) Club rooms
- (6) College and university classrooms, 50 persons and over
- (7) Conference rooms
- (8) Courtrooms
- (9) Dance halls
- (10) Drinking establishments
- (11) Exhibition halls
- (12) Gymnasiums
- (13) Libraries
- (14) Mortuary chapels
- (15) Motion picture theaters
- (16) Museums
- (17) Passenger stations and terminals of air, surface, underground, and marine public transportation facilities
- (18) Places of religious worship
- (19) Pool rooms
- (20) Recreation piers
- (21) Restaurants
- (22) Skating rinks
- (23) Special amusement buildings, regardless of occupant load
- (24) Theaters

Assembly occupancies are characterized by the presence or potential presence of crowds with attendant panic hazard in case of fire or other emergency. They are generally open or occasionally open to the public, and the occupants, who are present voluntarily, are not ordinarily subject to discipline or control. Such buildings are ordinarily occupied by able-bodied persons and are not used for sleeping purposes. Special conference rooms, snack areas, and other areas incidental to, and under the control of, the management of other occupancies, such as offices, fall under the 50-person limitation.

Restaurants and drinking establishments with an occupant load of fewer than 50 persons should be classified as mercantile occupancies.

A.3.3.69.2 Business Occupancy. Business occupancies include the following:

- (1) Air traffic control towers (ATCTs)
- (2) City halls
- (3) College and university instructional buildings, classrooms under 50 persons, and instructional laboratories
- (4) Courthouses
- (5) Dentists' offices
- (6) Doctors' offices
- (7) General offices
- (8) Outpatient clinics (ambulatory)
- (9) Town halls

Doctors' and dentists' offices are included, unless of such character as to be classified as ambulatory health care occupancies. (See 3.3.69.6.1.)

Birth centers should be classified as business occupancies if they are occupied by fewer than four patients, not including infants, at any one time; do not provide sleeping facilities for four or more occupants; and do not provide treatment procedures that render four or more patients, not including infants, incapable of self-preservation at any one time. For birth centers occupied by patients not meeting these parameters, see A.3.3.69.6 or A.3.3.69.6.1, as appropriate.

Service facilities common to city office buildings, such as newsstands, lunch counters serving fewer than 50 persons, barber shops, and beauty parlors are included in the business occupancy group.

City halls, town halls, and courthouses are included in this occupancy group, insofar as their principal function is the transaction of public business and the keeping of books and records. Insofar as they are used for assembly purposes, they are classified as assembly occupancies.

A.3.3.69.3 Day-Care Occupancy. Day-care occupancies include the following:

- (1) Adult day-care occupancies, except where part of a health care occupancy
- (2) Child day-care occupancies
- (3) Day-care homes
- (4) Kindergarten classes that are incidental to a child day-care occupancy
- (5) Nursery schools

In areas where public schools offer only half-day kindergarten programs, many child day-care occupancies offer state-approved kindergarten classes for children who need full-day care. Because these classes are normally incidental to the day-care occupancy, the requirements of the day-care occupancy should be followed.

A.3.3.69.4 Detention and Correctional Occupancy. Detention and correctional occupancies include the following:

- (1) Adult and juvenile substance abuse centers
- (2) Adult and juvenile work camps
- (3) Adult community residential centers
- (4) Adult correctional institutions
- (5) Adult local detention facilities
- (6) Juvenile community residential centers
- (7) Juvenile detention facilities
- (8) Juvenile training schools

A.3.3.69.5 Educational Occupancy. Educational occupancies include the following:

- (1) Academies
- (2) Kindergartens
- (3) Schools

An educational occupancy is distinguished from an assembly occupancy in that the same occupants are regularly present.

A.3.3.69.6 Health Care Occupancy. Health care occupancies include the following:

- (1) Hospitals
- (2) Limited care facilities
- (3) Nursing homes

Occupants of health care occupancies typically have physical or mental illness, disease, or infirmity. They also include infants, convalescents, or infirm aged persons.

A.3.3.69.6.1 Ambulatory Health Care Occupancy. It is not the intent that occupants be considered to be incapable of self-preservation just because they are in a wheelchair or use assistive walking devices, such as a cane, a walker, or crutches. Rather it is the intent to address emergency care centers that receive patients who have been rendered incapable of self-preservation due to the emergency, such as being rendered unconscious as a result of an accident or being unable to move due to sudden illness.

A.3.3.69.7 Industrial Occupancy. Industrial occupancies include the following:

- (1) Drycleaning plants
- (2) Factories of all kinds
- (3) Food processing plants
- (4) Gas plants
- (5) Hangars (for servicing/maintenance)
- (6) Laundries
- (7) Power plants
- (8) Pumping stations
- (9) Refineries
- (10) Sawmills
- (11) Telephone exchanges

In evaluating the appropriate classification of laboratories, the AHJ should treat each case individually, based on the extent and nature of the associated hazards. Some laboratories are classified as occupancies other than industrial; for example, a physical therapy laboratory or a computer laboratory.

A.3.3.69.8 Mercantile Occupancy. Mercantile occupancies include the following:

- (1) Auction rooms
- (2) Department stores
- (3) Drugstores
- (4) Restaurants with fewer than 50 persons
- (5) Shopping centers
- (6) Supermarkets

Office, storage, and service facilities incidental to the sale of merchandise and located in the same building should be considered part of the mercantile occupancy classification.

A.3.3.69.10 Residential Board and Care Occupancy. The following are examples of facilities that are classified as residential board and care occupancies:

- (1) Group housing arrangement for physically or mentally handicapped persons who normally attend school in the community, attend worship in the community, or otherwise use community facilities
- (2) Group housing arrangement for physically or mentally handicapped persons who are undergoing training in preparation for independent living, for paid employment, or for other normal community activities
- (3) Group housing arrangement for the elderly that provides personal care services but that does not provide nursing care
- (4) Facilities for social rehabilitation, alcoholism, drug abuse, or mental health problems that contain a group housing arrangement and that provide personal care services but do not provide acute care
- (5) Assisted living facilities
- (6) Other group housing arrangements that provide personal care services but not nursing care

A.3.3.69.11 Residential Occupancy. Residential occupancies are treated as separate occupancies in this code as follows:

- (1) One- and two-family dwellings
- (2) Lodging or rooming houses
- (3) Hotels, motels, and dormitories
- (4) Apartment buildings

A.3.3.69.12 Storage Occupancy. Storage occupancies include the following:

- (1) Barns
- (2) Bulk oil storage
- (3) Cold storage
- (4) Freight terminals
- (5) Grain elevators
- (6) Hangars (for storage only)
- (7) Parking structures
- (8) Stables
- (9) Truck and marine terminals
- (10) Warehouses

Storage occupancies are characterized by the presence of relatively small numbers of persons in proportion to the area.

A.3.3.73 Oxidizer. Examples of other oxidizing gases include bromine, chlorine, and fluorine.

The classification of oxidizers is based on the technical committee's evaluation of available scientific and technical data, actual experience, and its considered opinion. Classification refers to the pure oxidizer. Gross contamination can cause oxidizers of all classes to undergo exothermic or explosive reaction, particularly if they also are subjected to confinement and heating. (See G.2.2 through G.2.2 for oxidizer classifications.)

The classification of oxidizers is based on the degree to which an oxidizing chemical increases, if at all, the burning rate of available combustible fuels. Factors that can influence the burning rate of oxidizers are concentration, particle size, product form, product packaging, and packaging configuration. Examples of Class 1, 2, 3, and 4 chemical oxidizers are listed in Section G.2. The definition of the current classes and the oxidizers listed as typical of each Class in Section G.2 are based on the technical committee's evaluation of available data, experience, and results of tests done by the Bureau of Mines and GE Research in the 1970s.

The definition of Class 1, 2, 3, and 4 oxidizers is subjective. Currently, there is no bench scale test method that adequately measures the burning rate of oxidizers for large-scale storage. The UN's *Recommendations on the Transport of Dangerous Goods, Model Regulations*, includes a bench scale test method (Test O.1) to assign packing groups to solid oxidizers. Thirty grams (1.06 oz) of a mixture of the test substance and cellulose powder is ignited with a Nichrome wire. The time from ignition to the end of visible burning of the mixture is compared with the burning time of several different mixtures of potassium bromate (Class 3) and cellulose powder. The test does not characterize chemical reactivity or thermal stability. The test is not representative of packaged oxidizers. The determination of burning time is strongly dependent on test conditions, particle size, and the test operator's perception of the end of active burning.

The Fire Protection Research Foundation (FPRF) published *National Oxidizing Pool Chemicals Storage Fire Test Project* in August 1998. The technical report includes literature abstracts, large-scale calorimetry test data, and intermediate scale rack storage

Table A.3.3.73 Results of Large-Scale Calorimetry Tests with Packaging and Packaged Oxidizers on Wood Pallets

Oxidizer and Packaging	Total Weight with Pallets (lb)	Peak Convective HRR (kW)
40 cartons of empty HDPE 2 lb capacity containers	300	1736
40 cartons of pea gravel filled HDPE 2 lb capacity containers	1631	464
40 cartons of granular Trichlor in HDPE 2 lb capacity containers	1891	649
40 cartons of tablet form Trichlor in HDPE 2 lb capacity containers	1882	877
48 cartons of granular calcium hypochlorite in 1 lb capacity Surlin (plastic) bags	1468	6696
36 cartons of granular calcium hypochlorite in HDPE 1 lb capacity containers	1452	>16,184

For SI units, 1 lb = 0.45 kg.

Source: FPRF, *National Oxidizing Pool Chemicals Storage Fire Test Project*, Aug. 1998.

tests. The peak rate of heat release of packaging and packaged oxidizers trichloroisocyanuric acid (Trichlor, Class 1) and calcium hypochlorite (available chlorine >68%, Class 3) are summarized in Table A.3.3.73.

The Class 1 Trichlor did not increase the burning rate of the combustible packaging. Class 3 calcium hypochlorite (available chlorine >68%) caused a severe increase in the burning rate of the combustible packaging.

In 2006, the FPRF published a report on the *Development of an Enhanced Hazard Classification System for Oxidizers*. The report includes a review of fire losses, historical test data, and current test methods for oxidizing materials used by transportation and environmental regulatory agencies. Two classification schemes with multiple test methods and performance-based criteria were proposed to distinguish between Class 1, 2, 3, and 4 oxidizers in a storage situation.

Future FPRF effort is proposed to define an appropriate bench scale test, validated by medium scale free burn testing, for oxidizers. The goal of the enhanced classification system would be to prescribe tests and use performance based criteria to define the different classes of oxidizers based on the degree of burning rate enhancement, chemical reactivity, and thermal stability.

The FPRF completed a project that resulted in the development of a bench-scale test, validated by intermediate scale testing, for solid oxidizers. An enhanced classification system with prescribed tests and performance-based criteria to define the different classes of oxidizers based on the degree of burning rate enhancement was developed. [Buc, Elizabeth C., *Oxidizer Classification Research Project: Tests and Criteria*, Fire Protection Research Foundation, November 2009]

A.3.3.75 Protection Level. NFPA uses the concept of protection levels in a manner that is analogous to Group H occupancies in other model codes. Although NFPA 1 and NFPA 5000 do

not have unique occupancy classifications for occupancies containing hazardous materials, Protection Levels 1 to 5 in NFPA codes and standards reflect increased building safety requirements that are applicable to occupancies containing hazardous materials, which generally correlate to the Group H, Division 1 to 5 occupancy classifications in other codes.

A.3.3.77 Safety Data Sheet (SDS). SDSs in the United States are prepared in accordance with the Occupational Safety and Health Administration (OSHA) hazard communication standard (29 CFR 1910.1200, “Hazard Communication”). Chemicals transported internationally might include additional requirements. (See Annex B for additional information regarding SDSs.)

A.3.3.78 Secondary Containment. Examples of secondary containment include dikes, curbing, remote impoundment, and double-walled tanks.

A.3.3.82 Storage (Hazardous Material). Storage can include transient storage, which is intended to describe those materials being staged for transport. They are called transient while they are in the manufacturing area because they are not in their storage location. In the manufacturing location, finished goods can be found in a packaged state where they can be further palletized or otherwise arranged or collected awaiting transportation.

A.3.3.84 Tank. Pipes and piping systems are not considered to be tanks.

A.3.3.84.2 Portable Tank. A portable tank does not include any cylinder having less than 453.5 kg (1000 lb) water capacity, cargo tank, tank car tank, or trailers carrying cylinders of over 453.5 kg (1000 lb) water capacity. [55, 2016]

A.3.3.84.3 Stationary Tank. A stationary tank does not include a cylinder having less than 1000 lb (453.5 kg) water capacity. [55, 2016]

A.3.3.87 Tube Trailer [Gas]. The characteristic internal water volume of individual tubular cylinders ranges from 43 scf (1218 L) to 93 scf (2632 L) or a water capacity of 2686 lb (1218 kg) to 5803 lb (2632 kg). [55, 2016]

A.3.3.88 Use. Examples of use include, but are not limited to, blending, mixing, reacting, distillation, heating or cooling, pumping, compressing, drying, screening, filling, loading and unloading, repackaging, scrubbing, absorbing, neutralizing, and incineration.

A.3.3.88.1 Closed System Use. Examples of closed systems for solids and liquids include reaction process operations and product conveyed through a piping system into a closed vessel, system, or piece of equipment.

A.3.3.88.2 Open System Use. Examples of open systems for solids and liquids include dispensing from or into open beakers or containers, and dip tank and plating tank operations.

A.3.4.6 Exposure Fire. An exposure fire usually refers to a fire that starts outside a building, such as a wildlands fire or vehicle fire, and that, consequently, exposes the building to a fire. [101, 2018]

A.3.4.7 Fire Model. Due to the complex nature of the principles involved, models are often packaged as computer software. Any relevant input data, assumptions, and limitations needed to properly implement the model will be attached to the fire models. [101, 2018]

A.3.4.8 Fire Scenario. A fire scenario defines the conditions under which a proposed design is expected to meet the fire safety goals. Factors typically include fuel characteristics, ignition sources, ventilation, building characteristics, and occupant locations and characteristics. The term *fire scenario* includes more than the characteristics of the fire itself but excludes design specifications and any characteristics that do not vary from one fire to another; the latter are called assumptions. The term *fire scenario* is used here to mean only those specifications required to calculate the fire’s development and effects, but, in other contexts, the term might be used to mean both the initial specifications and the subsequent development and effects (i.e., a complete description of fire from conditions prior to ignition to conditions following extinguishment). [101, 2018]

A.3.4.9 Fuel Load. Fuel load includes interior finish and trim.

A.3.4.12 Performance Criteria. Performance criteria are stated in engineering terms. Engineering terms include temperatures, radiant heat flux, and levels of exposure to fire products. Performance criteria provide threshold values used to evaluate a proposed design.

A.3.4.13 Proposed Design. The design team might develop a number of trial designs that will be evaluated to determine whether they meet the performance criteria. One of the trial designs will be selected from those that meet the performance criteria for submission to the AHJ as the proposed design.

The proposed design is not necessarily limited to fire protection systems and building features. It also includes any component of the proposed design that is installed, established, or maintained for the purpose of life safety, without which the proposed design could fail to achieve specified performance criteria. Therefore, the proposed design often includes emergency procedures and organizational structures that are needed to meet the performance criteria specified for the proposed design.

A.4.1 The categorization and classification of hazardous materials enables the code user to determine the applicability of requirements based on hazard category and class related to the physical and health hazards of materials. The current definitions found in Chapter 3 have been developed using a compilation of criteria found in NFPA codes and standards, requirements of the U.S. DOT, and in some cases definitions established by OSHA in 29 CFR.

The Globally Harmonized System of Classification and Labelling of Chemicals (GHS) has been developed based on standards for classification published by the United Nations (UN) Subcommittee of Experts on the GHS. The U.S. continues its efforts to incorporate the GHS in its federal regulatory scheme. OSHA published its revised Hazard Communication Standard (29 CFR 1910.1200) to align with the GHS in March 2012. The revised standard became effective in May 2012.

It is anticipated by the Committee that over time, the GHS will be reviewed for applicability and possible integration into the regulatory scheme developed in NFPA 400 for hazardous materials storage, use, and handling. The evolution of this system of classification will be facilitated by the changes associated with classification, labeling, and safety data sheets. It is not anticipated that the GHS will be fully implemented immediately within NFPA 400, recognizing the historical basis that exists for some of the classifications of materials, such as flammable and combustible liquids.

A.4.4 Where a conflict exists between applicable requirements, an analysis should be made and the proper applicable requirement should be implemented or conformed to subject to the approval of the AHJ.

A.4.5 The safe handling, collection, and disposal of hazardous waste can be accomplished only if the physical, chemical, and hazardous properties of its components are known and that information is properly applied. The categorization of a material as waste is normally under the purview of the user. In some cases the waste might be contaminated or “off spec” material, or material where the concentration of the hazardous components has been diluted. In other cases the waste might consist of cleaning materials that have become contaminated with a hazardous material.

The classifiers of waste are cautioned that the classification of hazardous waste under the requirements of the Environmental Protection Agency (EPA) or Department of Transportation (DOT) for labeling required for shipping purposes might not correspond to the system of classification incorporated into Section 4.1. In addition, some judgment is needed to apply the code in circumstances where the waste material is not in a form that is normally encountered when the hazardous material employed is in its virgin state. For example, a material that might not have been hazardous in its pure form might become hazardous when it becomes contaminated as use occurs. A tank of water used for rinsing parts on a plating line will eventually become contaminated by the materials that are being rinsed from parts as they travel through the line. If the concentration of the material being rinsed from parts becomes high enough, the content of hazardous materials in the rinse tank might be present in a concentration sufficient enough to cause the waste rinse water to be classified as hazardous. See Section B.5 for examples on the classification of dilute solutions of common corrosive materials.

In many cases the waste material could be a mixture of materials that must be classified in accordance with the requirements of Section 4.3.

A.4.5.1 Just because a decision has been made that a material no longer has a useful life does not exempt the material from compliance with the applicable provisions of the code. Materials that have been classified as hazardous based on the system of classification used in Section 4.1 are required to comply with applicable sections of the code in the same manner as might be required for nonwaste material.

A.4.6.1 The provisions of 4.6.1 do not require inherently noncombustible materials to be tested in order to be classified as noncombustible materials. [5000:A.7.1.4.1]

A.4.6.1.1(1) Examples of such materials include steel, concrete, masonry, and glass. [5000:A.7.1.4.1.1(1)]

A.4.6.2 Material subject to increase in combustibility or flame spread index beyond the limits herein established through the effects of age, moisture, or other atmospheric condition is considered combustible. (See *NFPA 259* and *NFPA 220*.) [5000:A.7.1.4.2]

▲ **A.5.1** This chapter introduces the concepts of control areas and MAQ. The purpose is to permit limited amounts of hazardous contents in occupancies having minimum controls without triggering the more restrictive Protection Level 1 through Protection Level 4 building requirements. The MAQs in Table 5.2.1.1.3 and Table 5.2.1.2.1 are based on demonstrated need

and historical safe storage and use of hazardous contents. Section 5.3, however, establishes additional controls for occupancies exceeding the hazardous contents limits prescribed for control areas.

All of the hazardous materials within the scope of 1.1.1 are high-hazard contents (see 4.2.1.1). However, not all of the hazardous materials categories are placed into high-hazard levels 1–4 requiring Protection Levels 1–4 are considered to be high-hazard contents, and some of these materials have been recognized as being of low or ordinary hazards, depending on their nature in a fire. In some cases, Class 1 unstable (reactive) materials, Class 1 water-reactive materials, and Class IV and Class V organic peroxides do not have a MAQ and, therefore, are not required to comply with the requirements for Protection Level 1 through Protection Level 4. Figure A.5.1 helps to illustrate the conditions under which the protection level requirements are applicable.

■ **A.5.2.1.1.2** Powered industrial trucks’ power packs and fuel tanks (electrolyte, compressed gas, or propane) do not count toward the MAQs for such chemicals. Powered industrial trucks do not count as part of the emergency power or uninterrupted power supply amounts.

▲ **A.5.2.1.1.3** Where footnote c and footnote d both apply, the increase for footnote c and footnote d is permitted to be applied accumulatively (or additively). For example, the MAQ for the storage of a flammable solid is 125 lb (57 kg). If the material is stored in an approved cabinet in accordance with this code, the MAQ will increase to 250 lb (113 kg) (footnote c). If the building is equipped throughout with an automatic sprinkler system in accordance with NFPA 13, the MAQ will increase to 250 lb (113 kg) (footnote d). If both footnote c and footnote d apply, the MAQ will be 500 lb (226 kg).

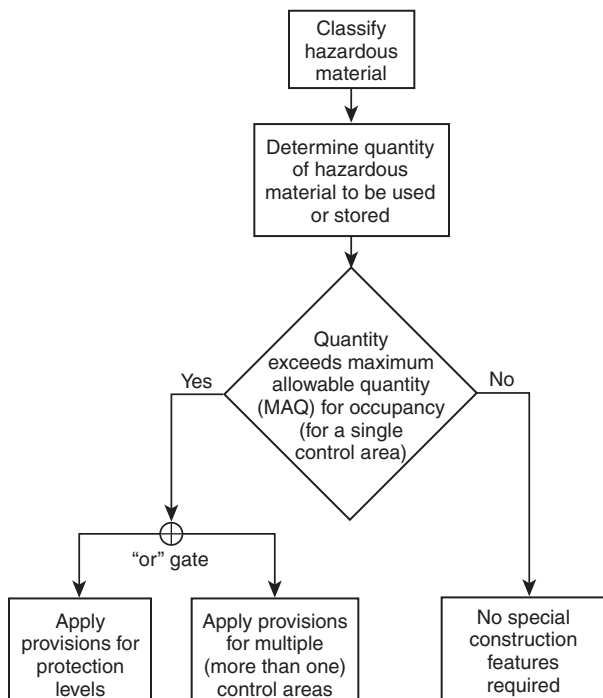


FIGURE A.5.1 Application of Chapter 5 and Chapter 6 Requirements for Hazardous Materials. [5000:Figure A.34.1.1]

See A.5.2.1.5.3 for more information on and examples of applying MAQ increases to control areas.

N A.5.2.1.5.3 The MAQ is an amount of material generally felt to represent a reasonable risk, or an amount that does not represent a significant risk when a specific control has been applied.

Where Table 5.2.1.1.3 allows for a 100 percent increase in the MAQ for quantities stored in approved cabinets or another specified control, a combination of storage both inside and outside approved cabinets in the control area is permitted. Storage amounts up to the MAQ are allowed outside of cabinets where the 100 percent increase is applied.

Example: The MAQ for storage of a Class 2 oxidizer is 250 lb (113 kg). The MAQ is allowed to be increased 100 percent to 500 lb (226 kg) per control area where stored in approved cabinets. Because the MAQ allows for 250 lb (113 kg) of Class 2 oxidizers outside of cabinets, only 250 lb (113 kg) of the 500 lb (226 kg) is required to be confined to cabinets.

Similarly, where Table 5.2.1.1.3 allows for a 100 percent increase for both cabinets and building sprinklers, storage outside of cabinets is permitted in the control area up to the MAQ for sprinklered buildings even after the cabinet increase is applied.

Example: The MAQ for storage of a Class 2 oxidizer is 250 lb (113 kg). The MAQ is allowed to be increased 100 percent to 500 lb (226 kg) in buildings equipped throughout with an approved sprinkler system. The MAQ is also allowed to be increased 100 percent where stored in approved storage cabinets. Because both increases are allowed and the sprinklered building increase allows for storage of 500 lb (226 kg) outside of cabinets, only 500 lb (226 kg) of the 1000 lb (454 kg) aggregate storage amount allowed is required to be confined to cabinets.

N A.5.4 Where a detached building is required for indoor storage in accordance with Table 5.3.7, detached outdoor storage can be used in lieu of indoor storage. Where detached outdoor storage is implemented, the outdoor storage requirements in Chapter 5, Chapter 6, and any material-specific chapters apply.

A.6.1.1.1 Outdoor control areas are not classified with protection levels.

A.6.1.1.2 Outdoor control areas are not classified with protection levels.

A.6.1.2 *Readily available* can mean access to the product manufacturer's or user's paper or electronic copies of SDSs.

A.6.1.3.4 There might be additional regulations that must be complied with to notify other agencies.

A.6.1.4 The hazard potential of a facility is not dependent on any single factor. Physical size, number of employees, and the quantity and the nature of the hazardous materials are important considerations. The level of training can vary with the complexity of the facility under consideration.

A.6.1.4.4 Emergency responders can include on-site personnel that have been designated and trained to respond to emergencies, persons from the public sector such as fire department personnel, or persons from the private sector that can be contracted or otherwise engaged to perform emergency response duties. (See Annex I.)

A.6.1.4.4.1 OSHA describes an Incident Command System as a standardized on-scene incident management concept designed specifically to allow responders to adopt an integrated organizational structure equal to the complexity and demands of any single incident or multiple incidents without being hindered by jurisdictional boundaries.

A.6.1.4.4.2 Responses to releases of hazardous materials where there is no potential safety or health hazard such as fire, explosion, or chemical exposure are not considered emergency responses as defined within the context of this code.

A.6.1.4.4.3 Emergency response training will vary depending on the level of emergency response required and by the requirements of the governmental agency.

A.6.1.5.3.1 The approved powered industrial trucks addressed in NFPA 505 are trucks that are listed by a testing laboratory for the use intended and should be tested and labeled in accordance with ANSI/UL 558, *Standard for Safety Industrial Trucks, Internal Combustion Engine-Powered*, or ANSI/UL 583, *Standard for Safety Electric-Battery-Powered Industrial Trucks*.

A.6.1.14 For seismic requirements and the seismic zone in which the material is located, see the building code.

A.6.1.16.1 Maintenance procedures are an important part of any mechanical integrity program. They should contain information on which equipment is covered; what tests and inspections are to be performed; how to perform the tests and inspections in accordance with recognized industry standards and manufacturer's recommendations; what constitutes acceptance of the measured parameters; corrective actions to be taken if the equipment does not meet requirements; and the frequency of the testing and inspection. For examples of additional guidance, refer to *Guidelines for Mechanical Integrity Systems* (AIChE/CCPS); *Guidelines for Safe and Reliable Instrumented Protective Systems* (AIChE/CCPS); and *Guidelines for Writing Effective Operating and Maintenance Procedures* (AIChE/CCPS).

A.6.1.16.2.3 Testing can include visual inspection, x-ray, spark testing, pressure testing, leak testing, or other nondestructive methods.

A.6.2.1.6 The following items should be considered in the design:

- (1) Deflagration vents designed to release from the exterior walls or roofs of the building should discharge directly to the exterior of the building where an unoccupied space of not less than 50 ft (15 m) in width is provided between the exterior walls of the building and the property line, unless the vents comply with A.6.2.1.6(2).
- (2) Deflagration vents designed to remain attached to the building when venting a deflagration should be located so that the discharge opening is not less than 10 ft (3050 mm) vertically from window openings and exit discharge doors in the building and not less than 20 ft (6100 mm) horizontally from exit discharge doors in the building, window openings and exit discharge doors in adjacent buildings on the same property, and property lines.
- (3) Deflagration vents should not discharge into the interior of the building.
- (4) Additional guidance for deflagration venting can be found in NFPA 68.

- (5) An authoritative standard used for the design of barricades is **TM 5-1300** (NAVFAC P-397, **AFM 88-22**), “Structures to Resist the Effects of Accidental Explosions.”

A.6.2.2.2.1 The use of multistoried detached buildings that **might** be needed to house special processes in occupancies requiring Protection Level 1 controls **might** be able to be approved through the use of alternative materials and methods. As detonation of Protection Level 1 materials is contemplated, the analysis of the proposed design must consider activities, occupancy, and means of egress from each level of the building. In some instances the “floors” in the process area **might** be of open grated construction. The restrictions regarding use for other purposes are intended to exclude other uses not directly related to the process or storage being conducted. Control rooms, restrooms, and ancillary electrical and mechanical rooms directly associated with the process are allowed. An engineering office, conference room, cafeteria, or similar use, although related to the process, would not be allowed, as these uses have occupancy that is outside of that intended to be addressed by Protection Level 1 controls.

It is to be expected that materials with multiple hazards **might** be present, and not intended that such materials be excluded providing those that are incompatible are separated by distance or barrier as required. Also see 6.2.2.2.3.

A.6.2.3.4.1 The use of multistoried detached buildings that **might** be needed to house special processes in occupancies requiring Protection Level 1 controls **might** be able to be approved through the use of alternative materials and methods. As detonation of Protection Level 1 materials is contemplated, the analysis of the proposed design must consider activities, occupancy, and means of egress from each level of the building. In some instances the “floors” in the process area **might** be of open grated construction. The restrictions regarding use for other purposes are intended to exclude other uses not directly related to the process or storage being conducted. Control rooms, restrooms, and ancillary electrical and mechanical rooms directly associated with the process are allowed. An engineering office, conference room, cafeteria, or similar use, although related to the process, would not be allowed, as these uses have occupancy that is outside of that intended to be addressed by Protection Level 1 controls.

It is to be expected that materials with multiple hazards **might** be present, and not intended that such materials be excluded providing those that are incompatible are separated by distance or barrier as required. Also see 6.2.2.2.3.

A.6.2.4.4.1 The use of multistoried detached buildings that **might** be needed to house special processes in occupancies requiring Protection Level 1 controls **might** be able to be approved through the use of alternative materials and methods. As detonation of Protection Level 1 materials is contemplated, the analysis of the proposed design must consider activities, occupancy, and means of egress from each level of the building. In some instances the “floors” in the process area **might** be of open grated construction. The restrictions regarding use for other purposes are intended to exclude other uses not directly related to the process or storage being conducted. Control rooms, restrooms, and ancillary electrical and mechanical rooms directly associated with the process are allowed. An engineering office, conference room, cafeteria, or similar use, although related to the process, would not be allowed, as these uses have occupancy that is outside of that intended to be addressed by Protection Level 1 controls.

It is to be expected that materials with multiple hazards **might** be present, and not intended that such materials be excluded providing those that are incompatible are separated by distance or barrier as required. Also see 6.2.2.2.3.

A.6.3.1 For storage, see Section 6.3.

A.7.1 Laboratory operations defined in NFPA 45 are not considered to be industrial processes.

A.7.1.2.1(3) One example is a maximum airborne concentration that does exceed an Emergency Response Planning Guide (ERPG-2) concentration at 65.6 ft (20 m) for 1 hour.

A.7.2.1 Understanding the hazards associated with chemicals and applying a means to control those hazards will vary depending on the nature of the chemicals used and the processing conditions. The level of understanding needed **might** consist of reviewing the basic hazard information contained within safety data sheets for chemicals being used, or to more detailed analytical techniques, including, but not limited to, a formal process hazards analysis described in other publications.

A.7.3.1.2 Operating procedures help control the hazards in a process and provide guidance and direction on how to operate the process. Operating procedures also provide information about the hazards of the process and how those hazards are controlled and are also essential for training the operators. Operating procedures contain, but are not limited to, the following:

- (1) Clear instructions for all phases of operation, including startup, normal operation, emergency shutdown, emergency operations, and startup after an unscheduled shutdown or maintenance
- (2) The safe limits of operation for each process variable, the consequences of deviations, and the corrective actions that should be taken
- (3) A discussion of the safety systems that are used to control the hazards of the process, including but not limited to instrumentation, alarms, interlocks, pressure relief and effluent handling systems, water sprays, deluge systems, and containment systems
- (4) Safe work practices for preparing equipment for maintenance, including but not limited to lockout/tagout, opening process equipment, confined space entry, hot work and admission of visitors, contractor, maintenance and other support personnel into the process area

For guidance on preparing operating procedures, refer to the latest editions of *Guidelines for Technical Management of Chemical Process Safety* (AIChE/CCPS); *Guidelines for Safe Process Operations and Maintenance* (AIChE/CCPS); and *Guidelines for Writing Effective Operating and Maintenance Procedures* (AIChE/CCPS).

A.7.3.2.2 The inspection and testing of alarms, interlocks, and controls are to ensure the safe operation of process equipment as designed. These systems include, but are not limited to, emergency alarms, shutdown systems, and isolation systems.

A.7.4 Conditions that might require repeating a review include, but are not limited to, the following:

- (1) When changes occur in the materials in process
- (2) When changes occur in process equipment
- (3) When changes occur in process control
- (4) When changes occur in operating procedures

A.7.5.1 The investigation should begin as soon as possible to avoid loss of critical information, but should be initiated not later than 48 hours after the incident. The contributing and root causes of the incident should be determined. A procedure should be in place to promptly address and resolve incident findings. All actions to correct the causes and the dates completed should be documented. The incident report should be communicated to all affected personal. Measures should be taken to prevent a recurrence.

A.9.1.2 See Annex D.

Δ A.10.1 The performance option of this code establishes acceptable levels of risk for facilities (i.e., buildings and other structures and the operations therewith associated) as addressed in Section 1.3. (Note that *facility* and *building* can be used interchangeably; *facility* is the more general term.) While the performance option of this code does contain goals, objectives, and performance criteria necessary to provide for an acceptable level of risk, it does not describe how to meet these goals, objectives, and performance criteria. Design and engineering are needed to meet the provisions of Chapter 5. For fire protection designs, the *SFPE Engineering Guide to Performance-Based Fire Protection* provides a framework for these assessments.

Preconstruction design requirements address those issues, which have to be considered before the certificate of occupancy is issued for a facility.

A.10.1.1 Performance code approaches written for other model codes can be used by the AHJ.

A.10.1.2 Performance code approaches written for other model codes can be used by the AHJ.

A.10.1.3 Qualifications should include experience, education, and credentials that demonstrate knowledge and responsible use of applicable models and methods.

Δ A.10.1.4 The *SFPE Engineering Guide to Performance-Based Fire Protection* outlines a process for using a performance-based approach in the design and assessment of building fire safety design and identifies parameters that should be considered in the analysis of a performance-based design. As can be seen, this process requires the involvement of all stakeholders who have a share or interest in the successful completion of the project. The steps that are recommended by the *SFPE Engineering Guide to Performance-Based Fire Protection* for this process are shown in Figure A.10.1.4.

The guide specifically addresses building fire safety performance-based design. It might not be directly applicable to performance-based designs involving other systems and operations covered within this code, such as hot work operations or hazardous materials storage. However, the various steps for defining, developing, evaluating, and documenting the performance-based design should still provide a useful framework for the overall design process.

The steps in the performance-based design process are as follows:

- (1) *Step 1: Defining Project Scope.* The first step in a performance-based design is to define the scope of the project. Defining the scope consists of identifying and documenting the following:
 - (a) Constraints on the design and project schedule

- (b) The stakeholders associated with project
- (c) The proposed building construction and features desired by the owner or tenant
- (d) Occupant and building characteristics
- (e) The intended use and occupancy of the building
- (f) Applicable codes and regulations

An understanding of these items is needed to ensure that a performance-based design meets the stakeholders' needs.

- (2) *Step 2: Identifying Goals.* Once the scope of the project is defined, the next step in the performance-based design process is to identify and document the fire safety goals of various stakeholders. Fire safety goals could include levels of protection for people and property, or they could provide for continuity of operations, historical preservation, and environmental protection. Goals could be unique for different projects, based on the stakeholders' needs and desires. The stakeholders should discuss which goals are the most important for the project. In order to avoid problems later in the design process, all stakeholders should be aware of and agree to the goals prior to proceeding with the performance-based design process (see *Step 7*).
- (3) *Step 3: Defining Stakeholder and Design Objectives.* The third step in the design process is to develop objectives. The objectives are essentially the design goals that are further refined into tangible values that can be quantified in engineering terms. Objectives could include mitigating the consequences of a fire expressed in terms of dollar values, loss of life, or other impact on property operations, or maximum allowable conditions, such as extent of fire spread, temperature, spread of combustion products, and so forth.
- (4) *Step 4: Developing Performance Criteria.* The fourth step in the design process is the development of performance criteria to be met by the design. These criteria are a further refinement of the design objectives and are numerical values to which the expected performance of the trial designs can be compared. Performance criteria could include threshold values for temperatures of materials, gas temperatures, carboxyhemoglobin (COHb) levels, smoke obscuration, and thermal exposure levels.
- (5) *Step 5: Developing Design Scenarios.* Once the performance criteria have been established, the engineer will develop and analyze design alternatives to meet performance criteria. The first part of this process is the identification of possible scenarios and design scenarios. Fire scenarios are descriptions of possible fire events, and consist of fire characteristics, building characteristics (including facility operations), and occupant characteristics. The fire scenarios identified will subsequently be filtered (i.e., combined or eliminated) into a subset of design fire scenarios against which trial designs will be evaluated. Hazardous materials scenarios can be treated similarly.
- (6) *Step 6: Developing Trial Design(s).* Once the project scope, performance criteria, and design scenarios are established, the engineer develops preliminary designs, referred to as trial designs, intended to meet the project requirements. The trial design(s) include proposed fire protection systems, construction features, and operation that are provided in order for a design to meet the performance criteria when evaluated using the design fire scenarios. The evaluation method should also be determined at this point. The evaluation methods used

should be appropriate for the situation and agreeable to the stakeholders.

- (7) *Step 7: Developing a Fire Protection Engineering Design Brief.* At this point in the process a fire protection engineering design brief should be prepared and provided to all stakeholders for their review and concurrence. This brief should document the project scope, goals, objectives, trial designs, performance criteria, design fire scenarios, and analysis methods. Documenting and agreeing upon these factors at this point in the design process will help avoid possible misunderstandings later.
- (8) *Step 8: Evaluating Trial Designs.* Each trial design is then evaluated using each design scenario. The evaluation results will indicate whether the trial design will meet the performance criteria. Only trial design(s) that meet the performance criteria can be considered as final design proposals. Yet, the performance criteria can be revised with the stakeholders' approval. The criteria cannot be arbitrarily changed to ensure that a trial design meets a criterion, but can be changed based on additional analysis and the consideration of additional data.
- (9) *Step 9: Modifying Designs or Objectives.* If none of the trial designs evaluated comply with the previously agreed upon performance criteria, it could be necessary to either develop and evaluate new trial designs, or revisit the objectives and performance criteria previously agreed upon by the stakeholders to determine if stakeholder objectives and performance criteria should be modified.
- (10) *Step 10: Selecting the Final Design.* Once an acceptable trial design is identified using the evaluation, it can be considered for the final project design. If multiple trial designs are evaluated, further analysis will be needed to select a final design. The selection of an acceptable trial design for the final design could be based on a variety of factors, such as financial considerations, timeliness of installation, system and material availability, ease of installation, maintenance and use, and other factors.
- (11) *Step 11: Preparing Performance-Based Design Report.* Once the final design is identified, design documents need to be prepared. Proper documentation will ensure that all stakeholders understand what is necessary for the design implementation, maintenance, and continuity of the fire protection design. The documentation should include the fire protection engineering design brief, a performance design report, detailed specifications and drawings, and a facility operations and maintenance manual.
- (12) *Step 12: Preparing Specifications, Drawings, and Operations and Maintenance Manual.* The specifications and drawings portion of the performance-based design report convey to building and system designers and installing contractors how to implement the performance design. Specifications and drawings could include required sprinkler densities; hydraulic characteristics and spacing requirements; the fire detection and alarm system components and programming; special construction requirements, including means of egress and location of fire-resistive walls; compartmentation; and the coordination of interactive systems. The detailed specifications are the implementation document of the performance-based design report. The detailed drawings will graphically represent the results of the performance design. The operations and maintenance (O&M) manual clearly states the requirement of the facility operator to ensure

that the components of the performance design are in place and operating properly. The O&M manual describes the commissioning requirements and the interaction of the different systems' interfaces. All subsystems are identified, and inspection and testing regimes and schedules are created.

The O&M manual also gives instruction to the facility operator on restrictions placed on facility operations. These limitations are based on the engineering assumptions made during the design and analysis. These limiting factors could include critical fire load, sprinkler design requirements, building use and occupancy, and reliability and maintenance of systems. The O&M manual can be used to communicate to tenants and occupants these limits and their responsibilities as a tenant. It could also be used as a guide for renovations and changes. It also can be used to document agreements between stakeholders.

A.10.1.5 A third-party reviewer is a person or group of persons chosen by the AHJ to review proposed performance-based designs. Qualifications of the third-party reviewer should include experience, education, and credentials that demonstrate knowledge and responsible use of applicable models and methods.

A.10.1.8 See Step 12 of A.10.1.4 for a description of these documents.

A.10.1.9 Information that could be needed by the fire service arriving at the scene of a fire in a performance-based designed facility includes, but is not limited to, the following:

- (1) Safe shutdown procedures of equipment and processes
- (2) Facility personnel responsible for assisting the fire service
- (3) Operating procedures required to maintain the effectiveness of the performance-based designed fire protection system (i.e., when it is and is not appropriate to alter, shut down, or turn off a design feature; assumptions that have to be maintained if a fire occurs; suggested fire-fighting tactics that relate to the specific nature of the performance-based design)

The design specifications and O&M manual documentation described in 10.1.8 should provide a guide for the facility owner and tenants to follow in order to maintain the required level of safety anticipated by the original design. It should also provide a guide for the AHJ to use in conducting ongoing inspections of the facility.

A.10.1.10 Continued compliance with the goals and objectives of the code involves many factors. The building construction, including openings, interior finish, and fire- and smoke-resistive construction, and the building and fire protection systems need to retain at least the same level of performance as is provided for by the original design parameters. The use and occupancy should not change to the degree that assumptions made about the occupant characteristics, combustibility of furnishings, and existence of trained personnel are no longer valid. In addition, actions provided by other personnel, such as emergency responders, should not be diminished below the documented assumed levels. Also, actions needed to maintain reliability of systems at the anticipated level need to meet the initial design criteria.

Subsection 10.1.10 deals with issues that arise after the facility has been constructed and a certificate of occupancy has been issued. Therefore, any changes to the facility or the oper-

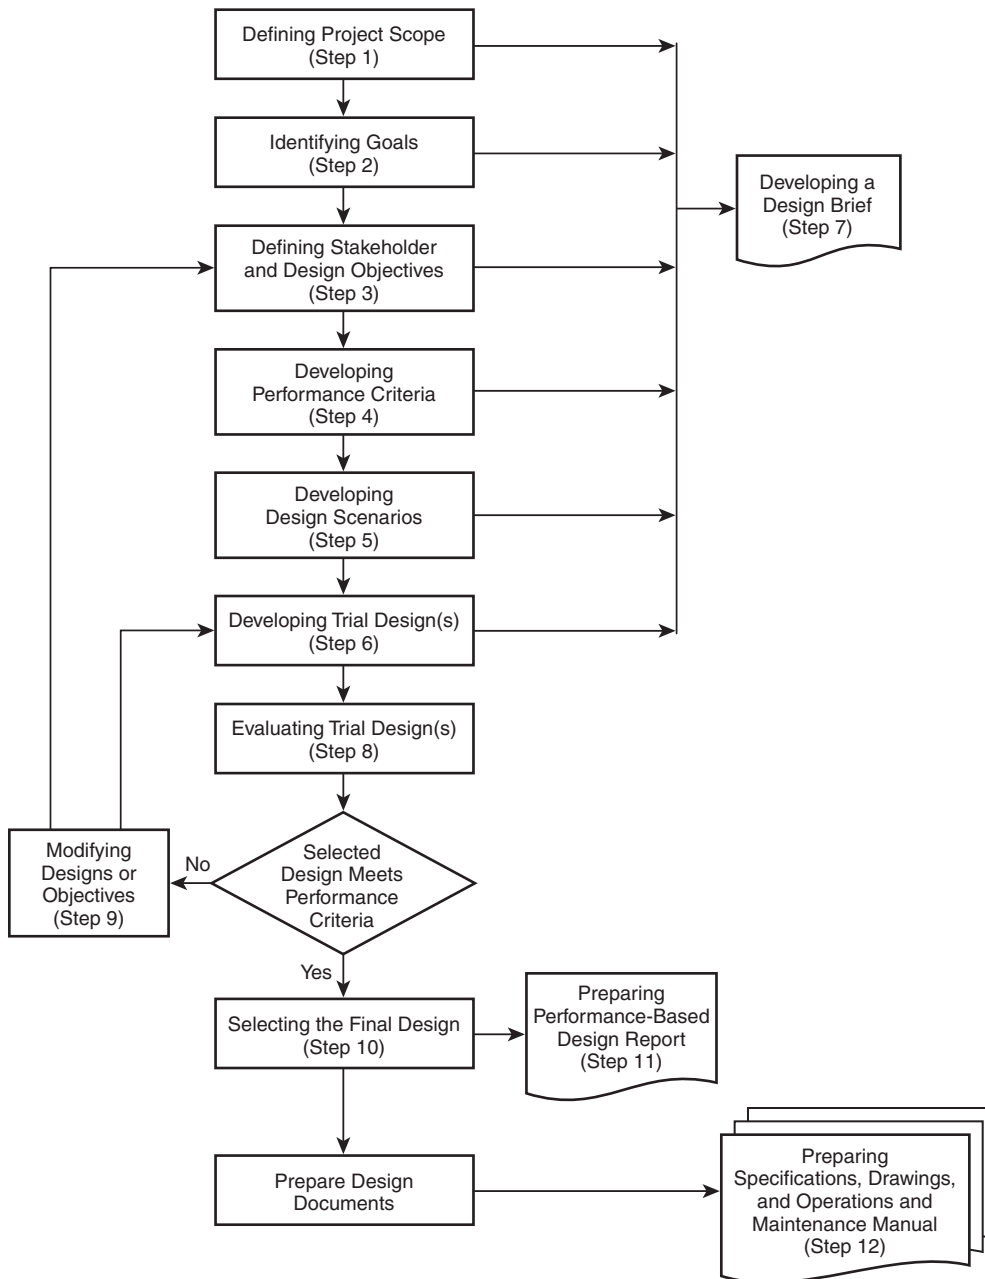


FIGURE A.10.1.4 Steps in the Performance-Based Analysis and the Conceptual Design Procedure for Fire Protection Design.

ations conducted therein, up to and including the demolition of the facility, that affect the assumptions of the original design are considered part of the management of change.

The following is a process for evaluating performance-based facilities:

- (1) Review of original design analysis and documentation as follows:
 - (a) Assumptions
 - (b) Input parameter values
 - (c) Predictions and/or results of other calculations
- (2) Review of design analysis and documentation for any subsequent renovations, additions, modifications, and so forth, as in Step 1 of A.10.1.4
- (3) Review of the facility's operations and maintenance manual, including any and all revisions to it
- (4) On-site inspection, involving the following:
 - (a) Consideration of "prescriptive" issues (e.g., blocked egress paths, poor maintenance of systems)

- (b) Comparison of assumptions to specific, pertinent on-site conditions
- (c) Comparison of input parameter values to pertinent on-site conditions
- (d) Review of maintenance and testing documentation to ensure adherence to the schedules detailed in the facility's O&M manual
- (5) Reconciliation of discrepancies as follows:
 - (a) A listing of discrepancies
 - (b) Consultation with the facility owner and/or their representative
 - (c) Preparation of a schedule that reconciles the discrepancies

A.10.1.11 Private fire inspection services can be used to meet this provision provided that they are qualified to assess the impact of changes on the performance-based design and assumptions.

A.10.2.2 The performance criteria in Section 10.2 define an acceptable level of performance that should be agreed upon by the stakeholders, including the owner and the AHJ. The acceptable level of performance can vary widely between facilities based on a number of factors, including the existence of potential ignition sources, potential fuel loads present, reactivity and quantity of hazardous materials present, the nature of the operations conducted at the facility, and the characteristics and number of personnel likely to be present at the facility.

A.10.2.2.1 Many of the performance criteria related to safety from fire can also be found in the annex of NFPA 101.

A.10.2.2.2 It is anticipated that the design provides protection for occupants who are not intimate with the initial unintentional detonation or deflagration of explosive materials, and individuals immediately adjacent to the property. It is recognized that employees should be trained and knowledgeable in the hazards of the materials present in the workplace. It is recognized that some of these individuals could experience psychological and physical injuries, such as hearing problems, on either a short or long term basis. However, the intent is that they do not experience thermal burns or loss of life or limb as a direct result of the explosion.

It is not the intent of the code to provide protection against explosions caused by acts of terrorism. This would involve the introduction of an unknown quantity of explosives in an unknown location within or adjacent to a building. Where protection is needed against such acts of terrorism, the appropriate military and law enforcement agencies should be consulted.

A.10.2.2.3 Given the nature and variety of hazardous materials, more than one performance criterion for a specific facility could need to be developed. Criteria have to be developed for each hazardous material and possibly for different personnel; for example, higher levels of exposure can be tolerated by personnel that are in some way protected than those personnel having no protection. Development of performance criteria for hazardous materials should be developed by the facility owner and the facility's safety personnel in conjunction with the AHJ and the emergency response personnel expected to respond to an incident.

It is anticipated that the design provides protection for occupants inside or immediately adjacent to the facility who are not intimate with the initial unauthorized release of hazardous

materials, or the initial unintentional reaction of hazardous materials. However, it is assumed that these individuals depart from the area of the incident in a time frame reasonable for their circumstances, based on their observation of the event, or some other form of notification.

It is also anticipated that employees and emergency response personnel are trained and aware of the hazardous materials present in the facility, and the potential consequences of their involvement in the incident, and take appropriate measures to ensure their own safety during search and rescue operations.

It is not the intent of the code to provide protection against acts of terrorism involving the introduction of hazardous materials into a facility. This involves the introduction of an unknown quantity of materials in an unknown location within or adjacent to a building. Where protection is needed against such acts of terrorism, the appropriate military and law enforcement agencies should be consulted.

A.10.2.2.4 Each facility designed using a performance-based approach most likely has different levels of acceptable and unacceptable property damage. This reflects the unique aspects of the performance-based designed facility and the reasons for pursuing a performance-based design. Therefore, the definition of an acceptable and an unacceptable level of property damage results from discussions between the facility's owner, manager and engineer, the designer, (possibly) the insurance underwriter and field engineer, and the AHJ. There could be cases where a property damage criterion is not needed.

Note that the structural integrity performance criteria for property damage most likely differ from the structural integrity performance criteria for life safety. This reflects the difference in the associated objectives: A life safety criterion probably is more restrictive than one for property damage.

A.10.2.2.5 Each facility designed using a performance-based approach most likely has a different level of acceptable and unacceptable interruption of the facility's mission. This reflects the unique aspects of the performance-based designed facility and the reasons for pursuing a performance-based design. Therefore, the definition of an acceptable and an unacceptable interruption of the facility's mission results from discussions between the facility's owner, manager and engineer, the designer, (possibly) the insurance underwriter and field engineer, and the AHJ. There could be cases where a mission continuity criterion is not needed.

A.10.3.2 In jurisdictions where NFPA electrical standards are not adopted, the provisions of the electrical standards adopted by the AHJ should be used.

A.10.3.4 In jurisdictions where NFPA 101 is not adopted, the provisions of the building code adopted by the AHJ should be used.

A.10.4 Many events can occur during the life of a facility; some have a higher probability of occurrence than others. Some events, though not typical, could have a devastating effect on the facility. A reasonable design should be able to achieve the goals, objectives, and performance criteria of this code for any typical or common design scenario and for some of the nontypical, potentially devastating scenarios, up to some level commensurate with society's expectations as reflected in this code.

The challenge in selecting design scenarios is finding a manageable number that are sufficiently diverse and representative so that, if the design is reasonably safe for those scenarios, it should then be reasonably safe for all scenarios, except for those specifically excluded as being unrealistically severe or sufficiently infrequent to be fair tests of the design.

▲ **A.10.4.1.2** The *SFPE Engineering Guide to Performance-Based Fire Protection* identifies methods for evaluating fire scenarios.

A.10.4.1.3 It is desirable to consider a wide variety of different design scenarios to evaluate the complete capabilities of the building or structure. Design scenarios should not be limited to one or two worst-case events.

A.10.4.2.1 An example of such a scenario for a health care occupancy is a patient room with two occupied beds with a fire initially involving one bed and the room door open. This is a cursory example in that much of the explicitly required information indicated in 10.4.2.1 can be determined from the information provided in the example. Note that it is usually necessary to consider more than one scenario to capture the features and conditions typical of an occupancy.

A.10.4.2.2 Examples of such scenarios are a fire involving ignition of gasoline as an accelerant in a means of egress, clothing racks in corridors, renovation materials, and other fuel configurations that can cause an ultrafast fire. The means of egress chosen is the doorway with the largest egress capacity among doorways normally used in the ordinary operation of the building. The baseline occupant characteristics for the property are assumed. At ignition, doors are assumed to be open throughout the building.

A.10.4.2.3 An example of such a scenario is a fire in a storage room adjacent to the largest occupiable room in the building. The contents of the room of fire origin are specified to provide the largest fuel load and the most rapid growth in fire severity consistent with the normal use of the room. The adjacent occupiable room is assumed to be filled to capacity with occupants. Occupants are assumed to be somewhat impaired in whatever form is most consistent with the intended use of the building. At ignition, doors from both rooms are assumed to be open. Depending on the design, doorways connect the two rooms or they connect via a common hallway or corridor.

For purposes of this scenario, an occupiable room is a room that could contain people (i.e., a location within a building where people are typically found).

A.10.4.2.4 An example of such a scenario is a fire originating in a concealed wall- or ceiling-space adjacent to a large, occupied function room. Ignition involves concealed combustibles, including wire or cable insulation and thermal or acoustical insulation. The adjacent function room is assumed to be occupied to capacity. The baseline occupant characteristics for the property are assumed. At ignition, doors are assumed to be open throughout the building.

A.10.4.2.5 An example of such a scenario is a cigarette fire in a trash can. The trash can is close enough to room contents to ignite more substantial fuel sources but is not close enough to any occupant to create an intimate-with-ignition situation. If the intended use of the property involves the potential for some occupants to be incapable of movement at any time, then the room of origin is chosen as the type of room likely to have such occupants, filled to capacity with occupants in that condition. If the intended use of the property does not involve the

potential for some occupants to be incapable of movement, then the room of origin is chosen to be an assembly or function area characteristic of the use of the property, and the trash can is placed so that it is shielded by furniture from suppression systems. At ignition, doors are assumed to be open throughout the building.

A.10.4.2.6 An example of such a scenario is a fire originating in the largest fuel load of combustibles possible in normal operation in a function or assembly room or in a process/manufacturing area, characteristic of the normal operation of the property. The configuration, type, and geometry of the combustibles are chosen so as to produce the most rapid and severe fire growth or smoke generation consistent with the normal operation of the property. The baseline occupant characteristics for the property are assumed. At ignition, doors are assumed to be closed throughout the building.

This scenario includes everything from a big couch fire in a small dwelling to a rack storage fire in combustible liquids stock in a big box retail store.

A.10.4.2.7 An example of such a scenario is an exposure fire. The initiating fire is the closest and most severe fire possible consistent with the placement and type of adjacent properties and the placement of plants and combustible adornments on the property. The baseline occupant characteristics of the property are assumed.

This category includes wildland/urban interface fires and exterior wood shingle problems, where applicable.

A.10.4.2.8 This scenario addresses a set of conditions with a typical fire originating in the building with any one passive or active fire protection system or feature being ineffective. Examples include unprotected openings between floors or between fire walls or fire barrier walls, rated fire doors that fail to close automatically or are blocked open, sprinkler system water supply that is shut off, a fire alarm system that is nonoperative, a smoke management system that is not operational, or automatic smoke dampers that are blocked open. This scenario should represent a reasonable challenge to the other building features provided by the design and presumed to be available.

The exemption from Fire Design Scenario 8 is applied to each active or passive fire protection system individually and requires two different types of information to be developed by analysis and approved by the AHJ. System reliability is to be analyzed and accepted. Design performance in the absence of the system is also to be analyzed and accepted, but acceptable performance does not require fully meeting the stated goals and objectives. It might not be possible to meet fully the goals and objectives if a key system is unavailable, and yet no system is totally reliable. The AHJ determines which level of performance, possibly short of the stated goals and objectives, is acceptable, given the very low probability (that is, the system's unreliability probability) that the system will not be available.

A.10.4.3.1 This scenario is intended to address facilities where explosives and products containing explosives are manufactured, stored, sold, or handled. From an overall safety standpoint, the operations being performed at these facilities should include stringent safety procedures that significantly reduce the likelihood of an explosion from occurring. However, if an explosion does occur, protection methods such as storage magazines, property set backs, deflagration, and explosion

venting and containment need to be in place, as appropriate, to minimize potential injury and loss of life and property.

Where products containing explosives, such as pyrotechnic displays or fireworks, are stored, handled, or used in buildings, such as arenas, an explosion scenario should not result in significant injuries to occupants not intimate with the materials.

A.10.4.4 Design hazardous materials scenarios should explicitly account for the following:

- (1) Occupant activities, training, and knowledge
- (2) Number and location of occupants
- (3) Discharge location and surroundings
- (4) Hazardous materials' properties
- (5) Ventilation, inerting, and dilution systems and conditions
- (6) Normal and emergency operating procedures
- (7) Safe shutdown and other hazard mitigating systems and procedures
- (8) Weather conditions affecting the hazard
- (9) Potential exposure to off-site personnel

Design hazardous materials scenarios should be evaluated as many times as necessary by varying the factors previously indicated. Design hazardous materials scenarios could need to be established for each different type of hazardous material stored or used at the facility.

A.10.4.4.2 This provision should be applied to each protection system individually and requires two different types of information to be developed by analysis and approved by the AHJ. System reliability is to be analyzed and accepted. Design performance in the absence of the system is also to be analyzed and accepted, but acceptable performance does not require fully meeting the stated goals and objectives. It might not be possible to meet fully the goals and objectives if a key system is unavailable, and yet no system is totally reliable. The AHJ determines which level of performance, possibly short of stated goals and objectives, is acceptable, given the very low probability (that is, the systems' unreliability probability) that the system will be unavailable.

A.10.4.5.1 An example of such a scenario would involve a fire or earthquake effectively blocking the principal entrance/exit but not immediately endangering the occupants. The full occupant load of the assembly space has to exit using secondary means.

A.10.6 The assessment of precision required in 10.7.7 requires a sensitivity and uncertainty analysis, which can be translated into safety factors.

Sensitivity Analysis. The first run a model user makes should be labeled as the base case, using the nominal values of the various input parameters. However, the model user should not rely on a single run as the basis for any performance-based fire safety system design. Ideally, each variable or parameter that the model user made to develop the nominal input data should have multiple runs associated with it, as should combinations of key variables and parameters. Thus, a sensitivity analysis should be conducted that provides the model user with data that indicates how the effects of a real fire could vary and how the response of the proposed fire safety design could also vary.

The interpretation of a model's predictions can be a difficult exercise if the model user does not have knowledge of fire dynamics or human behavior.

Reasonableness Check. The model user should first try to determine whether the predictions actually make sense; that is, they don't upset intuition or preconceived expectations. Most likely, if the results don't pass this test, an input error has been committed.

Sometimes the predictions appear to be reasonable but are, in fact, incorrect. For example, a model can predict higher temperatures farther from the fire than close to it. The values themselves could be reasonable; for example, they are not hotter than the fire, but they don't "flow" down the energy as expected.

A margin of safety can be developed using the results of the sensitivity analysis in conjunction with the performance criteria to provide the possible range of time during which a condition is estimated to occur.

Safety factors and margin of safety are two concepts used to quantify the amount of uncertainty in engineering analyses. Safety factors are used to provide a margin of safety and represent, or address, the gap in knowledge between the theoretically perfect model; that is, reality and the engineering models that can only partially represent reality.

Safety factors can be applied to either the predicted level of a physical condition or to the time at which the condition is predicted to occur. Thus, a physical or a temporal safety factor, or both, can be applied to any predicted condition. A predicted condition (that is, a parameter's value) and the time at which it occurs are best represented as distributions. Ideally, a computer fire model predicts the expected or nominal value of the distribution. Safety factors are intended to represent the spread of these distributions.

Given the uncertainty associated with data acquisition and reduction, and the limitations of computer modeling, any condition predicted by a computer model can be thought of as an expected or nominal value within a broader range. For example, an upper layer temperature of 1110°F (600°C) is predicted at a given time. If the modeled scenario is then tested (that is, full-scale experiment based on the computer model's input data), the actual temperature at that given time could be 1185°F (640°C) or 1085°F (585°C). Therefore, the temperature should be reported either as 1110°F, +75°F or -25°F (600°C, +40°C or -15°C) or as a range of 1085°F to 1184°F (585°C to 640°C).

Ideally, predictions are reported as a nominal value, a percentage, or an absolute value. As an example, an upper layer temperature prediction could be reported as 1112°F (600°C), 86°F (30°C), or 1112°F (600°C), 5 percent. In this case, the physical safety factor is 0.05 (i.e., the amount by which the nominal value should be degraded and enhanced). Given the state-of-the-art of computer fire modeling, this is a very low safety factor. Physical safety factors tend to be on the order of tens of percent. A safety factor of 50 percent is not unheard of.

Part of the problem in establishing safety factors is that it is difficult to state the percentage or range that is appropriate. These values can be obtained when the computer model predictions are compared to test data. However, using computer fire models in a design mode does not facilitate this since (1) the room being analyzed has not been built yet and (2) test scenarios do not necessarily depict the intended design.

A sensitivity analysis should be performed based on the assumptions that affect the condition of interest. A base case that uses all nominal values for input parameters should be developed. The input parameters should be varied over reasonable ranges, and the variation in predicted output should be noted. This output variation can then become the basis for physical safety factors.

The temporal safety factor addresses the issue of when a condition is predicted and is a function of the rate at which processes are expected to occur. If a condition is predicted to occur 2 minutes after the start of the fire, then this can be used as a nominal value. A process similar to that described for physical safety factors can also be employed to develop temporal safety factors. In this case, however, the rates (e.g., of heat release and toxic product generation) will be varied instead of absolute values (e.g., material properties).

The margin of safety can be thought of as a reflection of societal values and can be imposed by the AHJ for that purpose. Since the time for which a condition is predicted is most likely the focus of the AHJ (e.g., the model predicts occupants have 5 minutes to safely evacuate), the margin of safety is characterized by temporal aspects and tacitly applied to the physical margin of safety.

Escaping the harmful effects of fire (or mitigating them) is, effectively, a race against time. When assessing fire safety system designs based on computer model predictions, the choice of an acceptable time is important. When an AHJ is faced with the predicted time of untenability, a decision needs to be made regarding whether sufficient time is available to ensure the safety of facility occupants. The AHJ is assessing the margin of safety. Is there sufficient time to get everyone out safely? If the AHJ feels that the predicted egress time is too close to the time of untenability, then the AHJ can impose an additional time that the designer has to incorporate into the system design. In other words, the AHJ can impose a greater margin of safety than that originally proposed by the designer.

Δ A.10.7.1 The *SFPE Engineering Guide to Performance-Based Fire Protection* describes the documentation that should be provided for a performance-based design.

Proper documentation of a performance design is critical to the design acceptance and construction. Proper documentation also ensures that all parties involved understand what is necessary for the design implementation, maintenance, and continuity of the fire protection design. If attention to details is maintained in the documentation, then there should be little dispute during approval, construction, startup, and use.

Poor documentation could result in rejection of an otherwise good design, poor implementation of the design, inadequate system maintenance and reliability, and an incomplete record for future changes or for testing the design forensically.

A.10.7.2 The sources, methodologies, and data used in performance-based designs should be based on technical references that are widely accepted and used by the appropriate professions and professional groups. This acceptance is often based on documents that are developed, reviewed, and validated under one of the following processes:

- (1) Standards developed under an open consensus process conducted by recognized professional societies, codes or standards organizations, or governmental bodies

- (2) Technical references that are subject to a peer review process and published in widely recognized peer-reviewed journals, conference reports, or other publications
- (3) Resource publications such as the *SFPE Handbook of Fire Protection Engineering*, which are widely recognized technical sources of information

The following factors are helpful in determining the acceptability of the individual method or source:

- (1) Extent of general acceptance in the relevant professional community. Indications of this acceptance include peer-reviewed publication, widespread citation in the technical literature, and adoption by or within a consensus document.
- (2) Extent of documentation of the method, including the analytical method itself, assumptions, scope, limitations, data sources, and data reduction methods.
- (3) Extent of validation and analysis of uncertainties. This includes comparison of the overall method with experimental data to estimate error rates as well as analysis of the uncertainties of input data, uncertainties and limitations in the analytical method, and uncertainties in the associated performance criteria.
- (4) Extent to which the method is based on sound scientific principles.
- (5) Extent to which the proposed application is within the stated scope and limitations of the supporting information, including the range of applicability for which there is documented validation. Factors such as spatial dimensions, occupant characteristics, and ambient conditions can limit valid applications.

In many cases, a method is built from and includes numerous component analyses. These component analyses should be evaluated using the same factors that are applied to the overall method as outlined in items (1) through (5).

A method to address a specific fire safety issue, within documented limitations or validation regimes, might not exist. In such a case, sources and calculation methods can be used outside of their limitations, provided that the design team recognizes the limitations and addresses the resulting implications.

The technical references and methodologies to be used in a performance-based design should be closely evaluated by the design team and the AHJ, and possibly by a third-party reviewer. The strength of the technical justification should be judged using criteria in items (1) through (5). This justification can be strengthened by the presence of data obtained from fire testing.

A.10.7.11 Documentation for modeling should conform to ASTM E1472, *Standard Guide for Documenting Computer Software for Fire Models*, although most, if not all, models were originally developed before this standard was promulgated.

A.11.1.1 Determine the classification of ammonium nitrate in accordance with Chapter 4. Chapter 11 takes precedence to address the specific requirements for solid and liquid ammonium nitrate, when 1,000 lb is exceeded. The physical hazards of ammonium nitrate are dependent on the properties of the specific material or mixture of materials as a whole. Where used as a fertilizer, it is common for ammonium nitrate to exist as a component of a chemical mixture. It is not uncommon for the user to describe the mixture as ammonium nitrate when in reality the mixture can contain components that contribute to

altering the end classification of the material. The manufacturer's safety data sheet (SDS) should be used to assess the overall hazards of these materials. The user is cautioned that the DOT shipping classification for transportation purposes alone is not a sufficient means by which to determine the storage and use hazards of these materials. Ammonium nitrate in the undiluted or pure form has a higher degree of overall hazard than does ammonium nitrate when mixed or blended with compatible materials that can reduce the concentration. The tables in Chapter 5 are hazard specific; they are not chemical specific. Ammonium nitrate as such is not included in the tables, because the actual hazard classification varies with the material under consideration. The question must be answered as to whether the material is an oxidizer, and, if so, what Class; whether it is an unstable reactive, and, if so, what Class; or whether there are other physical or health hazards attendant to the mixture under evaluation. (See Annex E for additional information.)

A.11.1.1.5 Ammonium nitrate and ammonium nitrate-based materials that are DOT Hazard Class 1 explosives should be stored in accordance with the requirements of NFPA 495. Sensitivity is determined by the application of the UN Test Series 1, which includes testing to determine impact sensitivity, friction sensitivity, sensitivity to electrostatic discharge, and thermal stability.

A.11.1.1.6 Agricultural application refers to the actual transporting and spreading of the fertilizers in fields. Storage in a building for eventual agricultural use is not an agricultural application.

A.11.1.4.9.1 This requirement is intended to prohibit floor drains, traps, tunnels, pits, or pockets into which any molten ammonium nitrate is able to flow and be confined in the event of fire.

A.11.1.4.9.2 The slope of the storage floor should be pitched in such a manner that it drains away from the ammonium nitrate pile and toward a containment area. As noted in other sections, no drainage pits, sumps, or confined piping should be designed into this drainage plan.

A.11.1.5 Where a documented risk analysis demonstrates to the AHJ that an equivalent level of fire safety can be achieved using alternatives to the requirements of this section, such an approach is an acceptable alternative. The risk analysis should be submitted to the AHJ in accordance with the requirements of 1.5.3. A risk analysis report should demonstrate equivalent fire safety by addressing relevant topics, including, but not limited to, the following:

- (1) Location of the facility
- (2) Distance to exposed structures and population density of public areas and other areas associated with the ammonium nitrate facility.
- (3) Construction type
- (4) Storage configuration
- (5) Exposing combustible materials
- (6) Emergency response capability
- (7) Water supply
- (8) Ammonium nitrate mixtures, blends, and uses
- (9) Fire protection features provided (fire barriers, fire detection and alarm, and so on)

A.11.2.1 Sumps and collection systems as required by 6.2.1.9.2 create confinement conditions and should be avoided with molten ammonium nitrate, which could be created in a fire.

Δ A.11.2.3 Storage of ammonium nitrate prills at ambient temperature [up to 140°F (60°C)] does not create decomposition products to a level that would create hazards to personnel and is not sufficient to catalyze higher rates of decomposition and uncontrolled heating.

Ammonium nitrate storage facilities do not purposefully bring fresh air into buildings since ammonium nitrate is a hygroscopic material. Constant exposure to humid air leads to caking, product degradation, and breakdown. Some facilities, especially large manufacturing sites, use dehumidification to prevent moist air from contacting ammonium nitrate solids. Most retail facilities are substantially open to outside air (i.e., naturally ventilated and not mechanically refreshed with ambient air).

The following is stated in "Summary Report: Workshop on Ammonium Nitrate" from the European Commission's Joint Research Center:

"Pure ammonium nitrate can undergo thermal decomposition if it receives enough energy. Gases are then emitted, especially nitrogen oxides and ammonia, both toxic. With proper ventilation, the decomposition stops as soon as the energy flow stops. The decomposition rate is not dangerously high at moderate temperatures, and the overall thermal effect is not significant since the exothermic reactions are accompanied by endothermic disassociation..."

Providing ventilation for severely contaminated product would not be practical because an appropriate hazardous gas production rate cannot be realistically predicted. Ventilation for fire conditions involving ordinary combustibles that are adequately controlled by automatic sprinklers has not been shown to have a significant effect on control of the fire.

The proper loss prevention approach is to prevent product contamination and either to eliminate combustible construction or occupancy (preferred) or to control burning combustibles by providing adequate automatic sprinkler protection.

N A.11.2.5 It is not the intent to apply the requirements of 11.2.5, 11.2.7, or 11.2.8 to new or existing buildings of Type I and Type II construction storing only bulk ammonium nitrate.

N A.11.2.5.1 Where existing or equivalent methods are intended to meet the retroactive criteria, suitable documentation should be submitted to the AHJ (see 1.5.1 and 1.5.2). The documentation should follow the guidelines outlined in the performance-based option (see Chapter 10) focused on the specific alternative.

A.11.2.5.3 Foam, dry-chemical, or gaseous extinguishing systems are ineffective in controlling fires involving ammonium nitrate, which is an oxidizer that supplies its own oxygen. Steam is similarly ineffective and should not be used due to the addition of heat to the decomposing mass. Water cools the ammonium nitrate and reduces molten ammonium nitrate formation and decomposition.

N A.11.2.7.2 When first responders arrive at the facility after the emergency communications center has alerted them of activation of the alarm, detection, or automatic fire extinguishing system, they will need to size-up the situation and determine if the public notification/siren system needs to be activated.

Δ A.11.2.11 Explosion control methods required by 6.2.1.6 are not warranted for ammonium nitrate regulated by this chapter. Deflagration control methods described in NFPA 69 (primarily deflagration venting) are not effective for the detonations that

can sometimes result from ammonium nitrate that is involved in a fire situation. In Chapter 11, the emphasis is on explosion prevention, but using methods that will be effective on ammonium nitrate and not those required by NFPA 69 — namely combustible concentration reduction, oxidant concentration reduction, and deflagration control. The other requirements of Chapter 11 are intended to prevent ammonium nitrate explosions and are more effective than the requirements of 6.2.1.6 for this material. Ammonium nitrate that is formulated to be an explosive is regulated in accordance with NFPA 495 and not this chapter.

A.11.2.16.1.1 Provisions should be made to avoid the following conditions with ammonium nitrate:

- (1) Heating in a confined space
- (2) Localized heating potentially leading to development of high-temperature areas
- (3) Exposure to strong shock waves
- (4) Contamination with combustible materials or incompatible inorganic and organic substances that can result in sensitivity to explosion.
- (5) Low pH or acidic conditions

A.11.2.17 A pre-incident best practices plan should be developed by the local fire department in conjunction with any facility that stores, uses, or handles ammonium nitrate. NFPA 1620 can be used for further guidance.

A.11.2.17.1.3 A 1-mile (1.6 km) public evacuation distance has been recommended in the rare event of a facility containing ammonium nitrate becoming involved in a fire. This evacuation distance is recommended because the exact conditions of a facility during the emergency might not be known to the emergency response personnel. Under these potentially unknown conditions a worst-case scenario is assumed to ensure the public is evacuated to a safe distance. These unknown conditions can include the following:

- (1) The condition of the ammonium nitrate involved in the fire. For example, contamination from a material that can behave as a fuel could potentially lead to a more violent release of energy than uncontaminated ammonium nitrate.
- (2) Presence of a burning structure.
- (3) The quantity of ammonium nitrate involved in the fire.

Overpressure calculations alone are not adequate to determine evacuation distances and debris field modeling is necessary to help ensure public safety. The 1-mile (1.6 km) distance is based on a quantitative risk analysis of a scenario that involves ammonium nitrate mixed with a fuel source and the presence of a burning structure. Quantities up to one million pounds (453,592 kg) of ammonium nitrate were used in the determination based on projectile travel distance.

A.11.2.18 NFPA 704 currently lists ammonium nitrate under emergency conditions as Health = 0, Flammability = 0, Instability = 3, and Other = OX (oxidizer). Safety data sheets that provide NFPA 704 ratings typically agree with all ratings except Health where ratings of 0, 1, or 2 are reported by different manufacturers. Because decomposition products include various nitrogen oxides (NO_x) and nitric acid, the minimum health rating should be considered 1.

A.11.3.1.2 Housekeeping information can be found in *Safety and Security Guidelines for the Storage and Transportation of Fertilizer Grade Ammonium Nitrate at Fertilizer Retail Facilities*, and EPA 550-

F-15-001, *Chemical Advisory: Safe Storage, Handling, and Management of Solid Ammonium Nitrate Prills*.

A.11.3.2.3.1 Wood impregnated with ammonium nitrate is a fire hazard. It can be ignited by a low-energy source with a vigorous fire.

A.11.3.2.3.4 Metal bins can be protected by special coatings such as sodium silicate, epoxy coatings, or polyvinyl chloride (PVC) coatings.

A.11.3.2.3.5 Storage in aluminum transport vehicles is not recommended.

A.11.3.2.3.9 Bulk and bagged ammonium nitrate can become caked and degrade in storage. This is a factor affected by humidity and temperature in the storage space and by prill quality. Temperature cycles through 90°F (32°C) and high atmospheric humidity are undesirable for storage in depth.

A.11.4.3.3 Active loading or unloading of vehicles with ammonium nitrate from the hoppers/bins is not considered parking and is permitted. The vehicle operator should remain within 25 ft (7.6 m) of the vehicle during loading or unloading operations. Immediately upon completion of the loading/unloading activity, the vehicle should be moved at least 30 ft (9.1 m) away from the hopper/bins.

A.11.4.5 Many of the general principles for the storage of ammonium nitrate-based fertilizers apply equally to fertilizers stored in the open and those stored in a building. It is generally recommended that bagged ammonium nitrate fertilizers should not be stored in large piles outdoors.

It should be noted that repeated temperature cycles can cause physical deterioration of some products. Physical deterioration can result in the breakdown of the fertilizer particles and damage to packages. The product should be protected from direct sunlight. Due note should be taken of ground conditions when storing outdoors to avoid damage to the product. Outdoor storage areas should be protected against unauthorized access, for example, by means of a fence. Warnings against unauthorized entry should be posted.

A.11.5.5.1 Foam, dry-chemical, or gaseous extinguishing systems are ineffective in controlling fires involving ammonium nitrate, an oxidizer that supplies its own oxygen. Steam is similarly ineffective.

A.11.8.1.1.1 This includes battery-powered vehicles and vehicles powered by internal combustion engines such as motor vehicles, lift trucks, and cargo conveyors. It is recommended that electric or LP-Gas-powered trucks be employed rather than gasoline- or diesel to reduce the potential for contamination to ammonium nitrate. (See A.11.4.3.3.)

A.11.8.1.2 Examples of hollow spaces include hollow conveyor rollers and hollow screw conveyor shafts.

A.14.1.1 The classification system for organic peroxides is package and burn rate dependent. To address the scope of NFPA 400 for storage, use and handling of each organic peroxide formulation is to be classified with respect to quantity and type of container based upon testing performed to reach a transport classification. Classification should be done by professionals familiar with the properties of the organic peroxide formulation. Property information used for classification of organic peroxide formulations for UN Transportation of Dangerous Goods can be useful for the NFPA 400 classification.

Additionally the small-scale and sometimes large-scale burn rate data from actual experiments are used, in addition to the transport classification, to reach the storage classification. Other useful information includes density, small fire test data, and fire data for response to sprinkler conditions. For further guidance, see Annex F.

A.14.1.2 For information on combustible or limited-combustible construction, see NFPA 220.

A.14.2.4 In the venting equation, use the fuel characteristic constant for “gases with fundamental burning velocity less than 1.3 times that of propane.” See NFPA 68 for information on vent design. Refer to manufacturers’ technical data for information on organic peroxide formulations that give off flammable gases upon decomposition.

A.14.2.5.1 Fire protection systems for material in containers other than original DOT packaging, including bulk tanks, and materials in the unpackaged state should be designed by design professionals familiar with the nature of the product under fire conditions.

A.14.2.5.4 Dry pipe and double-interlock preaction (DIPA) sprinkler systems are not permitted for protection of buildings or areas containing Class I through Class III organic peroxide formulations, except as noted in 14.2.5.4.1. These formulations generally have a fast burning rate and high-heat release rate, requiring a quick response and immediate discharge of water from the sprinklers. Dry pipe and DIPA sprinkler systems generally result in delayed discharge of water when sprinkler activation occurs.

A.14.2.10.8 The method of disposal can vary depending on the specific formulation and materials with which they might have been contaminated. Refer to the manufacturer or the supplier of the specific formulation for advice.

A.14.3.2 The classification system described in Section 4.1 is used only to determine the storage requirements established by this code. It is not meant to be a substitute for the hazard identification system established by NFPA 704. Since the hazard characteristics of organic peroxide formulations vary widely depending on the type of organic peroxide, the diluent, and their relative concentrations, each specific formulation will have to be rated individually according to the criteria established in NFPA 704.

For the purpose of this document, an important building is one that is occupied or that contains facilities vital to the operation of the plant.

A.14.3.2.4 In the venting equation, use the fuel characteristic constant for “gases with fundamental burning velocity less than 1.3 times that of propane.” See NFPA 68 for information on vent design. Refer to manufacturers’ technical data for information on organic peroxide formulations that give off flammable gases upon decomposition.

A.14.3.2.5 For example, a sprinklered building, detached by 50 ft (15.3 m), can contain up to 500 lb (227 kg) of Class I, 50,000 lb (22,700 kg) of Class II, and 50,000 lb (22,700 kg) of Class III formulations, according to the following ratios:

(1) Class I:

$$\frac{500 \text{ lb}}{2000 \text{ lb (max)}} \times 100 = 25\% \quad \frac{227 \text{ kg}}{907 \text{ kg (max)}} \times 100 = 25\% \quad \text{[A.14.3.2.5a]}$$

(2) Class II:

$$\frac{50,000 \text{ lb}}{100,000 \text{ lb (max)}} \times 100 = 50\% \quad \frac{22,700 \text{ kg}}{45,400 \text{ kg (max)}} \times 100 = 50\% \quad \text{[A.14.3.2.5b]}$$

(3) Class III:

$$\frac{50,000 \text{ lb}}{200,000 \text{ lb (max)}} \times 100 = 25\% \quad \frac{22,700 \text{ lb}}{90,700 \text{ lb (max)}} \times 100 = 25\% \quad \text{[A.14.3.2.5c]}$$

In no case does the quantity in storage exceed the maximum for its class, nor does the sum of the percentages exceed 100 percent.

A.14.3.2.9.4 Since no commercially available Class I organic peroxide formulations are supplied in 55 gal (208 L) drums, there is no requirement for such storage.

A.14.3.4.3.1 A detached, mechanically refrigerated building for storing organic peroxide formulations that require temperature control is illustrated in Figure A.14.3.4.3.1.

A.14.3.4.3.3 Figure A.14.3.4.3.3 is an example of a nonrefrigerated building for storing less than 5000 lb (2270 kg) of organic peroxide formulations for detached storage as allowed by 14.3.4.3.3.


A.14.5.7 Considerations should be given for maintaining proper refrigeration capability in the event of a loss of power. Some materials, when frozen, could cause separation of a carrier from the organic peroxide.

A.14.5.14.3 The method of disposal can vary depending on the specific formulation and materials.


A.15.1.4 In the manufacturing process, materials are collected and staged for transportation from manufacturing areas to a storage or warehouse location. Transient storage is intended to describe those materials being staged for transport. They are called transient while they are in the manufacturing area because they are not in their storage location. In the manufacturing location, finished goods can be found in a packaged state where they can be further palletized or otherwise arranged or collected awaiting transportation.

A.15.2.1.1 The NFPA *Fire Protection Guide to Hazardous Materials* should be used for guidance on compatibility.

A.15.2.1.2 Spill control, drainage, and containment are typically required under environmental regulations. Check the building code to determine whether it contains spill control requirements.

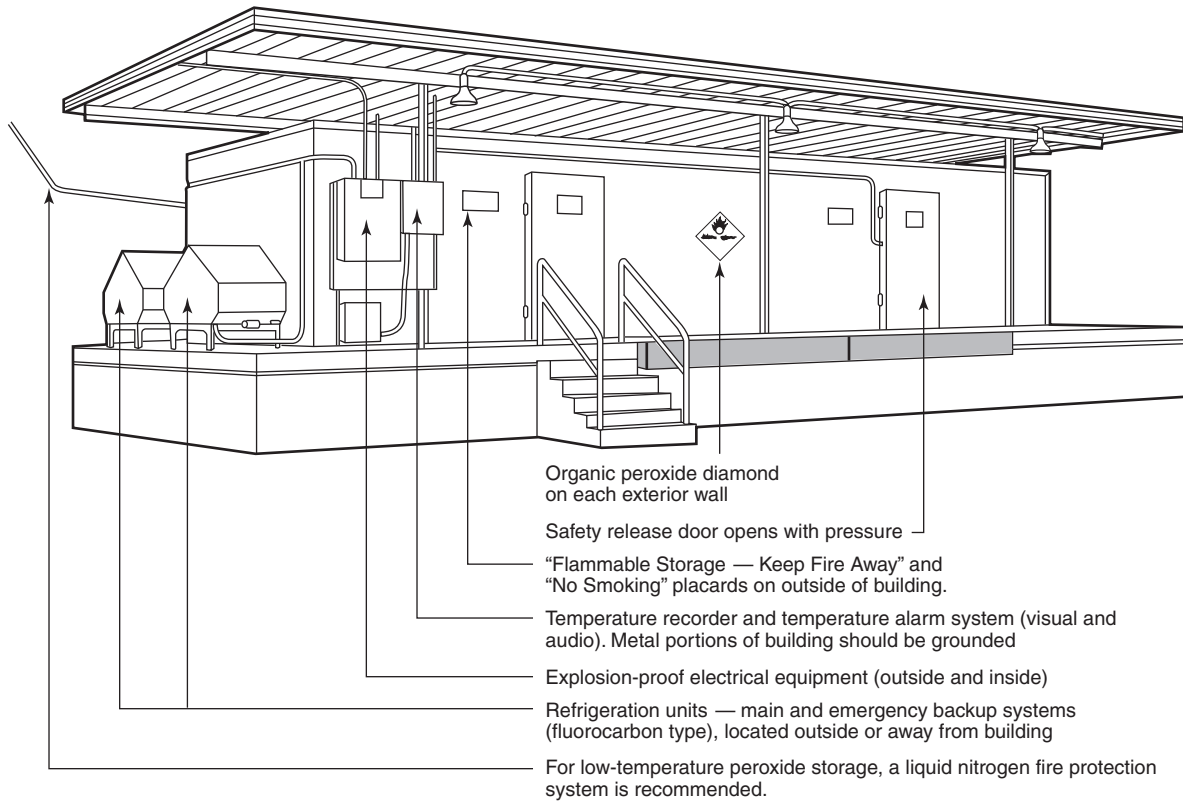

(a) OUTSIDE VIEW

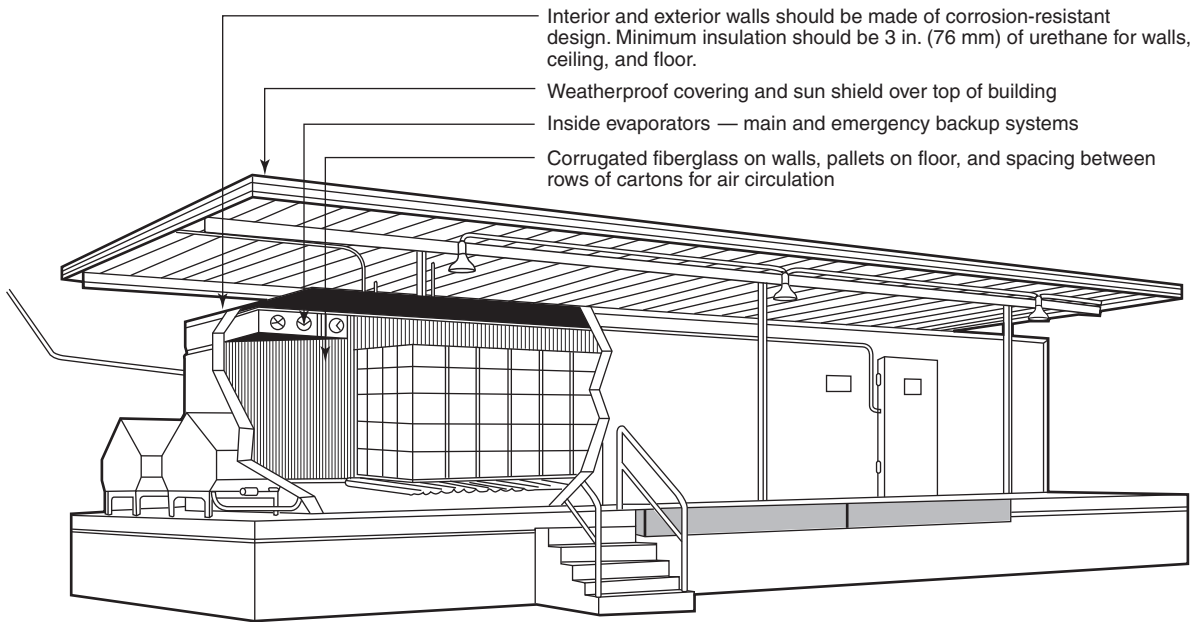

(b) INSIDE VIEW

FIGURE A.14.3.4.3.1 Refrigerated Storage Building and Key Recommendations.

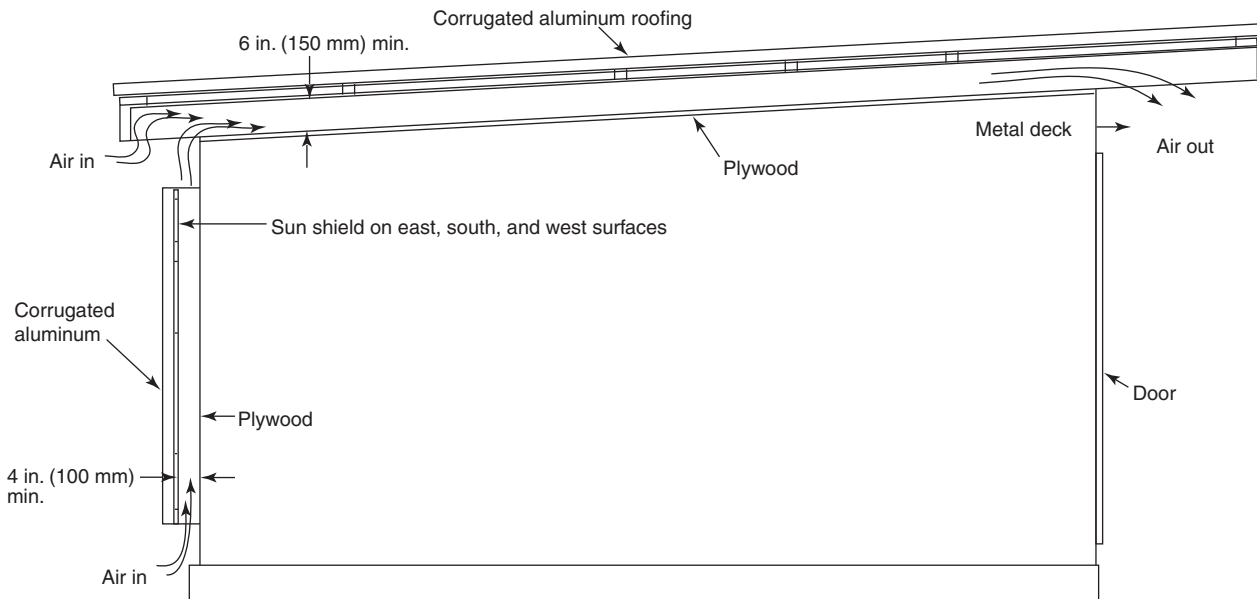


FIGURE A.14.3.4.3.3 Detached Storage Building for Storing Less than 5000 lb (2270 kg) of Organic Peroxide Formulations.

The decomposition of stored commercially available strengths of liquid and solid oxidizers can emit toxic gases. Additionally, the runoff from spills of stored oxidizers or from oxidizers mixed with fire-extinguishing agents can contain materials hazardous to the environment.

The hazards of stored oxidizers can manifest themselves in one or more of five distinct hazardous situations as follows:

- (1) They can increase the burning rate of combustible materials.
- (2) They can cause spontaneous ignition of combustible materials.
- (3) They can decompose rapidly.
- (4) They can liberate hazardous gases.
- (5) They can undergo self-sustained decomposition, which can result in an explosion.
- (6) They can react explosively if mixed with incompatibles or in fire conditions.

A.15.2.5 Automatic sprinklers are an effective method to control fires involving oxidizers in conjunction with the other fire prevention requirements in the document.

A.15.2.5.1 Dry pipe and double-interlock preaction (DIPA) sprinkler systems are generally prohibited by 15.2.5.1.1 for use with oxidizers. In mercantile occupancies with open-air environments that are already protected by these types of systems as prescribed by other codes, it is considered acceptable to store quantities defined by this code, with the recognition that these commodities might not be adequately protected. Outside storage in this manner is preferred to inside storage.

A.15.2.5.2.1 Conditions that affect the need for hydrant protection include nearness of the exposures, size and construction of the building, amount and class of the oxidizer stored, and availability of public fire protection.

A.15.2.5.3.1 A dry-chemical fire-extinguishing agent containing ammonium compounds (such as some A:B:C agents) should not be used on oxidizers that contain chlorine and

bromine. The reaction between the oxidizer and the ammonium salts in the fire-extinguishing agent can produce the explosive compound nitrogen trichloride (NCl_3). Carbon dioxide or other extinguishing agents that function by a smothering action for effective use are of no value in extinguishing fires involving oxidizers.

A.15.2.5.3.2 Halon extinguishers should not be used on fires involving oxidizers because they can react with the oxidizer.

Δ A.15.2.5.3.3 Halocarbon clean agent extinguishers as identified in NFPA 2001 are chemically similar to Halon and unless proved different should be assumed to react with the oxidizer.

A.15.2.11 Care should be exercised because some oxidizers are mutually incompatible. Chlorinated isocyanurates and hypochlorites are examples of oxidizers that are incompatible. The NFPA *Fire Protection Guide to Hazardous Materials* lists many oxidizers and other materials that result in hazardous interactions.

A.15.2.11.10 This requirement to restrict exposure to water is not intended to apply to the application of fire protection water.

A.15.2.11.11 Where absorptive combustible packing materials used to contain water-soluble oxidizers have become wet during either fire or nonfire conditions, the oxidizer can impregnate the packing material. This creates a serious fire hazard when the packing material dries. Wooden pallets that are exposed to water solutions of an oxidizer also can exhibit this behavior.

A.15.3.2.1.1 Impregnation of wood for fire retardancy or to prevent decay does not protect the wood from impregnation by the oxidizer.

N A.15.3.2.2.2.2(A) Figure A.15.3.2.2.2.2(A) shows an example of a storage layout in a typical sprinklered warehouse.

A.15.3.2.2.3 The term *commodity* is used as defined in NFPA 13.

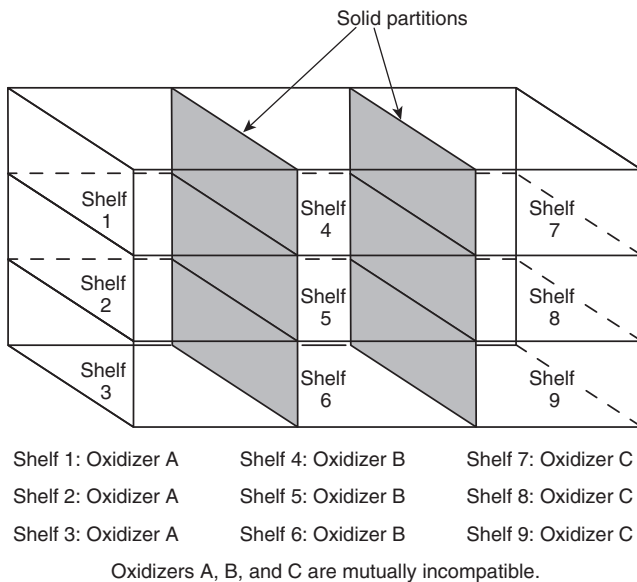


FIGURE A.15.3.5.2.1(a) Recommended Mercantile Store Arrangement for Mutually Incompatible Oxidizers.

A.17.2.1.1 The retention of spilled pyrophoric liquids around process tanks, storage tanks, or vessels and other containers should be avoided to prevent a catastrophic failure of the vessels or containers in the event of fire.

A.17.2.5 Pyrophoric liquids catch fire easily and are often water reactive. The amount of water needed to put out a fire might depend on the volume of material burning. Adding insufficient amounts of water could result in an uncontrolled reaction.

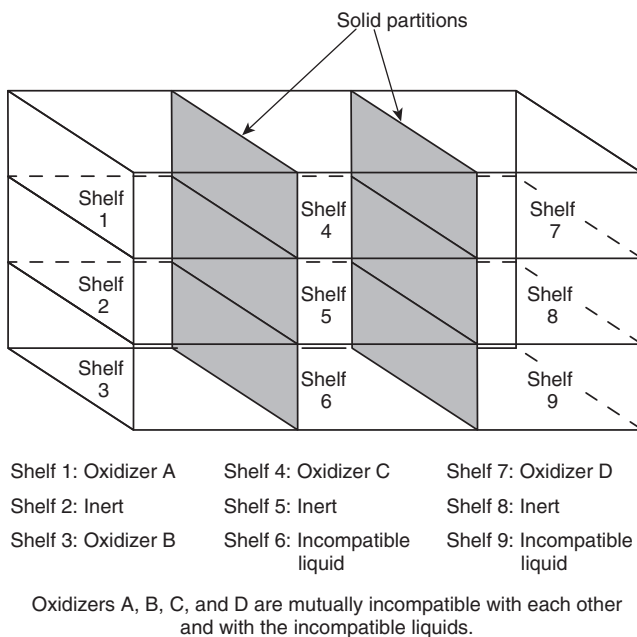


FIGURE A.15.3.5.2.1(b) Recommended Mercantile Store Arrangement for Mutually Incompatible Oxidizers and Other Incompatible Materials.

A.17.4.1.2 When solids are involved, an approximation of the liquid volume of the containers used is to be determined. For example, if the solids were packaged in a 55-gallon drum, a volume of 55 gal would be used. If the solids were packaged in 1-gallon containers, the volume would be determined accordingly.

A.17.4.3.1 In no event should the distance between exposures indicated in 17.4.1.2 be less than twice the distance required by NFPA 30 for an equivalent volume of Class IB flammable liquid.

A.17.6.1.3 Secondary containment areas can be designed to be remote from process or storage areas. Drainage can be used as a means to remove the spilled liquid and transport it to a remote location. Buried tanks can be used as a means to contain spilled liquids. Sloped floors or floors designed to drain spilled liquids away from storage tanks and container storage all serve to minimize a fire event created by a spill.

A.17.6.2.3.1 See A.17.6.1.3.

A.17.7.1.2 See A.17.6.1.3.

A.17.7.2.2.1 See A.17.6.1.3.

A.20.6.1.3.1 Secondary containment areas can be designed to be remote from process or storage areas. Drainage can be used as a means to remove spilled liquids and transport them to a remote location.

A.20.6.2.3.1 See A.20.6.1.3.1.

A.20.7.1.2.1 See A.20.6.1.3.1.

A.21.1.1.2.1(1) For regulations on the transportation of gases, see 49 CFR 100–185, “Pipeline and Hazardous Materials Safety Administration, Department of Transportation,” and *Transportation of Dangerous Goods Regulations*. [55:A.1.1.2(1)]

A.21.1.1.2.1(3) Bulk compressed gas and cryogenic fluid system installations are intended to be covered by the requirements of this code. Instrumentation and alarms that are attendant to the system and designed to interface with the application in a health care facility are to be retained within the purview of NFPA 99. [55:A.1.1.2(3)]

A.21.1.1.2.1(5) For information, see NFPA 52 or NFPA 58. [55:A.1.1.2(5)]

A.21.1.1.2.1(6) The storage of and use of compressed gases and cryogenic fluids outside the boundaries of laboratory work areas is covered by this code. [55:A.1.1.2(6)]

Δ A.21.1.1.2.1(11) NFPA 55 is used as the source document for the fundamental requirements for compressed hydrogen gas (GH₂), or liquefied hydrogen gas (LH₂) system installations. Correlation between NFPA 55 and NFPA 2 is the responsibility of the two technical committees involved. The installation requirements for bulk GH₂ or LH₂ are viewed as fundamental provisions. On the other hand, use-specific requirements for designated applications such as vehicular fueling are not resident in NFPA 55 and are under the purview of the NFPA 2 Technical Committee. Where there are specific provisions or controls included in NFPA 55, the specific controls of NFPA 55 will govern except that modifications made to provisions that have been extracted can be followed when the modifications have been made within NFPA’s extract procedure as indicated in the *Manual of Style for NFPA Technical Committee Documents*. [55:A.1.1.2(1)]

A.21.2.5 Bulk hydrogen compressed gas systems terminate at the source valve. In cylinder filling or packaging operations, cylinders located on filling manifolds located downstream of the source valve are not considered to be part of the bulk gas system. For definitions of source valve and bulk hydrogen compressed gas system, see 3.3.88 and 3.3.93.2 of NFPA 55. Additional requirements for source valves can be found in Section 6.19 of NFPA 55. [55:A.6.5]

A.21.2.8 Under the requirements of 29 CFR 1910.38, “Emergency Action Plans,” established by OSHA regulations, employers must establish an employee alarm system that complies with 29 CFR 1910.165, “Employee Alarm Systems.” The requirements of 29 CFR 1910.165 for the employee alarm system include, but are not limited to, systems that are capable of being perceived above ambient noise or light levels by all employees in the affected portions of the workplace. Tactile devices may be used to alert those employees who would not otherwise be able to recognize the audible or visual alarm. The alarm system can be electrically powered or powered by pneumatic or other means. State, local, or other governmental regulations might also establish requirements for employee alarm systems. [55:A.6.7]

A.21.2.9 See NFPA 55 for more information on this subject.

A.21.2.10 The intent of this section is to require a water-based fire extinguishing system to keep vessels containing compressed gases cool in the event of an exposure fire, thereby minimizing the likelihood of a release and associated consequences. Accordingly, alternative fire extinguishing systems, such as dry-chemical or gaseous agent systems, should not be substituted. [55:A.6.9]

A.21.3.1.7.2 Figure A.21.3.1.7.2 is a schematic showing the separation distances required by 21.3.1.7.2. [55:A.7.1.12.2]

A.21.3.1.7.3 Clearance is required from combustible materials to minimize the effects of exposure fires to the materials stored or used. The requirement to separate the materials from vegetation should not be interpreted to mean that the area is maintained free of all vegetation. In some settings, gas systems are located on grounds that are maintained with formal landscaping. Some judgment must be exercised to determine whether the vegetation poses what might be viewed as an exposure hazard to the materials stored. Cut lawns, formal landscaping, and similar vegetation do not ordinarily present a hazard and should be allowed. On the other hand, tall, dry grass or weeds and vegetation that fringes on the border of an urban-wildland interface might be viewed as a hazard. [55:7.1.10.3]

A.21.3.1.11.3 The gas supplier should be consulted for advice under these circumstances. [55:A.7.1.15.3]

A.21.3.1.14.1.3 Underground piping systems are those systems that are buried and in contact with earth fill or similar materials. Piping located in open-top or grated-top trenches is not considered to be underground although it may be below grade. [55:A.7.1.18.1.2]

A.21.3.3.1.11.1(A) In operations where an automatic emergency shutoff valve is activated by a control system that is operated from a remote station or by remote station software, the software system should be designed to provide a visual indication of the emergency shutdown control system. The visual emergency shutdown function should be able to be identified by trained operators and recognizable to emergency response personnel. [55:A.7.3.1.11.1.1]

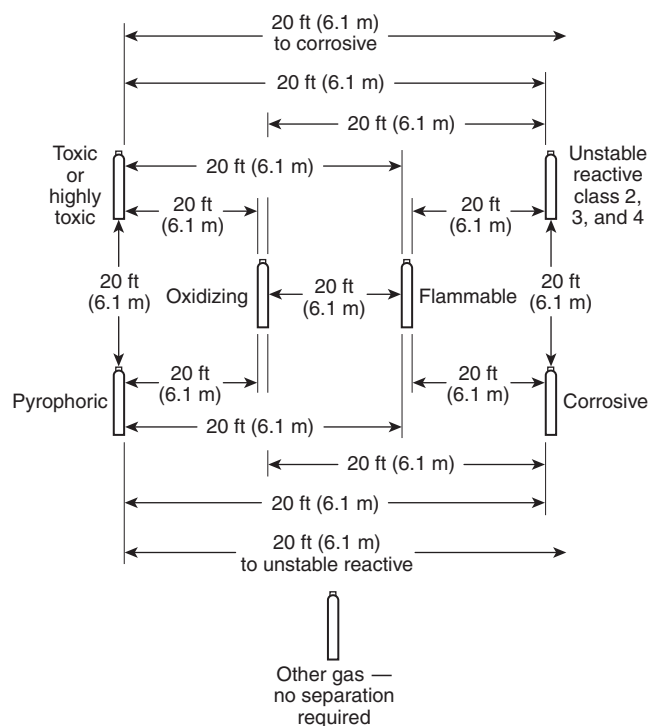


FIGURE A.21.3.1.7.2 Separation of Gas Cylinders by Hazard.

A.21.3.3.1.12.1 Bulk cryogenic fluids are not subject to the requirements for excess flow control based on a health hazard ranking due to cold temperature when installed in accordance with the requirements of NFPA 55. Bulk cryogenic fluids that are vaporized and distributed as a compressed gas downstream of the source valve are subject to the requirements for excess flow control if the gas has either a health hazard rating of Class 3 or 4 based on corrosivity or toxicity or a reactivity ranking of Class 3 or 4. [55:A.7.3.1.12.1]

A.21.3.5.2.2.1 Portions of the system upstream of the source valve include the containers or bulk supply as well as control equipment designed to control the flow of gas into a piping system. The piping system downstream of the source valve is protected by excess flow control should failure occur in the piping system and is not required to be protected by the fire barrier. The fire barrier serves to protect those portions of the system that are the most vulnerable, along with the necessary controls used to operate the system. [55:7.5.2.1.1]

A.21.3.7.2.1.1 See A.21.3.5.2.2.1. [55:A.7.7.2.1.1]

A.21.3.8.3.1.1 See A.21.3.5.2.2.1. [55:A.7.8.3.1.1]

A.21.3.9.3.4.3(A) See A.21.3.5.2.2.1. [55:A.7.9.2.2.1.1]

A.21.3.9.3.6 The areas for typical restricted flow orifices are shown in Table A.21.3.9.3.6. [55:A.7.9.3.6]

Δ A.21.3.9.3.6.2 The formula has been taken from industry publications, including the Scott Specialty Gases *Design and Safety Handbook*. It is based on estimated flow rates for air at 70°F (21°C) discharging to normal atmospheric pressure through an average shape and quality orifice. It can be assumed to be ±15 percent accurate. Correction factors have

Table A.21.3.9.3.6 Typical Orifice Areas

Orifice Diameter		Area	
in.	cm	in. ²	cm ²
0.006	0.015	2.83×10^{-5}	1.83×10^{-4}
0.010	0.025	7.85×10^{-5}	5.06×10^{-4}
0.014	0.036	1.54×10^{-4}	9.93×10^{-4}

been built into the formula as presented in 21.3.9.3.6.2 to accommodate the use of gases other than air (e.g., use of specific gravity data). [55:A.7.9.3.6.2]

A.21.3.10.1.2.1 See A.21.3.5.2.2.1. [55:A.7.10.1.2.1]

A.21.3.10.2.2.1 See A.21.3.5.2.2.1. [55:A.7.10.2.2.1]

A.21.4.2 Pressure vessels of any type can be subject to additional regulations imposed by various states or other legal jurisdictions. Users should be aware that compliance with DOT or ASME requirements might not satisfy all of the required regulations for the location in which the vessel is to be installed or used. [55:A.8.2]

A.21.4.2.3.3.1 Vaporizers or heat exchangers used to vaporize cryogenic fluids can accumulate a large load of ice during operation. Additional requirements to be considered in the design include snow load for the area where the installation is located as well as the requirements for seismic conditions. The operating conditions of systems vary, and the designer has a responsibility to consider all the loads that might be imposed. Foundations that could be used to support delivery vehicles as well might require special consideration relevant to live loads as well as for the dead loads imposed by the equipment itself. [55:A.8.2.3.3]

A.21.4.2.4.5.1 Pressure relief valves typically are spring-loaded valves where the relief pressure is set by adjustment of a spring. Valves should be made to be tamper resistant in order to prevent adjustment by other than authorized personnel typically found at a retest facility. An ASME pressure relief valve is designed to comply with the requirements of the ASME *Boiler and Pressure Vessel Code* and typically is equipped with a wire and lead seal to prevent tampering. [55:A.8.2.4.5.1]

A.21.4.4.1.1.2 An example of this identification is 360 degree wrap-around tape. [55:8.1.1.2]

A.21.4.7.2 It is not uncommon to have inert cryogenic fluids used to provide stage effects for theatrical performances that are conducted within assembly occupancies. The fluids are sometimes placed within these occupancies with special controls, including ventilation systems, fire detection systems, monitors for oxygen deficiency, warning signs, and remote fill indicating devices that indicate tank volume when a remote fill point is provided and stationary tanks are involved.

Such installations are normally permitted on a case-by-case basis under the requirements of Section 1.5.

Clearance is required from combustible materials to minimize the effects of exposure fires to the materials stored or used. The requirement to separate the materials from vegetation should not be interpreted to mean that the area is maintained free of all vegetation. In some settings, gas systems are located on grounds that are maintained with formal landscaping. Some judgment must be exercised to determine whether

the vegetation poses what might be viewed as an exposure hazard to the materials stored. Cut lawns, formal landscaping, and similar vegetation do not ordinarily present a hazard, and should be allowed. On the other hand, tall, dry grass or weeds and vegetation that fringes on the border of an urban-wildland interface might be viewed as a hazard. [55:A.8.7.2]

A.21.4.13.2.5 Flood hazard areas typically are identified on either (1) the special flood hazard area shown on the flood insurance rate map or (2) the area subject to flooding during the design flood and shown on a jurisdiction's flood hazard map or otherwise legally designated. [55:A.8.13.2.5]

A.21.4.13.2.6.4(B) The intent of these provisions is to make certain that the cryogenic installation is not exposed to the potential of a pool fire from the release of flammable or combustible liquids. Cryogenic fluids are not diked in order that they are allowed to dissipate should leakage occur. Studies conducted by NASA (NSS 1740.16, *Safety Standard for Hydrogen and Hydrogen Systems*) show that the use of dikes around liquid hydrogen storage facilities serves to prolong ground-level flammable cloud travel and that the dispersion mechanism is enhanced by vaporization-induced turbulence. The travel of spilled or leaked cryogenic fluid to distances greater than a few feet (meters) from the source given the nature of the typical leak is considered to be implausible due to the character of cryogenic fluids and their ability to quickly absorb heat from the surrounding environment.

A.21.4.13.2.7.2 The placement of stationary containers is limited with respect to exposure hazards. Table 21.4.7.2 establishes the minimum separation distance between a building and any stationary tank at 1 ft (0.3 m). Additional limitations are placed on wall openings, air intakes, and other exposures. The material-specific tables for liquid hydrogen and liquid oxygen specify increased distances according to the type of construction adjacent to the tank. A problem arises when courtyards are configured so as to interrupt the free movement of air around a tank where an asphyxiation hazard, a flammable hazard, or an oxygen-enriched environment can be created. [55:A.8.13.2.7.2]

Placement of stationary containers proximate to the wall of the building served is allowable provided the minimum separation distances for exposure hazards are met. When additional walls encroach on the installation to form a court, the focus of concern shifts away from the exposure hazards associated with the building itself to the hazards associated with personnel due to hazardous atmospheres that can be created due to the lack of free air movement and ventilation.

By specifying the minimum distance between the tank and the encroaching walls that form the court, the circulation of adequate air is ensured. Placing the tank at not less than the height of two of the three encroaching walls results in creating an opening such that the angular dimension between the top of two of the three encroaching walls and the point over which the tank is placed is not greater than 45 degrees, thereby allowing the circulation of air through the space in which the tank is installed.

A.21.4.13.2.7.2(A) See Figure A.21.4.13.2.7.2(A).

Δ A.21.4.14.1.3.1(A) CGA P-18, *Standard for Bulk Inert Gas Systems*, recommends periodic inspection intervals for inert gas systems. [55:A.8.14.1.3.1.1]

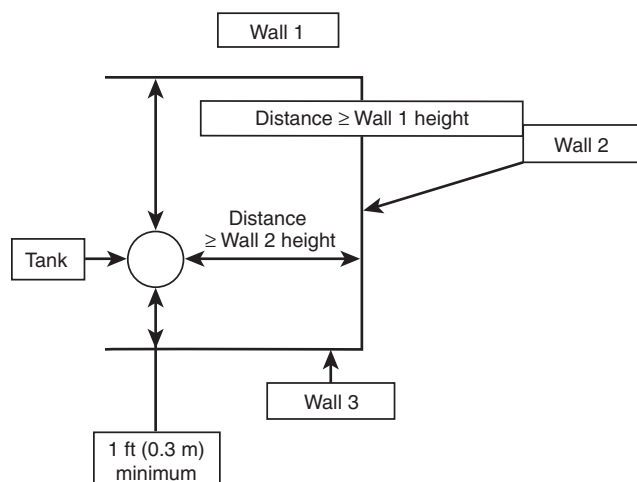


FIGURE A.21.4.13.2.7.2(A) Illustration of Minimum Separation Distance to Exposure from Stationary Tank.

A.21.4.14.11.2.3 In operations where an automatic emergency shutoff valve is activated by a control system that is operated from a remote station or by remote station software, the software system should be designed to provide a visual indication of the emergency shutdown control system. The visual emergency shutdown function should be able to be identified by trained operators and recognizable to emergency response personnel. [55:A.8.14.11.2.3.1]

A.21.4.14.11.3.4 The inert cryogenics, nitrogen and argon, do not require the installation of a noncombustible spill pad, because they do not typically condense oxygen from the air in sufficient quantities to pose a hazard during transfer. [55:A.8.14.11.3.4]

A.21.4.14.11.3.4(A) The noncombustible spill pad is provided for liquid helium transfer operations, because the cryogen is at a temperature that is sufficiently low enough to liquefy oxygen, presenting a hazard when in contact with combustible surfaces. [55:A.8.14.11.3.4.1]

Annex B Chemical Data

This annex is not a part of the requirements of this NFPA document but is included for informational purposes only.

B.1 General. The information provided in Annex B is not a part of the requirements of this document but is included for informational purposes.

▲ B.2 Hazard Recognition. Chapter 5 introduces the concepts of control areas and MAQs. The purpose is to permit limited amounts of hazardous materials in occupancies having minimum controls without triggering the more restrictive Protection Level 1 through Protection Level 5 building requirements. The allowable quantities in Table 5.2.1.1.3 and Table 5.2.1.2.1 are based on demonstrated need and historical safe storage and use of hazardous contents. The preponderance of provisions contained in Chapter 6 and those of Chapters 11 through 21 establish additional controls for occupancies exceeding the hazardous materials limits (MAQs) prescribed for control areas.

Not all of the hazardous materials categories are placed into the high-hazard category, and some of these materials (contents) have been recognized as being of low or ordinary hazards, depending on their nature in a fire. Class IIIB combustible liquids, Class 1 unstable (reactive) materials, Class 1 water-reactive materials, Class 1 oxidizing solids and liquids, and Class IV and Class V organic peroxides are high-hazard materials, which, in some cases, do not have an MAQ and, therefore, are not required to comply with the requirements for Protection Level 1 through Protection Level 5. Some materials, though classified as high-hazard, such as aerosols, are exempt from the requirements of NFPA 400 as they are regulated elsewhere in the code. For additional exceptions, see 1.1.2. [5000:A.34.1.1]

Figure B.2 helps to illustrate the conditions under which the protection level requirements are applicable. [5000:A.34.1.1]

Safety data sheets (SDS) are used as a primary means to assess the hazards of a specific material. In the U.S., the OSHA Hazard Communication Standard (29 CFR 1910.1200) prescribes what information is to be provided by the SDS. It also specifies the layout of SDS, including a 16-section format with standardized headings, the numbering and order of these headings, and the information required to complete the SDS. The major headings of this standard include the following:

Section 1: Identification

Section 2: Hazard(s) Identification

Section 3: Composition/Information on Ingredients

Section 4: First-Aid Measures

Section 5: Fire-Fighting Measures

Section 6: Accidental Release Measures

Section 7: Handling and Storage

Section 8: Exposure Controls/Personal Protection

Section 9: Physical and Chemical Properties

Section 10: Stability and Reactivity

Section 11: Toxicological Information

Section 12: Ecological Information

Section 13: Disposal Considerations

Section 14: Transport Information

Section 15: Regulatory Information

Section 16: Other Information, including date of preparation or last revision

The American Chemical Society publishes chemical abstracts as pointers to the chemical literature. Since 1907, their Chemical Abstracts Service (CAS) has indexed and summarized chemistry-related articles from more than 40,000 scientific journals, in addition to patents, conference proceedings, and other documents pertinent to chemistry, life sciences, and many other fields. In total, abstracts for more than 25 million documents are accessible online through CAS.

Substance identification is a special strength of CAS. It is widely known as the CAS Registry, the largest substance identification system in existence. When CAS processes a chemical substance newly encountered in the literature, its molecular

structure diagram, systematic chemical name, molecular formula, and other identifying information are added to the Registry, and it is assigned a unique CAS Registry Number. The Registry now contains records for more than 30 million organic and inorganic substances and more than 58 million sequences.

Individual chemicals are identified through the use of a CAS registry number, commonly referred to as the CAS number or CASRN. The number, which has no chemical significance, is used to link the material through its molecular structure into an index system where the Chemical Abstracts name is provided.

The CAS number is unique for each given material; however, with few exceptions, mixtures of chemicals are not assigned a CAS number per se, since each individual component of the mixture has its own unique CAS number. For the purposes of hazard classification and the application of NFPA 400, there are three primary identifiers for each chemical that must be known:

- (1) CAS number (unless it is a chemical mixture)
- (2) Concentration (typically expressed in weight percent for solids or liquids and volume percent for gases)
- (3) Physical state (solid, liquid, or gas)

For example, consider the material hydrochloric acid, also called hydrogen chloride. It can exist in the anhydrous form (as a gas) or in a water solution as the aqueous liquid material of varying concentrations. The hazard properties of the material vary with the form.

The regulatory approach used by NFPA 400 is based on hazard classification of the materials to be regulated. The materials under consideration must be evaluated to classify their hazards within the context of the code. The starting point begins with the SDS, where the material can be identified by name and other information, such as CAS registry number and physical state, is provided. Although there are 16 different main headings in the SDS, the primary need for classification of materials rests with determining the physical and health hazards of the material or mixture in question.

Within the context of NFPA 400, the user must determine whether the physical and/or health hazards of the material place it into one or more of the following hazard categories:

- (1) Corrosive solids and liquids
- (2) Flammable solids
- (3) Organic peroxide formulations
- (4) Oxidizer solids and liquids
- (5) Pyrophoric solids and liquids
- (6) Toxic and highly toxic solids and liquids
- (7) Unstable (reactive) solids and liquids
- (8) Water-reactive solids and liquids

Each of the hazard categories can be further subdivided into subcategories, each with its attendant hazard properties. For example, oxidizer solids and liquids are subdivided into Class 4, Class 3, Class 2, and Class 1 subcategories commonly referred to as the hazard classes.

Although it might be expected that the above nomenclature would appear on the SDS, this is not always the case. Appendices A and B of OSHA's Hazard Communication Standard (29 CFR 1910.1200) identify specific health and physical hazards that might differ from that of NFPA 400. Terms used in this code are consistent with those used in other NFPA standards and codes (see Annex J for a comparison of these hazard defini-

tions). The user must review the physical and chemical properties, as well as the health hazard information provided, to make a determination as to the appropriate hazard category and class for the material being regulated.

B.3 Chemical Family — A Pointer to Hazard Classification.

B.3.1 General. It is quite common that preparers of SDSs indicate the *chemical family* to which a material belongs, that is, the group of chemical substances that have a similar molecular structure. For example, materials such as acetone, methyl ethyl ketone, and amyl ethyl ketone are members of the *ketone* family. While the properties of various hazardous materials within a chemical family can vary, the chemical family becomes a pointer to the more likely hazard categories of the material under consideration.

While hundreds of thousands of chemicals are in use, this annex categorizes the more commonly used industrial chemicals into chemical families or unique groupings that have similar properties. Materials and/or chemicals exhibit a wide range of properties, some of which are hazardous. This code provides guidance for known physical and health hazards of materials within its scope.

▲ B.3.2 Chemical Families Related to Hazard Category. Table B.3.2 provides a summary of chemical families with associated physical and health hazard properties, which are subdivided into specific categories. This table is for informational purposes only. The physical and health hazards indicated are broad representations for the various chemical families. These classifications are not intended to cover all the hazards of a material. A more detailed description of the chemical families, subfami-

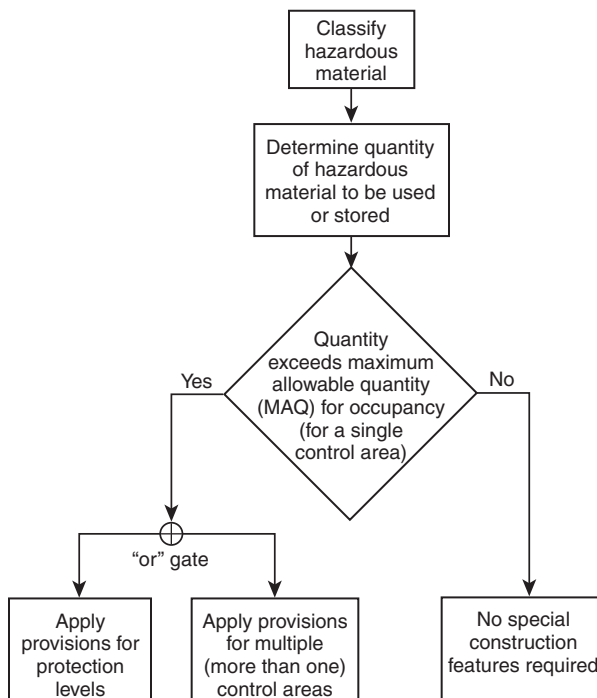


FIGURE B.2 Flow Chart Illustrating Protection Level Applicability. [5000:Figure A.34.1.1]

lies, and chemical structure of specific hazards are contained in the explanatory material following the table. For specific information, the chemical-specific SDS must be consulted. Additional information can be obtained from the manufacturer.

B.3.2.1 Table Descriptions. Nineteen general chemical families are listed in the first column of Table B.3.2. The chemical families include organic chemicals, inorganic chemicals, gases, and metals. Some of the general chemical families are further divided into subfamilies if one or more hazard category or categories further depend on chemical structure. The second column, Chemical Structure, shows the basic chemical formula or structure representing the chemical family and/or subfamilies.

The next several columns list the seven physical hazard categories and three health hazard categories. The specific hazard categories are defined in Chapter 3. The physical hazard categories include the following:

- (1) Unstable Reactive
- (2) Water Reactive
- (3) Oxidizer
- (4) Pyrophoric
- (5) Flammable Solid
- (6) Organic Peroxide
- (7) Flammable/Combustible

The health hazards include the following:

- (1) Corrosive
- (2) Toxic
- (3) Highly Toxic

Hazard categories are defined by the following symbols. A triple check mark (✓✓✓) is used to indicate that most or all of the chemicals within the family or subfamily have the indicated physical or health hazard. A double check mark (✓✓) is used to identify that *some* of the chemicals in the family *might* have this additional hazard. A single check mark (✓) indicates that only a select few chemicals within a specific family display the relevant physical and health hazard(s). The check marks are provided to inform the user as to the likely property of materials in each of the hazard categories listed. However, it must be recognized that the ultimate classification of a material is dependent on the application of the definitions found in Chapter 3 and the interpretation of the information provided relative to tests conducted by authoritative entities within the framework established by the definitions.

The last column provides examples of chemicals with the indicated hazards. The examples illustrate materials in the concentrated or undiluted state. Concentration-specific hazards for common materials are provided in the explanatory material following the table (*see Section B.5*).

B.3.2.2 Multiple Hazard Materials. A specific chemical can exhibit multiple hazard categories. In other words, there could be materials with more than one physical hazard property that also have one or more health hazard properties. The regulatory controls integral to NFPA 400 require that all hazards be addressed. It is incumbent on the code user to identify each applicable hazard property to properly classify the hazards of the material. It should also be recognized that each of the hazards considered could be concentration dependent.

B.3.2.2.1 Illustration of Table B.3.2. To illustrate the utility of Table B.3.2, consider the chemical family of mineral acids, listed in column 1 of Table B.3.2. Specific examples of mineral

acids are listed in the last column of Table B.3.2. Well-known mineral acids are hydrochloric acid and sulfuric acid. The row entries with dashes (—) under the physical hazard categories indicate that, in general, mineral acids are not considered to have the physical hazards of being unstable/reactive, oxidizer, pyrophoric, flammable solids, organic peroxides, or flammable/combustible. Specific mineral acids are water reactive (✓) based on concentration and the specific mineral acid itself. The row entries show the principal hazard properties of mineral acids are Health Hazards, especially Corrosive (✓✓✓). The one checkmark under Toxic (✓) indicates that a select few of the chemicals in the mineral acid family have this additional health hazard. (*See B.4.1.1 for additional information on mineral acids.*) The SDS for the specific mineral acid should be consulted for more detailed information relating to physical and health hazards.

B.3.3 Additional Source Material <http://www.epa.gov/oppt/chemrtk/>

<http://www.epa.gov/oppt/chemrtk/pubs/update/hpvchtml.htm>

http://www.osha.gov/pls/oshaweb/owadis.show_document?p_table=STANDARDS&p_id=9761

<http://www.osha.gov/SLTC/emergencypreparedness/guides/chemical.html>

B.4 Description of Chemical Families.

B.4.1 General. Dilution can cause the hazard characteristics of an individual chemical to diminish until the property is no longer pertinent. Each chemical must be individually reviewed by the manufacturer to provide the data to assess the physical and health hazards. For compressed gases, there are accepted standards that can be used to estimate both the flammability and toxicity without actual test data.

B.4.1.1 Acids.

B.4.1.1.1 Acids (Carboxylic) (R-COOH, Ar-COOH). Carboxylic acids are weak acids, unlike mineral acids, such as hydrochloric acid. Most are readily soluble in water. Physical and health properties vary significantly based on molecular weight and the number of carboxylic acid groups. Smaller molecular weight aliphatic carboxylic acids (such as formic and acetic acid) are liquids and are flammable and corrosive. Larger chain, higher molecular weight carboxylic acids are often solids with minimal hazards (such as citric acid). Aromatic acids are sometimes corrosive.

B.4.1.1.2 Acids (Peroxy) (R-OOH, Ar-OOH). All peroxy acids are classified as organic peroxides and are classified as oxidizers and corrosive. Aromatic peroxy acids (such as perbenzoic acid) are solids and are unstable reactive and toxic. Most are pastes or liquids and require refrigeration. Some forms of this acid family are often found as their sodium, potassium, or ammonium salts.

B.4.1.1.3 Acids (Mineral). These are all strong acids, are liquids, and are corrosive, even in dilute solutions. These include hydrofluoric acid (HF), hydrochloric acid (HCl), hydrobromic acid (HBr), phosphoric acid (H₃PO₄), and sulfuric acid (H₂SO₄). In some cases they are toxic and water reactive depending on acid and concentration.

▲ Table B.3.2 NFPA 400 Chemical Data

CHEMICAL FAMILY ^c	CHEMICAL STRUCTURE	PHYSICAL HAZARDS ^{a,b}							HEALTH HAZARDS ^{a,b}			EXAMPLES (CAS No.) ^f	
		Unstable Reactive	Water Reactive	Oxidizer	Pyrophoric	Flammable Solid	Organic Peroxide ^d	Flammable/Combustible ^e	Corrosive	Toxic	Highly Toxic		
		(S, L, G)	(S, L, G)	(S, L, G)	(S, G)	(S)	(S, L)	(S, L, G)	(S, L, G)	(S, L, G)	(S, L, G)		
Acids	Carboxylic	R-COOH, Ar-COOH	—	—	—	—	—	—	✓	✓✓	✓	—	Formic acid (64-18-6), acetic acid (64-19-7), benzoic acid (65-85-0), acrylic acid (79-10-7), oxalic acid (144-62-7), propanoic acid (79-09-4), 4-amino-3,5,6-trichloropicolinic acid (1918-02-1), 2-hydroxybenzoic acid (69-72-7), citric acid (77-92-9), benzoic acid (65-85-0)
	Peroxy	R-OOH, Ar-OOH	✓✓✓	—	✓✓✓	—	✓	✓✓✓	✓	✓✓	✓✓	—	Peroxyacetic acid (79-21-0), m-chloro perbenzoic acid (937-14-4), peroxymonosulfuric acid (7722-86-3)
	Mineral		—	✓	—	—	—	—	—	✓✓✓	✓	—	Hydrochloric acid (7647-01-0), sulfuric acid (7664-93-9), phosphoric acid (7664-38-2)
	Gaseous		—	✓	—	—	—	—	—	✓✓✓	✓✓✓	—	Hydrogen chloride (7647-01-0), hydrogen bromide (10035-10-6), hydrogen fluoride (7664-39-3), boron trichloride (10294-34-5), boron trifluoride (7637-07-2)
	Oxidizing		—	—	✓✓✓	—	—	—	—	✓✓✓	✓✓	✓	Nitric acid (7697-37-2), chloric acid (7790-93-4), chlorosulfonic acid (7790-94-5)
Alcohols	Aliphatic	R-OH	—	—	—	—	—	—	✓✓✓	—	✓	—	Methanol (67-56-1), ethanol (64-17-5), isopropanol (67-63-0), t-butanol (75-65-0), glycerol (56-81-5), 1-hexanol (111-27-3), 2-octanol (123-96-6)
	Aromatic	Ar-OH	—	—	—	—	✓	—	—	✓✓	✓✓	—	Phenol (108-95-2), 1,2-dihydroxybenzene (catechol) (120-80-9), 2-naphthol (135-19-3), 2,4-dichloro-phenol (120-83-2), 4-methylphenol (p-cresol) (106-44-5)
Alkyl halides		R-X	—	—	—	—	—	—	✓	—	✓✓	—	Bromoform (75-25-2), chloroform (67-66-3), 1,2-dichloroethane (ethylene dichloride) (107-06-2), 1,2-dichlorotetrafluoroethane (76-14-2), 1,2-dibromoethane (ethylene dibromide) (106-93-4), methyl bromide (74-83-9), 1,2-dichloropropane (propylene dichloride) (78-87-5)

(continues)

Table B.3.2 Continued

CHEMICAL FAMILY ^c	CHEMICAL STRUCTURE	PHYSICAL HAZARDS ^{a,b}							HEALTH HAZARDS ^{a,b}				EXAMPLES (CAS No.) ^f
		Unstable Reactive	Water Reactive	Oxidizer	Pyrophoric	Flammable Solid	Organic Peroxide ^d	Flammable/Combustible ^e	Corrosive	Toxic	Highly Toxic		
		(S, L, G)	(S, L, G)	(S, L, G)	(S, G)	(S)	(S, L)	(S, L, G)	(S, L, G)	(S, L, G)	(S, L, G)		
Amines	Aliphatic, organic	R-NH ₂ , R ₂ NH, R ₃ N	—	—	—	—	—	—	✓✓✓	✓✓	✓	—	Ethylamine (75-04-7), ethylenediamine (107-15-3), pyrrolidine (123-75-1), trimethylamine (75-50-3), hexylamine (111-26-2), isopropylamine (75-31-0), triethylamine (121-44-8), morpholine (110-91-8), butylamine (109-73-9)
	Aromatic	Ar-NH ₂ , Ar(N)	—	—	—	—	—	—	✓	✓	✓✓✓	—	Diethyltoluenediamine (68479-98-1), aniline (62-53-3), pyridine (110-86-1), N,N-diethyl aniline (91-66-7), 3-methylpyridine (3-picoline) (108-99-6), p-phenylenediamine (4-aminoaniline) (106-50-3), 4-aminotoluene (p-toluidine) (106-49-0), 2,4-diamino-toluene (TDA) (95-80-7)
Bases	Alkalis		—	✓	—	—	—	—	—	✓✓✓	✓	—	Sodium hydroxide (1310-73-2), potassium hydroxide (1310-58-3), sodium carbonate (497-19-8)
	Gaseous		—	—	—	—	—	—	✓✓✓	✓✓✓	—	—	Ammonia (7664-41-7), methylamine (74-89-5), trimethylamine (75-50-3)
Carbides/ Nitrides		M-C ₂ , M-N	—	✓	—	—	✓	—	—	—	—	—	Calcium carbide (75-20-7), lithium nitride (26134-62-3), gallium nitride (25617-97-4), boron nitride (10643-11-5)
Carbonyl com- pounds	Acid anhy- drides	R ₁ - C(O)OC (O)-R ₂	—	✓	—	—	—	—	✓	✓✓✓	✓	—	n-Butyric anhydride (106-31-0), maleic anhydride (108-31-6), propionic anhydride (123-62-6), isobutyric anhydride (97-72-3), phthalic anhydride (85-44-9), acetic anhydride (108-24-7), trifluoroacetic anhydride (407-25-0)
	Acyl halides	R, Ar- C(O)X, R, Ar- SO ₂ -X	—	✓✓✓	—	—	—	—	✓	✓✓✓	✓✓	—	Acetyl chloride (75-36-5), sulfonyl chloride (7791-25-5), benzoyl chloride (98-88-4), methanesulfonyl chloride (124-63-0), p-toluene sulfonyl chloride (98-59-9), trichloroacetyl chloride (76-02-8), pivaloyl chloride (3268-49-3)

(continues)

Table B.3.2 *Continued*

CHEMICAL FAMILY ^c	CHEMICAL STRUCTURE	PHYSICAL HAZARDS ^{a,b}							HEALTH HAZARDS ^{a,b}			EXAMPLES (CAS No.) ^f
		Unstable Reactive	Water Reactive	Oxidizer	Pyrophoric	Flammable Solid	Organic Peroxide ^d	Flammable/Combustible ^e	Corrosive	Toxic	Highly Toxic	
		(S, L, G)	(S, L, G)	(S, L, G)	(S, G)	(S)	(S, L)	(S, L, G)	(S, L, G)	(S, L, G)	(S, L, G)	
Aldehydes	RCH=O, Ar- CH=O	—	—	—	—	—	—	✓✓✓	—	—	—	Formaldehyde (50-00-0), acetaldehyde (75-07-0), butyraldehyde (123-72-8), benzaldehyde (100-52-7), 2-butenal (crotonaldehyde) (4170-30-3), n-valeraldehyde (110-62-3), p-methoxybenzaldehyde (4-anisaldehyde) (123-11-5), 2-propenal (acrolein) (107-02-8)
Esters	R ₁ (C=O)O R ₂	—	—	—	—	—	—	✓	—	—	—	Methyl formate (107-31-3), methyl acrylate (2-propenoic acid methyl ester), (96-33-3), benzenedicarboxylic acid dioctyl ester (117-84-0), ethyl ethanoate (ethyl acetate) (141-78-6), butanedioic acid dimethyl ester dimethyl fumarate) (106-65-0), oleic acid methyl ester (112-62-9), n-butyl acetate (123-86-4)
Halides	C(O)X ₂ , C(S)X ₂	✓	✓✓✓	—	—	—	—	✓	✓✓✓	—	✓✓✓	Phosgene (75-44-5), carbonyl fluoride (353-50-4), thiophosgene (463-71-8), oxalyl chloride (79-37-8), trichloromethyl chloroformate (diphosgene) (503-38-8), methyl chloroformate (79-22-1)
Ketones	R ₁ R ₂ C=O	—	—	—	—	—	—	✓✓✓	—	✓	—	Methyl propyl ketone (107-87-9), methyl isoamyl ketone (110-12-3), acetone (67-64-1), cyclohexanone (108-94-1), 1-chloro-2-propanone (chloroacetone) (78-95-5), 2-butanone (methyl ethyl ketone) (78-93-3), cyclopentanone (120-92-3), acetophenone (98-86-2), methyl isobutyl ketone (108-10-1), limonene (138-86-3), 1,3-dichloroacetone (534-07-6)
Cyanides	Gaseous	—	—	—	—	—	—	✓	✓	—	✓✓✓	Hydrogen cyanide (74-90-8), cyanogen chloride (506-77-4), cyanogen (460-19-5)
	Inorganic	—	✓	—	—	—	—	—	—	—	✓✓✓	Sodium cyanide (143-33-9), trimethylsilyl cyanide (7677-24-9), potassium cyanide (151-50-8)

(continues)

Table B.3.2 Continued

CHEMICAL FAMILY ^c	CHEMICAL STRUCTURE	PHYSICAL HAZARDS ^{a,b}							HEALTH HAZARDS ^{a,b}			EXAMPLES (CAS No.) ^f	
		Unstable Reactive	Water Reactive	Oxidizer	Pyrophoric	Flammable Solid	Organic Peroxide ^d	Flammable/Combustible ^e	Corrosive	Toxic	Highly Toxic		
		(S, L, G)	(S, L, G)	(S, L, G)	(S, G)	(S)	(S, L)	(S, L, G)	(S, L, G)	(S, L, G)	(S, L, G)		
	Organic (nitriles)	R, Ar-CN	—	—	—	—	—	—	✓✓	—	✓	—	Acetonitrile (75-05-8), benzonitrile (100-47-0), chloroacetonitrile (107-14-2), 2-propenenitrile (acrylonitrile) (107-13-1), butyronitrile (109-74-0)
Epoxides			✓	—	—	—	—	—	✓✓✓	✓	✓	✓	Ethylene oxide (75-21-8), propylene oxide (75-56-9), 1,2-epoxybutane (106-88-7), 1-chloro-2,3-epoxypropane (epichlorohydrin) (106-89-8)
Ethers/Glycols		R-O-R	—	—	—	—	—	—	✓✓	—	✓	—	1,2-Dimethoxyethane (glyme) (110-71-4), diethyl ether (60-29-7), furan (110-00-9), tetrahydrofuran (THF) (109-99-9), polyethylene glycol (25322-68-3), 1,4-dioxane (123-91-1), 1,3-butylene glycol (107-88-0), methyl vinyl ether (107-25-5), ethylene glycol monomethyl ether (EGME, 2-methoxyethanol) (109-86-4), dipropylene glycol monomethyl ether (DPM, 1-(2-methoxy-2-methylethoxy)-2-propanol) (34590-94-8)
Gases	Flammable		—	—	—	—	—	—	✓✓✓	—	—	—	Acetylene (74-86-2), hydrogen (1333-74-0), methane (74-82-8), propane (74-98-6)
	Halogens	X-X	—	✓	✓	—	—	—	—	✓✓✓	✓✓	—	Chlorine (7782-50-5), fluorine (7782-41-4), bromine trifluoride (7787-71-5), chlorine trifluoride (7790-91-2), bromine pentafluoride (7789-30-2)
	Non-flammable		—	—	—	—	—	—	—	—	—	—	Carbon dioxide (124-38-9), helium (7440-59-7), argon (7440-37-1)
	Oxidizing		—	—	✓✓✓	—	—	—	—	—	—	—	Oxygen (7782-44-7)
	Pyrophoric		—	—	—	✓✓✓	—	—	—	—	—	—	Silane (7803-62-5), methyl silane (992-94-9), disilane (1590-87-0)
	Sulfur gases	R-SH	—	—	—	—	—	—	✓✓	✓	✓✓	—	Hydrogen sulfide (7783-06-4), methyl mercaptan (74-93-1), sulfur dioxide (7446-09-5)
Hydrocarbons	Aliphatic	R	—	—	—	—	—	—	✓✓✓	—	—	—	Cyclopentane (287-92-3), hexane (110-54-3), dodecane (112-40-3), butane (106-97-8)

(continues)

▲ Table B.3.2 Continued

CHEMICAL FAMILY ^c	CHEMICAL STRUCTURE	PHYSICAL HAZARDS ^{a,b}							HEALTH HAZARDS ^{a,b}			EXAMPLES (CAS No.) ^f
		Unstable Reactive	Water Reactive	Oxidizer	Pyrophoric	Flammable Solid	Organic Peroxide ^d	Flammable/Combustible ^e	Corrosive	Toxic	Highly Toxic	
		(S, L, G)	(S, L, G)	(S, L, G)	(S, G)	(S)	(S, L)	(S, L, G)	(S, L, G)	(S, L, G)	(S, L, G)	
Alkenes	$R_1CH=CHR_2$	✓	—	—	—	—	—	✓✓✓	—	✓	—	Vinyl acetate (108-05-4), vinyl benzene (styrene) (100-42-5), vinyl chloride (75-01-4), ketene (463-51-4), 1-butene (106-98-9), 2-methylbutene (513-35-9), 1,4-dichloro-2-butene (764-41-0), 3-chloro-1-propene (allyl chloride) (107-05-1), butadiene (106-99-0)
Alkynes	$R_1C\equiv CR_2$, $R-C\equiv C-H$	✓✓	—	—	—	—	—	✓	—	✓	—	1,1,1,4,4,4-hexafluoro-2-butyne (692-50-2), 2-butyne-1,4-diol (110-65-6), 1-propyne (74-99-7), 2-propyn-1-ol (107-19-7)
Aromatic	Ar	—	—	—	—	✓	—	✓✓✓	—	✓✓	✓	Benzene (71-43-2), toluene (108-88-3), cumene (98-82-8), naphthalene (91-20-3), chlorobenzene (108-90-7), 1,2,3-trichlorobenzene (87-61-6), 3,4-dichlorotrifluoro toluene (328-84-7), 1,2-dimethyl benzene (o-xylene) (95-47-6), 1,4-dichlorobenzene (p-dichlorobenzene) (106-46-7), ethylbenzene (100-41-4)
Isocyanates	$R-N=C=O$, Ar- $N=C=O$	✓✓✓	✓✓	—	—	—	—	✓	✓	✓✓	✓	Toluene diisocyanate (TDI) (584-84-9), methylene bisphenyl isocyanate (MDI) (101-68-8), hexamethylene diisocyanate (HDI) (822-06-0), p-toluenesulfonyl isocyanate (4083-64-1), methyl isocyanate (624-83-9)
Metals	Metal alkyls	—	✓✓✓	—	✓✓✓	—	—	—	✓✓✓	✓	—	Butyllithium (109-72-8), triethylaluminum (97-93-8), triethylborane (97-94-9), n-butylethylmagnesium (62202-86-2), diethyl zinc (557-20-0)
	Metal halides	—	—	—	—	—	—	—	✓	✓✓	✓	Aluminum chloride (7446-70-0), chromium (III) chloride (10025-73-7), copper(I) chloride (7758-89-6), silver bromide (7785-23-1), ruthenium (II) chloride (10049-08-8), titanium tetrachloride (7550-45-0), tin chloride (7772-99-8), tungsten hexafluoride (7783-82-6)

(continues)

Table B.3.2 *Continued*

CHEMICAL FAMILY ^c	CHEMICAL STRUCTURE	PHYSICAL HAZARDS ^{a,b}							HEALTH HAZARDS ^{a,b}			EXAMPLES (CAS No.) ^f	
		Unstable Reactive	Water Reactive	Oxidizer	Pyrophoric	Flammable Solid	Organic Peroxide ^d	Flammable/Combustible ^e	Corrosive	Toxic	Highly Toxic		
		(S, L, G)	(S, L, G)	(S, L, G)	(S, G)	(S)	(S, L)	(S, L, G)	(S, L, G)	(S, L, G)	(S, L, G)		
Metal hydrides (solids)	M-H	—	✓✓✓	—	—	✓✓✓	—	—	✓✓✓	✓	—	Lithium aluminum hydride (16853-85-3), sodium borohydride (16940-66-2), sodium hydride (7646-69-7), lithium hydride (7580-67-8)	
Metal hydrides (gases)	M-H	—	—	—	—	—	—	✓✓✓	—	—	✓✓✓	Diborane (19287-45-7), hydrogen selenide (7783-07-5), phosphine (7803-51-2)	
Metals (alkali)	M	—	✓✓✓	—	—	✓✓✓	—	—	✓✓✓	✓✓	—	Sodium (7440-23-5), lithium (7439-93-2), potassium (7440-09-7)	
Metals (powdered)	M	—	✓✓✓	—	—	✓✓✓	—	—	—	—	—	Aluminum (7429-90-5), magnesium (7439-95-4), titanium (7440-32-6), zirconium (7440-67-7)	
Nitrated compounds	Nitro	R, Ar-NO ₂	✓✓	—	—	—	—	—	✓✓	✓	✓✓	✓	Nitromethane (75-52-5), o-nitroaniline (88-74-4), dinitrotoluene (25321-14-6), p-dinitrobenzene (100-25-4), m-nitrotoluene (99-08-1), 1-chloro-4-nitrobenzene (100-00-5), p-nitrophenol (100-02-7), nitro-p-nitroaniline (100-01-6), 1,4-diamino-2-nitrobenzene (5307-14-2), 1-nitropropane (108-03-2)
Azo (aliphatic)	R-N=N-R	✓✓✓	—	—	—	✓✓	—	—	—	—	✓✓	✓	Diethyl azodicarboxylate (1972-28-7), 1,1'-azobis(cyanocyclohexane) (2094-98-6), 2,2'-azobis(2-methylbutyronitrile) (13472-08-7), azoisobutyronitrile (AIBN) (78-67-1), 2,2'-azobis(2,4-dimethylvaleronitrile) (4419-11-8)
Azo (aromatic)	Ar-N=N-Ar	—	—	—	—	—	—	—	—	—	✓	✓	Azobenzene (103-33-3), p-aminoazobenzene (Aniline Yellow) (60-09-3), p-dimethylaminoazobenzene-sulfonic acid (Methyl Orange) (547-58-0), 1-(2-methoxy-phenylazo)-2-naphthol (Sudan Red G) (1229-55-6), 4-acetamido-2'-hydroxy-5'-methylazobenzene (Disperse Yellow 3) (2832-40-8), 4-[N-(2-cyanoethyl)-N-ethylamino]-4'-nitroazobenzene (Disperse Orange 25) (31482-56-1)
Azides	R, Ar-N ₃	✓✓✓	—	—	—	—	—	—	—	—	—	✓✓✓	Sodium azide (26628-22-8)

(continues)

▲ Table B.3.2 Continued

CHEMICAL FAMILY ^c	CHEMICAL STRUCTURE	PHYSICAL HAZARDS ^{a,b}							HEALTH HAZARDS ^{a,b}			EXAMPLES (CAS No.) ^f
		Unstable Reactive	Water Reactive	Oxidizer	Pyrophoric	Flammable Solid	Organic Peroxide ^d	Flammable/Combustible ^e	Corrosive	Toxic	Highly Toxic	
		(S, L, G)	(S, L, G)	(S, L, G)	(S, G)	(S)	(S, L)	(S, L, G)	(S, L, G)	(S, L, G)	(S, L, G)	
Inorganic nitrites	M-NO ₂	—	—	✓✓✓	—	—	—	—	✓	✓	—	Sodium nitrite (7632-00-0), potassium nitrite (7758-09-0)
Inorganic nitrates	M-NO ₃	✓	—	✓✓✓	—	—	—	✓	✓	✓	✓	Sodium nitrate (7631-99-4), silver nitrate (7761-88-8), zinc nitrate (7779-88-6), lithium nitrate (7790-69-4), lead nitrate (10099-74-8), potassium nitrate (7757-79-1)
Nitrogen-halogen compounds	R-N-X	✓	✓	✓✓✓	—	—	—	—	✓✓	✓✓	✓	Trichloroisocyanuric acid (87-90-1), sodium dichloroisocyanurate (2893-78-9), N-bromosuccinimide (128-08-5), 1-bromo-3-chloro-5,5-dimethylhydantoin (BCDMH) (126-06-7)
Oxyanion	M-ClO ₃ , M-ClO ₂ , M-ClO ₄ , M-OCl	✓	✓	✓✓✓	—	—	—	—	✓	✓✓	✓	Sodium chlorite (7758-19-2), sodium chlorate (7775-09-9), sodium perchlorate (7601-89-0), ammonium perchlorate (7790-98-9), calcium hypochlorite (7778-54-3), potassium bromate (7758-01-2), lithium hypochlorite (13840-33-0)
Peroxides	Organic R-O-O-R	✓✓✓	—	✓	—	—	✓✓✓	✓✓	✓	✓✓	✓	Benzoyl peroxide (94-36-0), diacetyl peroxide (>70%) (110-22-5), dibenzoyl peroxide (94-36-0), methyl ethyl ketone peroxide (>60%) (97-02-9), di- <i>t</i> -butyl peroxide (110-05-4), <i>t</i> -amyl hydroperoxide (3425-61-4), cumene hydroperoxide (80-15-9), <i>t</i> -butyl peroxyacetate (107-71-1)
	Metal/ Inorganic M-O-O	—	✓	✓✓✓	—	—	—	—	✓	—	—	Sodium perborate (10486-00-7), sodium percarbonate (15630-89-4), magnesium peroxide (1335-26-8), sodium peroxide (1313-60-6)

(continues)

Table B.3.2 Continued

CHEMICAL FAMILY ^c	CHEMICAL STRUCTURE	PHYSICAL HAZARDS ^{a,b}							HEALTH HAZARDS ^{a,b}			EXAMPLES (CAS No.) ^f
		Unstable Reactive	Water Reactive	Oxidizer	Pyrophoric	Flammable Solid	Organic Peroxide ^d	Flammable/Combustible ^e	Corrosive	Toxic	Highly Toxic	
		(S, L, G)	(S, L, G)	(S, L, G)	(S, G)	(S)	(S, L)	(S, L, G)	(S, L, G)	(S, L, G)	(S, L, G)	
Phosphorus-halogen compounds	O=P-X ₃ , P-X	—	✓✓✓	—	—	—	—	—	✓✓✓	✓	—	Phosphorus pentachloride (10026-13-8), phosphorus trichloride (7719-12-2), phosphorus oxychloride (10025-87-3), phosphorus pentafluoride (7647-19-0)

Ar = phenyl ring; X = halogen (i.e., fluorine, chlorine, bromine, iodine); R = organic; M = metal.

Notes:

(1) S, L, and G refers to whether hazards apply to solid, liquid, and/or gaseous physical forms.

(2) A triple check mark (✓✓✓) indicates that most or all of the chemicals within the family or sub-family might have the indicated physical and health hazards.

(3) A double check mark (✓✓) indicates that some of the chemicals within the family or sub-family might have this additional physical and health hazards.

(4) A single check mark (✓) indicates that only a select few chemicals within a specific family display the relevant physical and health hazards.

(5) No checkmarks (—) indicate that hazards are not applicable for the specific chemical category.

^aThe physical and health hazards are broad representations for the various classes of chemicals. These classifications are not intended to cover all hazards of a material. For specific information, the chemical-specific SDS must be consulted. Additional information can be obtained from the manufacturer.

^bFor additional concentration dependent hazard categories, see Section B.5.

^cSource material for the chemical families includes *Bretherick's Handbook of Reactive Chemical Hazards* (Elsevier Science & Technology Books), 7th ed.; *Comprehensive Guide to Hazardous Properties of Chemical Substances* (Wiley Interscience); and Table 2.4 and Table 2.5 of *Guidelines for Chemical Reactivity Evaluation and Application to Process Design* [Center for Chemical Process Safety (CCPS)/AIChE].

^d“Peroxide” is not a hazard characteristic but a unique chemical family with a range of properties listed as a specific physical hazard under NFPA 400.

^eThe “flammable or combustible” hazard categories are not regulated under NFPA 400. However, many chemicals exhibit the hazard properties of flammability or combustibility.

^fThe examples and their classifications represent neat, undiluted, commercially available products. Source material for the examples listed includes *US EPA High Production Volume (HPV) Challenge Program List*; the *OECD (Organization for Economic Co-operation and Development) Integrated HPV Database*; *Bretherick's Handbook of Reactive Chemical Hazards* (Elsevier Science & Technology Books), 7th ed.; *The Handbook of Compressed Gases* (Compressed Gas Association), 4th Ed.; and U.S. Department of Labor, 29 CFR 1910.119, Appendix A, “List of Highly Hazardous Chemicals, Toxics and Reactives (Mandatory).”

B.4.1.1.4 Acids (Gaseous). The common acid gases, which include hydrogen bromide (HBr), hydrogen chloride (HCl), hydrogen fluoride (HF), and hydrogen iodide (HI), are corrosive and in some cases toxic. They are highly soluble in water, forming the corresponding aqueous acid and are packaged as liquefied compressed gases. Other acid gases include boron trichloride (BCl₃), boron trifluoride (BF₃) and silicon tetrafluoride (SiF₄).

B.4.1.1.5 Acids (Oxidizing). Some strong acids are also oxidizing acids, most commonly nitric acid (HNO₃). As oxidizers, they are also corrosive and toxic. These physical and health properties are exhibited even in dilute solutions.

B.4.1.2 Alcohols.

B.4.1.2.1 Aliphatic Alcohols (R-OH). The category includes primary (1°), secondary (2°), and tertiary (3°) branched and cyclic alcohols. Most common alcohols include methanol, ethanol, isopropanol, t-butanol (2-methylpropan-2-ol), n-butanol (butan-1-ol) and cyclohexanol. Many alcohols, especially smaller chain alcohols, are highly flammable even in dilute solutions. This generally does not hold true for the small-chain glycols (or polyhydroxylated compounds), such as propylene glycol, which have significantly higher boiling points. Most

smaller chain aliphatic alcohols are readily soluble in water. Longer chain alcohols “fatty alcohols” (e.g., dodecanol, hexadecanol, and octadecanol) are solids, are not flammable, and are not miscible with water.

B.4.1.2.2 Aromatic Alcohols (Ar-OH). The most common aromatic alcohol is phenol (hydroxybenzene). Others include the dihydroxybenzenes (e.g., catechol) and hydroxytoluenes (e.g., o-cresol). Most phenols are usually solids or high-boiling point liquids and readily soluble in water. Phenol and p-cresol are highly corrosive and toxic. Functionalized phenol derivatives (e.g., 2,4-dichlorophenol), while also soluble in water, are not flammable and can be toxic. Higher molecular weight phenols such as hydroxynaphthalene (e.g., naphthol) can also be toxic but are not corrosive. The chemical and physical properties of aliphatic and aromatic alcohols vary significantly depending on the structure of the alcohol and other functional groups.

B.4.1.3 Alkyl Halides (R-X). This chemical family includes halogenated alkyl analogues, such as methylene chloride, chloroform, carbon tetrachloride, bromoform, dichloroethane, perchloroethylene, methyl bromide and methyl iodide, fluoroethane, and Freon[®] derivatives. Often these chemicals are nonflammable gases and liquids, used as fire extinguishers,

refrigerants, and solvents. The most widely known category is the chlorofluorocarbons (CFCs). Nonflammable gases include bromochlorodifluoromethane (Halon 1211) and dichlorodifluoromethane (Freon-12). Some chemicals in this family are flammable. Highly substituted alkyl halides (i.e., those chemicals with many halogen atoms present in a molecule) such as 1,2-dichloroethane and 1,1,2,2-tetrachloroethane are liquids and toxic.

B.4.1.4 Amines.

B.4.1.4.1 Amines (Aliphatic) ($R-NH_2$, R_2NH , R_3N). The aliphatic amines consist of primary (1°), secondary (2°), and tertiary (3°) branched compounds. Lower molecular weight amines such as ethylamine, propylamine, butylamine, and triethylamine are highly flammable liquids, corrosive and readily soluble in water. Some are toxic. Many amines, such as methylamine, are sold in diluted aqueous solutions, and are typically flammable. (For ammonia, see B.4.1.5.2.)

B.4.1.4.2 Amines (Aromatic) ($Ar-NH_2$, $Ar(N)$). This family includes substituted aromatic amines, such as benzene derivatives (e.g., aniline, and o-aminoaniline) and heteroaromatics (e.g., pyridine and picoline). Most of these chemicals are solids or liquids and can be readily soluble in water and are toxic. Some are flammable. Health hazards associated with these chemicals depend heavily on the ring structure, degree of substitution, and location of the nitrogen(s) within the heteroaromatic ring.

B.4.1.5 Bases.

B.4.1.5.1 Alkalis. Bases are found either as solids or as concentrated aqueous solutions. Most bases are highly corrosive with all tissues with which they come in contact. Bases, such as sodium carbonate (Na_2CO_3), sodium hydroxide (NaOH), and potassium hydroxide (KOH), readily absorb moisture from the air. When dissolved in water, these chemicals often liberate substantial heat and form corrosive solutions in concentrated form. The corrosiveness and toxicity of these chemicals decreases with dilution.

B.4.1.5.2 Gaseous. The common basic gases, ammonia (NH_3) and the lower molecular weight amines (methylamine, dimethylamine, and trimethylamine), are all are corrosive but not toxic. They are highly soluble in water and are liquefied compressed gases. The common bases are flammable gases with a narrow flammability range. They are often sold commercially as aqueous solutions, which are also flammable.

B.4.1.6 Carbides/Nitrides. Carbides have varying degrees of physical hazards. Carbides, such as calcium carbide (CaC_2) and sodium carbide (Na_2C_2), react violently with water, are flammable in the presence of moisture, and could be corrosive. Other carbides, such as zirconium carbide (ZrC), tungsten carbide (WC), and silicon carbide (SiC), have little reactivity. Nitrides, such as boron nitride (BN), are usually stable.

B.4.1.7 Carbonyl Compounds.

B.4.1.7.1 Carbonyl Compounds (Acid Anhydrides) ($R_1C(O)OC(O)R_2$). These chemicals, often referred to as simply "anhydrides," are more reactive than their corresponding carboxylic acids. Anhydrides react with water to form the corresponding acid or base, and are often good dehydrating agents. Lower molecular weight anhydrides, such as acetic anhydride, propionic anhydride, and isobutyric anhydride, are most often corrosive, flammable, and could react violently with water.

Functionalized anhydrides such as trifluoroacetic anhydride are highly corrosive and highly water reactive. Aromatic anhydrides, such as phthalic anhydride, are also corrosive but not water reactive.

B.4.1.7.2 Carbonyl Compounds (Acyl Halides) (R , $Ar-C(O)X$; R , $Ar-SO_2X$). These chemicals include the most common acid halides and sulfonyl halides and are considerably more reactive than the corresponding anhydrides. Acyl halides are most often corrosive, water reactive, and volatile. Higher molecular weight aromatic acid halides, such as benzoyl chloride, are toxic and corrosive and have limited water solubility and lower water reactivity. Lower molecular weight acid halides such as acetyl chloride are flammable, highly corrosive, and react violently with water.

B.4.1.7.3 Carbonyl Compounds (Aldehydes) ($R-CH=O$, $Ar-CH=O$). Most aldehydes are volatile organic compounds. Simple, lower molecular weight alkyl aldehydes, such as acetaldehyde, propionaldehyde (methylacetaldehyde), butyraldehyde, and 2-butenaldehyde (crotonaldehyde), for example, exist as liquids, and are most often highly flammable. Formaldehyde is known to be toxic. Many aromatic aldehydes, such as benzaldehyde, have limited flammability.

B.4.1.7.4 Carbonyl Compounds (Esters) ($R_1O(C=O)R_2$). In general, the category possesses few physical or health hazards. Aliphatic and aromatic esters are significantly more stable than the acid anhydrides and are not water reactive. Lower molecular weight alkyl esters, such as methyl formate, ethyl acetate, and n-butyl acetate, are flammable liquids.

B.4.1.7.5 Carbonyl Compounds (Halides) ($C(O)X_2$, $C(S)X_2$). These compounds are very reactive chemicals and are considered highly toxic, highly water reactive, and corrosive. Phosgene is a nonflammable gas, while thiophosgene and oxalyl chloride are liquids. Trichloromethyl chloroformate (diphosgene) and methyl chloroformate are liquids and less reactive but still water reactive.

B.4.1.7.6 Carbonyl Compounds (Ketones) ($R_1R_2C=O$). Similar to aldehydes, most ketones are volatile organic compounds. Many ketones are also flammable liquids. Simple, low molecular weight ketones, such as acetone, cyclohexanone, methyl ethyl ketone (MEK), and methyl isobutyl ketone (MIBK), for example, are liquids and highly flammable. Common functionalized ketones, such as chloroacetone, 1,3-dichloro-2-propanone, and chloroacetophenone (chloromethyl phenyl ketone), while not flammable, are toxic. Many aromatic ketones have limited flammability.

B.4.1.8 Cyanides.

B.4.1.8.1 Cyanides (Gaseous). The common cyanide gases, hydrogen cyanide (HCN), cyanogen chloride (ClCN), and cyanogen (C_2N_2), are highly toxic. Hydrogen cyanide is a liquid, but is treated and packaged as a gas. Cyanogen and hydrogen cyanide are flammable, while cyanogen chloride is corrosive.

B.4.1.8.2 Cyanides (Inorganic) ($M-CN$). Common inorganic cyanides include sodium cyanide (NaCN) and trimethylsilyl cyanide (TMSCN). This family is characterized as highly toxic. Cyanide salts are readily soluble in water and highly toxic.

Trimethylsilyl cyanide is water reactive. The family does not include the many organic compounds that contain the CN

group (called nitriles). Nitriles do not display the toxicity of the inorganic cyanides such as sodium and potassium cyanide.

B.4.1.8.3 Nitriles (Organic). Common, lower molecular weight nitriles, including acetonitrile and 2-propenenitrile (acrylonitrile), are highly flammable liquids and toxic. Many aromatic nitriles (benzonitriles) are solids and often toxic, depending on substituents. Benzonitriles have limited flammability.

B.4.1.9 Epoxides. Epoxides are very reactive chemicals. Common epoxides include ethylene oxide, which is a gas, and propylene oxide and 1-chloro-2,3-epoxypropane (epichlorohydrin), which are liquids. These chemicals most often have flammable, toxic, water-reactive, and unstable reactive hazard characteristics.

B.4.1.10 Ethers/Glycols (R-O-R). This broad category includes both simple alcohol ethers and polyhydroxylated glycol ethers. Simple, low molecular weight ethers such as diethyl ether or vinyl ether are low-boiling liquids or compressed gases and highly flammable. Cyclic ethers, such as tetrahydrofuran (THF) and 1,4-dioxane, are highly flammable liquids while slightly toxic. Common higher molecular weight glycol ethers, such as 1,2-dimethoxyethane (glyme), ethylene glycol monomethyl ether (EGME, 2-methoxyethanol), dipropylene glycol monomethyl ether (DPM, 1-(2-methoxy-2-methylethoxy)-2-propanol), propylene glycol monomethyl ether (PGME, 1-methoxy-2-propanol), diethylene glycol monomethyl ether (DEGME), and dipropylene glycol monomethyl ether (DPGME), are often water soluble liquids and combustible. Lower molecular weight glycol ethers are flammable liquids. Many are high-boiling point liquids.

B.4.1.11 Gases. Within the context of the model codes, gases are regulated as either compressed gases or as cryogenic fluids. Compressed gases can be found either in the nonliquefied or liquefied state. Any gas can be liquefied at a sufficiently low temperature by increasing its pressure through the use of compression. Gases that cannot be liquefied at normal ambient temperatures are called “permanent” gases. A permanent gas is able to be liquefied by reducing the temperature below ambient temperatures and increasing its pressure. However, at normal ambient temperatures of 68°F (20°C) these gases remain in a nonliquefied state.

The scientific explanation for this phenomenon is generally explained in the following discussion. There is a temperature for each gas at or below which it can be liquefied by pressure, but above which it is impossible to liquefy at any pressure. This temperature is called the critical temperature of the gas. At temperatures above the critical temperature, the substance can exist only in the gaseous state regardless of the pressure applied. The pressure that will just liquefy a gas at its critical temperature is called the critical pressure. In other words, the critical pressure of a gas is equal to the vapor pressure exerted by the liquefied gas at its critical temperature. All that is necessary to liquefy a gas is to cool it to its critical temperature and subject it to a pressure equal to or greater than its critical pressure. The farther below the critical temperature it is cooled, the less the pressure required for liquefaction. At the critical conditions of temperature and pressure the gaseous and liquid forms of the substance have the same density.

Atmospheric air is a mixture of permanent gases and principally composed of argon, oxygen, and nitrogen. Under normal ambient conditions it remains in the gaseous state. The critical

temperature of air is -221.1°F (-140.6°C). The critical pressure is an absolute pressure of 547 psi (3771 kPa, absolute). To liquefy compressed air, the temperature must be reduced to -221.1°F (-140.6°C) or less with a commensurate increase in pressure above absolute pressure of 547 psi (3771 kPa, absolute). By comparison, liquefied petroleum gas (LP-Gas), is a mixture of hydrocarbon gases, principally propane and butane, which is found in the liquid form under ambient conditions. These gases have a critical temperature well in excess of 68°F (20°C), and as a result, they are found as liquefied compressed gases under ambient temperatures.

Cryogenic fluids are refrigerated liquefied gases with a boiling point lower than -130°F (-90°C) at an atmospheric pressure of an absolute pressure of 14.7 psi (101.3 kPa, absolute). They are maintained in the cryogenic (super-cooled) state by artificial means.

B.4.1.11.1 Gases (Flammable). Common nonliquefied flammable compressed gases include carbon monoxide and hydrogen. Other flammable gases are hydrocarbon gases. The alkanes include methane (CH₄), ethane (C₂H₆), and propane (C₃H₈). Ethane and propane are liquefied compressed gases at ambient temperature. The alkenes include ethylene (C₂H₄) and propylene (C₃H₆), both liquefied compressed gases, and the alkynes include acetylene (C₂H₂). Acetylene is an unstable reactive gas; it is found in cylinders, packaged as a compressed gas dissolved in a solution of acetone or dimethyl formamide. While acetylene can be liquefied at ambient temperatures, for safety reasons it is shipped as a nonliquefied compressed gas.

B.4.1.11.2 Gases (Halogens) (X-X). The pure halogen gases, fluorine (F₂), chlorine (Cl₂), bromine trifluoride (BrF₃), and chlorine trifluoride (ClF₃), are extremely powerful oxidizers, and are corrosive and toxic. Fluorine and chlorine are only slightly soluble in water, while bromine trifluoride and chlorine trifluoride are extremely water reactive. Bromine trifluoride is explosive on contact with water. Fluorine is a compressed gas while chlorine, bromine trifluoride, and chlorine trifluoride are liquefied compressed gases.

Gases that are fully halogenated, such as hexafluoroethane (C₂F₆), carbon tetrafluoride (CF₄), and sulfur hexafluoride (SF₆), are inert and nonreactive.

B.4.1.11.3 Gases (Nonflammable). The atmospheric gases, with the exception of oxygen, have limited chemical reactivity, and are not corrosive, flammable, or toxic. These gases include nitrogen, argon, and carbon dioxide. Their greatest hazard is asphyxiation. The rare gases, such as helium, neon, krypton, xenon, and argon, were once thought to be inert (having no chemical activity at all); however, within the last 20 years compounds have been made through the use of strong oxidizer gases, such as fluorine, to form nitrogen trifluoride.

B.4.1.11.4 Gases (Oxidizing). The more common oxidizing gases are oxygen, nitrous oxide, and nitrogen trifluoride. Oxygen and nitrogen trifluoride are compressed gases, while nitrous oxide is a liquefied compressed gas.

B.4.1.11.5 Gases (Pyrophoric). Gases with an autoignition temperature below 130°F (54°C) are classified as pyrophoric. Silane (SiH₄) is probably one of the most common pyrophoric gases found in use today. Other pyrophoric gases include methylsilane (CH₃SiH₃) and disilane (Si₂H₆). Silane and methylsilane are compressed gases, while disilane is a liquefied compressed gas. Some pyrophoric gases, such as phosphine

(PH₃) and diborane (B₂H₆), are also highly toxic. Although all pyrophoric gases are flammable by nature, they are regulated as pyrophoric gases within the context of the model codes.

B.4.1.11.6 Gases (Sulfur Gases) (R-SH). The common sulfur gases are hydrogen sulfide (H₂S), methyl mercaptan (CH₃SH), and carbonyl sulfide (COS) and are toxic and flammable. They are all liquefied compressed gases.

B.4.1.12 Hydrocarbons.

B.4.1.12.1 Hydrocarbons (Aliphatic) (R). Commonly referred to as saturated hydrocarbons, alkanes as a whole are unreactive chemicals. The aliphatic hydrocarbons pentane, decane, and cyclohexane are flammable liquids. Lower molecular weight hydrocarbons such as methane, ethane, propane, and butane are flammable compressed gases.

B.4.1.12.2 Hydrocarbons (Alkenes) (R₁CH=CHR₂). Alkenes are a very broad category of hydrocarbons and are commonly referred to as unsaturated hydrocarbons, olefins, or vinyl compounds. Alkenes are relatively stable compounds, but are more reactive than alkanes. Smaller chain alkenes, such as ethylene, propylene, and butene, are all flammable gases and readily form explosive mixtures with air. Common derivatized alkenes, such as styrene (vinyl benzene), vinyl chloride (monochloroethylene), vinyl acetate, and 1,4-dichloro-2-butene, are toxic. Some are flammable liquids. They also readily polymerize (without inhibitors), which leads to unstable reactive characteristics.

B.4.1.12.3 Hydrocarbons (Alkynes) (R₁C≡CR₂, R-C≡CH). Of all the aliphatic hydrocarbons, alkynes are the most reactive. Many alkynes are highly reactive and considered unstable reactive, especially as molecular weights increase. Many halogenated alkynes and metal derivatives can be explosive. The most common alkynes are gases, including acetylene (ethyne — see Flammable Gases) and methyl acetylene (1-propyne), can form explosive mixtures with air. The most common derivatized alkyne is propargyl alcohol (2-propyn-1-ol), which is flammable, corrosive, and toxic.

B.4.1.12.4 Hydrocarbons (Aromatic) (Ar). This family is very broad and derived from such compounds as benzene and toluene and have limited alkyl (methyl, ethyl, etc.) substitution on the ring. Smaller aromatic hydrocarbons (benzene, toluene (methyl benzene), ethyl benzene, and xylene) are flammable liquids and are sometimes toxic. High-molecular-weight compounds with many aromatic rings (such as naphthalene and anthracene) are solids and are often toxic. Substituted analogues, such as dichlorobenzene, have varying degrees of toxicity based on the degree of substitution and arrangement on its ring structure. Many are also flammable solids.

B.4.1.13 Isocyanates (R-N=C=O, Ar-N=C=O). This family includes compounds such as toluene diisocyanate (TDI), p-toluenesulfonyl isocyanate, and methylene bisphenyl isocyanate (MDI). The chemicals are liquids and are typically unstable reactive, water-reactive, corrosive, and toxic. Some are highly toxic. Some are violently water reactive.

B.4.1.14 Metals.

B.4.1.14.1 Metal Alkyls (M-R). All metal alkyls are pyrophoric, corrosive, and highly reactive. The simple metal alkyls trimethylaluminum (TMAl), trimethylgallium (TMG), and trimethylindium (TMI) are pyrophoric liquids. They are also violently

water reactive. Dimethylzinc and trimethylaluminum are also unstable reactive. Tetramethyltin is a flammable liquid.

B.4.1.14.2 Metal Halides (M-X). Physical and health hazards of this chemical family vary significantly based on the corresponding metal. Most metal halides are typically inert (such as sodium chloride [table salt], calcium chloride, magnesium fluoride, aluminum chloride, and palladium (II) chloride), while some have a much higher reactivity (such as silver bromide and chromium (III) chloride) and are strong oxidizers. The chemical and physical properties vary significantly depending on the metal. If a metal halide contains a heavy metal, such as lead, chromium, thallium, and mercury, it is assumed to be highly toxic. Fluoride and bromide salts are more toxic than the corresponding chloride salts.

B.4.1.14.3 Metal Hydrides (Solids). Compounds such as lithium aluminum hydride (LiAlH₄), sodium borohydride (NaBH₄), and sodium hydride (NaH) are flammable solids, water-reactive, and corrosive. Metal hydrides react violently with water.

B.4.1.14.4 Metal Hydrides (Gaseous). The more common metal hydride gases are arsine (arsenic hydride, AsH₃), diborane (boron hydride, B₂H₆), hydrogen selenide (selenium hydride, H₂Se), and phosphine (phosphorus hydride, PH₃). In general, these chemicals are toxic, liquefied compressed gases, with many being highly toxic. They are flammable and some have autoignition temperatures low enough to make them pyrophoric, such as diborane and phosphine. The key exception is silane (SiH₄), which is not toxic. Silane is a compressed gas rather than a liquefied compressed gas.

B.4.1.14.5 Metals (Alkali). This category includes sodium, potassium, and lithium. All are highly corrosive and can often explode if they are exposed to water. They are all flammable solids as well.

B.4.1.14.6 Metals (Powdered). Metals, especially those in a finely divided state, are usually categorized as flammable solids, such as aluminum, magnesium, sodium, and potassium. Some, but not all, react violently and are water-reactive. Some are also toxic.

B.4.1.15 Nitrated Organic Compounds.

B.4.1.15.1 Organic Nitro Compounds (R, Ar-NO₂). Most often, smaller alkyl nitro compounds, such as nitromethane, are flammable, unstable reactive, and often toxic. Aromatic nitro analogues are toxic or highly toxic and unstable reactive, the latter being dependent on the amount of ring substitution.

B.4.1.15.2 Azo (Aliphatic) (R-N=N-R). Aliphatic azo derivatives are inherently unstable and readily decompose, often violently, upon the application of heat. Aliphatic azo compounds are characterized as unstable reactive, flammable solids and are often toxic.

B.4.1.15.3 Azo (Aromatic) (Ar-N=N-Ar). Aromatic azo derivatives have superior thermal stability properties compared to aliphatic azo derivatives. Many aromatic azo derivatives are quite stable and often used as dyes. They have a wide array of chemical and physical properties depending on the substituents on the aromatic ring and the number of azo groups present in the molecule (mono-, dis-, tris-, tetrakis-, etc.). Most exhibit low to moderate toxicity.

B.4.1.15.4 Azides (R, Ar-N₃). The most common chemicals of this family are the metal azides, including sodium and lithium azide. All the compounds in this family are unstable reactive and highly toxic.

B.4.1.15.5 Nitrites (Inorganic) (M-NO₂). The most common nitrites are sodium and potassium nitrite. All are strong oxidizers and toxic.

B.4.1.15.6 Nitrates (Inorganic) (M-NO₃). Examples of inorganic nitrates include sodium nitrate, silver nitrate, zinc nitrate, lithium nitrate, and lead nitrate. While all inorganic nitrates are strong oxidizers, the physical and health properties vary significantly depending on the metal. Many of these compounds are corrosive and can have unstable reactive properties. Toxicity varies with the associated metal.

B.4.1.16 Nitrogen-Halogen Compounds (R-N-X). This chemical family includes chlorinated isocyanurates (trichloroisocyanuric acid, sodium dichloroisocyanurate), halogenated succinimides (N-bromosuccinimide), and halogenated hydantoins (e.g., 1-bromo-3-chloro-5,5-dimethylhydantoin). Some are strong oxidizers and corrosive in their pure states, with varying properties of unstable reactive, water-reactive, and toxicity hazards. Specially formulated chlorinated isocyanurate products have been shown to reduce oxidizer properties.

B.4.1.17 Oxyanion (M-ClO₂, M-ClO₃, M-ClO₄, M-OCl). This chemical family includes chlorites, chlorates, perchlorates, bromates, and hypochlorites. The most common chemicals are sodium chlorite (NaClO₂), sodium chlorate (NaClO₃), ammonium perchlorate (NH₄ClO₄), potassium bromate (KBrO₃), and calcium hypochlorite (Ca(OCl)₂). Most are strong oxidizers and corrosive in their pure states with varying properties of unstable reactive, water reactive, and toxicity hazards. Chlorites and chlorates are most commonly found as diluted solutions that reduce toxicity and oxidizing properties. Specially formulated calcium hypochlorite products have been shown to reduce their oxidizing properties. Sodium hypochlorite (liquid bleach) is too unstable in solid form and is found only in dilute solutions that are corrosive.

B.4.1.18 Peroxides.

B.4.1.18.1 Peroxides (Organic) (R-O-O-R). The common organic peroxides include such chemicals as *t*-amyl hydroperoxide, dibenzoyl peroxide, di-*t*-butyl peroxide, diacetyl peroxide, methyl ethyl ketone peroxide, diisopropyl peroxydicarbonate, and cumyl hydroperoxide. Organic peroxides possess a wide range of properties based on the many physical forms and concentrations and have a large range of safety-related properties, including physical as well as health hazards. Organic peroxides are either used as the technically pure compound or as formulations where the peroxide might be found in a diluted form, such as solutions, pastes, or solid granules.

Organic peroxide formulations vary in reactivity hazard from self-extinguishing to the potential for a violent deflagration or detonation. Decomposition can be initiated by heat, friction, mechanical shock, or contamination, though sensitivity to these stimuli varies greatly. Dilution with water or other solvents is used as a means to reduce the level of sensitivity to outside stimuli and the potential for decomposition. Refrigeration is also used as a means to reduce the potential for decomposition. The health hazards of these materials as provided in

commerce vary greatly depending on concentration and formulation itself.

B.4.1.18.2 Metal Peroxides (Inorganic) (M-O-O). Metal peroxides, such as sodium peroxide and calcium peroxide, are all oxidizers. Some are corrosive and water reactive. Reaction with water can be explosive in some instances.

B.4.1.19 Phosphorus-Halogen Compounds (O=P-X₃, P-X). These phosphorus analogues are corrosive and often react violently with water and include such chemicals as phosphorus oxychloride (POCl₃), phosphorus trichloride (PCl₃), and phosphorus pentachloride (PCl₅). They are water reactive, corrosive, and toxic.

B.5 Hazard Category Based on Concentration.

B.5.1 General. Some chemicals exhibit different physical and/or health hazards based on the concentration. Some pertinent examples of concentration-dependent hazards of specific chemicals are provided in the following list. Additional information on concentration-dependent hazards should be contained in the SDS.

- (1) *Acetic Acid (64-19-7)*. Concentration: 100 percent — corrosive, flammable/combustible; 36 percent aqueous — corrosive; <5 percent aqueous — not corrosive.
- (2) *Ammonia (7664-41-7)*. Concentration: anhydrous — corrosive, flammable gas; <50 percent aqueous — not corrosive.
- (3) *Formaldehyde (50-00-0)*. Concentration: anhydrous — flammable, corrosive, highly toxic; 37 percent aqueous — combustible, highly toxic 10 percent aqueous — combustible.
- (4) *Hydrogen Fluoride (7664-39-3)*. Concentration: anhydrous — corrosive, water reactive, toxic; 10–48 percent — corrosive, toxic; 2–10 percent aqueous — corrosive.
- (5) *Nitric Acid (7697-37-2)*. Concentration: 7–40 percent aqueous — oxidizer, corrosive; 1–6 percent aqueous — not oxidizer, not corrosive.
- (6) *Phosphine (CAS numbers based on concentration)*. Concentration: 5 percent phosphine, 95 percent nitrogen — pyrophoric, toxic; phosphine: 2 percent phosphine, 98 percent nitrogen — toxic.
- (7) *Phosphoric Acid (7664-38-2)*. Concentration: 85-86 percent aqueous — corrosive; <80 percent aqueous — not corrosive.
- (8) *Potassium Hydroxide (1310-58-3)*. Concentration: 100 percent — corrosive, water reactive, toxic; 45 percent aqueous — corrosive, water reactive; 5 percent aqueous — corrosive.
- (9) *2-Propanol (Isopropanol) (67-63-0)*. Concentration: > 91 percent aqueous — flammable; 25-50 percent aqueous — combustible.
- (10) *Sodium chlorate (7775-09-9)*. Concentration: 100 percent — corrosive, oxidizer, unstable reactive; 40–50 percent aqueous — corrosive, oxidizer.
- (11) *Sodium hydroxide (1310-73-2)*. Concentration: 100 percent — corrosive, water reactive, toxic; 1–50 percent aqueous — corrosive.
- (12) *Sulfuric Acid (7664-93-9)*. Concentration: 92–98 percent aqueous — corrosive, water reactive, toxic; 12.7–50 percent aqueous — corrosive, water reactive, toxic; 4–12.6 percent aqueous — corrosive.
- (13) *Sodium Hypochlorite (7681-52-9)*. Concentration: 12–15 percent aqueous — corrosive; 3–5 percent aqueous — not corrosive.

B.6 Safety Data Sheets (SDSs) — A Starting Point for Hazards Identification.

B.6.1 General. Safety data sheets (SDSs) have been established as a primary means of hazard identification under OSHA's Hazard Communication standard (29 CFR 1910.1200). SDSs are provided by manufacturers or importers as a means to communicate hazards within a set of standardized terms and elements or bodies of information.

B.6.2 SDS Format. In 2012, OSHA revised its Hazard Communication Standard (40 CFR 1910.1200) to align with the United Nations *Globally Harmonized System of Classification and Labelling of Chemicals (GHS)*. The Hazard Communication Standard requires the use of a 16-section format for SDSs, similar to that of the format provided in ANSI Z400.1/Z129.1, *Hazardous Workplace Chemicals — Hazard Evaluation and Safety Data Sheet and Precautionary Labeling Preparation*. As manufacturers, importers, and distributors transition to the 16-section SDS format, they will include information in the 16 sections referenced in Section B.2. To classify the hazards of a given material, users should refer to key sections of the SDS that contain the following information:

- (1) Identification (SDS Section 1)
- (2) Hazard(s) identification (SDS Section 2)
- (3) Composition/information on ingredients (SDS Section 3)
- (4) Physical and chemical properties (SDS Section 9)
- (5) Stability and reactivity (SDS Section 10)
- (6) Toxicological information (SDS Section 11)
- (7) Transport information (SDS Section 14)

Each section should contain relevant information that can be used in the hazard classification process. The following subsections provide useful information to help the user with these required SDS sections.

B.6.2.1 Identification. Product identification will typically include the chemical name, common name, and synonyms. Pure materials, sometimes referred to as “neat” to indicate that they are in an undiluted form, are typically referred to by their chemical name. However, it is not uncommon to find that the manufacturer has identified the material under a trade name chosen by that particular manufacturer. Chemical synonyms will frequently be shown; however, it should be expected that the list of synonyms might be an abbreviated listing and that there could be other synonyms that are not listed.

For chemical mixtures the material will typically be identified by its trade name. Some confusion can be created when a material in its “neat” form is further identified in the Hazard Identification section as containing other constituents. Commercially available materials even in the pure or neat form contain impurities from the manufacturing process. Although there is no hard-and-fast rule, materials in concentrations of 95 percent or greater are generally considered to be in the pure form and are referred to by the CASRN for the major component. The impurities from manufacturing are generally not considered for the purposes of material identification and such materials are not considered to be “mixtures” of chemicals per se.

The product identification section provides additional information, including the identification of the manufacturer of the material and nomenclature intended to link the SDS to the label provided on the material in the container(s) as furnished by the manufacturer.

In addition to the product identifier, Section 1 of the SDS will list the chemical name, and the name, address, and phone number of the responsible party.

Similar to NFPA, the Hazard Communication Standard requires that hazardous chemicals be classified according to the severity of hazard presented by the chemical. However, the hazard categories defined and assigned by the Hazard Communication Standard are different than those used by NFPA. For example, the Hazard Communication Standard defines oxidizers differently than the NFPA (*see Annex J for a comparison of these definitions*). Within the hazard category of oxidizer, there are four subcategories or Classes of hazards recognized under the NFPA system, Class 4, Class 3, Class 2, and Class 1 materials. Hazard classes are used to describe a range of hazards within a given hazard category, and the class system is used for materials that are oxidizers other than oxidizing gases, organic peroxides, unstable reactives, and water reactives. Although not the subject of regulation by NFPA 400, flammable liquids are further subdivided into Class I, Class II, and Class III, and combustible liquids are further subdivided into Class II, IIIA, and IIIB liquids.

B.6.2.2 Hazards Identification. Section 2 of the SDS lists the hazard identification of the chemical, including the classification of the chemical, signal word, the pictogram(s), hazard statement(s), description of hazard(s), and precautionary statements. SDS Section 2 also describes hazards that are not otherwise classified.

The hazard identification section of the SDS provides an emergency overview of the material and includes information on health and physical hazards that can result from exposure to the material.

B.6.2.3 Composition/Information on Ingredients. The composition of the material or information on ingredients is listed in SDS Section 3, per the OSHA *Hazard Communication Standard*. The composition section typically lists the hazardous components as defined by OSHA, and not those categories used by NFPA 400. Although the OSHA hazard categories have been incorporated into the regulatory scheme used by NFPA 400, there are differences and the converse is not true. For example, OSHA does not incorporate the traditional NFPA hazard ratings used in NFPA 704. The revised *Hazard Communication Standard* allows the completed NFPA 704 diamond to be provided on the SDS. NFPA and OSHA developed a Quick Card to compare the classification and rating systems, located at www.nfpa.org/704.

The composition section is required to list hazardous components of a material and are themselves classified and contribute to the classification of the chemical. For mixtures, the composition section must also list the chemical name and concentration of all ingredients classified as health hazards and that are present above their cut-off/concentration limits or present a health risk below the cut-off/concentration limits. The SDS can also list components that are nonhazardous. The CASRN for each component is typically listed in this section of the SDS.

B.6.2.4 Physical and Chemical Properties. Section 9 of the SDS lists the physical and chemical properties of the materials. A description of its physical properties, including its physical state (i.e., solid, liquid, gas), is required. It is typical to find a wide array of physical and chemical properties listed. The phys-

ical and chemical properties required in SDS Section 9 include the following:

- (1) Appearance (physical state, color, and so on)
- (2) Odor
- (3) Odor threshold
- (4) pH
- (5) Melting/freezing point (specify which)
- (6) Initial boiling point and boiling range
- (7) Flash point
- (8) Evaporation rate
- (9) Flammability (solid, gas)
- (10) Upper/lower flammability or explosive limits
- (11) Vapor pressure
- (12) Vapor density
- (13) Relative density
- (14) Solubility(ies) (specify solvent, e.g., water)
- (15) Partition coefficient:n-octanol/water
- (16) Auto-ignition temperature
- (17) Decomposition temperature
- (18) Viscosity

B.6.2.5 Stability and Reactivity. Section 10 of the SDS lists information about the stability and reactivity of materials. This section typically describes conditions that affect the intrinsic stability of a material. An intrinsic property is a property that is inherent in the material in and of itself, as compared to its properties under conditions that are brought about by the environment in which it is located. Environmental conditions can be described as extrinsic conditions, such as when the material is exposed to heat, fire, shock, or other effects.

This section of the SDS is used as a means to assess its nature within the context of the unstable reactive hazard category. While many materials have an intrinsic stability, they can become unstable when exposed to high temperatures or mechanical or physical shock. Therefore, the information found on an SDS might have to be supplemented by referring to other authoritative sources regarding the reactivity of the material.

B.6.2.6 Toxicological Information. Section 11 of the SDS lists toxicological information. This section contains information on the health effects of the material or its components. It typically supports the detail provided in the section on hazards identification in the SDS. The information provided is written for use by health care professionals and those that have the technical training and experience in the safety and toxicology aspects of interface with materials from a toxicological perspective.

However, this section of the SDS contains information that is used to establish the approach to control integral to NFPA 400 with respect to toxicity and corrosivity. Data including the effects of acute exposure to mammals and other life forms or information regarding the irreversible destruction of tissue at the site of contact will be found in this section of the SDS.

There could be other information regarding the toxicological effects resulting in, but not limited to, irritation, sensitization, carcinogenicity, reproductive effects, and genetic and target organ effects, none of which fall under the scope of NFPA 400.

B.6.2.7 Transportation. Section 14 of the SDS lists the system of classification used by the Department of Transportation (DOT) to classify materials for shipment purposes, which is not compatible with the system used to classify materials within the

context of NFPA 400. With the alignment to the United Nations *Globally Harmonized System of Classification and Labeling of Chemicals (GHS)*, it must be recognized that OSHA's system of hazard communication has now become harmonized with the system used by the DOT. OSHA's hazard communication system embodied in the SDS, correlates with the DOT regulations for transporting hazardous chemicals, located in 49 CFR. The OSHA system, contemplates that users and producers of hazardous materials will encounter these materials in their unpackaged state where the materials are reasonably foreseen to have a potential for bodily contact or use within the work environment on a regular basis. On the other hand, the DOT system of control views the materials in their final packaging as required for transportation where the materials are not subject to exposure to personnel except under upset conditions.

Because OSHA does not enforce the contents of Section 14 of the SDS, users can find additional information in the section for transportation on the SDS, which might or might not be further explained in preceding sections. It is important to recognize that the classification for the purposes of transportation will not suffice as a means to assign the material to a given hazard category under the requirements of NFPA 400, and the user must carefully apply the material specific definitions found in Chapter 3 along with the criteria obtained from the SDS and other resources to determine the appropriate classification of a given material.

Annex C Hazardous Materials Management Plans and Hazardous Materials Inventory Statements

This annex is not a part of the requirements of this NFPA document unless specifically adopted by the authority having jurisdiction.

C.1 Scope. Hazardous materials inventory statements (HMIS) and hazardous materials management plans (HMMP), which are required by the AHJ pursuant to Chapter 1, must be provided for hazardous materials in accordance with Annex C.

Exception No. 1: Materials that have been satisfactorily demonstrated not to present a potential danger to public health, safety, or welfare, based upon the quantity or condition of storage, when approved.

Exception No. 2: Chromium, copper, lead, nickel, and silver need not be considered hazardous materials for the purposes of this annex unless they are stored in a friable, powdered, or finely divided state. Proprietary and trade secret information must be protected under the laws of the state or AHJ.

C.2 Hazardous Materials Inventory Statements (HMIS).

C.2.1 Where Required. A separate HMIS must be provided for each building, including its appurtenant structures, and each exterior facility in which hazardous materials are stored. The hazardous materials inventory statement must list by hazard class all hazardous materials stored. The hazardous materials inventory statement must include the following information for each hazardous material listed:

- (1) Hazard class
- (2) Common or trade name
- (3) Chemical name, major constituents, and concentrations if a mixture; if a waste, the waste category
- (4) Chemical Abstracts Service Registry number (CAS number), which can be found in the SDS
- (5) Whether the material is pure or a mixture, and whether the material is a solid, liquid, or gas
- (6) Maximum aggregate quantity stored at any one time

- (7) Storage conditions related to the storage type, temperature, and pressure

C.2.2 Changes to HMIS. An amended HMIS must be provided within 30 days of the storage of any hazardous materials that changes or adds a hazard class or that is sufficient in quantity to cause an increase in the quantity which exceeds 5 percent for any hazard class.

C.3 Hazardous Materials Management Plan (HMMP).

C.3.1 General. Applications for a permit to store hazardous materials must include an HMMP standard form or short form in accordance with C.3.3 and must provide a narrative description of the operations and processes taking place at the facility. (See Figure C.3.1.)

C.3.2 Information Required. The HMMP standard form must include the following information.

C.3.2.1 General Information. General information, including business name and address, emergency contacts, business activity, business owner or operator, SIC code, number of employees and hours, Dunn and Bradstreet number, and signature of owner, operator, or designated representative must be included.

C.3.2.2 General Site Plan. A general site plan drawn at a legible scale which must include, but not be limited to, the location of buildings, exterior storage facilities, permanent access ways, evacuation routes, parking lots, internal roads, chemical loading areas, equipment cleaning areas, storm and sanitary sewer accesses, emergency equipment, and adjacent property uses must be included. The exterior storage areas must be identified with the hazard class and the maximum quantities per hazard class of hazardous materials stored. When required by the AHJ, information regarding the location of wells, flood plains, earthquake faults, surface water bodies, and general land uses within 1 mi (1.6 km) of the facility boundaries must be included.

C.3.2.3 Building Floor Plan. A building floor plan drawn to a legible scale, which must include, but not be limited to, hazardous materials storage areas within the building and must indicate rooms, doorways, corridors, means of egress and evacuation routes must be included. Each hazardous materials storage facility must be identified by a map key that lists the individual hazardous materials, their hazard class, and quantity present for each area.

C.3.2.4 Hazardous Materials Handling. Information showing that activities involving the handling of hazardous materials between the storage areas and manufacturing processes on site are conducted in a manner to prevent the accidental release of such materials must be included.

C.3.2.5 Chemical Compatibility and Separation. Information showing procedures, controls, signs, or other methods used to ensure separation and protection of stored materials from factors that could cause accidental ignition or reaction of ignitable, reactive, or incompatible materials in each area must be included.

C.3.2.6 Monitoring Program. Information including, but not limited to, the location, type, manufacturer's specifications, if applicable, and suitability of monitoring methods for each storage facility when required must be included.

C.3.2.7 Inspection and Record Keeping. Schedules and procedures for inspecting safety and monitoring and emergency equipment must be included. The permittee must develop and follow a written inspection procedure acceptable to the AHJ for inspecting the facility for events or practices that could lead to unauthorized discharges of hazardous materials. Inspections must be conducted at a frequency appropriate to detect problems prior to a discharge. An inspection check sheet must be developed to be used in conjunction with routine inspections. The check sheet must provide for the date, time, and location of inspection; note problems and dates and times of corrective actions taken; and include the name of the inspector and the countersignature of the designated safety manager for the facility.

C.3.2.8 Employee Training. A training program appropriate to the types and quantities of materials stored or used must be conducted to prepare employees to safely handle hazardous materials on a daily basis and during emergencies. The training program must include the following:

- (1) Instruction in safe storage and handling of hazardous materials, including maintenance of monitoring records
- (2) Instruction in emergency procedures for leaks, spills, fires or explosions, including shutdown of operations and evacuation procedures
- (3) Record-keeping procedures for documenting training given to employees

C.3.2.9 Emergency Response. A description of facility emergency procedures must be provided.

C.3.3 HMMP Short Form (Minimal Storage Site). A facility must qualify as a minimal storage site if the quantity of each hazardous material stored in one or more facilities in an aggregate quantity for the facility is 500 lb (227 kg) or less for solids, 55 gal (208.2 L) or less for liquids, or 200 ft³ (5.7 m³) or less at NTP for compressed gases and does not exceed the threshold planning quantity as listed in 40 CFR 355, "Emergency Planning and Notification," Sections 302 and 304. The applicant for a permit for a facility that qualifies as a minimal storage site must be permitted to file the short form HMMP. Such plan must include the following components:

- (1) General facility information
- (2) A simple line drawing of the facility showing the location of storage facilities and indicating the hazard class or classes and physical state of the hazardous materials being stored
- (3) Information describing that the hazardous materials will be stored and handled in a safe manner and will be appropriately contained, separated, and monitored
- (4) Assurance that security precautions have been taken, employees have been appropriately trained to handle the hazardous materials and react to emergency situations, adequate labeling and warning signs are posted, adequate emergency equipment is maintained, and the disposal of hazardous materials will be in an appropriate manner

C.4 Maintenance of Records. Hazardous materials inventory statements and hazardous materials management plans must be maintained by the permittee for a period of not less than three (3) years after submittal of updated or revised versions. Such records must be made available to the AHJ upon request.

SAMPLE FORMAT OF HAZARDOUS MATERIALS MANAGEMENT PLAN (HMMP) INSTRUCTIONS

SECTION I — FACILITY DESCRIPTION

1.1 Part A

1. Fill out Items 1 through 11 and sign the declaration.
2. Only Part A of this section is required to be updated and submitted annually, or within 30 days of a change.

1.2 Part B—General Facility Description (Site Plan)

1. Provide a site plan on 8½ in. by 11 in. (215 mm by 279 mm) paper, using letters on the top and bottom margins and numbers on the right and left side margins, showing the location of all buildings, structures, chemical loading areas, parking lots, internal roads, storm and sanitary sewers, wells, and adjacent property uses.
2. Indicate the approximate scale, northern direction, and date the drawing was completed.
3. List all special land uses within 1 mi (1.609 km).

1.3 Part C—Facility Storage Map (Confidential Information)

1. Provide a floor plan of each building on 8½ in. by 11 in. (215 mm by 279 mm) paper, using letters on the top and bottom margins and numbers on the right and left side margins, with approximate scale and northern direction, showing the location of each storage area. Mark map clearly “Confidential—Do Not Disclose” for trade-secret information as specified by federal, state, and local laws.
2. Identify each storage area with an identification number, letter, name, or symbol.
3. Show the following:
 - (a) Accesses to each storage area.
 - (b) Location of emergency equipment.
 - (c) The general purpose of other areas within the facility.
 - (d) Location of all aboveground and underground tanks to include sumps, vaults, below-grade treatment systems, piping, etc.
4. Provide the following on the map or in a map key or legend for each storage area:
 - (a) A list of hazardous materials, including wastes
 - (b) Hazard class of each hazardous waste
 - (c) The maximum quantity for hazardous materials
 - (d) The contents and capacity limit of all tanks at each area and indicate whether they are above or below ground
5. List separately any radioactives, cryogenics, and compressed gases for each facility.
6. Trade-secret information shall be listed as specified by federal, state, and local laws.

SECTION II — HAZARDOUS MATERIALS INVENTORY STATEMENT (HMIS)

2.1 Part A—Declaration

Fill out all appropriate information.

2.2 Part B—Inventory Statement

1. You must complete a separate inventory statement for all waste and nonwaste hazardous materials. List all hazardous materials in alphabetical order by hazard class.
2. Inventory Statement Instructions.

Column	Information Required
1	Provide hazard class for each material.
2	Nonwaste. Provide the common or trade name of the regulated material. Waste. In lieu of trade names, you may provide the waste category.
3	Provide the chemical name and major constituents and concentrations, if a mixture.
4	Enter the chemical abstracts service registry number (CAS number) found in the MSDS. For mixtures, enter the CAS number of the mixture as a whole if it has been assigned a number distinct from its constituents. For a mixture that has no CAS number, leave this item blank.
5	Enter the following descriptive codes as they apply to each material. You may list more than one code, if applicable. P = Pure M = Mixture S = Solid L = Liquid G = Gas
6	Provide the maximum aggregate quantity of each material handled at any one time by the business. For underground tanks, list the maximum volume [in gallons (liters)] of the tank. Enter the estimated average daily amount on site during the past year.
7	Enter the units used in Column 6 as: lb = Pounds gal = Gallons cf = Cubic Feet
8	Enter the number of days that the material was present on site (during the last year).

▲ FIGURE C.3.1 Sample Format of Hazardous Materials Management Plan (HMMP) Instructions.

Column	Information Required	SECTION III—SEPARATION AND MONITORING
9	Enter the storage codes below for type, temperature, and pressure:	3.1 Part A—Aboveground Fill out Items 1 through 6, or provide similar information for each storage area shown on the facility map. Use additional sheets as necessary.
	Type A = Aboveground Tank B = Belowground Tank C = Tank Inside Building D = Steel Drum E = Plastic or Nonmetallic Drum F = Can G = Carboy H = Silo I = Fiber Drum J = Bag K = Box L = Cylinder M = Glass Bottle or Jug N = Plastic Bottles or Jugs O = Tote Bin P = Tank Wagon Q = Rail Car R = Other	3.2 Part B—Underground 1. Complete a separate page for each underground tank, sump, vault, belowgrade treatment system, etc. 2. Check the type of tank and method(s) that applies to your tank(s) and piping, and answer the appropriate questions. Provide any additional information in the space provided or on a separate sheet.
	Temperature 4 = Ambient 5 = Greater than Ambient 6 = Less than Ambient, but not Cryogenic [less than -150°F (-101.1°C)] 7 = Cryogenic conditions [less than -150°F (-101.1°C)]	SECTION IV—WASTE DISPOSAL Check all that apply and list the associated wastes for each method checked.
	Pressure 1 = Ambient (Atmospheric) 2 = Greater than Ambient (Atmospheric) 3 = Less than Ambient (Atmospheric)	SECTION V—RECORD KEEPING Include a brief description of your inspection procedures. You are also required to keep an inspection log and recordable discharge log, which are designed to be used in conjunction with routine inspections for all storage facilities or areas. Place a check in each box that describes your forms. If you do not use the sample forms, provide copies of your forms for review and approval.
10	For each material listed, provide the SARA Title III hazard class as listed below. You may list more than one class. These categories are defined in 40 CFR 370.66.	SECTION VI—EMERGENCY RESPONSE PLAN 1. This plan should describe the personnel, procedures, and equipment available for responding to a release or threatened release of hazardous materials that are stored, handled, or used on site. 2. A check or a response under each item indicates that a specific procedure is followed at the facility, or that the equipment specified is maintained on site. 3. If the facility maintains a more detailed emergency response plan on site, indicate this in Item 5. This plan shall be made available for review by the inspecting jurisdiction.
	Physical Hazard F = Fire P = Sudden Release of Pressure R = Reactivity	SECTION VII—EMERGENCY RESPONSE TRAINING PLAN 1. This plan should describe the basic training plan used at the facility. 2. A check in the appropriate box indicates the training is provided or the records are maintained. 3. If the facility maintains a more detailed emergency response training plan, indicate this in Item 4. This plan shall be made available for review by the inspecting jurisdiction.
	Health Hazard I = Immediate (Acute) D = Delayed (Chronic)	
11	Waste Only. For each waste, provide the total estimated amount of hazardous waste handled throughout the course of the year.	

▲ FIGURE C.3.1 *Continued*

**HAZARDOUS MATERIALS MANAGEMENT PLAN
SECTION I: FACILITY DESCRIPTION**

Part A — General Information

1. Business Name: _____ Phone: _____

Address: _____

2. Person Responsible for the Business:

Name	Title	Phone
_____	_____	_____

3. Emergency Contacts:

Name	Title	Home Number	Work Number
_____	_____	_____	_____
_____	_____	_____	_____
_____	_____	_____	_____

4. Person Responsible for the Application/Principal Contact:

Name	Title	Phone
_____	_____	_____

5. Property Owner:

Name	Address	Phone
_____	_____	_____

6. Principal Business Activity: _____

7. Number of Employees: _____

8. Number of Shifts: _____

9. Hours of Operation: _____

10. SIC Code: _____

11. Dunn and Bradstreet Number: _____

12. Declaration:

I certify that the information above and on the following parts is true and correct to the best of my knowledge.

Signature: _____ Date: _____

Print Name: _____ Title: _____

(Must be signed by owner/operator or designated representative)

Part B — General Facility Description/Site Plan

(Use grid format in Part C)

Special land uses within 1 mi (1.609 km): _____

▲ FIGURE C.3.1 *Continued*

SECTION I: FACILITY DESCRIPTION (Continued)

Part C— Facility Map
(Use grid format below)

	A	B	C	D	E	F	G	H	I	J	K	L	M	N	
1															1
2															2
3															3
4															4
5															5
6															6
7															7
8															8
9															9
10															10
11															11
12															12
13															13
14															14
15															15
16															16
17															17
	A	B	C	D	E	F	G	H	I	J	K	L	M	N	
BUSINESS NAME											DATE				
ADDRESS											CITY				
											PAGE ____ OF ____				

SECTION II: HAZARDOUS MATERIALS INVENTORY STATEMENT

Part A—Declaration

1. Business Name: _____
2. Address: _____
3. Declaration:
Under penalty of perjury, I declare the above and subsequent information, provided as part of the hazardous materials inventory statement, is true and correct.

Signature: _____ Date: _____

Print Name: _____ Title: _____

(Must be signed by owner / operator or designated representative)

▲ FIGURE C.3.1 *Continued*

SECTION II: HAZARDOUS MATERIALS INVENTORY STATEMENT *(Continued)*

Part B—Hazardous Materials Inventory Statement

(1) Hazard Class	(2) Common/Trade Name	(3) Chemical Name, Components and Concentration	(4) Chemical Abstract Service No.	(5) Physical State

(6) Maximum Quantity on Hand at Any Time	(7) Units	(8) Days on Site	(9) Storage Code (Type, Pressure, Temperature)	(10) SARA Class	(11) Annual Waste Throughput

SECTION III: SEPARATION, SECONDARY CONTAINMENT, AND MONITORING

Part A—Aboveground Storage Areas

Storage Area Identification (as shown on facility map): _____

1. Storage Type:

- | | |
|---|--|
| <input type="checkbox"/> Original containers | <input type="checkbox"/> Safety cans |
| <input type="checkbox"/> Inside machinery | <input type="checkbox"/> Bulk tanks |
| <input type="checkbox"/> 55 gal (208.2 L) drums or storage shed | <input type="checkbox"/> Outside barrels |
| <input type="checkbox"/> Pressurized vessel | <input type="checkbox"/> Other: _____ |

2. Storage Location:

- | | |
|--|---|
| <input type="checkbox"/> Inside building | <input type="checkbox"/> Outside building |
| <input type="checkbox"/> Secured | |

3. Separation:

- | | |
|--|---|
| <input type="checkbox"/> All materials | <input type="checkbox"/> One-hour separation wall/partition |
| <input type="checkbox"/> Compatible | <input type="checkbox"/> Approved cabinets |
| <input type="checkbox"/> Separation by 20 ft (6.1 m) | <input type="checkbox"/> Other: _____ |

▲ FIGURE C.3.1 *Continued*

SECTION III: SEPARATION, SECONDARY CONTAINMENT, AND MONITORING *(Continued)*

4. Secondary Containment:

- | | |
|---|---|
| <input type="checkbox"/> Approved cabinet | <input type="checkbox"/> Secondary drums |
| <input type="checkbox"/> Tray | <input type="checkbox"/> Bermed, coated floor |
| <input type="checkbox"/> Vaulted tank | <input type="checkbox"/> Other: _____ |
| <input type="checkbox"/> Double-wall tank | _____ |

5. Monitoring:

- | | |
|-------------------------------------|---------------------------------------|
| <input type="checkbox"/> Visual | <input type="checkbox"/> Other: _____ |
| <input type="checkbox"/> Continuous | _____ |
| | Attach specifications if necessary |

6. Monitoring Frequency:

- | | |
|---------------------------------|---------------------------------------|
| <input type="checkbox"/> Daily | <input type="checkbox"/> Other: _____ |
| <input type="checkbox"/> Weekly | _____ |
| | Attach additional sheets as necessary |

Part B—Underground

Single-Wall Tanks and Piping

Tank Area Identification (as shown on facility map): _____

1. Backfill vapor wells
 Model and manufacturer: _____
 Continuous or monthly testing: _____
2. Groundwater monitoring wells
3. Monthly precision tank test
4. Piping
 Monitoring method: _____
 Frequency: _____
5. Other: _____

Double-Wall Tanks and Piping

Tank Area Identification (as shown on facility map): _____

1. Method of monitoring the annular space: _____
2. Frequency: Continuous Daily Weekly Other: _____
3. List the type of secondary containment for piping: _____
4. List method of monitoring the secondary containment for piping: _____
5. Are there incompatible materials within the same vault? Yes No
 If yes, how is separate secondary containment provided? _____

Note: If you have continuous monitoring equipment, you shall maintain copies of all service and maintenance work. Such reports shall be made available for review on site, and shall be submitted to the fire prevention bureau upon request.

Attach additional sheets as necessary

SECTION IV: WASTE DISPOSAL

- | | |
|--|---|
| <input type="checkbox"/> Discharge to the Sanitary Sewer—
Wastes: _____ | <input type="checkbox"/> Pretreatment—
Wastes: _____ |
| _____ | _____ |
| <input type="checkbox"/> Licensed Waste Hauler—
Wastes: _____ | <input type="checkbox"/> Recycle—
Wastes: _____ |
| _____ | _____ |

▲ FIGURE C.3.1 *Continued*

SECTION IV: WASTE DISPOSAL *(Continued)*

- Other—
Describe method: _____
Wastes: _____
- No Waste

SECTION V: RECORD KEEPING

Description of our inspection program: _____

- We will use the attached sample forms in our inspection program.
 We will not use the sample forms. We have attached a copy of our own forms.

SECTION VI: EMERGENCY RESPONSE PLAN

1. In the event of an emergency, the following shall be notified:

A. On-Site Responders:

Name	Title	Phone
_____	_____	_____
_____	_____	_____

B. Method of Notification to Responder:

- Automatic alarm Verbal
 Manual alarm Other: _____
 Phone

C. Agency and Phone Number: _____

Fire Department: _____

State Office of Emergency: _____

Services: _____

Other: _____

2. Designated Local Emergency Medical Facility:

Name	Address	Phone (24 hours)
_____	_____	_____

3. Mitigation Equipment:

A. Monitoring Devices:

- Toxic or flammable gas detection
 Fluid detection
 Other: _____

B. Spill Containment:

- Absorbents Other: _____

C. Spill Control and Treatment

- Vapor scrubber Mechanical ventilation
 Pumps/vacuums Secondary containment
 Neutralizer Other: _____

▲ FIGURE C.3.1 *Continued*

SECTION VI: EMERGENCY RESPONSE PLAN *(Continued)*

4. Evacuation:

- Immediate area evacuation routes posted
 Entire building evacuation procedures developed
 Assembly areas preplanned
 Evacuation maps posted
 Other: _____

5. Supplemental hazardous materials emergency response plan on site

Location: _____
 Responsible person: _____
 Phone: _____

SECTION VII: EMERGENCY RESPONSE TRAINING PLAN

1. Person responsible for the emergency response training plan:

Name	Title	Phone
_____	_____	_____

2. Training Requirements:

A. All employees trained in the following as indicated:

- Procedures for internal alarm/notification
 Procedures for notification of external emergency response organizations
 Location and content of the emergency response plan

B. Chemical handlers are trained in the following as indicated:

- Safe methods for handling and storage of hazardous materials
 Proper use of personal protective equipment
 Locations and proper use of fire- and spill-control equipment
 Specific hazards of each chemical to which they may be exposed

C. Emergency response team members are trained in the following:

- Procedures for shutdown of operations
 Procedures for using, maintaining, and replacing facility emergency and monitoring equipment

3. The following records are maintained for all employees:

- Verification that training was completed by the employee
 Description of the type and amount of introductory and continuing training
 Documentation on and description of emergency response drills conducted at the facility

4. A more comprehensive and detailed emergency response training plan is maintained on site.

Location: _____
 Responsible person: _____
 Phone: _____

▲ FIGURE C.3.1 *Continued*

Annex D Security Information

This annex is not a part of the requirements of this NFPA document but is included for informational purposes only.

D.1 Security Plans.

D.2 Informational References Relevant to Security. The following documents or portions thereof are listed here as informational resources only. They are not a part of the requirements of this document.

- △ **D.2.1 American Chemistry Council.** “Responsible Care® Process Safety Code of Management Practices” and “Responsible Care® Security Code of Management Practices,” American Chemistry Council, 700 Second Street, NE, Washington, DC 20002, Phone: 202-249-7000, www.americanchemistry.com

This code is designed to help companies achieve continuous improvement in security performance using a risk-based approach to identify, assess, and address vulnerabilities, prevent or mitigate incidents, enhance training and response capabilities, and maintain and improve relationships with key stakeholders.

- D.2.2 American Institute of Chemical Engineers.** *Guidelines for Analyzing and Managing the Security Vulnerabilities of Fixed Chemical Sites*, June 2003, Center for Chemical Process Safety, American Institute of Chemical Engineers, 3 Park Avenue, New York, NY, 10016-5991, Phone: 1-800-242-4363, www.aiche.org

This publication demonstrates a process and tools for managing the security vulnerability of sites that produce and handle chemicals, petroleum products, pharmaceuticals, and related materials such as fertilizers and water treatment chemicals. The publication includes enterprise screening, site screening, protection analysis, security vulnerability assessment, and action planning and tracking.

D.2.3 American Petroleum Institute.

- D.2.3.1** API Recommended Practice 70, *Security for Offshore Oil and Natural Gas Operations*, American Petroleum Institute, 1220 L Street, NW, Washington, DC, 20005-4070. Phone: 1-800-854-7179; 303-397-7956 (local and international); www.api.org

This document is intended to assist the offshore oil and natural gas drilling and producing operators and contractors in assessing security needs during the performance of oil and natural gas operations. It includes information on security awareness, conducting security vulnerability assessments when warranted, and developing security plans for offshore facilities.

- △ **D.2.3.2** *Security Vulnerability Assessment for the Petroleum and Petrochemical Industries*, October 2004, American Petroleum Institute, 1220 L Street, NW, Washington, DC, 20005-4070. Phone: 1-800-854-7179; 303-397-7956 (local and international); www.api.org

The publication describes an approach for assessing security vulnerabilities that is widely applicable to the types of facilities operated by the industry and the security issues they face. The objective of conducting a security vulnerability assessment (SVA) is to identify security hazards, threats, and vulnerabilities facing a facility, and to evaluate the countermeasures to provide for the protection of the public, workers, national interests, the environment, and the company. With this information security risks can be assessed and strategies can be

formed to reduce vulnerabilities as required. SVA is a tool to assist management in making decisions on the need for countermeasures to address the threats and vulnerabilities.

- △ **D.2.3.3** *Security Guidance for the Petroleum and Petrochemical Industries*, April 2005, American Petroleum Institute, 1220 L Street, NW, Washington, DC, 20005-4070. Phone: 1-800-854-7179; 303-397-7956 (local and international); www.api.org

This document provides general security guidance and other reference data on applicable regulatory requirements, which can be tailored to meet the differing security needs of the petroleum industry. This security guidance is by necessity general in nature. It is intended to provide an overview of security issues in the petroleum industry and provide general guidance on effective policies and practices.

- D.2.4 Chlorine Institute.** *CI Pamphlet 155, The Security Management Plan for the Transportation and On-site Storage and Use of Chlorine Cylinders, Ton Containers and Cargo Tanks*, The Chlorine Institute, 1300 Wilson Boulevard, Arlington, VA 22209, Phone: 703-741-5760, www.chlorineinstitute.org

The Security Management Plan for the Transportation and On-Site Storage and Use of Chlorine Cylinders, Ton Containers and Cargo Tanks (the CI Cylinder, Ton and Cargo Tank Plan) contains mandatory actions on the part of the chlor-alkali industry to achieve greater chlorine security. Two critical elements of the CI Cylinder, Ton and Cargo Tank Plan include the implementation of baseline countermeasures and actions at higher threat levels. The implementation examples given are intended solely to stimulate thinking and offer helpful ideas on implementing the CI Cylinder, Ton and Cargo Tank Plan. They are in no way intended to establish a standard, legal obligation, or preferred option for any practice. Other approaches not described here may be just as effective, or even more effective, for a particular company. If a company so chooses, it may adopt any of these examples or may modify them to fit the company's unique situation.

D.2.5 Compressed Gas Association.

- D.2.5.1** CGA P-50—2005, *Site Security Standard*, 4221 Walney Road, 5th Floor, Chantilly, VA 20151, Phone: 703-788-2700, www.cganet.com

This publication provides guidance to the compressed gas industry for assessing security risks and identifying and implementing preventive security measures at fixed sites. It is intended as a resource to help managers at individual facilities make security decisions based on risk. The guide does not attempt to provide an all-inclusive list of security considerations for compressed gas companies nor does it address transportation security and security at customer sites.

- CGA P-51—2004, *Transportation Security Standard for the Compressed Gas Industry*, 4221 Walney Road, 5th Floor, Chantilly, VA 20151, Phone: 703-788-2700, www.cganet.com

This publication is intended for management personnel, transportation specialists, and all other personnel that are responsible for the safe and secure transportation of raw materials and products. It applies to both for-hire and private motor carriers. It contains tools and resources that are useful when assessing security issues related to the transportation of hazardous materials. It also provides guidance for compliance with the U.S. Department of Transportation (DOT) regulation

HM-232, Security Requirements for Offerors and Transporters of Hazardous Materials.

The implementation of the information in this publication will vary according to the compressed gas being distributed and the mode and route of transportation.

D.2.5.2 CGA P-52—2005, *Security Guidelines for Qualifying Customers Purchasing Compressed Gases*, 4221 Walney Road, 5th Floor, Chantilly, VA 20151, Phone: 703-788-2700, www.cganet.com

This document provides guidelines to the compressed gas industry for qualifying customers who purchase products considered at risk for illegal use.

Δ D.2.6 Federal Motor Carrier Association. *Guide to Developing an Effective Security Plan for the Highway Transportation of Hazardous Materials*, Federal Motor Carrier Safety Administration (FMCSA), U.S. Department of Transportation, 400 7th Street SW, Washington, DC 20590, Phone: 1-800-832-5660, www.fmcsa.dot.gov

The guide is designed to provide the hazardous materials industry with information to understand the nature of the threats against hazardous materials transportation, identify the vulnerabilities to those threats that exist in a facility, and address actions to reduce the vulnerabilities identified at a facility.

D.2.7 Institute of Makers of Explosives. Safety Library Publication No. 27 (SLP-27), *Security in Manufacturing, Transportation, Storage and Use of Commercial Explosives*, April 2012. Institute of Makers of Explosives, 1120 Nineteenth Street, NW, Suite 310, Washington, DC 20036, Phone: 202-429-9280, www.ime.org

SLP-27 presents security recommendations for commercial explosives operations in a regulation-style format. Appendices include a sample site security plan, vulnerability assessment, employee identification system, and recommendations for enhanced security when security risks have temporarily increased. Although occasional reference may be made to federal regulations, a deliberate effort was made to provide recommendations that do not simply repeat the regulations. Other IME publications should also be consulted for additional, detailed information that might be appropriate.

D.2.8 National Association of Chemical Distributors. NACD Responsible Distribution, "Code of Management Practice," National Association of Chemical Distributors, 1560 Wilson Boulevard, Arlington, VA 22209, Phone: 703-527-6223, www.nacd.com

Responsible Distribution Process (RDP) is designed to help companies achieve continuous improvement in security as well as in environmental, health, and safety performance using a risk-based approach to develop site and transportation security programs, select carriers based on security criteria, pre-qualify customers for certain security-sensitive chemicals, conduct a security vulnerability assessment, and undergo independent, third-party verification of management system.

D.2.9 National Fire Protection Association.

D.2.9.1 NFPA 601, *Standard for Security Services in Fire Loss Prevention*, National Fire Protection Association, 1 Batterymarch Park, Quincy, MA 02169-7471, Phone: 617-770-3000, www.nfpa.org

The requirements of this standard are intended to aid management in defining the requirements, duties, and training for individuals to perform security services to protect a property against fire loss.

D.2.9.2 NFPA 730, *Guide for Premises Security*, National Fire Protection Association, 1 Batterymarch Park, Quincy, MA 02169-7471, Phone: 617-770-3000, www.nfpa.org

This guide describes construction, protection, and occupancy features and practices, intended to reduce security vulnerabilities to life and of property.

D.2.9.3 NFPA 731, *Standard for the Installation of Electronic Premises Security*, National Fire Protection Association, 1 Batterymarch Park, Quincy, MA 02169-7471, Phone: 617-770-3000, www.nfpa.org

This standard covers the application, location, installation, performance, testing, and maintenance of physical security systems and their components.

D.2.10 Organic Peroxide Safety Division Society of the Plastics Industry, 202-974-5217, www.OPPSD.org

This organization provides the following information relative to organic peroxides:

- (1) Identification of the hazards of organic peroxides
- (2) Disposal information
- (3) Regulations
- (4) Safety and health information
- (5) Storage and handling information
- (6) Transportation information

Annex E Properties and Uses of Ammonium Nitrate and Fire-Fighting Procedures

This annex is not a part of the requirements of this NFPA document but is included for informational purposes only.

Δ E.1 Properties and Uses of Ammonium Nitrate. Ammonium nitrate (AN) (NH₄NO₃, CAS 6484-52-2) is used, handled, and stored in solid and liquid forms in various concentrations (*see Table E.1*). It is commercially produced by reacting nitric acid with ammonia and evaporating the resultant solution of AN to make a concentrated AN melt, which is then spray granulated in a prilling tower or pelletized or flaked by some other means. Prill-form AN is used in industrial applications, including explosives for mining, and in agricultural applications as fertilizer. Solid and liquid AN can be used undiluted or in mixtures. Pure AN is stable; however, under certain conditions, AN can become explosive. AN in undiluted or pure form has a higher degree of overall hazard than does AN mixed or blended with materials that can reduce the concentration. Contamination must be avoided so that an unstable, unintentional mixture does not result.

Most solid, liquid, and gaseous nitrates are oxidizers. AN is an oxidizer. AN is classed as an oxidizer by the U.S. Department of Transportation (DOT) and Pipeline and Hazardous Materials Safety Administration (PHMSA). Pure AN melts and meets the definition of an oxidizer that is not combustible in and of itself but accelerates the burning of combustible materials with which it comes into contact. The burning rate of technical-grade AN prill falls within the Class 2 oxidizer criteria in Annex G. The loss history of AN also indicates potential for unstable reactive hazard properties, uncontrolled decomposi-

tion, and/or detonation if subject to one or more of the following conditions:

- (1) Fire
- (2) Heating in a confined space
- (3) Localized heating potentially leading to development of high-temperature areas
- (4) Exposure to strong shock waves
- (5) Contamination with combustible materials, incompatible inorganic and organic substances that can result in sensitivity to explosion (*see 11.2.16.1.1 for examples*)
- (6) Low pH or acidic conditions

The requirements in Chapter 11 are intended to protect AN as an oxidizer with multiple physical hazards and to prevent AN from exhibiting unstable reactive physical hazard properties. With code compliance and proper precautions against fire and explosion, AN can be stored safely.

The physical hazards of pure AN are: capable of detonation with reported TNT equivalence between 25 and 45 percent, accelerated burning of combustibles, and self-sustaining decomposition. The health hazards of AN are toxic gaseous products of decomposition and fire off-gases: oxygen, ammonia, nitric acid, and nitrous oxide.

Factors influencing the risk of detonation of AN are the following:

- (1) Heating under confinement permitting high-pressure buildup
- (2) Strong shocks, such as those from an explosive

The sensitivity of AN to detonation increases with contamination and elevated temperatures. The likelihood of an explosion in a typical warehouse fire where AN is stored increases under the following conditions:

- (1) If molten AN can accumulate in large pools
- (2) If there is potential for confinement of molten AN, such as in drains, pits, sumps, sewers, or dead spaces in equipment
- (3) If there is potential for physical shock of the molten AN, such as high-velocity projectiles generated in a fire
- (4) If the AN is or becomes contaminated before or during a fire
- (5) If the temperature is in excess of 554°F (290°C) at atmospheric pressure and adiabatic conditions

Although AN can be contaminated before a fire, it can also become contaminated during a fire. Potential sources of contamination from the fire can include carbon black (creosote, asphalt, and soot), charcoal from combustible materials (wood, paper, pallets, organics, etc.), spilled diesel fuel, oils, plastics, polyethylene (from bags, etc.), aluminum, and copper.

AN as an oxidizer can support combustion even in the absence of atmospheric oxygen, such as in poorly ventilated structures. Molten AN is a powerful oxidizer capable of igniting some combustible materials with which it comes in contact and of reacting explosively with organic materials and finely divided metals. AN can undergo self-sustaining decomposition when exposed to elevated temperatures including exposure to fire. The rate of self-sustained decomposition can be increased by contamination. Contamination by carbon black; charcoal; finely divided metals (copper, iron, etc.); sulfur; or potash, which liberates chlorine as it decomposes, can catalyze the decomposition mechanism into a self-sustaining, internal exothermic reaction that will spread within a fertilizer pile

creating a zone of decomposition. This reaction can continue and spread through the entire fertilizer mass, even after the actual fire is suppressed.

AN melts at approximately 338°F (170°C). Temperatures between 374°F (190°C) and 446°F (230°C) are considered sufficient to initiate self-sustained decomposition for some mixtures and contaminated AN; however, some mixtures of AN fertilizer can undergo self-sustained decomposition at lower temperatures. A self-sustained decomposition cannot be controlled by smothering.

Typical solid and liquid AN products are listed in Table E.1.

AN is commonly blended with other fertilizer materials, such as diammonium phosphate, sulfate, and potash. Fertilizers containing less than 60 percent AN are not covered by this code. Fertilizer materials that contain AN are commonly described, not by their chemical composition, but by their plant nutrient (N-P-K) values. For example, agricultural-grade AN will appear in the market place with a guaranteed nitrogen content of 34-0-0. This means there is a guaranteed analysis of 34 percent total nitrogen, with 0 percent phosphate and 0 percent potassium. The theoretical maximum nitrogen content of pure or 100 percent AN is 35 percent by weight. The typical nitrogen content of AN fertilizers offered in the marketplace is usually between 28 and 34 percent. Other nutrients such as sulfates or phosphates, added hardening agents, coating agents, and residual water make up the balance.

If the total available nitrogen in an AN-based fertilizer comes from AN, the percentage of AN can be determined through the use of the following formula:

$$\% \text{ ammonium nitrate} = \frac{(\% \text{ total nitrogen listed in the fertilizer})}{0.35} \quad \text{[E.1]}$$

For example, if a fertilizer is indicated as being 30-0-0, then it contains $(30/0.35) = 85.7\%$ AN.

However, when some, but not all, of the nitrogen could come from other nitrogen compounds in the mixture, the percentage of nitrogen for each component containing nitrogen in the fertilizer mixture must first be determined. For example, a fertilizer product described as 28-0-0-5(S) has a guaranteed analysis of 28 percent total nitrogen, 0 percent phosphate, 0 percent potassium, and 5 percent sulfur. Whether the nitrogen is derived from AN or another nitrogen fertilizer source, it must be disclosed by the manufacturer to determine the hazard classification of the material. This type of information is usually found on the SDS provided by the manufacturer where the names of the material included in the mixture along with the concentration of each material is expressed. It is not unusual for a range of concentrations to be given on an SDS, and users are cautioned to assume the AN concentration to be at the top of the range.

By use of Equation E.1, AN fertilizers with a nitrogen content of less than 21 percent by weight derived from AN (60 percent AN) are not regulated by Chapter 11 (e.g., $(21/0.35) = 60\%$ AN).

For interstate shipments, the U.S. DOT classifies AN with not more than 0.2 percent total combustible material, including any organic substance, calculated as carbon to the exclusion of

any other added substance, as an oxidizer Division 5.1. AN with more than 0.2 percent combustible substances, including any organic substance calculated as carbon to the exclusion of any other added substance, as a Division 1.1D material. AN-based fertilizers can be classified as an oxidizer Division 5.1, or in some cases as a Division 9 material (miscellaneous hazardous material). (See U.S. DOT Transportation Regulations 49 CFR 172.101, "Purpose and Use of Hazardous Materials Table.")

The requirements for classification of AN as a Division 5.1 oxidizer by the DOT are described in the United Nations publication, *Recommendations on the Transport of Dangerous Goods, Model Regulations*. Such oxidizing materials can yield oxygen upon decomposition under fire conditions and will, therefore, under proper conditions of mixing, vigorously support combustion if involved in a fire with combustible materials.

AN in higher concentrations is capable of undergoing detonation with about half the blast effect of explosives, if heated under confinement that permits high-pressure buildup, or if subjected to strong shocks, such as those from an explosive. The sensitivity of AN to detonation increases at elevated temperatures. Additional information on the explosive nature of AN, including the degree of confinement along with the effect of certain inert diluents, such as chalk, limestone, dolomite, and so forth, can be found in U.S. Bureau of Mines Report of Investigations 4994, *Investigations on the Explosibility of Ammonium Nitrate*.

Industrial use of AN extends to use as an ingredient in blasting agents. When a carbonaceous or organic substance such as fuel (or diesel) oil, nut hulls, or carbon black is added and mixed in with AN, the mixture could become a blasting agent. A blasting agent as defined by NFPA 495 is a material or mixture that meets the requirements of the DOT *Hazardous Material Regulations*, as set forth in 49 CFR 173.56, "New Explosives — Definition and Procedures for Classification and Approval," 49 CFR 173.57, "Acceptance Criteria for New Explosives," and 49 CFR 173.58, "Assignment of Class and Division for New Explosives," Explosive 1.5D.

Test data on AN are included in the U.S. Bureau of Mines Report of Investigations 6746, *Sympathetic Detonation of Ammonium Nitrate and Ammonium Nitrate Fuel Oil*; Report of Investigations 6903, *Further Studies on Sympathetic Detonation*; and Report of Investigations 6773, *Explosion Hazards of Ammonium Nitrate Under Fire Exposure*. On the basis of these reports, a table of recommended separation distances of AN and blasting agents from explosives or blasting agents has been developed [see Table 9.4.2.2(b) of NFPA 495]. However, the table is only valid for AN and AN-based materials that are NOT DOT Hazard Class 1 sensitive. The table is only applicable to materials that show positive results in the UN Test Series 1 sensitivity and thermal stability tests and negative results in the UN Test Series 2 gap tests. Products that show positive results when tested in the UN Test Series 1 and 2 tests could potentially be classified as having a mass explosion hazard. NFPA 495 requires that Hazard Class 1 materials be stored in accordance with the requirements for high explosives (Division 1.1) under the quantity-distance requirements of SLP 2, "American Table of Distances (ATD)," developed by the Institute of Makers of Explosives (IME) and published in NFPA 495.

The maximum quantities of material indicated by the ATD are limited to quantities less than what might be found on sites where large amounts of AN or AN mixtures might be found. The Department of Defense Explosives Safety Board

(DODESB) currently uses software called SAFER along with tables of distance methods to assess DOD potential explosives sites. The IME, in collaboration with the DODESB, APT Research, and Canadian and U.S. regulatory agencies, has developed a software called IMESAFR. The software incorporates risk-based methodology to address the impact of siting for explosives and explosive operations. Provisions for AN are included using an approach and distances based on TNT equivalency.

While blasting agents should not be confused with fertilizer products, extreme care should be taken to ensure that stored AN does not become sensitized by intimate mixing with carbonaceous, organic, or combustible material.

E.2 Suggested Fire-Fighting Procedure. Pre-incident planning by the fire department and/or emergency management officials should be developed for every AN storage facility and include when to evacuate. The pre-incident planning and emergency response should account for toxic AN gaseous products of decomposition, fire effluents, and potential for explosions. Pre-incident plans should account for emission of toxic gases from fires involving AN and plume travel depending on wind direction.

Only incipient fires in an area where AN is stored or in vehicles transporting AN should be attacked using manual fire-extinguishing methods (fire extinguishers, hose streams, etc.) that require a human operator. Fire fighters, emergency responders, and/or facility personnel should withdraw to a safe distance and allow a structure or vehicle to burn to completion if a fire in an area where AN is stored or in vehicles transporting AN progresses beyond the incipient stage or should a fire break out in an area where AN is stored, or in a vehicle transporting AN. When evacuation is deemed necessary, fire-fighting personnel should immediately evacuate the area within 1 mile (1609 m) (or as determined by the Emergency Action Plan) in all directions.

Water is the only satisfactory extinguishing material for fires involving AN. It is important that the mass be kept cool and the burning be promptly extinguished. Large volumes of water should be applied as quickly as possible. This is best accomplished by automatic fire-extinguishing systems and not the use of manual suppression means (fire hoses, master streams, etc.) that require fire fighter actions. Normally, ventilation and the application of water, including automatic sprinklers, can quickly desensitize and stabilize the hot AN material. Firewater should be contained and prevented from leaving the site and entering streams, lakes, and rivers.

After extinguishment of the fire, the loose and contaminated unsalvageable AN should be disposed of according to federal, state, and local environmental agencies' acceptable practices or regulations. Any residue that cannot be removed by sweeping should be washed away; contaminated water from flushing must be disposed of. Flushing and scrubbing of all areas should be very thorough to ensure the dissolving of all residue. Wet empty bags should be removed, and disposed of in accordance with federal, state, and local regulations.

Remediation of a site involving AN should be conducted by someone trained on the hazards of AN and a HAZMAT technician-level responder or qualified third-party responder. Any contaminated material should be properly disposed of by dilution. Any wood exposed to AN should be properly disposed. Any porous material should be treated with special care

△ Table E.1 Typical Solid and Liquid AN Products

Composition	Common Description	AN content	Typical Nitrogen (N) Content	Combustible Material (maximum)	UN No. (Division)
AN (high-density prill)	Fertilizer grade	> 99%	34%	0.20%	1942 (5.1)
AN (low-density prill)	Industrial grade	> 99%	34%	0.20%	1942 (5.1)
AN-based NPK capable of SSD (note 1)	Compound fertilizers	45–70%	16–25%	0.40%	2071 (9)
AN-based NPK capable of SSD (note 1)	Compound fertilizers	0–45%	< 16%	unrestricted	2071(9)
AN-based NPK not capable of SSD	Compound fertilizers	45–70%	16–25%	0.40%	1942 (5.1)
AN-based NPK not capable of SSD	Compound fertilizers	0–45%	< 16%	unrestricted	N/A
AN liquid – hot concentrated solution		≥ 80%	≥28%	N/A	2426 (5.1)
AN liquid		<80%	<28%	N/A	N/A

Notes:

(1) Some compound (NPK or NK) fertilizers can exhibit the self-sustaining decomposition (SSD) property by the UN Trough Test S.1. Where not capable of SSD, the oxidizing classification (i.e., Division 5.1) might take precedence.

(2) N=Nitrogen, P=Phosphorus, K=Potassium, N/A=Not Applicable.

(3) U.S. Department of Transportation 49 CFR 172.101 uses the UN identification methods.

because of the potential to re-ignite after the material has dried. Metal surfaces if in contact with the residues of AN should be thoroughly cleaned with water to prevent corrosion.

△ E.3 Ammonium Nitrate Resources. References that discuss the production of AN include *Nitric Acid and Fertilizer Nitrates* and *The Fertilizer Manual*.

Guidance for storage can be found in the following references:

- (1) EPA 550-F-15-001, *Chemical Advisory: Safe Storage, Handling, and Management of Solid Ammonium Nitrate Prills*, U.S. Environmental Protection Agency (EPA), Occupational Safety and Health Administration (OSHA), and Bureau of Alcohol, Tobacco, Firearms, and Explosives (ATF), June 2015.
- (2) “Guidance for the Storage, Handling and Transportation of Solid Mineral Fertilisers,” European Fertilizers Manufacturers’ Association, 2007. www.fertilizerseurope.com.
- (3) HSE INDG230, “Storing and Handling Ammonium Nitrate,” Health and Safety Executive, 1996. <http://www.hse.gov.uk/explosives/ammonium>.

Test data on AN is included in the following references:

- (1) Oxley, J., J. Smith, E. Rogers, and M. Yu, “Ammonium nitrate: thermal stability and explosivity modifiers,” *Thermochimica Acta* 384 (2002): 23–45.
- (2) Report of Investigations 6903, *Further Studies on Sympathetic Detonation*, U.S. Bureau of Mines, 1966.
- (3) Report of Investigations 6773, *Explosion Hazards of Ammonium Nitrate Under Fire Exposure*, U.S. Bureau of Mines, 1966.
- (4) Report of Investigations 6746, *Sympathetic Detonation of Ammonium Nitrate and Ammonium Nitrate Fuel Oil*, U.S. Bureau of Mines, 1966.

Information on safety and security for AN can be found in “Safety and Security Guidelines for Ammonium Nitrate,” International Association of Fire Chiefs Association (IAFC); Institute of Makers of Explosives (IME); and National Stone, Sand, and

Gravel Association (NSSGA), December 2013. https://www.osha.gov/chemicalexecutiveorder/an_guidelines_IAFC-IME-NSSGA-ISEE.pdf.

Annex F Typical Organic Peroxide Formulations

This annex is not a part of the requirements of this NFPA document but is included for informational purposes only.

△ F.1 General. The assignment of the organic peroxide formulation classifications shown in the tables in this annex are based on the container sizes shown. A change in the container size could affect the classification. The information in this annex was collected from the Organic Peroxides Producers (Plastics Industry Association — Organic Peroxide Producers Safety Division). The most current version of the information can be found at plasticsindustry.org/oppsd.

For an alphabetical listing of typical organic peroxide formulations, see Table F.1.

F.2 Class I Formulations.

F.2.1 Fire Hazard Characteristics. Class I formulations present a deflagration hazard through easily initiated, rapid explosive decomposition. Large-scale burn rates greater than or equal to 661 lb/min (300 kg/min) can be expected. Class I includes some formulations that are relatively safe only under closely controlled temperatures. Both excessively high and excessively low temperatures can increase the potential for severe explosive decomposition and/or rapid burning.

F.2.2 Fire-Fighting Information. The immediate area should be evacuated and the fire should be fought from a remote location. Some damage to structures from overpressure can be expected should a deflagration occur.

△ F.2.3 Typical Class I Formulations. See Table F.2.3.

Table F.1 Organic Peroxide Formulations

Organic Peroxide Formulation	CAS Number	Concentration	Diluent ^c	Recommended Maximum Temperatures ^a		Hazard Identification NFPA 704 Ratings ^b			Storage Class	Max. Quantity per Container	Subsidiary Risks and Remarks ^d	
				Water	°C/°F	°C/°F	Health	Flammability				Instability
ACETYL ACETONE PEROXIDE	37187-22-7	≤ 42	A ≥ 48	≥ 8			2	1	3	III	16 gal (60 L)	2
ACETYL ACETONE PEROXIDE ACETYL CYCLOHEXANESULPHONYL PEROXIDE	37187-22-7	≤ 32 as a paste					2	NE	3	III	110 lb (50 kg)	20
ACETYL CYCLOHEXANESULPHONYL PEROXIDE	3179-56-4	≤ 82		≥ 12	-10/14	0/32	3	NE	4	I	55 lb (25 kg)**	3
ACETYL CYCLOHEXANESULPHONYL PEROXIDE	3179-56-4	≤ 32	B ≥ 68		-1/14	0/32	3	4	3	III	16 gal (60 L) 60 gal (225 L)	
t-AMYL HYDROPEROXIDE	3425-61-4	≤ 88	A ≥ 6	≥ 6			3	2	2	IIA	16 gal (60 L)	
t-AMYL PEROXYACETATE	690-83-5	≤ 62	A ≥ 38				3	2	3	IIA	16 gal (60 L)	
t-AMYL PEROXYBENZOATE	4511-39-1	≤ 100					2	2	3	IIA	16 gal (60 L)	
t-AMYL PEROXY-2- ETHYLHEXANOATE	686-31-7	≤ 100			20/68	25/77	2	2	3	IIA	16 gal (60 L)	
t-AMYL PEROXY-2-ETHYLHEXYL CARBONATE	70833-40-8	≤ 100					1	2	3	IIA	16 gal (60 L)	
t-AMYL PEROXY ISOPROPYL CARBONATE	2372-22-7	≤ 77	A ≥ 23				NE	2	3	I	16 gal (60 L)**	
t-AMYL PEROXYNEODECANOATE	68299-16-1	≤ 77	B ≥ 23		0/32	10/50	1	2	3	IIA	16 gal (60 L)	
t-AMYL PEROXYNEODECANOATE	68299-16-1	≤ 47	A ≥ 53		0/32	10/50	1	2	1	III	IBC tank	
t-AMYL PEROXYPIVALATE	29240-17-3	≤ 77	B ≥ 23		10/50	15/59	2	2	3	IIA	16 gal (60 L)	
t-AMYL PEROXY-3,5,5- TRIMETHYLHEXANOATE	68860-54-8	≤ 100					2	2	4	I	16 gal (60 L) 60 gal (225 L)	
t-BUTYL CUMYL PEROXIDE	3457-61-2	> 42 – 100					2	2	2	III	440 lb (200 kg)	
t-BUTYL CUMYL PEROXIDE n-BUTYL-4,4-DI-(t-BUTYLPEROXY) VALERATE	3457-61-2	≤ 52	Inert solid ≥ 48				2	NE	2	III	16 gal (60 L)**	
t-BUTYL CUMYL PEROXIDE n-BUTYL-4,4-DI-(t-BUTYLPEROXY) VALERATE	995-33-5	> 52 – 100	Inert solid ≥ 48				1	2	3	IIA	440 lb (200 kg)	
t-BUTYL CUMYL PEROXIDE n-BUTYL-4,4-DI-(t-BUTYLPEROXY) VALERATE	995-33-5	≤ 52					1	NE	2	III	16 gal (60 L)**	
t-BUTYL HYDROPEROXIDE ^e	75-91-2	> 79 – 90		≥ 10			3	3	3	I	60 gal (225 L)	13
t-BUTYL HYDROPEROXIDE ^e	75-91-2	≤ 80	A ≥ 20				3	NE	3	IIA	16 gal (60 L) 60 gal (225 L)	4, 13
t-BUTYL HYDROPEROXIDE ^e	75-91-2	≤ 79		> 14			3	NE	2	IIB	IBC tank/ tank truck	13, 23
t-BUTYL HYDROPEROXIDE ^e	75-91-2	≤ 72		≥ 28			3	2	1	III	16 gal (60 L)**	13, 32
t-BUTYL HYDROPEROXIDE ^e +DI-t-BUTYLPEROXIDE	75-91-2	< 82 + > 9		≥ 7			3	4	3	I	16 gal (60 L)**	13
t-BUTYL MONOPEROXYMALEATE	1931-62-0	> 52 – 100					3	2	4	I	55 lb (25) kg**	3
t-BUTYL MONOPEROXYMALEATE	1931-62-0	≤ 52	A ≥ 48				3	NE	3	IIB	16 gal (60 L)**	
t-BUTYL MONOPEROXYMALEATE	1931-62-0	≤ 52	Inert solid ≥ 48				3	NE	2	IIB	440 lb (200 kg)	
t-BUTYL MONOPEROXYMALEATE	1931-62-0	≤ 52 as a paste					3	2	2	IIB	440 lb (200 kg)	
t-BUTYL PEROXYACETATE	107-71-1	> 52 – 77	A ≥ 23				2	2	4	I	8 gal (30 L)**	3
t-BUTYL PEROXYACETATE	107-71-1	> 32 – 52	A ≥ 48				2	2	3	IIA	16 gal (60 L)**	
t-BUTYL PEROXYACETATE	107-71-1	≤ 32	B ≥ 68				2	2	1	III	IBC tank	
t-BUTYL PEROXYBENZOATE	614-45-9	> 77 – 100					2	1	3	IIA	16 gal (60 L)**	
t-BUTYL PEROXYBENZOATE	614-45-9	> 52 – 77	A ≥ 23				2	2	3	IIA	16 gal (60 L) 110 lb (50 kg)	
t-BUTYL PEROXYBENZOATE t-BUTYL PEROXYBUTYL FUMARATE	614-45-9	≤ 52	Inert solid ≥ 48				2	NE	3	IIB	16 gal (60 L)	
t-BUTYL PEROXYBENZOATE t-BUTYL PEROXYBUTYL FUMARATE	23474-91-1	≤ 77	A ≥ 23				2	2	3	IIA	16 gal (60 L)	
t-BUTYL PEROXYDIETHYLACETATE	2550-33-6	≤ 100			20/68	25/77	3	2	3	IIA	16 gal (60 L)**	
t-BUTYL PEROXY-2- ETHYLHEXANOATE	3006-82-4	> 52 – 100			20/68	25/77	1	2	3	IIA	16 gal (60 L)**	
t-BUTYL PEROXY-2- ETHYLHEXANOATE	3006-82-4	> 32 – 52	B ≥ 48		30/86	35/95	1	2	2	III	60 gal (225 L)	
t-BUTYL PEROXY-2- ETHYLHEXANOATE	3006-82-4	≤ 52	Inert solid ≥ 48		20/68	25/77	1	NE	2	IIB	440 lb (200 kg)	
t-BUTYL PEROXY-2- ETHYLHEXANOATE	3006-82-4	≤ 32	B ≥ 68		40/104	45/113	1	2	1	III	IBC tank	

(continues)

Table F.1 Continued

Organic Peroxide Formulation	CAS Number	Concentration	Diluent ^c	Water	Recommended Maximum Temperatures ^a		Hazard Identification NFPA 704 Ratings ^b			Storage Class	Max. Quantity per Container	Subsidiary Risks and Remarks ^d	
					Control	Emergency	Health	Flammability	Instability				
													°C/°F
#BUTYL PEROXY-2-ETHYLHEXANOATE + 2,2-DI-(#BUTYLPEROXY) BUTANE	3006-82-4 and 2167-23-9	≤ 12 + ≤ 14	A ≥ 14; Inert solid ≥ 60					1	NE	3	III	110 lb (50 kg)	
#BUTYL PEROXY-2-ETHYLHEXANOATE + 2,2-DI-(#BUTYLPEROXY) BUTANE	3006-82-4 and 2167-23-9	≤ 31 + ≤ 36	B ≥ 33		35/95	40/104		1	NE	3	IIA	16 gal (60 L)	
#BUTYL PEROXY-2-ETHYLHEXYL CARBONATE	34443-12-4	≤ 100						1	1	3	IIA	16 gal (60 L)	
#BUTYL PEROXYISOBUTYRATE	109-13-7	> 52– 77	B ≥ 23		15/59	20/68		1	2	4	I	8 gal (30 L)**	3
#BUTYL PEROXYISOBUTYRATE	109-13-7	≤ 52	B ≥ 48		15/59	20/68		1	3	3	IIB	16 gal (60 L)	
#BUTYL PEROXY ISOPROPYL CARBONATE	2372-21-6	≤ 77	A ≥ 23					2	2	3	IIB	16 gal (60 L)**	
1-(2-#BUTYLPEROXY ISOPROPYL)-3-ISOPROPENYL BENZENE	96319-55-0	≤ 77	A ≥ 23					NE	NE	3	IIA	16 gal (60 L)	
1-(2-#BUTYLPEROXY ISOPROPYL)-3-ISOPROPENYL BENZENE	96319-55-0	≤ 42	Inert solid ≥ 58					NE	NE	2	IIB	440 lb (200 kg)	
#BUTYL PEROXY-2-METHYLBENZOATE	22313-62-8	≤ 100						3	4	3	I	16 gal (60 L)**	
#BUTYL PEROXYNEODECANOATE	26748-41-4	> 77 – 100			-5/23	5/41		2	3	3	IIA	16 gal (60 L)	
#BUTYL PEROXYNEODECANOATE	26748-41-4	≤ 77	B ≥ 23		0/32	10/50		2	2	3	IIA	16 gal (60 L)	
#BUTYL PEROXYNEODECANOATE	26748-41-4	≤ 52 as a stable dispersion in water			0/32	10/50		2	NE	1	IV	IBC tank	
#BUTYL PEROXYNEODECANOATE	26748-41-4	≤ 42 as a stable dispersion in water (frozen)			0/32	10/50		2	NE	2	IV	440 lb (200 kg)	
#BUTYL PEROXYNEODECANOATE	26748-41-4	≤ 32	A ≥ 68		0/32	10/50		2	NE	1	III	IBC tank	
#BUTYL PEROXYNEOHEPTANOATE	26748-38-9	≤ 77	A ≥ 23		0/32	10/50		1	2	3	IIA	16 gal (60 L)	
#BUTYL PEROXYNEOHEPTANOATE	26748-38-9	≤ 42 as a stable dispersion in water			0/32	10/50		1	NE	2	IV	60 gal (225 L)	
#BUTYL PEROXYPIVALATE	927-07-1	> 67 – 77	A ≥ 23		0/32	10/50		2	2	3	IIA	16 gal (60 L)**	
#BUTYL PEROXYPIVALATE	927-07-1	> 27 – 67	B ≥ 33		0/32	10/50		2	2	3	IIA	16 gal (60 L)	
#BUTYL PEROXYPIVALATE	927-07-1	≤ 27	B ≥ 73		30/86	35/95		2	2	1	III	IBC tank	
#BUTYL PEROXY STEARYLCARBONATE	62476-60-6	≤ 100						NE	NE	3	IIA	110 lb (50 kg)	
#BUTYL PEROXY-3,5,5-TRIMETHYL HEXANOATE	13122-18-4	> 37 – 100						2	1	3	IIA	16 gal (60 L)	
#BUTYL PEROXY-3,5,5-TRIMETHYL HEXANOATE	13122-18-4	≤ 42	Inert solid ≥ 58					1	2	1	III	110 lb (50 kg)	
#BUTYL PEROXY-3,5,5-TRIMETHYL HEXANOATE	13122-18-4	≤ 37	A > 63					2	2	1	III	IBC tank	
3-CHLOROPEROXYBENZOIC ACID	937-14-4	> 57 – 86	Inert solid ≥ 14					NE	NE	4	I	55 lb (25 kg)**	3
3-CHLOROPEROXYBENZOIC ACID	937-14-4	≤ 57	Inert solid ≥ 3	≥ 40				NE	NE	3	IIA	110 lb (50 kg)	
3-CHLOROPEROXYBENZOIC ACID	937-14-4	≤ 77	Inert solid ≥ 6	≥ 17				NE	NE	3	IIA	110 lb (50 kg)	
CUMYL HYDROPEROXIDE	80-15-9	> 90 – 98	A ≥ 10					3	1	2	III	60 gal (225 L)	13
CUMYL HYDROPEROXIDE	80-15-9	≤ 90	A ≥ 10					3	2	1	III	IBC tank	13, 18
CUMYL PEROXYNEODECANOATE	26748-47-0	≤ 87	A ≥ 13		-10/14	0/32		1	3	3	IIA	16 gal (60 L)	
CUMYL PEROXYNEODECANOATE	26748-47-0	≤ 77	B ≥ 23		-10/14	0/32		1	3	3	IIB	16 gal (60 L)	
CUMYL PEROXYNEODECANOATE	26748-47-0	≤ 52 as a stable dispersion in water			-10/14	0/32		1	NE	1	III	IBC tank	
CUMYL PEROXYNEOHEPTANOATE	104852-44-0	≤ 77	A ≥ 23		-10/14	0/32		1	3	3	IIA	16 gal (60 L)	
CUMYL PEROXYPIVALATE	23383-59-7	≤ 77	B ≥ 23		-5/23	5/41		NE	3	3	IIA	16 gal (60 L)	

(continues)

Table F.1 Continued

Organic Peroxide Formulation	CAS Number	Concentration	Diluent ^c	Water	Recommended Maximum Temperatures ^a		Hazard Identification NFPA 704 Ratings ^b			Storage Class	Max. Quantity per Container	Subsidiary Risks and Remarks ^d
					Control	Emergency	Health	Flammability	Instability			
CYCLOHEXANONE PEROXIDE(S)	12262-58-7	≤ 91		≥ 9			3	NE	3	I	110 lb (50 kg)**	13
CYCLOHEXANONE PEROXIDE(S)	12262-58-7	≤ 72	A ≥ 28				3	NE	3	IIB	16 gal (60 L)	5
CYCLOHEXANONE PEROXIDE(S)	12262-58-7	≤ 72 as a paste					3	NE	3	IIB	110 lb (50 kg)	5, 20
CYCLOHEXANONE PEROXIDE(S)	12262-58-7	≤ 32	Inert solid ≥ 68				3	NE	0	V	Exempt	29
DIACETONE ALCOHOL PEROXIDES	54693-46-8	≤ 57	B ≥ 26	≥ 8	40/104	45/113	NE	NE	3	IIB	16 gal (60 L)	6
DIACETYL PEROXIDE	110-22-5	≤ 27	B ≥ 73		20/68	25/77	1	2	3	IIB	16 gal (60 L) 60 gal (225 L)	7, 13
DI- <i>t</i> -AMYL PEROXIDE	10508-09-5	≤ 100					2	4	2	IIB		
2,2-DI-(<i>t</i> -AMYLPEROXY) BUTANE	13653-62-8	≤ 57	A ≥ 43				1	3	3	IIA	16 gal (60 L)	
1,1-DI-(<i>t</i> -AMYLPEROXY) CYCLOHEXANE	15667-10-4	≤ 82	A ≥ 18				1	2	3	IIA	16 gal (60 L)**	
DIBENZOYL PEROXIDE	94-36-0	> 52 – 100	Inert solid ≤ 48				2	4	4	I	55 lb (25 kg)**	3
DIBENZOYL PEROXIDE	94-36-0	> 77 – 94		≥ 6			2	4	4	I	55 lb (25 kg)**	3
DIBENZOYL PEROXIDE	94-36-0	≤ 77		≥ 23			2	2	3	IIB	110 lb (50 kg)**	
DIBENZOYL PEROXIDE	94-36-0	≤ 62	Inert solid ≥ 28	≥ 10	T ^f		2	NE	3	IIB	110 lb (50 kg)	
DIBENZOYL PEROXIDE	94-36-0	> 52 – 62 as a paste			T ^f		2	2	3	IIB	110 lb (50 kg)	20
DIBENZOYL PEROXIDE	94-36-0	> 35 – 52	Inert solid ≥ 48				2	2	3	IIB	110 lb (50 kg)	
DIBENZOYL PEROXIDE	94-36-0	> 36 – 42	A ≥ 18	≤ 40	T ^f		2	2	2	IIB	60 gal (225 L)	
DIBENZOYL PEROXIDE	94-36-0	≤ 56.5 as a paste		≥ 15	T ^f		2	2	2	IIB	440 lb (200 kg)	
DIBENZOYL PEROXIDE	94-36-0	≤ 52 as a paste ≤ 42 as a stable dispersion in water			T ^f		2	2	2	IIB	440 lb (200 kg)	20
DIBENZOYL PEROXIDE	94-36-0	≤ 35	Inert solid ≥ 65				2	2	1	III	IBC tank	
DIBENZOYL PEROXIDE	94-36-0	≤ 35					2	2	0	V	Exempt	29
DI-(4- <i>t</i> -BUTYL)CYCLOHEXYL) PEROXYDICARBONATE	15520-11-3	≤ 100			30/86	35/95	1	2	3	I	110 lb (50 kg)**	
DI-(4- <i>t</i> -BUTYL)CYCLOHEXYL) PEROXYDICARBONATE	15520-11-3	≤ 42 as a stable dispersion in water			30/86	35/95	1	2	1	IV	IBC tank	
DI- <i>t</i> -BUTYL PEROXIDE ^c	110-05-4	> 52 – 100					1	4	2	IIA	60 gal (225 L)	
DI- <i>t</i> -BUTYL PEROXIDE	110-05-4	≤ 52	B ≥ 48				1	4	1	III	IBC tank	25
DI- <i>t</i> -BUTYL PEROXYAZELATE	16580-06-6	≤ 52	A ≥ 48				NE	2	3	IIB	16 gal (60 L)	
2,2-DI-(<i>t</i> -BUTYLPEROXY)BUTANE	2167-23-9	≤ 52	A ≥ 48				1	2	3	IIB	16 gal (60 L)	
1,6-DI-(<i>t</i> -BUTYLPEROXY CARBONYLOXY) HEXANE		≤ 72	A ≥ 28				NE	NE	3	I	16 gal (60 L)**	
1,1-DI-(<i>t</i> -BUTYLPEROXY) CYCLOHEXANE	3006-86-8	> 80 – 100					1	2	4	I	8 gal (30 L)**	3
1,1-DI-(<i>t</i> -BUTYLPEROXY) CYCLOHEXANE	3006-86-8	≤ 72	B ≥ 28				1	2	3	IIA	16 gal (60 L)**	30
1,1-DI-(<i>t</i> -BUTYLPEROXY) CYCLOHEXANE	3006-86-8	> 52 – 80	A ≥ 20				1	2	3	IIA	16 gal (60 L)**	
1,1-DI-(<i>t</i> -BUTYLPEROXY) CYCLOHEXANE	3006-86-8	> 42 – 52	A ≥ 48				1	2	3	IIA	16 gal (60 L)	
1,1-DI-(<i>t</i> -BUTYLPEROXY) CYCLOHEXANE	3006-86-8	≤ 42	A ≥ 13	≥ 45			1	NE	3	III	110 lb (50 kg)	
1,1-DI-(<i>t</i> -BUTYLPEROXY) CYCLOHEXANE	3006-86-8	≤ 42	A ≥ 58				1	2	1	III	IBC tank	
1,1-DI-(<i>t</i> -BUTYLPEROXY) CYCLOHEXANE	3006-86-8	≤ 27	A ≥ 25				1	1	2	III	60 gal (225 L)	21
1,1-DI-(<i>t</i> -BUTYLPEROXY) CYCLOHEXANE	3006-86-8	≤ 13	A ≥ 13; B ≥ 74				1	NE	1	III	IBC tank	
1,1-DI-(<i>t</i> -BUTYLPEROXY)-CYCLOHEXANE + <i>t</i> -BUTYL PEROXY-2-ETHYL HEXANOATE	3006-86-8 and 3006-82-4	≤ 43 + ≤ 16	A ≥ 41				1	2	3	IIA	16 gal (60 L)	
DI- <i>n</i> -BUTYL PEROXYDICARBONATE	16215-49-9	> 27 – 52	B ≥ 48		-15/5	-5/23	1	NE	3	IIB	16 gal (60 L)	
DI- <i>n</i> -BUTYL PEROXYDICARBONATE	16215-49-9	≤ 42 as a stable dispersion in water (frozen)			-15/5	-5/23	1	NE	2	IV	440 lb (200 kg)	

(continues)

Table F.1 Continued

Organic Peroxide Formulation	CAS Number	Concentration	Diluent ^c	Water	Recommended Maximum Temperatures ^a		Hazard Identification NFPA 704 Ratings ^b			Storage Class	Max. Quantity per Container	Subsidiary Risks and Remarks ^d
					Control	Emergency	Health	Flammability	Instability			
DI- <i>n</i> -BUTYL PEROXYDICARBONATE	16215-49-9	≤ 27	B ≥ 73		-10/14	0/32	1	NE	2	III	60 gal (225 L)	
DI- <i>sec</i> -BUTYL PEROXYDICARBONATE	19910-65-7	> 52 – 100			-20/-4	-10/14	1	4	3	I	16 gal (60 L)**	
DI- <i>tert</i> -BUTYL PEROXYDICARBONATE	19910-65-7	≤ 52	B ≥ 48		-15/5	-5/23	1	4	3	IIA	16 gal (60 L)	
DI-(<i>n</i> -BUTYLPEROXYISOPROPYL) BENZENE(S)	25155-25-3	> 42 – 100	Inert solid ≥ 57				1	1	3	IIB	110 lb (50 kg)	
DI-(<i>n</i> -BUTYLPEROXYISOPROPYL) BENZENE(S)	25155-25-3	≤ 42	Inert solid ≥ 58				1	1	0	V	Exempt	29
DI-(<i>n</i> -BUTYLPEROXY) PHTHALATE	15042-77-0	> 42 – 52	A ≥ 48				NE	2	3	IIB	16 gal (60 L)	
DI-(<i>n</i> -BUTYLPEROXY) PHTHALATE	15042-77-0	≤ 52 as a paste					NE	NE	3	IIB	110 lb (50 kg)	20
DI-(<i>n</i> -BUTYLPEROXY) PHTHALATE	15042-77-0	≤ 42	A ≥ 58				NE	1	2	IIB	60 gal (225 L)	
2,2-DI-(<i>n</i> -BUTYLPEROXY)PROPANE	2167-23-9	≤ 52	A ≥ 48 A ≥ 13; Inert solid ≥ 45				NE	2	3	IIB	16 gal (60 L)	
2,2-DI-(<i>n</i> -BUTYLPEROXY)PROPANE	2167-23-9	≤ 42					NE	NE	3	III	110 lb (50 kg)	
1,1-DI-(<i>n</i> -BUTYLPEROXY)-3,3,5-TRIMETHYLCYCLOHEXANE	6731-36-8	> 90 – 100					1	2	4	I	8 gal (30 L)**	3
1,1-DI-(<i>n</i> -BUTYLPEROXY)-3,3,5-TRIMETHYLCYCLOHEXANE	6731-36-8	≤ 90	B ≥ 10				1	2	4	IIA	16 gal (60 L)**	30
1,1-DI-(<i>n</i> -BUTYLPEROXY)-3,3,5-TRIMETHYLCYCLOHEXANE	6731-36-8	> 57 – 90	A ≥ 10				1	2	3	IIA	60 gal (225 L)**	
1,1-DI-(<i>n</i> -BUTYLPEROXY)-3,3,5-TRIMETHYLCYCLOHEXANE	6731-36-8	≤ 77	B ≥ 23				1	NE	3	IIA	16 gal (60 L)**	
1,1-DI-(<i>n</i> -BUTYLPEROXY)-3,3,5-TRIMETHYLCYCLOHEXANE	6731-36-8	≤ 57	Inert solid ≥ 43				1	2	1	III	IBC type 60 gal (225 L)	
1,1-DI-(<i>n</i> -BUTYLPEROXY)-3,3,5-TRIMETHYLCYCLOHEXANE	6731-36-8	≤ 57	A ≥ 43				1	NE	2	IIB	60 gal (225 L)	
1,1-DI-(<i>n</i> -BUTYLPEROXY)-3,3,5-TRIMETHYLCYCLOHEXANE	6731-36-8	≤ 32	A ≥ 26; B ≥ 42				1	4	2	IIB	60 gal (225 L)	
DICETYL PEROXYDICARBONATE	26322-14-5	≤ 100 ≤ 42 as a stable dispersion in water			30/86	35/95	1	2	3	III	110 lb (50 kg)	
DICETYL PEROXYDICARBONATE	26322-14-5				30/86	35/95	1	2	1	IV	IBC tank 55 lb (25 kg)**	3
DI-4-CHLOROBENZOYL PEROXIDE	94-17-7	≤ 77		≥ 23			NE	NE	4	I	110 lb (50 kg)**	20
DI-4-CHLOROBENZOYL PEROXIDE	94-17-7	≤ 52 as a paste					NE	NE	3	IIB	55 lb (25 kg)**	29
DI-4-CHLOROBENZOYL PEROXIDE	94-17-7	≤ 32	Inert solid ≥ 68				NE	NE	0	V	Exempt	12
DICUMYL PEROXIDE	80-43-3	> 52 – 100					1	1	1	III	IBC type	
DICUMYL PEROXIDE	80-43-3	≤ 52	Inert solid ≥ 48				1	NE	0	V	Exempt	29
DICYCLOHEXYL PEROXYDICARBONATE	1561-49-5	> 91 – 100			10/50	15/59	NE	NE	4	I	55 lb (25 kg)**	3
DICYCLOHEXYL PEROXYDICARBONATE	1561-49-5	≤ 91 ≤ 42 as a stable dispersion in water		≥ 9	10/50	15/59	NE	NE	3	IIA	110 lb (50 kg)**	
DICYCLOHEXYL PEROXYDICARBONATE	1561-49-5				15/59	20/68	NE	NE	1	IV	IBC tank 110 lb (50 kg)**	
DIDECANOYL PEROXIDE	762-12-9	≤ 100			30/86	35/95	1	NE	3	IIB	110 lb (50 kg)**	
2,2-DI-(4,4-DI-(<i>n</i> -BUTYLPEROXY)CYCLOHEXYL)PROPANE	1705-60-8	≤ 42	Inert solid ≥ 58				1	NE	3	III	110 lb (50 kg)	
2,2-DI-(4,4-DI-(<i>n</i> -BUTYLPEROXY)CYCLOHEXYL)PROPANE	1705-60-8	≤ 22	B ≥ 78				1	NE	2	III	60 gal (225 L)	
DI-2,4-DICHLOROBENZOYL PEROXIDE	133-14-2	≤ 77		≥ 23			1	NE	4	I	55 lb (25 kg)**	3
DI-2,4-DICHLOROBENZOYL PEROXIDE	133-14-2	≤ 52 as a paste ≤ 52 as a paste with silicon oil			20/68	25/77	1	2	2	IIB	440 lb (200 kg)	
DI-2,4-DICHLOROBENZOYL PEROXIDE	133-14-2				T ^f		1	2	3	IIB	110 lb (50 kg)	
DI-(2-ETHOXYETHYL) PEROXYDICARBONATE		≤ 52	B ≥ 48		-10/14	0/32	NE	NE	3	IIA	16 gal (60 L)	
DI-(2-ETHYLHEXYL) PEROXYDICARBONATE	16111-62-9	> 77 – 100			-20/-4	-10/14	2	4	3	IIA	16 gal (60 L)**	
DI-(2-ETHYLHEXYL) PEROXYDICARBONATE	16111-62-9	≤ 77 ≤ 62 as a stable dispersion in water	B ≥ 23		-15/5	-5/23	2	4	3	IIB	16 gal (60 L)	
DI-(2-ETHYLHEXYL) PEROXYDICARBONATE	16111-62-9				-15/5	-5/23	2	NE	2	III	IBC tank	

(continues)

Table F.1 Continued

Organic Peroxide Formulation	CAS Number	Concentration	Diluent ^c	Recommended Maximum Temperatures ^a		Hazard Identification NFPA 704 Ratings ^b			Storage Class	Max. Quantity per Container	Subsidiary Risks and Remarks ^d	
				Water	°C/°F	°C/°F	Health	Flammability				Instability
DI-(2-ETHYLHEXYL) PEROXYDICARBONATE	16111-62-9	≤ 52 as a stable dispersion in water (frozen)	Inert solid		-15/5	-5/23	2	NE	1	IV	IBC type 55 lb (25 kg)**	3
2,2-DIHYDROPEROXYPROPANE	2614-76-8	≤ 27	≥ 73				NE	NE	4	I	110 lb (50 kg)	
DI-(1-HYDROXYCYCLOHEXYL) PEROXIDE	2407-94-5	≤ 100					NE	NE	3	IIB	8 gal (30 L)**	
DIISOBUTYRYL PEROXIDE	3437-84-1	> 32 – 52	B ≥ 48		-20/-4	-10/14	3	4	4	I	16 gal (60 L)	3
DIISOBUTYRYL PEROXIDE	3437-84-1	≤ 32	B ≥ 68		-20/-4	-10/14	3	NE	3	IIB	110 lb (50 kg)	
DIISOPROPYLBENZENE DIHYDROPEROXIDE		≤ 82	A ≥ 5	≥ 5			NE	NE	3	IIB	55 lb (25 kg)**	24
DIISOPROPYL PEROXYDICARBONATE	105-64-6	> 52 – 100			-15/5	-5/23	3	4	4	I	16 gal (60 L)	3
DIISOPROPYL PEROXYDICARBONATE	105-64-6	≤ 52	B ≥ 48		-20/-4	-10/14	3	NE	3	IIB	110 lb (50 kg)	
DIISOPROPYL PEROXYDICARBONATE	105-64-6	≤ 32	A ≥ 68		-15/5	-5/23	2	NE	3	IIB	16 gal (60 L)	
DILAULOYL PEROXIDE	105-74-8	≤ 100					1	2	3	IIB	110 lb (50 kg)	
DILAULOYL PEROXIDE	105-74-8	≤ 42 as a stable dispersion in water					1	NE	1	IV	IBC tank	
DI-(3-METHOXYBUTYL) PEROXYDICARBONATE	52238-68-3	≤ 52	B ≥ 48		-5/23	5/41	NE	NE	3	IIA	16 gal (60 L)	
DI-(2-METHYLBENZOYL) PEROXIDE	22313-62-8	≤ 87		≥ 13	30/86	35/95	3	NE	4	I	55 lb (25 kg)**	3
DI-(3-METHYLBENZOYL) PEROXIDE + BENZOYL (3-METHYLBENZOYL) PEROXIDE + DIBENZOYL PEROXIDE		≤ 20 + ≤ 18 + ≤ 4	B ≥ 58		35/95	40/104	NE	NE	3	IIA	16 gal (60 L)	
DI-(4-METHYLBENZOYL) PEROXIDE	895-85-2	≤ 52 as a paste with silicon oil					NE	NE	3	IIB	110 lb (50 kg)	
2,5-DIMETHYL-2,5-DI-(BENZOYLPEROXY)HEXANE	2618-77-1	> 82 – 100	Inert solid				1	2	4	I	55 lb (25 kg)**	3
2,5-DIMETHYL-2,5-DI-(BENZOYLPEROXY)HEXANE	2618-77-1	≤ 82	≥ 18				1	NE	3	IIA	110 lb (50 kg)	
2,5-DIMETHYL-2,5-DI-(BENZOYLPEROXY)HEXANE	2618-77-1	≤ 82		≥ 18			1	NE	3	IIB	110 lb (50 kg)**	
2,5-DIMETHYL-2,5-DI-(t-BUTYLPEROXY)HEXANE	78-63-7	> 90 – 100					2	2	3	IIB	16 gal (60 L)	
2,5-DIMETHYL-2,5-DI-(t-BUTYLPEROXY)HEXANE	78-63-7	> 52 – 90	A ≥ 10				2	2	3	IIB	440 lb (200 kg)	
2,5-DIMETHYL-2,5-DI-(t-BUTYLPEROXY)HEXANE	78-63-7	≤ 77	Inert solid	≥ 23			2	2	1	IIB	200 kg	
2,5-DIMETHYL-2,5-DI-(t-BUTYLPEROXY)HEXANE	78-63-7	≤ 52	A ≥ 48				2	2	1	III	IBC tank	
2,5-DIMETHYL-2,5-DI-(t-BUTYLPEROXY)HEXANE	78-63-7	≤ 47 as a paste					2	1	2	IIB	440 lb (200 kg)	
2,5-DIMETHYL-2,5-DI-(t-BUTYLPEROXY)HEXYNE-3	1068-27-5	> 86 – 100					1	2	4	I	8 gal (30 L)**	3
2,5-DIMETHYL-2,5-DI-(t-BUTYLPEROXY)HEXYNE-3	1068-27-5	> 52 – 86	A ≥ 14				1	2	3	IIA	16 gal (60 L)**	26
2,5-DIMETHYL-2,5-DI-(t-BUTYLPEROXY)HEXYNE-3	1068-27-5	≤ 52	Inert solid	≥ 48			1	NE	3	III	110 lb (50 kg)	
2,5-DIMETHYL-2,5-DI-(2-ETHYLHEXANOYLPEROXY)HEXANE	13052-09-0	≤ 100			20/68	25/77	2	2	3	IIA	16 gal (60 L)**	
2,5-DIMETHYL-2,5-DIHYDROPEROXYHEXANE	3025-88-5	≤ 82		≥ 18			3	2	3	IIA	110 lb (50 kg)**	
2,5-DIMETHYL-2,5-DI-(3,5-TRIMETHYLHEXANOYLPEROXY)HEXANE		≤ 77	A ≥ 23				NE	NE	3	IIA	16 gal (60 L)	
1,1-DIMETHYL-3-HYDROXYBUTYL PEROXYNEOHEPTANOATE	110972-57-1	≤ 52	A ≥ 48		0/32	10/50	NE	2	2	IIB	60 gal (225 L)	
DIMYRISTYL PEROXYDICARBONATE	53220-22-7	≤ 100			20/68	25/77	1	NE	3	IIB	110 lb (50 kg)	
DIMYRISTYL PEROXYDICARBONATE	53220-22-7	≤ 42 as a stable dispersion in water			20/68	25/77	1	NE	1	IV	IBC tank	
DI-(2-NEODECANOYL) PEROXYISOPROPYL) BENZENE	117663-11-3	≤ 52	A ≥ 48		-10/14	0/32	NE	NE	3	IIB	16 gal (60 L)	

(continues)

Table F.1 Continued

Organic Peroxide Formulation	CAS Number	Concentration	Diluent ^c	Water	Recommended Maximum Temperatures ^a		Hazard Identification NFPA 704 Ratings ^b			Storage Class	Max. Quantity per Container	Subsidiary Risks and Remarks ^d
					°C/°F	°C/°F	Health	Flammability	Instability			
DI- <i>n</i> -NONANOYL PEROXIDE	762-13-0	≤ 100			0/32	10/50	NE	NE	3	IIA	110 lb (50 kg)	
DI- <i>n</i> -OCTANOYL PEROXIDE	762-16-3	≤ 100			10/50	15/59	1	NE	3	IIA	110 lb (50 kg)**	
DI-(2-PHENOXYETHYL) PEROXYDICARBONATE	41935-39-1	>85 – 100					1	NE	4	I	55 lb (25 kg)**	3
DI-(2-PHENOXYETHYL) PEROXYDICARBONATE	41935-39-1	≤ 85		≥ 15			1	NE	3	IIA	110 lb (50 kg)	
DIPROPIONYL PEROXIDE	3248-28-0	≤ 27	B ≥ 73		15/59	20/68	NE	NE	2	III	60 gal (225 L)	
DI- <i>n</i> -PROPYL PEROXYDICARBONATE	16066-38-9	≤ 100			-25/-13	-15/5	2	4	3	I	16 gal (60 L)**	
DI- <i>n</i> -PROPYL PEROXYDICARBONATE	16066-38-9	≤ 77	B ≥ 23		-20/-4	-10/14	2	4	3	I	16 gal (60 L)**	
DISUCCINIC ACID PEROXIDE	123-23-9	> 72 – 100					3	NE	4	I	55 lb (25 kg)**	3, 17
DISUCCINIC ACID PEROXIDE	123-23-9	≤ 72		≥ 28	10/50	15/59	3	NE	3	IIIB	110 lb (50 kg)	
DI-(3,5,5-TRIMETHYLHEXANOYL) PEROXIDE	3851-87-4	> 38 – 82 ≤ 52 as a stable dispersion in water	A ≥ 18		0/32	10/50	2	2	3	IIA	16 gal (60 L)	
DI-(3,5,5-TRIMETHYLHEXANOYL) PEROXIDE	3851-87-4				10/50	15/59	2	2	1	III	IBC tank	
DI-(3,5,5-TRIMETHYLHEXANOYL) PEROXIDE	3851-87-4	≤ 38	A ≥ 62		20/68	25/77	2	NE	1	III	IBC tank	
ETHYL 3,3-DI-(<i>t</i> -AMYLPEROXY) BUTYRATE	67567-23-1	≤ 67	A ≥ 33				NE	2	3	IIA	16 gal (60 L)	
ETHYL 3,3-DI-(<i>t</i> -BUTYLPEROXY) BUTYRATE	55794-20-2	> 77 – 100					1	1	3	IIA	16 gal (60 L)**	
ETHYL 3,3-DI-(<i>t</i> -BUTYLPEROXY) BUTYRATE	55794-20-2	≤ 77	A ≥ 23				1	2	3	IIA	16 gal (60 L)	
ETHYL 3,3-DI-(<i>t</i> -BUTYLPEROXY) BUTYRATE	55794-20-2	≤ 52	Inert solid ≥ 48				1	NE	3	III	110 lb (50 kg)	
1-(2-ETHYLHEXANOYLPEROXY)-1,3-DIMETHYLBUTYL PEROXYPIVALATE	228415-62-1	≤ 52	A ≥ 45; B ≥ 10		-20/-4	-10/14	2	NE	3	IIA	16 gal (60 L)	
<i>t</i> -HEXYL PEROXYNEODECANOATE	62178-88-5	≤ 71	A ≥ 29		0/32	10/50	1	NE	3	IIA	16 gal (60 L)	
<i>t</i> -HEXYL PEROXYPIVALATE	51938-28-4	≤ 72	B ≥ 28		10/50	15/59	NE	NE	3	IIA	16 gal (60 L)	
3-HYDROXY-1,1-DIMETHYLBUTYL PEROXYNEODECANOATE	95718-78-8	≤ 77	A ≥ 23		-5/23	5/41	NE	3	3	IIA	16 gal (60 L)	
3-HYDROXY-1,1-DIMETHYLBUTYL PEROXYNEODECANOATE	95718-78-8	≤ 52	A ≥ 48		-5/23	5/41	NE	3	2	IIA	60 gal (225 L)	
3-HYDROXY-1,1-DIMETHYLBUTYL PEROXYNEODECANOATE	95718-78-8	≤ 52 as a stable dispersion in water			-5/23	5/41	NE	3	1	IV	IBC tank	
ISOPROPYL <i>sec</i> -BUTYL PEROXYDICARBONATE + DI- <i>sec</i> -BUTYL PEROXYDICARBONATE + DI-ISOPROPYL PEROXYDICARBONATE		≤ 32 + ≤ 15 – 18 ≤ 12 – 15	A ≥ 38		-20/-4	-10/14	2	NE	3	IIA	16 gal (60 L)	
ISOPROPYL <i>sec</i> -BUTYL PEROXYDICARBONATE + DI- <i>sec</i> -BUTYL PEROXYDICARBONATE + DI-ISOPROPYL PEROXYDICARBONATE		≤ 52 + ≤ 28 + ≤ 22			-20/-4	-10/14	2	4	4	I	8 gal (30 L)**	3
ISOPROPYL CUMYL HYDROPEROXIDE	26762-93-6	≤ 72	A ≥ 28				3	2	1	III	IBC tank	13
<i>p</i> -MENTHYL HYDROPEROXIDE	26762-92-5	> 72 – 100					3	2	3	IIA	16 gal (60 L)	13
<i>p</i> -MENTHYL HYDROPEROXIDE	26762-92-5	≤ 72	A ≥ 28				3	2	1	III	IBC tank	27
METHYLCYCLOHEXANONE PEROXIDE(S)		≤ 67	B ≥ 33		35/95	40/104	NE	NE	3	IIA	16 gal (60 L)	
METHYL ETHYL KETONE PEROXIDE(S)	1338-23-4	See Remark 8.	A ≥ 48				3	NE	4	I	8 gal (30 L)**	3, 8, 13
METHYL ETHYL KETONE PEROXIDE(S)	1338-23-4	See Remark 9.	A ≥ 55				3	2	3	IIA	16 gal (60 L)	9
METHYL ETHYL KETONE PEROXIDE(S)	1338-23-4	See Remark 10.	A ≥ 60				3	2	2	III	60 gal (225 L)	10
METHYL ISOBUTYL KETONE PEROXIDE(S)	37206-20-5	≤ 62	A ≥ 19				NE	2	3	IIA	16 gal (60 L)	22
METHYL ISOPROPYL KETONE PEROXIDE(S)	33373-82-7	See Remark 31.	A ≥ 70				NE	NE	1	III	IBC tank	31
ORGANIC PEROXIDE, LIQUID, SAMPLE							NE	NE	NE	IIA	16 gal (60 L)**	11

(continues)

△ Table F.1 Continued

Organic Peroxide Formulation	CAS Number	Concentration	Diluent ^c	Water	Recommended Maximum Temperatures ^a		Hazard Identification NFPA 704 Ratings ^b			Storage Class	Max. Quantity per Container	Subsidiary Risks and Remarks ^d
					Control	Emergency	Health	Flammability	Instability			
ORGANIC PEROXIDE, LIQUID, SAMPLE, TEMPERATURE CONTROLLED							NE	NE	NE	IIA	16 gal (60 L)**	11
ORGANIC PEROXIDE, SOLID, SAMPLE							NE	NE	NE	IIA	110 lb (50 kg)**	11
ORGANIC PEROXIDE, SOLID, SAMPLE, TEMPERATURE CONTROLLED							NE	NE	NE	IIA	110 lb (50 kg)**	11
3,3,5,7,7-PENTAMETHYL-1,2,4-TRIOXEPANE	215877-64-8	≤ 100					2	2	2	IIA	60 gal (225 L)	
PEROXYACETIC ACID, TYPE D, stabilized	79-21-0	≤ 43					NE	NE	3	IIA	16 gal (60 L)	13, 14, 19
PEROXYACETIC ACID, TYPE E, stabilized	79-21-0	≤ 43					NE	NE	2	III	60 gal (225 L)	13, 15, 19
PEROXYACETIC ACID, TYPE F, stabilized	79-21-0	≤ 43					NE	NE	1	IV	IBC tank 440 lb (200 kg)	13, 16, 19
PEROXYLAURIC ACID	2388-12-7	≤ 100			35/95	40/104	NE	NE	2	IIA	440 lb (200 kg)	
PINANYL HYDROPEROXIDE	28324-52-9	> 56 – 100					NE	NE	3	IIA	16 gal (60 L)	13
PINANYL HYDROPEROXIDE	28324-52-9	≤ 56	A ≥ 44				NE	NE	1	III	IBC tank	
POLYETHER POLY- <i>t</i> -BUTYLPEROXY CARBONATE	Proprietary	≤ 52	B ≥ 48				NE	4	2	IIA	60 gal (225 L)	
1,1,3,3-TETRAMETHYLBUTYL HYDROPEROXIDE	5809-08-5	≤ 100					3	2	3	IIA	16 gal (60 L)	
1,1,3,3-TETRAMETHYLBUTYL PEROXY-2 ETHYL-HEXANOATE	22288-43-3	≤ 100			15/59	20/68	NE	3	3	IIA	16 gal (60 L)	
1,1,3,3-TETRAMETHYLBUTYL PEROXYNEODECANOATE	51240-95-0	≤ 72 ≤ 52 as a stable dispersion in water	B ≥ 28		-5/23	5/41	1	3	3	IIA	16 gal (60 L)	
1,1,3,3-TETRAMETHYLBUTYL PEROXYNEODECANOATE	51240-95-0				-5/23	5/41	1	3	1	III	IBC tank	
1,1,3,3-TETRAMETHYLBUTYL PEROXYPIVALATE	22288-41-1	≤ 77	A ≥ 23		0/32	10/50	2	4	3	IIA	16 gal (60 L)	
3,6,9-TRIETHYL-3,6,9-TRIMETHYL-1,4,7-TRIPEROXONANE	24748-23-0	≤ 42	A ≥ 58				2	2	3	IIA	16 gal (60 L)	28

**Depending on package used for tests.

^aThese columns refer to temperatures in the Department of Transportation (DOT) Organic Peroxides Table. (See 49 CFR 173.225 for more information.)

The emergency temperature is the temperature at which, due to imminent danger, emergency measures must be initiated.

^bThe column refers to NFPA 704 hazard ratings for health, flammability, and instability. (See NFPA 704 for more information.)

^cType A diluents are organic liquids which are compatible with the organic peroxide and which have a boiling point of not less than 302°F (150°C).

Type A diluents can be used for desensitizing all organic peroxides.

Type B diluents are organic liquids which are compatible with the organic peroxide and which have a boiling point of less than 302°F (150°C) but not less than 140°F (60°C) and a flash point of not less than 41°F (5°C). Type B diluents can be used for desensitizing of all organic peroxides providing that the boiling point is at least 108°F (60°C) higher than the SADT in a 110 lb (50 kg) package.

^dSee Table F.8.

^eSee NFPA 30 for additional storage requirements.

^f — Temperature control should be considered to reduce fire hazard depending on packaging size and recommendations in manufacturers' literature.

F.3 Class IIA Formulations.

F.3.1 Fire-Hazard Characteristics. Class IIA formulations present a severe fire hazard similar to Class IA flammable liquids. The decomposition is not as rapid or violent as that produced by Class I organic peroxide formulations. As with Class I formulations, this class includes some formulations that are relatively safe when under controlled temperatures or when diluted. Many of the formulations in this class might require controlled temperatures or might contain diluents to maintain their safety and stability.

F.3.2 Fire-Fighting Information. Fires should be fought from a safe distance because a hazard exists from rupturing containers.

△ F.3.3 Typical Class IIA Formulations. See Table F.3.3.

F.4 Class IIB Formulations.

F.4.1 Fire-Hazard Characteristics. Class IIB formulations present a severe fire hazard similar to Class IIA flammable liquids. The decomposition is not as rapid or violent as that produced by Class IIA organic peroxide formulations. As with Class IIA formulations, this class includes some formulations that are relatively safe when under controlled temperatures or when diluted. Many of the formulations in this class might require controlled temperature or might contain diluents to maintain their safety and stability.

F.4.2 Fire-Fighting Information. Fires should be fought from a safe distance because a hazard exists from rupturing containers.

N F.4.3 Typical Class IIB Formulations. See Table F.4.3.

Table F.2.3 Typical Class I Formulations

Organic Peroxide Formulation	CAS Number	Concentration	Diluent	Water	Recommended Maximum Temperatures ^a		Hazard Identification NFPA 704 Ratings ^b			Storage Class	Max. Quantity per Container	Subsidiary Risks and Remarks ^c
					Control	Emergency	Health	Flammability	Instability			
					°C/°F	°C/°F						
ACETYL CYCLOHEXANESULPHONYL PEROXIDE	3179-56-4	≤ 82		≥ 12	-10/14	0/32				I	55 lb (25 kg)**	3
<i>t</i> -AMYL PEROXY ISOPROPYL CARBONATE	2372-22-7	≤ 77	A ≥ 23				3	NE	4	I	16 gal (60 L)**	
<i>t</i> -AMYL PEROXY-3,5,5-TRIMETHYL HEXANOATE	68860-54-8	≤ 100					NE	2	3	I	16 gal (60 L)	
<i>t</i> -BUTYL HYDROPEROXIDE ^d	75-91-2	> 79–90		≥ 10			2	2	4	I	16 gal (60 L)	13
<i>t</i> -BUTYL HYDROPEROXIDE + DI- <i>t</i> -BUTYL PEROXIDE	75-91-2	< 82 + > 9		≥ 7			3	4	3	I	16 gal (60 L)**	13
<i>t</i> -BUTYL MONOPEROXYMALEATE	1931-62-0	> 52–100					3	2	4	I	55 lb (25 kg)**	3
<i>t</i> -BUTYL PEROXYACETATE	107-71-1	> 52–77	A ≥ 23				2	2	4	I	8 gal (30 L)**	3
<i>t</i> -BUTYL PEROXYISOBUTYRATE	109-13-7	> 52–77	B ≥ 23		15/59	20/68	1	2	4	I	8 gal (30 L)**	3
<i>t</i> -BUTYL PEROXY-2-METHYLBENZOATE	22313-62-8	≤ 100								I	16 gal (60 L)**	
3-CHLOROPEROXYBENZOIC ACID	937-14-4	> 57–86	Inert solid ≥ 14				3	4	3	I	55 lb (25 kg)**	3
CYCLOHEXANONE PEROXIDE(S)	12262-58-7	≤ 91		≥ 9			NE	NE	4	I	110 lb (50 kg)**	13
DIBENZOYL PEROXIDE	94-36-0	> 52–100	Inert solid ≥ 48				3	NE	3	I	55 lb (25 kg)**	3
DIBENZOYL PEROXIDE	94-36-0	> 77–94		≥ 6			2	4	4	I	55 lb (25 kg)**	3
DI-(4- <i>t</i> -BUTYLCYCLOHEXYL) PEROXYDICARBONATE	15520-11-3	≤ 100			30/86	35/95	1	2	3	I	110 lb (50 kg)**	
1,6-DI-(<i>t</i> -BUTYL PEROXY CARBONYLOXY) HEXANE		≤ 72	A ≥ 28				NE	NE	3	I	16 gal (60 L)**	
1,1-DI-(<i>t</i> -BUTYL PEROXY) CYCLOHEXANE	3006-86-8	> 80–100					1	2	4	I	8 gal (30 L)**	3
DI- <i>sec</i> -BUTYL PEROXYDICARBONATE	19910-65-7	> 52–100			-20/-4	-10/14	1	2	4	I	16 gal (60 L)**	
1,1-DI-(<i>t</i> -BUTYL PEROXY)-3,3,5-TRIMETHYLCYCLOHEXANE	6731-36-8	> 90–100					1	4	3	I	8 gal (30 L)**	3
DI-4-CHLOROBENZOYL PEROXIDE	94-17-7	≤ 77		≥ 23			1	2	4	I	55 lb (25 kg)**	3
DICYCLOHEXYL PEROXYDICARBONATE	1561-49-5	> 91–100			10/50	15/59	NE	NE	4	I	55 lb (25 kg)**	3
DI-2,4-DICHLOROBENZOYL PEROXIDE	133-14-2	≤ 77		≥ 23			1	NE	4	I	55 lb (25 kg)**	3
2,2-DIHYDROPEROXYPROPANE	2614-76-8	≤ 27	Inert solid ≥ 73				NE	NE	4	I	55 lb (25 kg)**	3
DIISOBUTYRYL PEROXIDE	3437-84-1	> 32–52	B ≥ 48		-20/-4	-10/14	3	4	4	I	8 gal (30 L)**	3
DIISOPROPYL PEROXYDICARBONATE	105-64-6	> 52–100			-15/5	-5/23	3	4	4	I	55 lb (25 kg)**	3
DI-(2-METHYLBENZOYL) PEROXIDE	22313-62-8	≤ 87		≥ 13	30/86	35/95	3	NE	4	I	55 lb (25 kg)**	3
2,5-DIMETHYL-2,5-DI-(BENZOYL PEROXY) HEXANE	2618-77-1	> 82–100					3	4	4	I	55 lb (25 kg)**	3
2,5-DIMETHYL-2,5-DI-(<i>t</i> -BUTYL PEROXY) HEXANE-3	1068-27-5	> 86–100					1	2	4	I	8 gal (30 L)**	3
DI-(2-PHENOXYETHYL) PEROXYDICARBONATE	41935-39-1	> 85–100					1	2	4	I	55 lb (25 kg)	3
DI- <i>n</i> -PROPYL PEROXYDICARBONATE	16066-38-9	≤ 100			-25/-1	-15/5	1	NE	4	I	16 gal (60 L)**	
DI- <i>n</i> -PROPYL PEROXYDICARBONATE	16066-38-9	≤ 77	B ≥ 23		-20/-4	-10/14	2	4	3	I	16 gal (60 L)**	
DISUCCINIC ACID PEROXIDE	123-23-9	> 72–100					2	4	3	I	16 gal (60 L)**	
ISOPROPYL <i>sec</i> -BUTYL PEROXYDICARBONATE + DI- <i>sec</i> -BUTYL PEROXYDICARBONATE + DI-ISOPROPYL PEROXYDICARBONATE		≤ 52 + ≤ 28 + ≤ 22			-20/-4	-10/14	3	NE	4	I	55 lb (25 kg)**	3, 17
METHYL ETHYL KETONE PEROXIDE(S)	1338-23-4	See Remark 8.	A ≥ 48				2	4	4	I	8 gal (30 L)**	3, 8, 13

**Depending on package used for tests.

^aThese columns refer to temperatures in the Department of Transportation (DOT) Organic Peroxides Table. (See 49 CFR 173.225 for more information.)

The emergency temperature is the temperature at which, due to imminent danger, emergency measures must be initiated.

^bThe column refers to NFPA 704 hazard ratings for health, flammability, and instability. (See NFPA 704 for more information.)

^cSee Table F.8.

^dSee NFPA 30 for additional storage requirements.

Table F.3.3 Typical Class IIA Formulations

Organic Peroxide Formulation	CAS Number	Concentration	Diluent	Water	Recommended Maximum Temperatures ^a		Hazard Identification NFPA 704 Ratings ^b			Storage Class	Max. Quantity per Container	Subsidiary Risks and Remarks ^c
					Control	Emergency	Health	Flammability	Instability			
					°C/°F	°C/°F						
t-AMYL HYDROPEROXIDE	3425-61-4	≤ 88	A ≥ 6	≥ 6			3	2	2	IIA	60 gal (225 L)	
t-AMYL PEROXYACETATE	690-83-5	≤ 62	A ≥ 38				3	2	3	IIA	16 gal (60 L)	
t-AMYL PEROXYBENZOATE	4511-39-1	≤ 100					2	2	3	IIA	16 gal (60 L)	
t-AMYL PEROXY-2-ETHYLHEXANOATE	686-31-7	≤ 100			20/68	25/77	2	2	3	IIA	16 gal (60 L)	
t-AMYL PEROXY-2-ETHYLHEXYL CARBONATE	70833-40-8	≤ 100					1	2	3	IIA	16 gal (60 L)	
t-AMYL PEROXYNEODECANOATE	68299-16-1	≤ 77	B ≥ 23		0/32	10/50	1	2	3	IIA	16 gal (60 L)	
t-AMYL PEROXYPIVALATE	29240-17-3	≤ 77	B ≥ 23		10/50	15/59	2	2	3	IIA	16 gal (60 L)**	
n-BUTYL-4,4-DI-(t-BUTYLPEROXY) VALERATE	995-33-5	> 52-100					1	2	3	IIA	16 gal (60 L)**	
t-BUTYL HYDROPEROXIDE	75-91-2	≤ 80	A ≥ 20				3	NE	3	IIA	16 gal (60 L)	4, 13
t-BUTYL PEROXYACETATE	107-71-1	> 32-52	A ≥ 48				2	2	3	IIA	16 gal (60 L)**	
t-BUTYL PEROXYBENZOATE	614-45-9	> 77-100					2	1	3	IIA	16 gal (60 L)**	
t-BUTYL PEROXYBENZOATE	614-45-9	> 52-77	A ≥ 23				2	2	3	IIA	16 gal (60 L)	
t-BUTYL PEROXYCROTONATE	23474-91-1	≤ 77	A ≥ 23				2	2	3	IIA	16 gal (60 L)	
t-BUTYL PEROXYDIETHYLACETATE	2550-33-6	≤ 100			20/68	25/77	3	2	3	IIA	16 gal (60 L)**	
t-BUTYL PEROXY-2-ETHYLHEXANOATE	3006-82-4	> 52-100			20/68	25/77	1	2	3	IIA	16 gal (60 L)**	
t-BUTYL PEROXY-2-ETHYLHEXANOATE + 2,2-DI-(t-BUTYLPEROXY) BUTANE	3006-82-4 and 2167-23-9	≤ 31 + ≤ 36	B ≥ 33		35/95	40/104		NE		IIA	16 gal (60 L)	
t-BUTYL PEROXY-2-ETHYLHEXYLCARBONATE	34443-12-4	≤ 100					1	1	3	IIA	16 gal (60 L)	
1-(2-t-BUTYLPEROXY ISOPROPYL)-3-ISOPROPENYL BENZENE	96319-55-0	≤ 77	A ≥ 23				NE	NE	3	IIA	16 gal (60 L)	
t-BUTYL PEROXYNEODECANOATE	26748-41-4	> 77-100			-5/23	5/41	2	3	3	IIA	16 gal (60 L)	
t-BUTYL PEROXYNEODECANOATE	26748-41-4	≤ 77	B ≥ 23		0/32	10/50	2	2	3	IIA	16 gal (60 L)	
t-BUTYL PEROXYNEOHEPTANOATE	26748-38-9	≤ 77	A ≥ 23		0/32	10/50	1	2	3	IIA	16 gal (60 L)	
t-BUTYL PEROXYPIVALATE	927-07-1	> 67-77	A ≥ 23		0/32	10/50	2	2	3	IIA	16 gal (60 L)**	
t-BUTYL PEROXYPIVALATE	927-07-1	> 27-67	B ≥ 33		0/32	10/50	2	2	3	IIA	16 gal (60 L)	
t-BUTYLPEROXY STEARYLCARBONATE	62476-60-6	≤ 100					NE	NE	3	IIA	110 lb (50 kg)	
t-BUTYL PEROXY-3,5,5-TRIMETHYL HEXANOATE	13122-18-4	> 37-100					2	1	3	IIA	16 gal (60 L)	
3-CHLOROPEROXYBENZOIC ACID	937-14-4	≤ 57	Inert solid ≥ 3	≥ 40			NE	NE	3	IIA	110 lb (50 kg)	

(continues)

Table F.3.3 *Continued*

Organic Peroxide Formulation	CAS Number	Concentration	Diluent	Water	Recommended Maximum Temperatures ^a		Hazard Identification NFPA 704 Ratings ^b			Storage Class	Max. Quantity per Container	Subsidiary Risks and Remarks ^c
					Control	Emergency	Health	Flammability	Instability			
					°C/°F	°C/°F						
3-CHLOROPEROXYBENZOIC ACID	937-14-4	≤ 77	Inert solid ≥ 6	≥ 17			NE	NE	3	IIA	110 lb (50 kg)	
CUMYL PEROXYNEODECANOATE	26748-47-0	≤ 87	A ≥ 13		-10/14	0/32	1	3	3	IIA	16 gal (60 L)	
CUMYL PEROXYNEOHEPTANOATE	104852-44-0	≤ 77	A ≥ 23		-10/14	0/32	1	3	3	IIA	16 gal (60 L)	
CUMYL PEROXYPIVALATE	23383-59-7	≤ 77	B ≥ 23		-5/23	5/41	NE	3	3	IIA	16 gal (60 L)	
2,2-DI-(<i>t</i> -AMYLPEROXY) BUTANE	13653-62-8	≤ 57	A ≥ 43				1	3	3	IIA	16 gal (60 L)	
1,1-DI-(<i>t</i> -AMYLPEROXY) CYCLOHEXANE	15667-10-4	≤ 82	A ≥ 18				1	2	3	IIA	16 gal (60 L)**	
DI- <i>t</i> -BUTYL PEROXIDE ^d	110-05-4	> 52–100					1	4	2	IIA	60 gal (225 L)	
1,1-DI-(<i>t</i> -BUTYLPEROXY) CYCLOHEXANE	3006-86-8	≤ 72	B ≥ 28				1	2	3	IIA	16 gal (60 L)**	30
1,1-DI-(<i>t</i> -BUTYLPEROXY) CYCLOHEXANE	3006-86-8	> 52–80	A ≥ 20				1	2	3	IIA	16 gal (60 L)**	
1,1-DI-(<i>t</i> -BUTYLPEROXY) CYCLOHEXANE	3006-86-8	> 42–52	A ≥ 48				1	2	3	IIA	16 gal (60 L)	
1,1-DI-(<i>t</i> -BUTYLPEROXY)-CYCLOHEXANE + <i>t</i> -BUTYL PEROXY-2-ETHYLHEXANOATE	3006-86-8 and 3006-82-4	≤ 43 + ≤ 16	A ≥ 41				1	2	3	IIA	16 gal (60 L)	
DI- <i>sec</i> -BUTYL PEROXYDICARBONATE	19910-65-7	≤ 52	B ≥ 48		-15/5	-5/23	1	4	3	IIA	16 gal (60 L)	
1,1-DI-(<i>t</i> -BUTYLPEROXY)-3,3,5-TRIMETHYLCYCLOHEXANE	6731-36-8	≤ 90	B ≥ 10				1	2	4	IIA	16 gal (60 L)**	30
1,1-DI-(<i>t</i> -BUTYLPEROXY)-3,3,5-TRIMETHYLCYCLOHEXANE	6731-36-8	> 57–90	A ≥ 10				1	2	3	IIA	16 gal (60 L)**	
1,1-DI-(<i>t</i> -BUTYLPEROXY)-3,3,5-TRIMETHYLCYCLOHEXANE	6731-36-8	≤ 77	B ≥ 23				1	NE	3	IIA	16 gal (60 L)**	
DICYCLOHEXYL PEROXYDICARBONATE	1561-49-5	≤ 91		≥ 9	10/50	15/59	NE	NE	3	IIA	110 lb (50 kg)**	
DI-(2-ETHOXYETHYL) PEROXYDICARBONATE		≤ 52	B ≥ 48		-10/14	0/32	NE	NE	3	IIA	16 gal (60 L)	
DI-(2-ETHYLHEXYL) PEROXYDICARBONATE	16111-62-9	> 77–100			-20/-4	-10/14	2	4	3	IIA	16 gal (60 L)**	
DI-(3-METHOXYBUTYL) PEROXYDICARBONATE	52238-68-3	≤ 52	B ≥ 48		-5/23	5/41	NE	NE	3	IIA	16 gal (60 L)	

(continues)

Table F.3.3 Continued

Organic Peroxide Formulation	CAS Number	Concentration	Diluent	Water	Recommended Maximum Temperatures ^a		Hazard Identification NFPA 704 Ratings ^b			Storage Class	Max. Quantity per Container	Subsidiary Risks and Remarks ^c
					Control	Emergency	Health	Flammability	Instability			
					°C/°F	°C/°F						
DI-(3-METHYLBENZOYL) PEROXIDE + BENZOYL (3-METHYLBENZOYL) PEROXIDE + DIBENZOYL PEROXIDE		≤ 20 + ≤ 18 + ≤ 4	B ≥ 58		35/95	40/104	NE	NE		IIA	16 gal (60 L)	
2,5-DIMETHYL-2,5-DI-(BENZOYLPEROXY)HEXANE	2618-77-1	≤ 82	Inert solid ≥ 18				1	NE	3	IIA	110 lb (50 kg)	
2,5-DIMETHYL-2,5-DI-(<i>t</i> -BUTYLPEROXY)HEXYNE-3	1068-27-5	>52-86	A ≥ 14				1	2	3	IIA	16 gal (60 L)**	26
2,5-DIMETHYL-2,5-DI-(2-ETHYLHEXANOYLPEROXY)HEXANE	13052-09-0	≤ 100			20/68	25/77				IIA	16 gal (60 L)**	
2,5-DIMETHYL-2,5-DIHYDROPEROXYHEXANE	3025-88-5	≤ 82		≥ 18			3	2	3	IIA	110 lb (50 kg)**	
2,5-DIMETHYL-2,5-DI-(3,5,5-TRIMETHYLHEXANOYLPEROXY)HEXANE		≤ 77	A ≥ 23				NE	NE	3	IIA	16 gal (60 L)	
DI- <i>n</i> -NONANOYL PEROXIDE	762-13-0	≤ 100			0/32	10/50	NE	NE	3	IIA	110 lb (50 kg)	
DI- <i>n</i> -OCTANOYL PEROXIDE	762-16-3	≤ 100			10/50	15/59	1	NE	3	IIA	110 lb (50 kg)**	
DI-(2-PHENOXYETHYL) PEROXYDICARBONATE	41935-39-1	≤ 85		≥ 15			1	NE	3	IIA	110 lb (50 kg)	
DI-(3,5,5-TRIMETHYLHEXANOYL) PEROXIDE	3851-87-4	> 38-82	A ≥ 18		0/32	10/50				IIA	16 gal (60 L)	
ETHYL 3,3-DI-(<i>t</i> -AMYLPEROXY)BUTYRATE	67567-23-1	≤ 67	A ≥ 33				NE	2	3	IIA	16 gal (60 L)	
ETHYL 3,3-DI-(<i>t</i> -BUTYLPEROXY)BUTYRATE	55794-20-2	> 77-100					1	1	3	IIA	16 gal (60 L)**	
ETHYL 3,3-DI-(<i>t</i> -BUTYLPEROXY)BUTYRATE	55794-20-2	≤ 77	A ≥ 23				1	2	3	IIA	16 gal (60 L)	
1-(2-ETHYLHEXANOYLPEROXY)-1,3-DIMETHYLBUTYL PEROXYPIVALATE	228415-62-1	≤ 52	A ≥ 45; B ≥ 10		-20/-4	-10/14				IIA	16 gal (60 L)	
<i>t</i> -HEXYL PEROXYNEODECANOATE	62178-88-5	≤ 71	A ≥ 29		0/32	10/50	1	NE	3	IIA	16 gal (60 L)	
<i>t</i> -HEXYL PEROXYPIVALATE	51938-28-4	≤ 72	B ≥ 28		10/50	15/59	NE	NE	3	IIA	16 gal (60 L)	
3-HYDROXY-1,1-DIMETHYLBUTYL PEROXYNEODECANOATE	95718-78-8	≤ 77	A ≥ 23		-5/23	5/41	NE	3	3	IIA	16 gal (60 L)	
3-HYDROXY-1,1-DIMETHYLBUTYL PEROXYNEODECANOATE	95718-78-8	≤ 52	A ≥ 48		-5/23	5/41	NE	3	2	IIA	60 gal (225 L)	
ISOPROPYL <i>sec</i> -BUTYL PEROXYDICARBONATE + DI- <i>sec</i> -BUTYL PEROXYDICARBONATE+DI-ISOPROPYL PEROXYDICARBONATE		≤ 32 + ≤ 15 - 18 ≤ 12 - 15	A ≥ 38		-20/-4	-10/14	2	NE	3	IIA	16 gal (60 L)	
<i>p</i> -MENTHYL HYDROPEROXIDE	26762-92-5	> 72-100					3	2	3	IIA	16 gal (60 L)	13
METHYLCYCLOHEXANONE PEROXIDE (S)		≤ 67	B ≥ 33		35/95	40/104	NE	NE		IIA	16 gal (60 L)	
METHYL ETHYL KETONE PEROXIDE (S)	1338-23-4	See Remark 9.	A ≥ 55				3	2	3	IIA	16 gal (60 L)	9

(continues)

△ Table F.3.3 Continued

Organic Peroxide Formulation	CAS Number	Concentration	Diluent	Water	Recommended Maximum Temperatures ^a		Hazard Identification NFPA 704 Ratings ^b			Storage Class	Max. Quantity per Container	Subsidiary Risks and Remarks ^c
					Control	Emergency	Health	Flammability	Instability			
					°C/°F	°C/°F						
METHYL ISOBUTYL KETONE PEROXIDE(S)	37206-20-5	≤ 62	A ≥ 19				NE	2	3	IIA	16 gal (60 L)	22
ORGANIC PEROXIDE, LIQUID, SAMPLE							NE	NE	NE	IIA	16 gal (60 L)**	11
ORGANIC PEROXIDE, LIQUID, SAMPLE, TEMPERATURE CONTROLLED							NE	NE	NE	IIA	16 gal (60 L)**	11
ORGANIC PEROXIDE, SOLID, SAMPLE,							NE	NE	NE	IIA	110 lb (50 kg)**	11
ORGANIC PEROXIDE, SOLID, SAMPLE, TEMPERATURE CONTROLLED							NE	NE	NE	IIA	110 lb (50 kg)**	11
3,3,5,7,7-PENTAMETHYL-1,2,4-TRIOXEPANE	215877-64-8	≤ 100					2	2	2	IIA	60 gal (225 L)	
PEROXYACETIC ACID, TYPE D, stabilized	79-21-0	≤ 43					NE	NE	3	IIA	16 gal (60 L)	13, 14, 19
PEROXYLAURIC ACID	2388-12-7	≤ 100			35/95	40/104	NE	NE	2	IIA	440 lb (200 kg)	
PINANYL HYDROPEROXIDE	28324-52-9	> 56–100					NE	NE	3	IIA	16 gal (60 L)	13
POLYETHER POLY- <i>t</i> -BUTYLPEROXYCARBONATE	Proprietary	≤ 52	B ≥ 48				NE	4	2	IIA	60 gal (225 L)	
1,1,3,3-TETRAMETHYLBUTYL HYDROPEROXIDE	5809-08-5	≤ 100					3	2	3	IIA	16 gal (60 L)	
1,1,3,3-TETRAMETHYLBUTYL PEROXY-2 ETHYL-HEXANOATE	22288-43-3	≤ 100			15/59	20/68	NE	3	3	IIA	16 gal (60 L)	
1,1,3,3-TETRAMETHYLBUTYL PEROXYNODECANOATE	51240-95-0	≤ 72	B ≥ 28		-5/23	5/41	1	3	3	IIA	16 gal (60 L)	
1,1,3,3-TETRAMETHYLBUTYL PEROXYPIVALATE	22288-41-1	≤ 77	A ≥ 23		0/32	10/50	2	4	3	IIA	16 gal (60 L)	
3,6,9-TRIMETHYL-3,6,9-TRIMETHYL-1,4,7-TRIPEROXONANE	24748-23-0	≤ 42	A ≥ 58				2	2	3	IIA	16 gal (60 L)	28

^aThese columns refer to temperatures in the Department of Transportation (DOT) Organic Peroxides Table. (See 49 CFR 173.225 for more information.)

The emergency temperature is the temperature at which, due to imminent danger, emergency measures must be initiated.

^bThe column refers to NFPA 704 hazard ratings for health, flammability, and instability. (See NFPA 704 for more information.)

^cSee Table F.8.

^dSee NFPA 30 for additional storage requirements.

F.5 Class III Formulations.

F.5.1 Fire Hazard Characteristics. Class III formulations present a fire hazard similar to Class IIB combustible liquids. They are characterized by rapid burning and high heat liberation due to decomposition. Large-scale burn rates of less than 132 lb/min (60 kg/min) but greater than or equal to 22 lb/min (10 kg/min) for Type D, or small-scale burning rates for Type D, Type E, and Type F of less than 0.184 lb/min(ft²) [0.9 kg/min(m²)], are expected for these organic peroxide formulations. These organic peroxides are typically less reactive or contain much higher levels of diluent than the Class I, Class IIA, and Class IIB formulations.

F.5.2 Fire-Fighting Information. Caution should be observed due to possible unexpected increases in fire intensity.

△ F.5.3 Typical Class III Formulations. See Table F.5.3.

F.6 Class IV Formulations.

F.6.1 Fire Hazard Characteristics. Class IV formulations present fire hazards that are easily controlled. Reactivity has little effect on fire intensity. Large-scale burn rates of these organic peroxide formulations are less than 22 lb/min (10 kg/min).

F.6.2 Fire-Fighting Information. Normal fire-fighting procedures can be used.

△ F.6.3 Typical Class IV Formulations. See Table F.6.3.

Table F.4.3 Typical Class IIB Formulations

Organic Peroxide Formulation	CAS Number	Concentration	Diluent	Water	Recommended Maximum Temperatures ^a		Hazard Identification NFPA 704 Ratings ^b			Storage Class	Max. Quantity per Container	Subsidiary Risks and Remarks ^c
					Control	Emergency	Health	Flammability	Instability			
					°C/°F	°C/°F						
<i>t</i> -BUTYL HYDROPEROXIDE ^d	75-91-2	≤79		>14			3	NE	2	IIB	60 gal (225 L)	13, 23
<i>t</i> -BUTYL MONOPEROXYMALEATE	1931-62-0	≤52	A ≥ 48				3	NE	3	IIB	16 gal (60 L)**	
<i>t</i> -BUTYL MONOPEROXYMALEATE	1931-62-0	≤52	Inert solid ≥ 48				3	NE	2	IIB	440 lb (200 kg)	
<i>t</i> -BUTYL MONOPEROXYMALEATE	1931-62-0	≤ 52 as a paste					3	2	2	IIB	440 lb (200 kg)	
<i>t</i> -BUTYL PEROXYBENZOATE	614-45-9	≤52	Inert solid ≥ 48				2	NE	3	IIB	110 lb (50 kg)	
<i>t</i> -BUTYL PEROXYBUTYL FUMARATE		≤52	A ≥ 48				NE	NE	3	IIB	16 gal (60 L)	
<i>t</i> -BUTYL PEROXY-2-ETHYLHEXANOATE	3006-82-4	≤52	Inert solid ≥ 48		20/68	25/77	1	NE	2	IIB	440 lb (200 kg)	
<i>t</i> -BUTYL PEROXYISOBUTYRATE	109-13-7	≤52	B ≥ 48		15/59	20/68	1	3	3	IIB	16 gal (60 L)	
<i>t</i> -BUTYLPEROXY ISOPROPYLCARBONATE	2372-21-6	≤77	A ≥ 23				2	2	3	IIB	16 gal (60 L)**	
1-(2- <i>t</i> -BUTYLPEROXY ISOPROPYL)-3-ISOPROPENYLBENZENE CUMYL	96319-55-0	≤42	Inert solid ≥ 58				NE	NE	2	IIB	440 lb (200 kg)	
PEROXYNEODECANOATE	26748-47-0	≤77	B ≥ 23		-10/14	0/32	1	3	3	IIB	16 gal (60 L)	
CYCLOHEXANONE PEROXIDE(S)	12262-58-7	≤72	A ≥ 28				3	NE	3	IIB	16 gal (60 L)	5
CYCLOHEXANONE PEROXIDE(S)	12262-58-7	≤ 72 as a paste					3	NE	3	IIB	110 lb (50 kg)	5, 20
DIACETONE ALCOHOL PEROXIDES	54693-46-8	≤57	B ≥ 26	≥8	40/104	45/113	NE	NE	3	IIB	16 gal (60 L)	6
DIACETYL PEROXIDE	110-22-5	≤27	B ≥ 73		20/68	25/77	1	2	3	IIB	16 gal (60 L)	7, 13
DI- <i>t</i> -AMYL PEROXIDE	10508-09-5	≤100					2	4	2	IIB	60 gal (225 L)	
DIBENZOYL PEROXIDE	94-36-0	≤77		≥23			2	2	3	IIB	110 lb (50 kg)**	
DIBENZOYL PEROXIDE	94-36-0	≤62	Inert solid ≥ 28	≥10	T ^f		2	NE	3	IIB	110 lb (50 kg)	
DIBENZOYL PEROXIDE	94-36-0	> 52–62 as a paste			T ^f		2	2	3	IIB	110 lb (50 kg)	20
DIBENZOYL PEROXIDE	94-36-0	>35–52	Inert solid ≥ 48				2	2	3	IIB	110 lb (50 kg)	
DIBENZOYL PEROXIDE	94-36-0	>36–42	A ≥ 18	≥40	T ^f		2	2	2	IIB	60 gal (225 L)	
DIBENZOYL PEROXIDE	94-36-0	≤ 56.5 as a paste		≥15	T ^f		2	2	2	IIB	440 lb (200 kg)	
DIBENZOYL PEROXIDE	94-36-0	≤ 52 as a paste			T ^f		2	2	2	IIB	440 lb (200 kg)	20
DI- <i>t</i> -BUTYL PEROXYAZELATE	16580-06-6	≤52	A ≥ 48				NE	2	3	IIB	16 gal (60 L)	
2,2-DI-(<i>t</i> -BUTYLPEROXY) BUTANE	2167-23-9	≤52	A ≥ 48				1	2	3	IIB	16 gal (60 L)	
DI- <i>n</i> -BUTYL PEROXYDICARBONATE	16215-49-9	>27–52	B ≥ 48		-15/5	-5/23	1	NE	3	IIB	16 gal (60 L)	
DI-(<i>t</i> -BUTYLPEROXYISOPROPYL)BENZENE(S)	25155-25-3	>42–100	Inert solid ≥ 57				1	1	3	IIB	110 lb (50 kg)	
DI-(<i>t</i> -BUTYLPEROXY) PHTHALATE	15042-77-0	>42–52	A ≥ 48				NE	2	3	IIB	16 gal (60 L)	
DI-(<i>t</i> -BUTYLPEROXY) PHTHALATE	15042-77-0	≤ 52 as a paste					NE	NE	3	IIB	110 lb (50 kg)	20
DI-(<i>t</i> -BUTYLPEROXY) PHTHALATE	15042-77-0	≤42	A ≥ 58				NE	1	2	IIB	60 gal (225 L)	
2,2-DI-(<i>t</i> -BUTYLPEROXY)PROPANE	4262-61-7	≤52	A ≥ 48				NE	2	3	IIB	16 gal (60 L)	
1,1-DI-(<i>t</i> -BUTYLPEROXY)-3,3,5-TRIMETHYLCYCLOHEXANE	6731-36-8	≤57	A ≥ 43				1	NE	2	IIB	60 gal (225 L)	
1,1-DI-(<i>t</i> -BUTYLPEROXY)-3,3,5-TRIMETHYLCYCLOHEXANE	6731-36-8	≤32	A ≥ 26; B ≥ 42				1	4	2	IIB	60 gal (225 L)	
DI-4-CHLOROBENZOYL PEROXIDE	94-17-7	≤ 52 as a paste					NE	NE	3	IIB	110 lb (50 kg)	20
DIDECANOYL PEROXIDE	762-12-9	≤100			30/86	35/95	1	NE	3	IIB	110 lb (50 kg)**	
DI-2,4-DICHLOROBENZOYL PEROXIDE	133-14-2	≤ 52 as a paste			20/68	25/77	1	2	2	IIB	440 lb (200 kg)	
DI-2,4-DICHLOROBENZOYL PEROXIDE	133-14-2	≤ 52 as a paste with silicon oil			T ^f		1	2	3	IIB	110 lb (50 kg)	
DI-(2-ETHYLHEXYL) PEROXYDICARBONATE	16111-62-9	≤77	B ≥ 23		-15/5	-5/23	2	4	3	IIB	16 gal (60 L)	
DI-(1-HYDROXYCYCLOHEXYL) PEROXIDE	2407-94-5	≤100					NE	NE	3	IIB	110 lb (50 kg)	
DIISOBUTYRYL PEROXIDE	3437-84-1	≤32	B ≥ 68		-20/-4	-10/14	3	NE	3	IIB	16 gal (60 L)	
DIISOPROPYLBENZENE DIHYDROPEROXIDE		≤82	A ≥ 5	≥5			NE	NE	3	IIB	110 lb (50 kg)	24
DIISOPROPYL PEROXYDICARBONATE	105-64-6	≤52	B ≥ 48		-20/-4	-10/14	3	NE	3	IIB	16 gal (60 L)	

(continues)

Table F.4.3 *Continued*

Organic Peroxide Formulation	CAS Number	Concentration	Diluent	Water	Recommended Maximum Temperatures ^a		Hazard Identification NFPA 704 Ratings ^b			Storage Class	Max. Quantity per Container	Subsidiary Risks and Remarks ^c
					Control	Emergency	Health	Flammability	Instability			
					°C/°F	°C/°F						
DIISOPROPYL PEROXYDICARBONATE	105-64-6	≤32	A ≥ 68		-15/5	-5/23	2	NE	3	IIB	16 gal (60 L)	
DILAULOYL PEROXIDE	105-74-8	≤100					1	2	3	IIB	110 lb (50 kg)	
DI-(4-METHYLBENZOYL) PEROXIDE	895-85-2	≤ 52 as a paste with silicon oil					NE	NE	3	IIB	110 lb (50 kg)	
2,5-DIMETHYL-2,5-DI-(BENZOYLPEROXY)HEXANE	2618-77-1	≤82		≥18			1	NE	3	IIB	110 lb (50 kg)	
2,5-DIMETHYL-2,5-DI-(t-BUTYLPEROXY)HEXANE	78-63-7	>90–100					2	2	3	IIB	16 gal (60 L)	**
2,5-DIMETHYL-2,5-DI-(t-BUTYLPEROXY)HEXANE	78-63-7	>52–90	A ≥ 10				2	2	3	IIB	16 gal (60 L)	
2,5-DIMETHYL-2,5-DI-(t-BUTYLPEROXY)HEXANE	78-63-7	≤77	Inert solid ≥ 23				2	2	1	IIB	440 lb (200 kg)	
2,5-DIMETHYL-2,5-DI-(t-BUTYLPEROXY)HEXANE	78-63-7	≤ 47 as a paste					2	1	2	IIB	440 lb (200 kg)	
1,1-DIMETHYL-3-HYDROXYBUTYL PEROXYNEOHEPTANOATE	110972-57-1	≤52	A ≥ 48		0/32	10/50	NE	2	2	IIB	60 gal (225 L)	
DIMYRISTYL PEROXYDICARBONATE	53220-22-7	≤100			20/68	25/77	1	NE	3	IIB	110 lb (50 kg)	
DI-(2-NEODECANOYLPEROXYISOPROPYL) BENZENE	117663-11-3	≤52	A ≥ 48		-10/14	0/32	NE	NE	3	IIB	16 gal (60 L)	
DISUCCINIC ACID PEROXIDE	123-23-9	≤72		≥28	10/50	15/59	3	NE	3	IIB	110 lb (50 kg)	

^aThese columns refer to temperatures in the Department of Transportation (DOT) Organic Peroxides Table. (See 49 CFR 173.225 for more information.)

The emergency temperature is the temperature at which, due to imminent danger, emergency measures must be initiated.

^bThe column refers to NFPA 704 hazard ratings for health, flammability, and instability. (See NFPA 704 for more information.)

^cSee Table F.8.

^dSee NFPA 30 for additional storage requirements.

T^f— Temperature control should be considered to reduce fire hazard depending on packaging size and recommendations in manufacturers' literature.

F.7 Class V Formulations.

F.7.1 Fire Hazard Characteristics. Class V formulations do not present severe fire hazards. Those that do burn do so with less intensity than ordinary combustibles.

F.7.2 Fire-Fighting Information. Fire-fighting procedures need to primarily consider the combustibility of containers.

Δ F.7.3 Typical Class V Formulations. See Table F.7.3.

F.8 Subsidiary Risks and Remarks. Table F.8 lists subsidiary risks and remarks.

▲ Table F.5.3 Typical Class III Formulations

Organic Peroxide Formulation	CAS Number	Concentration	Diluent	Water	Recommended Maximum Temperatures ^a		Hazard Identification NFPA 704 Ratings ^b			Storage Class	Max. Quantity per Container	Subsidiary Risks and Remarks ^c
					Control	Emergency	Health	Flammability	Instability			
					°C/°F	°C/°F						
ACETYL ACETONE PEROXIDE	37187-22-7	≤42	A > 48	≥8			2	1	3	III	16 gal (60 L)	2
ACETYL ACETONE PEROXIDE	37187-22-7	≤ 32 as a paste					2	NE	3	III	110 lb (50 kg)	20
ACETYL CYCLOHEXANESULPHONYL PEROXIDE	3179-56-4	≤ 32			-10/14	0/32	3	4	3	III	16 gal (60 L)	
†-AMYL PEROXYNEODECANOATE	68299-16-1	≤ 47	A ≥ 53		0/32	10/50				III	IBC tank	
†BUTYL CUMYL PEROXIDE	3457-61-2	>42-100					2	2	2	III	60 gal (225 L)	
†BUTYL CUMYL PEROXIDE	3457-61-2	≤52	Inert solid ≥ 48				2	NE	2	III	440 lb (200 kg)	
n-BUTYL-4,4-DI-(†BUTYLPEROXY)VALERATE	995-33-5	≤ 52	Inert solid ≥ 48				1	NE	2	III	440 lb (200 kg)	
†BUTYL HYDROPEROXIDE ^d	75-91-2	≤ 72		≥ 28						III	IBC type/tank truck	13, 32
†BUTYL PEROXYACETATE	107-71-1	≤ 32	B ≥ 68				3	2	1	III	IBC tank	
†BUTYL PEROXY-2-ETHYLHEXANOATE	3006-82-4	>32-52	B ≥ 48		30/86	35/95	1	2	2	III	60 gal (225 L)	
†BUTYL PEROXY-2-ETHYLHEXANOATE	3006-82-4	≤ 32			40/104	45/113				III	IBC tank	
†BUTYL PEROXY-2-ETHYLHEXANOATE	3006-82-4	≤12 + ≤14	A ≥ 14; Inert solid ≥ 60				1	2	1	III	110 lb (50 kg)	
†BUTYL PEROXY-2-ETHYLHEXANOATE + 2,2-DI-(†BUTYLPEROXY)BUTANE	3006-82-4 and 2167-23-9						1	NE	3	III	110 lb (50 kg)	
†BUTYL PEROXYNEODECANOATE	26748-41-4	≤ 32	A ≥ 68		0/32	10/50		NE		III	IBC tank	
†BUTYL PEROXYPIVALATE	927-07-1	≤ 27	B ≥ 73		30/86	35/95	2	2	1	III	IBC tank	
†BUTYL PEROXY-3,5,5-TRIMETHYLHEXANOATE	13122-18-4	≤42	Inert solid ≥ 58				1	2	1	III	110 lb (50 kg)	
†BUTYL PEROXY-3,5,5-TRIMETHYLHEXANOATE	13122-18-4	≤ 37	A > 63				2	2	1	III	IBC tank	
CUMYL HYDROPEROXIDE	80-15-9	> 90-98	A ≥ 10				3	1	2	III	60 gal (225 L)	13
CUMYL HYDROPEROXIDE	80-15-9	≤ 90	A ≥ 10				3	2	1	III	IBC tank	13, 18
CUMYL PEROXYNEODECANOATE	26748-47-0	≤ 52 as a stable dispersion in water			-10/14	0/32				III	IBC tank	
DIBENZOYL PEROXIDE	94-36-0	≤ 42 as a stable dispersion in water					1	NE	1	III	IBC tank	
DI-†BUTYL PEROXIDE	110-05-4	≤ 52	B ≥ 48				2	2	1	III	IBC tank	25
1,1-DI-(†BUTYLPEROXY)CYCLOHEXANE	3006-86-8	≤ 42	A ≥ 13	≥ 45			1	4	1	III	110 lb (50 kg)	
1,1-DI-(†BUTYLPEROXY)CYCLOHEXANE	3006-86-8	≤ 42	A ≥ 58				1	NE	3	III	IBC tank	
1,1-DI-(†BUTYLPEROXY)CYCLOHEXANE	3006-86-8	≤ 27	A ≥ 25				1	2	1	III	60 gal (225 L)	21
1,1-DI-(†BUTYLPEROXY)CYCLOHEXANE	3006-86-8	≤ 13	A ≥ 13; B ≥ 74				1	1	2	III	IBC tank	
DI-n-BUTYL PEROXYDICARBONATE	16215-49-9	≤ 27	B ≥ 73		-10/14	0/32	1	NE	1	III	60 gal (225 L)	
2,2-DI-(†BUTYLPEROXY)PROPANE	4262-61-7	≤ 42	A ≥ 13; Inert solid ≥ 45				1	NE	2	III	110 lb (50 kg)	
1,1-DI-(†BUTYLPEROXY)-3,3,5-TRIMETHYLCYCLOHEXANE	6731-36-8	≤ 57	Inert solid ≥ 43				1	2	1	III	IBC tank	
DICETYL PEROXYDICARBONATE	26322-14-5	≤100			30/86	35/95	1	2	3	III	110 lb (50 kg)	
DICUMYL PEROXIDE	80-43-3	> 52-100					1	1	1	III	IBC tank	12
2,2-DI-(4,4-DI-(†BUTYLPEROXY)CYCLOHEXYL)PROPANE	1705-60-8	≤ 42	Inert solid ≥ 58				1	NE	3	III	110 lb (50 kg)	
2,2-DI-(4,4-DI-(†BUTYLPEROXY)CYCLOHEXYL)PROPANE	1705-60-8	≤ 22	B ≥ 78				1	NE	3	III	60 gal (225 L)	
DI-(2-ETHYLHEXYL) PEROXYDICARBONATE	16111-62-9	≤ 62 as a stable dispersion in water			-15/5	-5/23			2	III	IBC tank	
2,5-DIMETHYL-2,5-DI-(†BUTYLPEROXY)HEXANE	78-63-7	≤ 52	A ≥ 48				2	NE	2	III	IBC tank	
2,5-DIMETHYL-2,5-DI-(†BUTYLPEROXY)HEXYNE-3	1068-27-5	≤ 52	Inert solid ≥ 48				2	2	1	III	110 lb (50 kg)	
DIPROPIONYL PEROXIDE	3248-28-0	≤ 27	B ≥ 73		15/59	20/68	NE	NE	2	III	60 gal (225 L)	
DI-(3,5,5-TRIMETHYLHEXANOYL) PEROXIDE	3851-87-4	≤ 52 as a stable dispersion in water			10/50	15/59	2	2	1	III	IBC tank	

(continues)

Table F.5.3 *Continued*

Organic Peroxide Formulation	CAS Number	Concentration	Diluent	Water	Recommended Maximum Temperatures ^a		Hazard Identification NFPA 704 Ratings ^b			Storage Class	Max. Quantity per Container	Subsidiary Risks and Remarks ^c
					Control	Emergency	Health	Flammability	Instability			
					°C/°F	°C/°F						
DI-(3,5,5-TRIMETHYLHEXANOYL) PEROXIDE	3851-87-4	≤ 38	A ≥ 62		20/68	25/77		NE		III	IBC tank	
ETHYL 3,3-DI-(<i>t</i> -BUTYLPEROXY)BUTYRATE	55794-20-2	≤ 52	Inert solid ≥ 48				1	NE	3	III	110 lb (50 kg)	
ISOPROPYL CUMYL HYDROPEROXIDE	26762-93-6	≤ 72	A ≥ 28				3	2	1	III	IBC tank	13
<i>p</i> -MENTHYL HYDROPEROXIDE	26762-92-5	≤ 72	A ≥ 28				3	2	1	III	IBC tank	27
METHYL ETHYL KETONE PEROXIDE(S)	1338-23-4	See Remark 10.	A ≥ 60				3	2	2	III	60 gal (225 L)	10
METHYL ISOPROPYL KETONE PEROXIDE(S)	33373-82-7	See Remark 31.	A ≥ 70				NE	NE	1	III	IBC tank	31
PEROXYACETIC ACID, TYPE E, stabilized	79-21-0	≤ 43					NE	NE	2	III	60 gal (225 L)	13, 15, 19
PINANYL HYDROPEROXIDE	28324-52-9	≤ 56	A ≥ 44				NE	NE	1	III	IBC tank	
1,1,3,3-TETRAMETHYLBUTYL PEROXYNEODECANOATE	51240-95-0	≤ 52 as a stable dispersion in water			-5/23	5/41	1	3	1	III	IBC tank	

^aThese columns refer to temperatures in the Department of Transportation (DOT) Organic Peroxides Table. (See 49 CFR 173.225 for more information.) The emergency temperature is the temperature at which, due to imminent danger, emergency measures must be initiated.

^bThe column refers to NFPA 704 hazard ratings for health, flammability, and instability. (See NFPA 704 for more information.)

^cSee Table F.8.

^dSee NFPA 30 for additional storage requirements.

Table F.6.3 Typical Class IV Formulations

Organic Peroxide Formulation	CAS Number	Concentration	Diluent	Water	Recommended Maximum Temperatures ^a		Hazard Identification NFPA 704 Ratings ^b			Storage Class	Max. Quantity per Container	Subsidiary Risks and Remarks ^c
					Control	Emergency	Health	Flammability	Instability			
					°C/°F	°C/°F						
<i>t</i> -BUTYL PEROXYNEODECANOATE	26748-41-4	≤ 52 as a stable dispersion in water			0/32	10/50	2	NE	1	IV	IBC tank	
<i>n</i> -BUTYL PEROXYNEODECANOATE	26748-41-4	≤ 42 as a stable dispersion in water (frozen)			0/32	10/50	2	NE	2	IV	440 lb (200 kg)	
<i>n</i> -BUTYL PEROXYNEOHEPTANOATE	26748-38-9	≤ 42 as a stable dispersion in water			0/32	10/50	1	NE	2	IV	60 gal (225 L)	
DI-(4- <i>t</i> -BUTYLCYCLOHEXYL) PEROXYDICARBONATE	15520-11-3	≤ 42 as a stable dispersion in water			30/86	35/95	1	2	1	IV	IBC tank	
DI- <i>n</i> -BUTYL PEROXYDICARBONATE	16215-49-9	≤ 42 as a stable dispersion in water (frozen)			-15/5	-5/23	1	NE	2	IV	440 lb (200 kg)	
DICETYL PEROXYDICARBONATE	26322-14-5	≤ 42 as a stable dispersion in water			30/86	35/95	1	2	1	IV	IBC tank	
DICYCLOHEXYL PEROXYDICARBONATE	1561-49-5	≤ 42 as a stable dispersion in water			15/59	20/68	NE	NE	1	IV	IBC tank	
DI-(2-ETHYLHEXYL) PEROXYDICARBONATE	16111-62-9	≤ 52 as a stable dispersion in water (frozen)			-15/5	-5/23	2	NE	1	IV	IBC tank	
DILAULOYL PEROXIDE	105-74-8	≤ 42 as a stable dispersion in water					1	NE	1	IV	IBC tank	
DIMYRISTYL PEROXYDICARBONATE	53220-22-7	≤ 42 as a stable dispersion in water			20/68	25/77	1	NE	1	IV	IBC tank	
3-HYDROXY-1,1-DIMETHYLBUTYL PEROXYNEODECANOATE	95718-78-8	≤ 52 as a stable dispersion in water			-5/23	5/41	NE	3	1	IV	IBC tank	
PEROXYACETIC ACID, TYPE F, stabilized	79-21-0	≤ 43					NE	NE	1	IV	IBC tank	13, 16, 19

^aThese columns refer to temperatures in the Department of Transportation (DOT) Organic Peroxides Table. (See 49 CFR 173.225 for more information.) The emergency temperature is the temperature at which, due to imminent danger, emergency measures must be initiated.

^bThe column refers to NFPA 704 hazard ratings for health, flammability, and instability. (See NFPA 704 for more information.)

^cSee Table F.8.

△ Table F.7.3 Typical Class V Formulations

Organic Peroxide Formulation	CAS Number	Concentration	Diluent	Water	Recommended Maximum Temperatures ^a		Hazard Identification NFPA 704 Ratings ^b			Storage Class	Max. Quantity per Container	Subsidiary Risks and Remarks ^c
					Control	Emergency	Health	Flammability	Instability			
					°C/°F	°C/°F						
CYCLOHEXANONE PEROXIDE(S)	12262-58-7	≤ 32	Inert solid ≥ 68				3	NE	0	V	Exempt	29
DIBENZOYL PEROXIDE	94-36-0	≤ 35	Inert solid ≥ 65				2	2	0	V	Exempt	29
DI-(<i>t</i> -BUTYLPEROXYISOPROPYL) BENZENE(S)	25155-25-3	≤ 42	Inert solid ≥ 58				1	1	0	V	Exempt	29
DI-4-CHLOROBENZOYL PEROXIDE	94-17-7	≤ 32	Inert solid ≥ 68				NE	NE	0	V	Exempt	29
DICUMYL PEROXIDE	80-43-3	≤ 52	Inert solid ≥ 48				1	NE	0	V	Exempt	29

^aThese columns refer to temperatures in the Department of Transportation (DOT) Organic Peroxides Table. (See 49 CFR 173.225 for more information.) The emergency temperature is the temperature at which, due to imminent danger, emergency measures must be initiated.

^bThe column refers to NFPA 704 hazard ratings for health, flammability, and instability. (See NFPA 704 for more information.)

^cSee Table F.8.

△ Table F.8 Subsidiary Risks and Remarks

Risk	Remark
1	Diluent type B can always be replaced by diluent type A. The boiling point of diluent type B should be at least 108°F (60°C) higher than the SADT of the organic peroxide formulation.
2	Available (or active) oxygen < 4.7 percent
3	EXPLOSIVE subsidiary risk label required
4	Diluent can be replaced by di- <i>t</i> -butyl peroxide
5	Available (or active) oxygen < 9 percent
6	With < 9 percent hydrogen peroxide; available (or active) oxygen < 10 percent
7	Only nonmetallic packaging allowed
8	Available (or active) oxygen > 10 percent and < 10.7 percent, with or without water
9	Available (or active) oxygen < 10 percent with or without water
10	Available (or active) oxygen < 8.2 percent with or without water
11	See 2.5.3.2.5.1 of UN <i>Recommendations on the Transport of Dangerous Goods</i>
12	Up to 4410 lb (2000 kg) per receptacle assigned to ORGANIC PEROXIDE TYPE F on the basis of large-scale trials
13	CORROSIVE subsidiary risk label required
14	Peroxyacetic acid formulations that fulfill the criteria of 2.5.3.3.2(d) of UN <i>Recommendations on the Transport of Dangerous Goods</i>
15	Peroxyacetic acid formulations that fulfill the criteria of 2.5.3.3.2(e) of UN <i>Recommendations on the Transport of Dangerous Goods</i>
16	Peroxyacetic acid formulations that fulfill the criteria of 2.5.3.3.2(f) of UN <i>Recommendations on the Transport of Dangerous Goods</i>
17	Addition of water to this organic peroxide will decrease its thermal stability
18	No "CORROSIVE" subsidiary risk label required for concentrations below 80 percent
19	Mixtures with hydrogen peroxide, water, and acid(s)
20	With diluent type A, with or without water
21	With > 25 percent diluent type A by mass, and in addition to ethylbenzene
22	With > 19 percent diluent type A by mass, and in addition to methyl isobutyl ketone
23	With < 6 percent di- <i>t</i> -butyl peroxide
24	With < 8 percent 1-isopropylhydroperoxy-4-isopropylhydroxybenzene
25	Diluent type B with boiling point > 230°F (110°C)
26	With < 0.5 percent hydroperoxides content
27	For concentrations > 56 percent, "CORROSIVE" subsidiary risk label required
28	Available (or active) oxygen < 7.6 percent in diluent type A having a 95 percent boil-off point in the range of 392–500°F (200–260°C)
29	Not subject to the requirements of these model regulations for Division 5.2 per UN <i>Recommendations on the Transport of Dangerous Goods</i>
30	Diluent type B with boiling point > 266°F (130°C)
31	Active oxygen < 6.7 percent
32	TBHP can be transported and stored in bulk provided that polyethylene saddles are used per 49 CFR 173.225(g) and (h)

Annex G Oxidizers

This annex is not a part of the requirements of this NFPA document but is included for informational purposes only.

G.1 General.

▲ G.1.1 Solid Oxidizers. Oxidizers can have both physical and health hazards. The tests and criteria described in G.1.2 through G.1.5 are based on burning rate only and do not address other physical hazards of oxidizers, such as thermal instability and chemical reactivity, or health hazards of gaseous products generated during combustion or decomposition. If confined, gaseous products generated from oxidizer decomposition can result in overpressure events and explosions. Cumulative research test data indicate the burning rate of solid oxidizers is principally a function of the chemical composition of the oxidizer and its concentration, and to a lesser degree, its physical form (e.g., powder, granular, or tablets). Inclusive in the influence of the oxidizer composition are the amount and type of additives (if any) as well as the moisture content of the oxidizer or hydrated salt additives. The tests and criteria apply to oxidizers or formulations containing oxidizers that are found in commerce, use, and storage and do not apply to the evaluation of oxidizer-containing explosive mixtures, and pyrotechnic mixtures. The tests and criteria assign an oxidizer to an NFPA Class for storage and are not applicable to and should not be confused with Department of Transportation (DOT) and United Nations (UN) Packing Group (III, II, I) assignments and vice versa. The UN and DOT Division 5.1 solid oxidizer packing groups are different from, and not synonymous with, the NFPA Class (1, 2, 3, 4) assignments for storage, handling and use. The NFPA Classes for solid oxidizers are also different from the hazard categories (Categories 3, 2, 1) for oxidizing solids defined by the Global Harmonization System (GHS) adopted by the revised OSHA Hazard Communication Standard in March, 2012.

The oxidizer classification method consists of two reaction-to-fire tests: (1) a bench-scale test with 30 g mixtures of oxidizer and dried cellulose exposed to a glowing wire and (2) an intermediate-scale test with 10.9 kg of oxidizer in combustible test packaging exposed to a constant external fire source. The key physical indicators of burning rate measured in the intermediate-scale test are peak convective heat release rate and the burning time calculated from the radiant heat flux profile. The key physical indicators of burning rate measured in the bench-scale test are mass loss rate and burning time calculated from the mass data. Either of these tests can be used to classify a solid oxidizer. If both of these tests are conducted and the results differ, then the results from the intermediate-scale fire exposure test data should be used as the basis for the classification.

Referenced Documents:

ASTM E2067, *Standard Practice for Full-Scale Oxygen Consumption Calorimetry Fire Tests*, 2012.

Buc, Elizabeth, Oxidizer Classification Research Project: Tests and Criteria, Final Report, The Fire Protection Research Foundation, Fire and Materials Research Laboratory, November 2, 2009.

Huczek, Jason P., Medium-Scale Burn Testing: Determination of Total (Oxygen Consumption and Carbon Dioxide Generation) and Convective (Temperature Rise) Heat Release Rates of Various Chemical Oxidizers, Final Report, Southwest

Research Institute, San Antonio TX, January 7, 2009, SwRI Project No. 01.13538.01.303.

Trevino, Javier O., Arthur F. Grand, Marc L. Janssens, Simplified calibration procedure for large scale oxygen consumption calorimeters. Document available at http://www.priestassociates.com/uploads/C_Hood_Calibration_2.pdf.

United Nations ST/SG/AC.10/40/Add.2, Report of the Committee of Experts on the Transport of Dangerous Goods and on the Globally Harmonized System of Classification and Labeling of Chemicals on its sixth session, held in Geneva on 14 December 2012. Addendum, Annex II, Amendments to the fifth revised edition of the Recommendations on the Transport of Dangerous Goods, Manual of Tests and Criteria (ST/SG/AC.10/11/Rev.5).

United Nations ST/SG/AC.10/11/Rev.5, Recommendations on the Transport of Dangerous Goods, Manual of Tests and Criteria, fifth revised edition, 2009.

G.1.2 Tests and Criteria. Oxidizers and formulated products containing an oxidizer are assigned to Oxidizer Class 1, Class 2, Class 3, or Class 4 according to the tests and criteria specified in Table G.1.2(a) and Table G.1.2(b).

G.1.3 Definitions.

G.1.3.1 Active Burning Time. Duration of burning with flaming combustion, or decomposition with minor flaming combustion, calculated from test data. From the bench-scale test data, the active burning time is calculated as the time from first measurable mass loss to the time at which 80 percent of the total mass loss has occurred. From the intermediate-scale radiant heat flux test data, the active burning time is the width of the curve at one-half the peak radiant heat flux.

G.1.3.2 Burning Behavior. The complete characterization of a material or mixture's reaction to fire including both visual descriptors and test data.

G.1.3.3 Burning Rate. The principal physical hazard of oxidizer fires described by the intensity or quantity of energy release, in the form of heat and light or accelerated fire, and time duration over which the energy is released.

▲ G.1.3.4 Fire-test-response Characteristic. A response characteristic of a material, product, or assembly to a prescribed source of heat or flame, under controlled fire conditions; such response characteristics may include, but are not limited to, ease of ignition, flame spread, heat release, mass loss, smoke generation, fire resistance, and toxic potency of smoke. [ASTM E176, *Standard Terminology of Fire Standards*]

G.1.3.5 Formulated Product. A product that contains a solid or liquid oxidizer as one of its constituents, including admixtures. Some oxidizers are not sold in pure form (e.g., lithium hypochlorite, calcium hypochlorite). Formulations include chemical by-products and unreacted raw materials inevitably present in the product and intentionally added diluents and exotherm control agents, such as hydrated salt crystals coarsely blended with the manufactured oxidizer.

▲ G.1.3.6 Heat Release Rate (HRR). The thermal energy released per unit time by an item during combustion under specified conditions. [ASTM E176, *Standard Terminology of Fire Standards*]

Table G.1.2(a) NFPA Oxidizer Class Tests and Criteria (Metric Units)

Class	Bench-Scale Test [30 g mixtures with cellulose powder]		Intermediate-Scale Fire Exposure Test [10.9 kg in test packaging]	
	Maximum Mass Loss Rate ^a (g/sec)	Active Burning Time ^b (sec)	Peak Convective Heat Release Rate (kW)	Active Burning Time Based on Radiant Heat Flux Profile ^c (sec)
Class 1	≤0.3	≥30	≤100	≥120
Class 2	0.3 < max MLR < 3	6 < t _{active} < 30	100–200	60 < t _{active} < 120
Class 3	≥3	≤6	≥200	≤60
Class 4	A Class 4 oxidizer meets the Class 3 burning rate criteria plus has evidence to support explosive reaction due to contamination or exposure to thermal or physical shock (as determined from Tests 1(b), 3(a), or 3(b) in the United Nations ST/SG/AC.10/11/Rev.5, <i>Recommendations on the Transport of Dangerous Goods, Manual of Tests and Criteria</i> , fifth revised edition, 2009).			

MLR: Mass loss rate.

^aMax MLR: The maximum mass loss rate of a test mixture from 20 to 80 percent the final measured masst_{active}: burning time calculated from first measurable mass loss to time of 80 percent final mass loss^bCalculated from the mass loss profiles.^cCalculated from the width of the curve at ½ the peak radiant heat flux.**Table G.1.2(b) NFPA Oxidizer Class Tests and Criteria (U.S. Units)**

Class	Bench-Scale Screening Test [0.066 lb mixtures with cellulose powder]		Intermediate-Scale Fire Exposure Test [24 lb in test packaging]	
	Maximum Mass Loss Rate ^a (lb/min)	Active Burning Time ^b (min)	Peak Convective Heat Release Rate (kW)	Active Burning Time Based on Radiant Heat Flux Profile ^c (min)
Class 1	≤0.04	≥0.5	≤100	≥2
Class 2	0.04 < MLR < 0.4	0.1 < t _{active} < 0.5	100–200	1 < t _{active} < 2
Class 3	≥0.4	≤0.1	≥200	≤1
Class 4	A Class 4 oxidizer meets the Class 3 burning rate criteria plus has evidence to support explosive reaction due to contamination or exposure to thermal or physical shock (as determined from Tests 1(b), 3(a), or 3(b) in the United Nations ST/SG/AC.10/11/Rev.5, <i>Recommendations on the Transport of Dangerous Goods, Manual of Tests and Criteria</i> , fifth revised edition, 2009).			

MLR: Mass loss rate.

^aMax MLR: The maximum mass loss rate of a test mixture from 20 to 80 percent the final measured masst_{active}: burning time calculated from first measurable mass loss to time of 80 percent final mass loss^bCalculated from the mass loss profiles.^cCalculated from the width of the curve at ½ the peak radiant heat flux.

G.1.3.7 Mass Burning Rate. Mass loss per unit time by materials burning under specified conditions. [ASTM E176, *Standard Terminology of Fire Standards*]

G.1.3.8 Mass Loss. The change in mass of a solid material to gaseous products during combustion or decomposition expressed per unit quantity of material (g/g, %).

G.1.3.9 Test Packaging. Packaging for solid (granular, tablet, or powder) oxidizers during the intermediate-scale fire exposure test consisting of six, high-density polyethylene (HDPE) containers in a double-wall corrugated board carton.

G.1.3.10 Visual Burning Duration. Duration (s, min) of visible flaming combustion, as measured with a stopwatch.

G.1.4 Bench-Scale Test. The solid oxidizer (granular, powder, crystalline) is evaluated in the particle size and distribution intended for storage, handling, and use. For tablets, the pre-tablet or raw material is tested. Thirty gram (30 g) mixtures (1:1, 4:1, and 9:1 by mass) of the oxidizer or formulated product and dry cellulose powder are exposed to a glowing wire energized to 150 W on a data logging laboratory balance in a laboratory hood. The mass loss rate of each mixture is calculated from test data. The mixture with the highest or maximum mass loss rate is compared to the mass loss rate and burning rate duration criteria in Table G.1.2(a) and Table G.1.2(b). The bench-scale test is capable of distinguishing weak oxidizers (Class 1), strong oxidizers (Class 3), and oxidizers that principally decompose.

G.1.4.1 Test Materials. *Cellulose Powder.* Dried fibrous cellulose with a fiber length between 50 μm and 250 μm and a mean diameter of 25 μm is used as the combustible material. The cellulose powder is spread in a pan so the depth of powder is less than or equal to 0.25 in. and dried in a laboratory oven at 221°F (105°C) for 4 hours. After drying, the powder is transferred to a desiccator cabinet with desiccant. When cool, the moisture content is measured using an analytical moisture analyzer or by gravimetric analysis. The moisture content must be below 0.5 percent w/w when measured at 105°F. Suitable cellulose is currently available as Technocel 75 from CFF GmbH & Co. KG, Arnstaedter Strasse 2, 98708 Gehren, Germany, www.dff.de, and was previously available as CF-11 from Whatman.

Oxidizer. A solid (granular, crystalline, powder, prill, or tablet) containing an oxidizer functional group requiring evaluation for assignment to Class 1, Class 2, Class 3, or Class 4. The oxidizer should be documented as-received to include: CAS number of the oxidizer(s), chemical composition if a mixture or formulation, form, and, if granular, the particle size and distribution measured with certified sieves and recorded as mass percent of each particle size fraction.

G.1.4.2 Instrumentation and Test Set-Up. *Laboratory Balance.* A laboratory balance is positioned and leveled inside a clean laboratory hood. The hood air stream velocity should be 0.5 m/s (1.6 ft/s) or less measured at the face of the hood and capable of capturing all gaseous products generated. An apparatus such as a metal frame, constructed of welded steel and having two pins at the diagonal of the weighing surface, is used to center scale protection materials. The pins do not contact the laboratory balance but function to center protection materials. The laboratory balance programmable response-time settings are optimized to establish the data output interval. Data collection at 0.2-, 0.5-, or 1-second intervals is typical. Data-logging parameters are similarly set at the computer interface and software to collect and record time-stamped mass data. Auto-calibration functions of the balance, if any, are disabled during tests.

Protection Materials. The laboratory balance weighing pan is protected with three or more layers of high-temperature ceramic fiberboard. For example, a balance weighing surface with dimensions 0.15 m × 0.15 m (6 in. × 6 in.) would be protected with a bottom or base layer of Kaowool HT board with dimensions 0.30 m × 0.30 m × 0.013 m (12 in. × 12 in. × ½ in.). The base layer extends beyond the balance to capture material ejected from the test platform. Two openings in the

base layer correspond to the location of the centering pins of the apparatus. The middle layer is Kaowool HT board with dimensions 0.178 m × 0.178 m × 0.013 m (7 in. × 7 in. × ½ in.), and the top layer, or test platform, is Kaowool PM board with dimensions 0.114 m × 0.114 m × 0.006 m (4½ in. × 4½ in. × ¼ in.). The base layer of protection remains on the balance after each trial.

Due to heat retained from the glowing wire and/or test mixtures, the two top layers of ceramic board on the base layer are removed after each test. The middle and top layers of HT board can be reused after cleaning and cooling to room temperature.


A suitable barrier is constructed around the laboratory balance and protection materials to prevent air currents from the operating hood from influencing balance stability. For example, a barrier might consist of up to three 0.0127 m (½ in.) thick fiber boards — one on each side of the balance extending from the back of the hood to the front of the hood and one in the back — and clear plastic in the front secured to the sides with tape. The hood air velocity should not interfere with balance stability.

Thermocouples (Optional). Three K-type air thermocouples (TC) are secured to a ring stand to one side of the protected lab balance. The tips of the thermocouples are centered above the test platform. The distances from the surface of the test platform recommended to capture the range in plume temperatures are 7.6 cm (3 in.), 15.2 cm (6 in.), and 22.8 cm (9 in.). A fourth K-type thermocouple monitors the ambient temperature. The TCs are attached to the data acquisition system programmed to record the plume temperatures over the same time interval as the lab balance (e.g., 0.2-, 0.5-, and 1-second intervals). The fixed-height thermocouples are also used to estimate peak flame height during a test.

Ignition source. A wire (for example, Nichrome) is formed as specified in Figure G.1.4.2. The length of the wire is 30±1 cm (11.8 in.); the wire diameter is <1 mm (<0.039 in.). A variable laboratory power supply is used to regulate the voltage and current to the wire to achieve 150±7 W when energized. It is very important that the power connection to the heating wire is flexible enough to avoid any influence on the proper operation of the balance. For example, conductors from the power supply output can be secured to one or more ceramic terminal blocks. The first terminal block, secured with a clamp at the rear of the lab balance, has conductors to a second ceramic terminal block near the test platform, and the looped wire is inserted in the second terminal block to complete the circuit. The looped portion of the wire is centered over the test platform.

Source: Recommendations on the Transport of Dangerous Goods, Manual of Tests and Criteria, United Nations Economic Commission for Europe, 2015.

G.1.4.3 Test Methodology. Test Mixtures. Three concentrations of oxidizer-cellulose powder mixtures evaluated are (1) 1:1 by mass mixtures containing 15 g oxidizer and 15 g dried cellulose powder; (2) 4:1 by mass mixtures containing 24 g oxidizer and 6 g dried cellulose powder; and (3) 9:1 by mass mixtures containing 27 g oxidizer and 3 g dried cellulose powder. Five trials of each concentration are tested. Each mixture should be prepared individually and not taken from a pre-mixed batch.

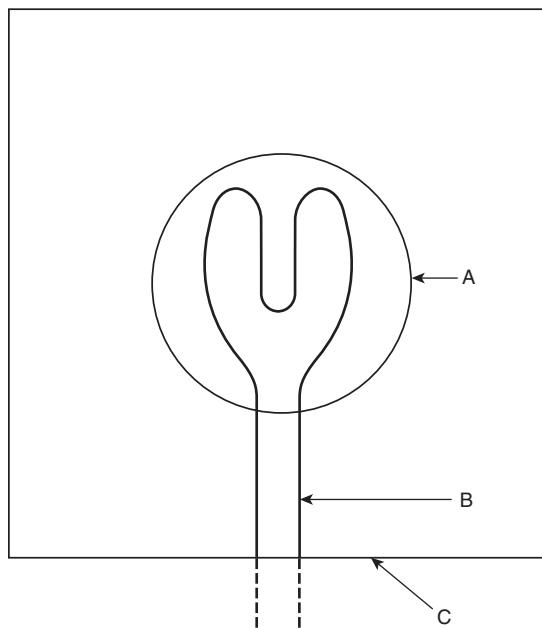

A: Base of sample cone [2.75 in. (70 mm) diameter]
B: Heating wire
C: Low heat conducting plate

N **FIGURE G.1.4.2 Ignition Wire Example.**

Single Test Procedure. Each mixture of oxidizer and dried cellulose powder is prepared immediately prior to each trial in a test series. A second laboratory balance is used to weigh the required amounts of cellulose powder and oxidizer to the nearest 0.1 g. The materials are transferred to and combined in a clean, labeled container (500 mL) with a screw-top lid. Mixing of the contents is done by inverting (not shaking) the container no less than 25 times. After mixing, the contents of the container are transferred into a funnel (70 mm diameter, 102 mL volume, 60 degree angle) with a sealed stem. The funnel with the mixture is tamped lightly. The funnel with material is inverted so that the conical pile of material is centered over the looped ignition wire. This can be done by putting the wire and test platform over the funnel and then inverting the entire assemblage. Alternatively, using cardstock paper, the funnel with the mixture is inverted over the looped wire ignition source on the test platform. When the cardstock is removed, gently twisting the funnel over the wire allows for uniform settling of the mixture around the ignition wire on the test platform. The funnel is removed, leaving the conical pile of material centered on the wire.

The balance is tared to zero. The sash of the hood is lowered and the hood blower is energized. The laboratory temperature and relative humidity are recorded. If necessary, the balance is re-tared to zero. Once balance stability is confirmed, data acquisition is initiated, and baseline data is collected for at least 10 seconds before the wire is energized at the power supply. A stopwatch is activated when the wire is energized. Mass loss and the temperature data are collected until spreading discoloration and/or visible flaming combustion cease. In the event of little or no flaming combustion, mass and temperature data are collected for 5 min.

After each trial, whether the wire is open or continuous, the electrical power to the wire is shut off, the wire is disconnected, and the top two layers of balance protection materials with the test residue are removed.

A new wire should be used for each test.

A video-recorded demonstration of the single test procedure is available at: www.nfpa.org/foundation.

G.1.4.4 Test Sequence. The oxidizer:cellulose powder mixtures are tested in the following sequence: 1:1 (5 trials), 4:1 (5 trials), then 9:1 (5 trials). If either the 1:1 or 4:1 mixture results in vigorous burning with stopwatch burning durations less than 6 sec and/or the calculated peak mass loss rate is greater than 3 g/sec, the 9:1 mixture does not need to be tested.

G.1.4.5 Test Data. *Visual.* Photographs and/or video recordings are used to document, at a minimum, one representative trial in a test series. Visual observations should be recorded and might include: the peak flame height above the test platform; whether the pile ignited readily or was slow to ignite; whether flames readily spread over the pile or were slow to spread; the flame color; the relative volume and color of gaseous products generated; material displaced from the test platform, if any; unusual burning behavior such as swelling or “boiling”; observable or clear dependence of burning rate on the duration of the energized wire; irregular or intermittent burning; and presence of unburned or uninvolved material remaining at the end of a test.

Calculated. The profile of each burning test is examined by plotting the mass loss data as a function of time. The percent material consumed is calculated from the final measured mass loss (m_f) over the initial mass (m_i or 30.0 g) of the mixture times 100 percent. The mass loss rate is then calculated from the time at 20 percent and 80 percent the final measured mass loss. For example, the balance with a 30.0 g mixture is tared to and starts with a reading of 0.0 g and, at the completion of combustion, ends with a reading of -20.0 g. The percent material consumed is $20.0/30.0 \text{ g} \times 100$ or 67 percent. The mass loss rate is calculated from the time at $0.20 \times 20.0 \text{ g}$ or 4.0 g to the time at $0.80 \times 20.0 \text{ g}$ or 16.0 g. The mass loss rate is preferably calculated by performing a least squares linear fit of the mass loss data between $0.20 m_f$ and $0.80 m_f$. The coefficient of correlation (R^2) of the mass curve from each trial should be at least 0.90 between 20 percent and 80 percent mass loss. The active burning time is the time from first measurable mass loss to the time at $0.80 m_f$. First measurable mass loss is defined as, upon energizing the wire, the first time-stamped mass data that leads a continuous series of decreasing mass at the pile as ignition, combustion, or decomposition occurs.

Mass loss rate and active burning time data are calculated for each trial within a series and are then used to calculate an average and sample standard deviation for the series of trials (e.g., 5 trials for 1:1 mixture). If the burning behavior is found to depend on the duration of wire continuity, the highest mass loss rate is used instead of the average; or a sufficient number of trials are conducted to obtain trials where the wire break occurs after the main reaction time.

G.1.4.6 Test Criteria. The bench-scale test criteria, based on the maximum mass loss rate from the averages and the active burning time, are shown in Table G.1.2(a) and Table G.1.2(b). The average active burning time and mass loss rate data for an

oxidizer in 1:1, 4:1, and, if necessary, 9:1 oxidizer:cellulose powder mixtures are compared after completing the series of trials. The mixture with the greater mass loss rate is identified; the maximum mass loss rate within that mixture is compared with the test criteria. For example, a 1:1 oxidizer:cellulose powder mixture has average mass loss rate and active burning time $2.1 \pm 0.2 \text{ g/sec}$ and $10.7 \pm 1.3 \text{ s}$, respectively. The 4:1 mixture of the same oxidizer with cellulose powder result in average mass loss rate and active burning time $11.3 \pm 1.2 \text{ g/sec}$ and $2.0 \pm 0.4 \text{ s}$, respectively. The 4:1 mixture has the greater mass loss rate with a maximum mass loss rate $11.3 \text{ g/sec} + 1.2 \text{ g/sec}$ or 12.5 g/sec . Using the maximum mass loss rate, active burning time, and criteria in Table G.1.2(a), the oxidizer is assigned to Class 3.

G.1.5 Intermediate-Scale Fire Exposure Test. If the bench-scale test results in borderline Class assignment (e.g., borderline Class 1/Class 2 or borderline Class 2/Class 3), the intermediate-scale test should be performed. The intermediate-scale test can be performed instead of the bench-scale test. Otherwise, the intermediate-scale test is optional. Twenty-four pounds (10.9 kg) of the solid oxidizer (in the form and concentration intended for storage, handling, and use are transferred to the combustible test packaging is centered on a drywall-lined table and inside the opening of a U-shaped propane-fueled burner, and ignited under a calibrated 2 MW hood instrumented in accordance with ASTM E2067. The peak convective heat release rate, less the burner contribution, is calculated from gas temperature rise calorimetry equations. The duration of active burning is calculated from radiant heat flux transducers, less the burner contribution, at a fixed distance from the packaged test material. The peak convective heat release rate of the oxidizer in test packaging is compared to the peak convective heat release rate active and burning time criteria in Table G.1.2(a) or Table G.1.2(b).

G.1.5.1 Test Materials. *Oxidizer.* The chemical composition and physical properties of the oxidizer or formulated product containing an oxidizer being evaluated are recorded. The oxidizer or formulated physical form is characterized as granular, crystalline, powder, prill, or tablet. The test material is not ground or subject to any mechanical attrition or sieving to reduce the particle size. The original packaging of the oxidizer is recorded.

Combustible Test Packaging. High-density polyethylene (HDPE) wide-mouth containers with screw-top lids in corrugated board cartons are used as combustible test packaging. The HDPE containers should not contain additives that would reduce the burn rate. The HDPE container specifications are summarized in Table G.1.5.1(a). Suitable containers are currently supplied by Consolidated Plastics Inc. (Twinsburg, OH).

The corrugated board carton should be double-wall construction and not contain additives that would reduce the burn rate. The carton specifications are summarized in Table G.1.5.1(b). Suitable cartons are made by JM Packaging-Detroit Tape and Label (Warren, MI).

Although oxidizers and formulations containing oxidizers can be sold in other packaging, the standard test method utilizes combustible packaging consisting of six, HDPE containers (60 oz or 85 oz) with lids in a corrugated board carton. The $1,774 \text{ cm}^3$ (60 oz) HDPE containers accommodate most oxidizer solids based on density; the $2,514 \text{ cm}^3$ (85 oz) containers can be used for low-density (i.e., powder form) oxidizers. Four pounds (1.8 kg) of oxidizer are transferred to each HDPE

Table G.1.5.1(a) Description of HDPE Containers with Lids

Volume Ounce (cm ³)	Overall Height Inch (cm)	Outer Diameter Inch (cm)	Wall Thickness Inch (cm)	Mass (g)
60 ± 0.5 (1,774)	6.38 ± 0.5 (16.19)	4.81 (12.22)	0.04 (0.10)	99

container. The HDPE containers are then arranged in the corrugated board carton with doubled-wall construction. The dimensions of the carton that enclose six, 1,774 cm³ (60 oz) HDPE containers are 40.6 cm × 25.4 cm × 20.3 cm (16 in. × 10 in. × 8 in.); the dimensions of the carton that enclose six 2,514 cm³ (85 oz) HDPE containers are 40.6 cm × 20.3 cm × 20.3 cm (16 in. 10 in. × 10 in.).

G.1.5.2 Instrumentation and Test Set-Up. Laboratory Balance. A laboratory balance is used to measure the oxidizer from the as-received packaging for transfer into the test packaging. The mass of oxidizer in each container and/or bag is measured and recorded.

Hood. A minimum 2 MW capacity hood designed and equipped with instrumentation described in ASTM E2067, *Standard Practice for Full-Scale Oxygen Consumption Calorimetry Fire Tests*, is required to capture and measure the temperature of the gaseous products of combustion or decomposition. The skirt of the hood should be no more than 6 ft from the floor. For consistency between burns, the hood flow rate should be the same for the calorimetric calibration, the baseline burner, and the test materials. Because oxidizers can evolve oxygen during combustion, gas temperature rise and not oxygen consumption calorimetry is used to calculate the heat release rate.

Burn Table. A noncombustible table, with a removable top and tray, is centered and leveled under the hood. The bottom of the tray is lined with ≥ 6.35 mm (0.25 in.) thick drywall 0.91 m × 0.91 m (3 ft × 3 ft). Four short 7.6 cm to 10.1 cm (3 in. to 4 in.) walls made of non-combustible material are attached to the edges of the tray to contain and prevent the flow of material from the tray during a test. The table height is such that the bottom of the test package is 1.1 m (3 ft 8 in.) from the floor.

Ignition Source. A U-shaped burner is constructed from threaded black gas pipe (1 in. NPS) and cast iron threaded fittings. The distance between the two legs of the U-shaped burner is 43.8 cm (17¼ in.); the length of each leg is 50.8 cm (20¼ in.). Each leg of the burner has 38 uniformly spaced openings oriented toward the interior each with a diameter 3.4 mm (0.13 in.); the pipe joining the two legs has 26 drilled openings. The carton is centered between the parallel burner legs and 4 in. from joining the section opposite the open side of the U. The burner does not contact the protected load cell, table, or

Table G.1.5.1(b) Description of Cartons

Height Inches (cm)	Length Inches (cm)	Width Inches (cm)	Mass Pounds (g)
8 ± 0.1 (20.3)	16 ± 0.1 (40.6)	10 ± 0.1 (25.4)	1.4 ± 0.1 (625)

tray. Propane gas is supplied to the burner from a cylinder. The flow rate to the burner is adjusted using a regulator at the cylinder outlet. The flow rate to the burner is adjusted using the regulator so that the output of the burner is 38 kW (convective heat release rate). Note: Using the effective heat of combustion of propane (46.4 kJ/g), for a 38 kW fire, the mass flow rate of propane gas to the burner is will probably be approximately 0.8 g/sec.

Radiant Heat Flux Transducers. Two calibrated, water-cooled, Schmidt-Boelter or Gardon Gage incident radiant heat flux (0-50 kW/m²) transducers are affixed to a rigid stand and positioned next to the table with the sensors center with the carton between the legs of the U-shaped burner. The distance from the floor to the lower target is 1.2 m (4 ft 2 in.); the distance between the lower and upper target is 0.45 m (18 in.). The distance from the heat flux sensors to the center of the table where the carton is positioned is 0.95 m (3 ft 2 in.). With respect to the test packaging, the lower heat flux transducer is located at the height of the top section of the carton (or pail). The second heat flux transducer is located at 0.4 m (16 in.) above the top of the carton.

Digital Clock. A digital clock that will be visible and readable in the video recording of the test can be used.

Ambient Air Thermocouple (Required). The ambient air temperature is measured continuously during the test at the same data acquisition rate as the exhaust gas temperature. The ambient air thermocouple should be placed outside of the hood, far enough away to prevent interference from the burn test, but close enough to represent the ambient air in the room. The thermocouple should be protected from radiant heat from the burn test.

Thermocouples (Optional). Four, K-type fiberglass insulated thermocouples (TC) are attached to the carton. One TC is taped to the exterior bottom center of the carton; a second TC is taped to the exterior top center of the carton. A hole is punched through one side of the carton, through which two TCs are inserted. A hole is drilled through the lid of one HDPE container and a TC is inserted into the material inside. The hole in the lid is sealed with tape. The second TC is secured to the side exterior center of one HDPE container with the bead positioned between the container and the carton wall. The bead of the TC is exposed (e.g., not taped). Temperature data is recorded using a data acquisition system.

Data should be collected at least every second for the calibration, baseline, and test burns.

G.1.5.3 Test Methodology. Before each test, the temperature and relative humidity inside the burn facility are recorded. At the start of a test, the hood is turned on and a 2-minute baseline of data is collected. The data should be collected at a frequency rate of at least 1 second; 5 second intervals is typical. The gas burner is ignited at 2 minutes and a timer is activated. The gaseous products of combustion and/or decomposition from the packaged oxidizer are entrained in the hood and exhaust collection duct. The burner remains on for the duration of a test and for sufficient time after enhanced burning of the packaged test material to return to burner baseline values. For example, for inert materials and weaker oxidizers, the burner remains on for up to 20 minutes. For stronger oxidizers, the burner remains on for 10 minutes. At the conclusion of a test, the regulator at the propane cylinder supplying fuel to the burner is closed. The test material is observed for residual

fire or decomposition. The post-test residue is photographed and examined — specifically noting evidence of a phase change (i.e., molten) and the presence of unburned combustible packaging material(s). After cooling, the post-test residue is prepared for disposal.

A new test tray should be used for each test.

G.1.5.4 Test Sequence. It is recommended that bench scale tests are performed prior to intermediate-scale testing to understand the potential burning behavior. A typical test series includes hood calibration, empty test packaging, then the oxidizer or formulation containing an oxidizer in the combustible test packaging. The following **test sequence** is recommended each day of testing:

The calibration runs are used to calculate the C factor (see calculations). The baseline should be obtained at the same hood and gas flow rates as the test. The baseline runs should be conducted so that at least 5 minutes of stable data is obtained.

G.1.5.5 Test Data. *Visual.* Photographs and video recordings document the intermediate-scale fire exposure test of the oxidizer in test packaging, specifically the visual increase in burning behavior when the test packaging is compromised and the oxidizer is involved. Other notable observations include the generation, relative quantity, and color of gaseous products, flame color, and the presence or absence of residual flaming or decomposition after the burner is extinguished. Time-resolved combustion gas analysis by Fourier Transform Infrared spectroscopy is optional.

Calculated. The convective heat release rate (Equation G.1.5.5a) is calculated from the mass flow rate (Equation G.1.5.5b) and temperature of combustion gases in the exhaust duct. The width of the curve at one-half the peak radiant heat flux is used to calculate the duration of active burning. The propane burner convective heat release rate is subtracted from the peak convective heat release rate to arrive at the heat release rate from the packaged oxidizer (Equation G.1.5.5c).

△ [G.1.5.5a]

$$\dot{q}_{conv} = \dot{m}c_p (T_g - T_a)$$

where:

\dot{q}_{conv} = convective heat release rate (kW)

\dot{m} = mass flow in exhaust duct (kg/s)

c_p = specific heat of combustion gas (kJ/kg-K)

T_g = gas temperature (K)

T_a = ambient temperature (K)

△ Table G.1.5.4

Sequence	Burner Output, kW
Hood calibration per ASTM E2067	0, 40, 160, 0
Burner baseline with U-shaped burner only	38
Sample runs (1 or more) with U-shaped burner and packaged oxidizer	38
Burner baseline with U-shaped burner only	38

△ [G.1.5.5b]

$$\dot{m} = C\sqrt{Dp/T_g}$$

where:

C = is the calibration constant measured for the calorimeter

Δp = is the pressure drop at the bidirectional probe (Pa)

△ [G.1.5.5c]

$$\dot{q}_{oxidizer} = \dot{q}_{conv} - \dot{q}_{conv,burner} \text{ (kW)}$$

ASTM E2067, *Standard Practice for Full-Scale Oxygen Consumption Calorimetry Fire Tests*, provides details regarding hood instrumentation and calibration. Because combustion products consist primarily of excess air and nitrogen, it is reasonable to approximate the specific heat of the gas mixture in the exhaust duct, c_p , by that of air. The specific heat of air is nearly independent of temperature and on the order of $c_{p,air} = 1.01$ kJ/kg K.

The calibration constant is calculated using the following procedure from Trevino et al:

- (1) An “initial” calibration constant is calculated using the following equation: $C = 22.1 \times A$, where A is the area of the duct (in m²).
- (2) Propane or methane fuel is burned at a constant rate for a specific time interval (e.g., 10 min). The heat release rate is measured using oxygen consumption calorimetry and the “initial” value for C. The mass of fuel consumed is measured directly or from a calibrated mass flowmeter.
- (3) The total heat release is calculated from the mass of fuel consumed and net heat of combustion. Multiply this value by 0.98 to take into account efficiency of combustion.
- (4) Adjust the calibration constant, C, so that the total heat release from the system calculations agrees with that calculated from the mass of fuel consumed.
- (5) Use this new constant for subsequent tests for calculations of HRR and volumetric flow rate.

Typically, a spreadsheet with equations is used to generate calibration and test material heat release rate profiles. The equations needed to calculate the total heat released for the calibration only can be found in ASTM E2067.

△ [G.1.5.5d]

$$qT, O_2 = \left[E\phi - (E - E_{CO}) \frac{1 - \phi X_{CO}^A}{2 X_{O_2}^A} \right] \frac{M_{O_2}}{M_a} \frac{\dot{m}_r}{1 + \phi(a-1)} X \frac{A^O}{O_2}$$

△ [G.1.5.5e]

$$\phi = \frac{X_{O_2}^{A^O} (1 - X_{CO_2}^A - X_{CO}^A) - X_{O_2}^A (1 - X_{CO_2}^{A^O})}{X_{O_2}^{A^O} (1 - X_{O_2}^A - X_{CO_2}^A - X_{CO}^A)}$$

where:

$X_{O_2}^{A^O}$ = measured mole fraction of O₂ in incoming air

$X_{CO_2}^{A^O}$ = measured mole fraction of CO₂ in incoming air

$X_{\text{CO}}^{\text{A}0}$ = measured mole fraction of CO in incoming air

$X_{\text{O}_2}^{\text{A}}$ = measured mole fraction of O₂ in exhaust flow

$X_{\text{CO}_2}^{\text{A}}$ = measured mole fraction of CO₂ in exhaust flow

X_{CO}^{A} = measured mole fraction of CO in exhaust flow

E = net heat released per unit mass of O₂ consumed, generic (13.1 MJ/kg). *This value should be used for burning of samples other than oxidizers.*

E = net heat released per unit mass of O₂ consumed, propane (12.8 MJ/kg). *This value should be used for burning of propane.*

E_{CO} = net heat release per unit mass of O₂ consumed, for CO (17.6 MJ/kg)

M^{a} = molecular weight of incoming air (29 kg/kmol)

M_{CO} = molecular weight of carbon monoxide (28 kg/kmol)

M_{CO_2} = molecular weight of carbon dioxide (44 kg/kmol)

M_{O_2} = molecular weight of oxygen (32 kg/kmol)

A = combustion expansion factor (nondimensional) (1.084)

$\Delta H_{\text{CO}_2}^*$ = net heat of complete combustion per unit mass of carbon dioxide generated (13.3 MJ/kg)

ΔH_{CO}^* = net heat of complete combustion per unit mass of carbon monoxide generated (11.1 MJ/kg)

ρ_o = density of air at 273.15 K (1.293 kg/m³)

The baseline burner convective heat release rate (q_{conv}) is calculated using Equations G.1.5.5d and G.1.5.5e then averaging over at least a 5-minute steady-state period. The two baseline averages (start and end) should then be compared and the average used for the baseline value used in the calculation of the oxidizer convective heat release rate (Equation G.1.5.5c). The active burning time is calculated from the width of the radiant heat flux-time profile at one-half the peak radiant heat flux.

Test Report. The following information and data to report should include:

- (1) Any chemical analysis information available on the test sample
- (2) SDS of test sample
- (3) Weight of each individual HDPE container, empty and filled with sample.
- (4) Total weight of sample, HDPE containers, and carton.

For the calibration burns:

- (1) Heat release rate versus time profile
- (2) All measurements, calculations, and constants used to calculate the C factor.

For the baseline and test burns:

- (1) Ambient and exhaust gas temperature versus time profiles
- (2) Radiant heat flux versus time profile
- (3) Convective heat release versus time profile with peak convective heat release indicated
- (4) Burn times calculated from each heat flux transducer versus time profile
- (5) All measurements, calculations, and constants used to calculate the convective heat release
- (6) Unusual burning behavior

G.1.5.6 Test Criteria. The intermediate-scale fire exposure test criteria, based on the peak convective heat release rate, are summarized in Table G.1.2(a) and Table G.1.2(b). If the peak convective heat release rate and active burning times result in assignment to different Classes, the heat release rate should be used to assign the oxidizer to a Class. A Class 4 oxidizer meets the Class 3 burning rate criteria plus there is evidence (such as results from Tests 1(b), 3(a), or 3(b) in the United Nations ST/SG/AC.10/11/Rev.5, Recommendations on the Transport of Dangerous Goods, Manual of Tests and Criteria, fifth revised edition, 2009) to support explosive reaction due to contamination or exposure to the thermal or physical shock.

G.2 Typical Oxidizers.

Δ G.2.1 General. Unless concentration is specified, undiluted material is referenced. The oxidizers marked with ** are classed based on the results of tests and criteria in Table G.1.2(a). The lists are not all-inclusive and are amended to reflect how typical oxidizers are used, handled, and stored.

• G.2.2 Class 1 Oxidizers. The following are typical Class 1 oxidizers:

- (1) All inorganic nitrates (unless otherwise classified)
- (2) All inorganic nitrites (unless otherwise classified)
- (3) Ammonium persulfate
- (4) Barium peroxide
- (5) Calcium hypochlorite (nominal 80 percent, maximum 81 percent) blended with magnesium sulfate heptahydrate (nominal 20 percent, minimum 19 percent) having an available chlorine of less than or equal to 66 percent and a total water content of at least 17 percent
- (6) Calcium peroxide
- (7) Hydrogen peroxide solutions (greater than 8 percent up to 27.5 percent)
- (8) Lead dioxide
- (9) Lithium hypochlorite (39 percent or less available chlorine)
- (10) Lithium peroxide
- (11) Magnesium peroxide
- (12) Manganese dioxide
- (13) Nitric acid (40 percent concentration or less)
- (14) Perchloric acid solutions (less than 50 percent by weight)
- (15) Potassium dichromate
- (16) Potassium monopersulfate (45 percent KHSO₅ or 90 percent triple salt)**
- (17) Potassium percarbonate
- (18) Potassium persulfate
- (19) Sodium carbonate peroxide
- (20) Sodium dichloro-s-triazinetriene dihydrate (sodium dichloroisocyanurate dihydrate)
- (21) Sodium dichromate
- (22) Sodium perborate (anhydrous)
- (23) Sodium perborate monohydrate
- (24) Sodium perborate tetrahydrate
- (25) Sodium percarbonate
- (26) Sodium persulfate
- (27) Strontium peroxide
- (28) Trichloro-s-triazinetriene [trichloroisocyanuric acid (TCCA; trichlor), all physical forms]
- (29) Zinc peroxide

G.2.3 Class 2 Oxidizers. The following are typical Class 2 oxidizers:

- (1) Ammonium nitrate prill (99 percent)**
- (2) Barium bromate
- (3) Barium chlorate
- (4) Barium hypochlorite
- (5) Barium perchlorate
- (6) Barium permanganate
- (7) 1-Bromo-3-chloro-5,5-dimethylhydantoin (BCDMH)
- (8) Calcium chlorate
- (9) Calcium chlorite
- (10) Calcium hypochlorite (48 percent or less by weight unless covered by other formulations in G.1.2)**
- (11) Calcium hypochlorite (50 percent or less by weight unless covered by other formulations in Section G.2).
- (12) Calcium perchlorate
- (13) Calcium permanganate
- (14) Calcium peroxide (75 percent)**
- (15) Chromium trioxide (chromic acid)
- (16) Copper chlorate
- (17) Halane (1,3-dichloro-5,5-dimethylhydantoin)
- (18) Hydrogen peroxide (greater than 27.5 percent up to 52 percent)
- (19) Lead perchlorate
- (20) Lithium chlorate
- (21) Lithium hypochlorite (more than 39 percent available chlorine)
- (22) Lithium perchlorate
- (23) Magnesium bromate
- (24) Magnesium chlorate
- (25) Magnesium perchlorate
- (26) Mercurous chlorate
- (27) Nitric acid (more than 40 percent but less than 86 percent)
- (28) Nitrogen tetroxide
- (29) Perchloric acid solutions (more than 50 percent but less than 60 percent)
- (30) Potassium perchlorate
- (31) Potassium permanganate
- (32) Potassium peroxide
- (33) Potassium superoxide
- (34) Silver peroxide
- (35) Sodium dichloro-s-triazinetrione anhydrous (sodium dichlorocyanurate anhydrous)**
- (36) Sodium chlorite (40 percent or less by weight)
- (37) Sodium perchlorate
- (38) Sodium perchlorate monohydrate
- (39) Sodium permanganate
- (40) Sodium peroxide
- (41) Sodium persulfate (99 percent)**
- (42) Strontium chlorate
- (43) Strontium perchlorate
- (44) Thallium chlorate
- (45) Urea hydrogen peroxide
- (46) Zinc bromate
- (47) Zinc chlorate
- (48) Zinc permanganate

G.2.4 Class 3 Oxidizers. The following are typical Class 3 oxidizers:

- (1) Ammonium dichromate
- (2) Calcium hypochlorite (over 48 percent by weight unless covered by other formulations in G.1.2)**

- (3) Calcium hypochlorite (over 50 percent by weight unless covered in other formulations in Section G.2)
- (4) Calcium hypochlorite (over 50 percent by weight)
- (5) Chloric acid (10 percent maximum concentration)
- (6) Hydrogen peroxide solutions (greater than 52 percent up to 91 percent)
- (7) Mono-(trichloro)-tetra-(monopotassium dichloro)-penta-s-triazinetrione
- (8) Nitric acid, fuming (more than 86 percent concentration)
- (9) Perchloric acid solutions (60 percent to 72 percent by weight)
- (10) Potassium bromate
- (11) Potassium chlorate
- (12) Potassium dichloro-s-triazinetrione (potassium dichloroisocyanurate)
- (13) Potassium perchlorate (99 percent)**
- (14) Potassium permanganate (greater than 97.5 percent)**
- (15) Sodium bromate
- (16) Sodium chlorate
- (17) Sodium chlorite (over 40 percent by weight)

G.2.5 Class 4 Oxidizers. The following are typical Class 4 oxidizers:

- (1) Ammonium perchlorate (particle size greater than 15 microns)
- (2) Ammonium permanganate
- (3) Guanidine nitrate
- (4) Hydrogen peroxide solutions (greater than 91 percent)
- (5) Tetranitromethane

Ammonium perchlorate that is less than 15 microns is classified as an explosive and, as such, is not covered by this code. (See NFPA 495.)

G.3 Safety Information on Oxidizers Used in Detergents.

G.3.1 Sodium Percarbonate. Sodium percarbonate (CAS 15630-89-4), or sodium carbonate perhydrate, is a solid adduct of hydrogen peroxide ($\text{Na}_2\text{CO}_3 \cdot 3/2\text{H}_2\text{O}_2$) used in detergent formulations. The active oxygen content of granular solid sodium percarbonate ranges from 12 to 14.5 percent. Granular particles are typically coated. Sodium percarbonate (99 percent) is a Class 1 oxidizer. Sodium percarbonate and sodium percarbonate-rich mixtures (>70 wt percent) are sensitive to gross contamination, heat, and reducing agents and are potentially explosive if mixed with organics. Sodium percarbonate and its formulated products have the propensity to undergo exothermic decomposition with the rapid release of oxygen, water as steam, and heat sufficient to ignite nearby combustible materials. The kinetics and decomposition reactions are complex. The self-accelerating decomposition temperature (SADT), the lowest ambient temperature at which self-accelerating decomposition can occur in a material in the packaging used for transportation, is reported to be 168°F (76°C) for 55 lb (25 kg) packages and 122°F (50°C) for 1 ton (1000 kg) bags. If improperly discarded or mixed with combustible trash, a fire can result.

G.4 Safety Information on Oxidizers Used in Swimming Pools.

G.4.1 Handling Swimming Pool Chemicals. Oxidizers and sanitizers for swimming pools are some of the most widely used, manufactured, and distributed oxidizers. Anyone handling or using swimming pool chemicals should be fully aware of proper storage and handling requirements, as well as emergency and first-aid procedures in case of an accident. Chlorinated pool

chemicals are incompatible with many chemicals associated with pool care, including algacides, pool conditioners (stabilizers), clarifiers, and other types of chlorine. It is essential to follow all storage and handling procedures to prevent conditions that might cause emergencies, such as a fire or explosion. This section includes specific information on pool oxidizers.

Calcium hypochlorite (cal hypo), lithium hypochlorite, and chlorinated isocyanurates (dichlor and trichlor) are not combustibles. They are oxidizers. Some oxidizers can cause the spontaneous ignition and increase the burning rate of combustible materials, including the majority of their packaging material. Some oxidizers decompose rapidly and undergo self-sustained decomposition, which can result in an intense fire or explosion. The decomposition of dry chlorinated pool chemicals can also produce toxic and corrosive gases.

Because of the composition and properties of calcium hypochlorite, lithium hypochlorite, and chlorinated isocyanurates, special precautions are required to prevent contact and reaction with each other and other chemicals. Reactions will occur if they are physically mixed together.

Emergency responders should be aware of oxidizers being stored in their area of response, visit the facilities, and obtain copies of the SDS associated with the chemicals being stored. Knowledge of the facility and the chemicals being stored makes any response more efficient and effective.

Containers should be stored away from combustible or flammable products, and product packaging should be kept clean and free of all contamination, including other pool treatment products, acids, organic materials, nitrogen-containing compounds, dry-powder fire extinguishers (containing monoammonium phosphate), oxidizers, all corrosive liquids, flammable or combustible materials, and so forth.

G.4.1.1 Calcium Hypochlorite. Calcium hypochlorite, commonly known as cal hypo, decomposes above 350°F (177°C). The decomposition will generate oxygen and heat, possibly resulting in a fire of great intensity if combustible materials are present. Direct-exposure fire could cause the materials to decompose, the container to erupt, and the fire to reach vastly higher levels of intensity. Decomposition leaves an inert residue consisting mainly of calcium chloride. Cal hypo (over 50 percent by weight) is classified as a Class 3 oxidizer. Cal hypo (50 percent or less by weight) is classified as a Class 2 oxidizer.

G.4.1.2 Lithium Hypochlorite. Lithium hypochlorite decomposes at 275°F (135°C), producing oxygen, lithium hydroxide, lithium chlorates, and hazardous gases. Contamination with moisture, organic matter, or other chemicals can start a chemical reaction that generates heat, hazardous gases, fire, and explosion. Lithium hypochlorite (available chlorine of 39 percent or less) is classified as a Class 1 oxidizer. Lithium hypochlorite (more than 39 percent available chlorine) is classified as a Class 2 oxidizer.

G.4.1.3 Sodium Dichloroisocyanurate. Sodium dichloroisocyanurate is commonly known as dichlor. It decomposes in the range of 428°F to 482°F (220°C to 250°C) and can generate enough heat to ignite items such as paper and wood. Dichlors will sustain thermal decomposition above 428°F (220°C), even in the absence of oxygen. Decomposition results in a yellow or brown porous inert residue. Anhydrous dichlor is classified as a Class 2 oxidizer in accordance with testing criteria found in

G.1.2. Dichlor dihydrate is classified by NFPA as a Class 1 oxidizer.

G.4.1.4 Trichloroisocyanuric Acid. Trichloroisocyanuric acid is commonly known as trichlor. It decomposes in the range of 428°F to 482°F (220°C to 250°C). Decomposition of trichlor requires a continuous source of heat. Once the heat source is removed, trichlor will not continue to decompose. Partial decomposition leaves a yellow or brown residue. Complete decomposition leaves only traces of residue. Trichlor is classified by NFPA as a Class 1 oxidizer.

G.4.1.5 Sodium Hypochlorite. Sodium hypochlorite (7681-52-9) solutions are not classified as oxidizers by NFPA. Sodium hypochlorite is manufactured by reacting chlorine with dilute sodium hydroxide solution. Solutions are generally formulated in the range of 3–20 percent sodium hypochlorite by weight. The balance of the solution consists of water, sodium chloride, and sodium hydroxide. Depending upon the residual quantity of sodium hydroxide in the finished product, it is classified as an irritant material or a corrosive material as those terms are defined in OSHA's Hazard Communication Standard, 29 CFR 1910.1200. Generally speaking, solutions with less than 1 percent residual caustic are irritants, while solutions containing more than 1 percent residual caustic are classified as corrosives. Total evaporation of sodium hypochlorite solutions yields water and sodium chloride. Unlike calcium hypochlorite, sodium hypochlorite does not exist outside of solution. Sodium hypochlorite solutions do not readily yield oxygen or other oxidizing gases and do not initiate or promote combustion of combustible materials. The major decomposition pathway of hypochlorite ion evolves chlorite ion which combines with additional hypochlorite ion to form chlorates, which in turn form chlorides. The formation of oxygen from decomposing hypochlorite ion is a very slow side reaction, although the rate can increase with exposure to transition metals. Other oxidizing gases, for example, chlorine, are not evolved in the decomposition.

G.4.2 Specific Response Information for Chlorinated Isocyanurates (Dichlor, Trichlor). It is necessary for emergency responders to be aware of the properties of chlorinated isocyanurates (dichlor, trichlor) that can create hazardous conditions. The reaction of these chemicals or mixtures containing these chemicals with other materials can lead to the generation of hazardous gases and fire.

When stored correctly and not exposed to other materials, these chemicals are safe to transport, store, handle, and use. However, in emergencies, conditions can occur that will cause containers to rupture and material to spill or become contaminated. It is important that correct actions be taken quickly in response to these conditions.

The best approach to dealing with the reactivity of these chemicals is to assume that they will react with anything they contact. Some of the reactions, particularly those with fuels (kerosene, diesel oil, etc.) and some other organic materials, are very fast and violent. Others take some time to happen. An example of this is when spilled material is placed in a dumpster with no apparent reaction. Hours later, a fire occurs because of a slow reaction with other material.

Other oxidizers, particularly cal hypo, also react with chlorinated isocyanurates. Wet mixtures of chlorinated isocyanurates and calcium hypochlorite react vigorously, releasing large volumes of chlorine (Cl₂) gas.

The following suggested actions and precautions should be taken during an emergency where chlorinated isocyanurates are present:

- (1) Emergency responders need to know their capabilities and limitations. If you are not completely sure that you can deal effectively with an emergency, get help from other responders or the manufacturer of the chemical. Contact chemical manufacturers directly or through Chemtrec® at 800-424-9300.
- (2) During an emergency, only allow necessary personnel in the affected area.
- (3) Because hazardous gases might be present, be sure to have self-contained breathing apparatus (SCBA) available and wear when necessary. Other personal protective equipment might also be necessary to use.
- (4) Do not flush these chemicals or otherwise allow them to go into waterways or sewers without clearance from the appropriate officials.
- (5) If there is any sign of a reaction taking place, cordon off and do not approach the area until a complete assessment has taken place.
- (6) Breached containers of chlorinated isocyanurate products that become wet can generate nitrogen trichloride (NCl₃), a potential explosion hazard in confined environments. Contact the manufacturer for detailed instructions when handling wet chlorinated isocyanurate products. Do not repackage a wet product.
- (7) Do not put spilled material back into its original container or any trash receptacle.
- (8) Read the SDS and product label for additional safety information.

Chlorinated isocyanurate products should be stored in sealed original containers in a cool, dry, well-ventilated area. If the product has been contaminated, decomposition can occur. Signs of decomposition are heat product discoloration, gas formation, or package degradation. (See G.6 for additional information.)

G.4.3 Specific Response Information for Calcium Hypochlorite. It is necessary for emergency responders to be aware of the properties of calcium hypochlorite that can create hazardous conditions. The reactions of calcium hypochlorite or mixtures containing calcium hypochlorite with other materials can lead to fire and hazardous gases. When stored correctly and not exposed to other materials, these chemicals are safe to transport, store, handle, and use. However, in emergencies, conditions can occur that will cause containers to rupture and material to spill or become contaminated. It is important that correct actions be taken quickly in response to these conditions.

In its initial stage, the decomposition of calcium hypochlorite [Ca(OCl)₂] proceeds to calcium chloride and oxygen and calcium chlorate. This reaction is an exothermic reaction, which can produce sufficient heat to decompose the product and ignite surrounding materials. Thermal runaway reaction does not occur as long as material is at equilibrium, where the heat generated is equal to the heat lost to the surroundings. A secondary reaction can give off chlorine gas.

Other oxidizers, particularly chlorinated isocyanurates, also react with calcium hypochlorite. Wet mixtures of calcium hypochlorite and chlorinated isocyanurates react vigorously, releasing large volumes of chlorine (Cl₂) gas.

The following suggested actions and precautions should be taken during an emergency where calcium hypochlorite is present:

- (1) Emergency responders need to know their capabilities and limitations. If you are not completely sure that you can deal effectively with an emergency, get help from other responders or the manufacturer of the chemical. Contact chemical manufacturers directly or through Chemtrec® at 800-424-9300.
- (2) During an emergency, allow only necessary personnel in the affected area.
- (3) Because hazardous gases might be present, be sure to have self-contained breathing apparatus (SCBA) available and wear when necessary. Other personal protective equipment might also be necessary to use.
- (4) Do not flush these chemicals or otherwise allow them to go into waterways or sewers without clearance from the appropriate officials.
- (5) If there is any sign of a reaction taking place, cordon off and do not approach the area until a complete assessment has taken place.
- (6) Do not put spilled material back into its original container or any trash receptacle.
- (7) Read the SDS and product label for additional safety information.

Calcium hypochlorite products should be stored in sealed original containers in a cool, dry, well-ventilated area. These products must not be stored at temperatures above 125°F (52°C). Storage above this temperature for an extended period of time (5 days or more) can result in decomposition, evolution of chlorine gas, and heat sufficient to ignite combustible products.

If calcium hypochlorite has been contaminated or stored at elevated temperatures above 125°F (52°C) for an extended period of time, decomposition can occur. Signs of decomposition are heat; calcium chloride (CaCl₂) release, which can be seen as moisture on the surrounding walls from the CaCl₂ absorbing moisture from the air; Cl₂ gas plus container discoloration; or degradation of the packaging.

Extra caution should be taken when handling calcium hypochlorite or any other oxidizer that might be decomposing.

If the material shows signs of decomposition, it should be moved to a safe, protected, and well-ventilated area away from other hazardous materials. This movement would prevent a fire spreading in the event of rapid decomposition.

Special care should be taken when overpacking material that could be slowly decomposing to be sure that the heat can be dissipated and that a runaway reaction does not occur.

If the decomposing material cannot be moved, move other hazardous or combustible material out of the area.

A fire water protection source should be available during the disposal and cleanup operation in case the product starts an accelerated decomposition. Water can be used to mitigate decomposing calcium hypochlorite; once the material is thoroughly wet, the risk of a runaway reaction has been greatly reduced. Lime can be added to reduce the fuming or off gassing of wet calcium hypochlorite.

G.5 Safety Information on Oxidizers Used as Fertilizers—Ammonium Nitrate (AN) Prill. Solid-form AN (NH_4NO_3) prill is used in agricultural applications as a fertilizer and in industrial applications as a component of explosives. AN prill for agricultural use is typically 99 percent AN, has larger prill size, and has lower porosity. AN is an oxidizer. It decomposes or melts at 337°F (169°C); the gaseous products of decomposition are toxic, can support combustion, and can cause an increase in pressure where confined. Under certain conditions, including contamination, confinement, strong shock, and exposure to an external fire, AN prill can detonate. Guidance for the safe storage, use, and handling of AN prill is contained in Chapter 11, Annex E, and EPA 550-F-15-001, *Chemical Advisory: Safe Storage, Handling, and Management of Solid Ammonium Nitrate Prills*.

G.6 Methods and Procedures for Emergency Response Involving Solid Oxidizers.

G.6.1 Oxidizer Hazards. Incidents that involve oxidizers must be handled in a timely manner and with an understanding of the hazards and properties of the materials involved. This section identifies the key elements that must be understood when dealing with oxidizers that are under distress either from a spill, contamination, decomposition, or fire from a source other than the oxidizers.

The hazards of stored oxidizers can manifest themselves in one or more of six distinct hazardous situations as follows:

- (1) They increase the burning rate of combustible materials.
- (2) They can cause spontaneous ignition of combustible materials.
- (3) They can decompose rapidly.
- (4) They can liberate hazardous gases.
- (5) They can undergo self-sustained decomposition, which can result in an explosion.
- (6) They can react explosively if mixed with incompatibles or in fire conditions.

G.6.2 Handling Incidents Involving Oxidizers. Anyone handling or using oxidizers should be fully aware of proper storage and handling requirements as well as emergency and first-aid procedures in case of an accident. Oxidizers are incompatible with many chemicals or other materials. It is essential to follow all storage and handling procedures to prevent conditions that might cause emergencies, such as a fire or explosion.

Before attempting to clean any oxidizer spill, be certain that the spilled material is dry and has not been contaminated. If there are any signs that a reaction has begun (hissing, bubbling, smoking, gassing, burning, or bulging or hot containers), evacuate the area immediately and contact your local fire department for assistance. If the product is not reacting but has mixed with chemicals or other materials, contact your local fire department. If you have any concerns regarding emergency procedures, immediately contact Chemtrec® at 800-424-9300 or the manufacturer for emergency instructions.

G.6.2.1 General considerations when responding to an oxidizer incident are as follows:

- (1) Use trained personnel who understand the specific hazards of the oxidizers involved.
- (2) Consult the manufacturer for technical assistance.
- (3) Understand the reaction characteristic of the hazards of the specific oxidizer involved.

- (4) Use a specific protocol on how to clean up the oxidizers involved.
- (5) Prevent oxidizer and incompatibles from contacting each other.
- (6) Control temperature below the maximum recommended storage temperature.
- (7) If there are signs of decomposition, allow for heat dissipation.
- (8) Control the cleanup site, including moving overpack containers to a safe and secure location, preferably outside the storage building.
- (9) Move container to a safe, secure, dry, open outside area, or to a location designated by the competent individual, to await disposal in conformance with applicable regulations and manufacturer's or processor's instructions.
- (10) Monitor overpacks to ensure that a slow decomposition reaction cannot lead to a self-accelerated decomposition reaction or fire.
- (11) Manage the size and location of the cleanup pile so that a decomposition reaction cannot spread to other areas.
- (12) Have water available for early intervention if a reaction starts.
- (13) Do not use any material or equipment that could contaminate the spilled material.
- (14) Do not dispose of the material with incompatible chemicals or materials.
- (15) Keep material dry during cleanup and, if material becomes damp, see G.6.3.
- (16) Do not allow unnecessary or untrained personnel in the area during the cleanup.
- (17) Wear appropriate protective gear and refer to the emergency response plan or safety data sheet (SDS).
- (18) Store cleanup supplies in a cabinet or marked-off area where they can be accessed quickly when needed.
- (19) Train employees in the cleanup procedures of the facility.

G.6.2.1.1 Water is the most important element in controlling an oxidizer incident or fire. The proper use of water is the most important element in controlling a fire involving oxidizers. Do not use dry-chemical extinguishing agent on oxidizer fires.

G.6.2.1.2 The following are guidelines for the use of water in fire control:

- (1) Water in sufficient quantities stops or prevents an oxidizer fire from spreading.
- (2) Water in sufficient quantities greatly reduces the reactivity of most oxidizers. Refer to the SDS to determine the characteristics of the specific oxidizers that you are handling.
- (3) Adding water normally slows the decomposition, reduces liberation of hazardous gas, and eliminates self-sustained decomposition.
- (4) Some oxidizers, primarily trichlor, can react with small amounts of water over a period of time and form NCl_3 , a potentially explosive compound. Even though NCl_3 is formed, water should continue to be added. Water in sufficient quantities is still the best method to control an oxidizer in a fire. Consult the manufacturer on how to handle and dispose of damp oxidizers.
- (5) Some oxidizers can dry out after wetting and, if contaminated, can react, causing a possible fire.
- (6) The water runoff from an oxidizer fire should be contained to protect the environment.

G.6.2.2 Spill Responses. If you have expertise addressing chemical spills, be sure to evaluate whether the material you are handling and the containers you are using are dry and uncontaminated. Follow applicable regulations when disposing of any material. Whether or not there is a fire, call the supplier for instructions on how best to clean up and remove spilled material and for other useful information. (Use the emergency telephone number on the container, the SDS, or other information supplied by the manufacturer. Additional emergency information can be obtained through Chemtrec® and Canutec.)

G.6.2.3 Procedure for Cleaning Uncontaminated Dry Spills. If the spill is dry and uncontaminated and there are no signs of decomposition or fire, the following approach should be used. Alternate or additional procedures might be advisable, depending upon site-specific circumstances. Users must tailor the cleanup to their own particular circumstances. Contact the manufacturer for further instructions.

The following procedure should be used:

- (1) Evaluate and respond as follows:
 - (a) If reacting, call the fire department.
 - (b) If product is contaminated with any other chemical or material, call the fire department.
 - (c) In the event of a large spill [100 lb (45.4 kg) or more], call the fire department.
 - (d) In the event of a small spill [under 100 lb (45.4 kg)], proceed only if trained, or refer to manufacturer's instructions.
 - (e) Contact the manufacturer.
- (2) Isolate and ventilate the area as follows:
 - (a) Mark off area.
 - (b) Keep people away.
 - (c) Do not breathe dust.
 - (d) Open doors and windows.
- (3) Wear protective clothing as follows:
 - (a) Rubber or neoprene gloves, boots, and aprons
 - (b) Protective goggles or safety glasses
 - (c) NIOSH/MSHA-approved respirator or breathing apparatus
- (4) Get two clean, dry, plastic containers (or suitable containers) large enough to hold the spilled material and proceed as follows:
 - (a) Line clean, suitable container with two clear-plastic bags.
 - (b) Place damaged container into one of the suitable containers.
 - (c) Label the container(s) properly and identify contents.
 - (d) Loosely place lid and leave unsealed.
 - (e) Do not place spilled chemical into original container.
- (5) Get clean broom and shovel and proceed as follows:
 - (a) Carefully sweep up spilled chemical.
 - (b) Place spilled material in clean clear-plastic bag.
 - (c) Place plastic bag into second container.
 - (d) Label container(s) accordingly to identify contents.
- (6) Remove containers to isolated area as follows:
 - (a) Move waste material to a safe and protected location in case there is a decomposition reaction.
 - (b) Keep away from children and high-traffic areas.
 - (c) Avoid getting process duct wet.
- (7) Thoroughly wash area with water to remove residue.
- (8) Wash and dry the following equipment:
 - (a) Broom and shovel
 - (b) Protective clothing
- (9) Contact manufacturer for proper disposal of chemicals.

G.6.3 Specific Hazards of Oxidizer Fires, Reacting Oxidizers, and Large Oxidizer Incidents.

G.6.3.1 Emergency Response Plans and Actions. It is the responsibility of each facility to have an emergency plan and train their employees in the requirements of the plan.

It is the primary responsibility of each facility employee to follow the pre-established guidelines set forth in an emergency plan.

G.6.3.2 Specific Emergencies.

G.6.3.2.1 Fire and Fume Hazards. Oxidizers are not combustible per se. However, if oxidizers are heated and/or contaminated to their decomposition range by an outside source, they can decompose, resulting in the generation of heat. The intensity of the decomposition can be sufficient to ignite paper and wood and a fire can result. Upon thermal decomposition, some oxidizers can give off dense clouds of gases that can be toxic, noxious, and very difficult to see through. Check the SDS or contact the manufacturer for the possible types of hazardous decomposition products during a thermal decomposition.

In case of fire or decomposition, immediately implement your emergency plan to minimize loss of life or property. An emergency plan commonly includes the following steps:

- (1) In the event of an emergency, contact your local fire department, ambulatory service, or police department immediately.
- (2) State your full name, company name, address, and telephone number.
- (3) State nature of emergency (e.g., fire, gas leak).
- (4) State type of assistance required (e.g., ambulance, fire).
- (5) If possible, stay on the line until the emergency operator understands the information.

Emergency numbers should be pre-set on all store phones to assist calling. Numbers should be in bold or colored print.

The following are issues regarding the use of personal protective equipment that should be considered:

- (1) Be prepared to use the appropriate personal protective equipment, which can include SCBA, in an emergency.
- (2) For small, controllable fires, use appropriate safety equipment. Only trained personnel should attempt to extinguish fires. Do not fight any fire alone.
- (3) If swimming pool chemicals are involved in a fire or reaction, use large quantities of water. Do not use dry-chemical extinguishers because they can contain ammonium compounds, which could react and release toxic or explosive gases. Provisions should be made for the containment of runoff water (i.e., diking with sandbags, dirt, or other suitable material). If there is a fire or if the pool chemical product is contaminated with another chemical, the area should be evacuated and the fire department called immediately, even if the building has a sprinkler system.
- (4) Direct unnecessary personnel away from the area.

Do not allow oxidizers or fire water to enter sewers, waterways, or trash containers, and keep unneutralized and chlorinated chemicals out of sewers, watersheds, or water systems.

G.6.3.2.2 Reacting Oxidizers. Oxidizers are stable when stored in a cool, dry, well-ventilated area and not contaminated by other materials, such as acids, bases, or easily oxidizable materials. Oxidizers can become dangerous if mishandled, improperly stored, or contaminated. They could become unstable or undergo a decomposition reaction, which could produce intense heat, hazardous gases, fire, or explosion.

Oxidizers are also incompatible with many of the other chemicals used in commerce, such as organic solvents, algaecides, other oxidizers, and pH adjusting materials. Some of the materials that are incompatible with oxidizers are listed as follows:

- (1) Acids
- (2) Alcohols (methyl, ethyl, propyl, and higher alcohols)
- (3) Aliphatic and aromatic unsaturated compounds
- (4) Amines
- (5) Ammonia and ammonium salts
- (6) Bases
- (7) Carbonated beverages
- (8) Ethers
- (9) Floor sweeping compounds
- (10) Glycerin
- (11) Paint, oils, and greases
- (12) Peroxides (hydrogen, sodium, calcium, etc.)
- (13) Petroleum products (gasoline, kerosene, etc.)
- (14) Phenols
- (15) Other oxidizers
- (16) Quaternary ammonium compounds (“quats”), such as algaecides
- (17) Reducing agents (sulfides, sulfites, bisulfites, thiosulfates)
- (18) Solvents (toluene, xylene, etc.)

It should be noted that this list is not comprehensive. For more information on the incompatibilities between pool chemicals and other materials, the appropriate pool chemical supplier or manufacturer should be contacted.

Some oxidizers, such as trichloroisocyanuric acid (TCCA; trichlor) can give off toxic gases and form NCl_3 if small amounts of water are added. Special precautions should be used when handling these oxidizers. If containers of one of these oxidizers become wet, they could contain NCl_3 , which is a potential explosive. Before handling wet oxidizers, the manufacturer should be contacted for instructions.

A response to a reacting oxidizer incident is as follows:

- (1) Contact appropriate emergency personnel. Responder should assess the nature and magnitude of the emergency.
- (2) If there are any signs that a reaction has begun (hissing, bubbling, smoking, gassing, burning, or bulging or hot containers), evacuate the area immediately and contact the local fire department for assistance. If the product is not reacting but has mixed with other chemicals or other materials, contact your local fire department.
- (3) Additional information can be obtained by using the emergency telephone number on the container or other information supplied by the manufacturer or by calling Chemtrec®.

- (4) Water in sufficient quantities greatly reduces the reactivity of most oxidizers and can stop or prevent a fire. Water slows the decomposition reaction, reduces liberation of hazardous gas, and eliminates self-sustained decomposition.
- (5) When overpacking product, continuously monitor to be sure that the product is not decomposing, because if the heat of decomposition cannot be dissipated, then the increased temperature can result in a self-sustained decomposition and possible fire.
- (6) On-site neutralization might be the only acceptable solution for reacting and contaminated material.
- (7) Have a sufficient water source available to stop an oxidizer reaction in case a decomposition reaction starts.
- (8) Contamination and high temperatures are the major reasons an oxidizer reaction starts. During a cleanup, packaging materials should be handled so that the product is not contaminated and the temperatures of all packages are maintained below the recommended storage temperature for the specific oxidizers involved.
- (9) Contaminated oxidizers should never be mixed with packaging material. Only original noncontaminated packaging material can be in overpack.
- (10) Do not place spilled chemicals into the trash. Contact with incompatible materials could cause a reaction.
- (11) Keep spilled material dry. If allowed to stand in damp or wet areas, tear-producing vapors can result. Dampening the product with water during the cleanup process can cause a decomposition reaction.
- (12) Keep unneutralized and chlorinated chemicals out of sewers, watersheds, or water systems.

G.6.3.2.3 Personal Protective Equipment. When handling chemicals or cleaning up a spill, the manufacturer’s SDS for personal protective equipment recommendations should be consulted. Recommended personal protective equipment includes the following:

- (1) Chemical-resistant gloves
- (2) Chemical-resistant boots
- (3) Chemical-resistant coveralls/aprons
- (4) Face shields
- (5) NIOSH-approved respiratory protection for the conditions

A NIOSH-approved, positive-pressure, self-contained breathing apparatus (SCBA) plus any other necessary personal protective equipment should be worn if toxic fumes are present. Chlorine and other toxic gases can be released during a fire or decomposing reaction.

Annex H Compressed Gases and Cryogenic Fluids

This annex is not a part of the requirements of this NFPA document but is included for informational purposes only.

H.1 Attended Operations.

H.1.1 Introduction. Section 112(r) of the Clean Air Act (CAA) mandates that the U.S. Environmental Protection Agency (EPA) promulgate a regulatory program to prevent accidental releases of regulated toxic and flammable substances and reduce the severity of releases that do occur. The rule, published on June 20, 1996, formally appears in the Code of Federal Regulations as 40 CFR 68 and is officially titled “Accidental Release Prevention Requirements: Risk Management Programs Under Clean Air Act Section 112(r)(7).”

H.1.1.1 In addition to qualified judgment and expertise, the following three resources must be considered in the selection of alternative release scenarios in evaluating the hazards of any system:

- (1) The five scenarios listed in Section 68.28 of 40 CFR 68
- (2) The 5-year accident history of all accidental releases from covered processes that resulted in deaths, injuries, or significant property damage on-site or all known off-site deaths, injuries, evacuations, sheltering-in-place, or property or environmental damage
- (3) The hazard review or process hazards analysis completed as part of the required prevention program

H.1.1.2 The five scenarios encompassed in Section 68.28 of 40 CFR 68 of the regulation include the following:

- (1) Transfer hose releases due to splits or sudden hose uncoupling (typical of delivery operations)
- (2) Process piping releases from failures at flanges, joints, welds, valves and valve seals, and drains or bleeds
- (3) Process vessel or pump releases due to cracks, seal failure, or drain, bleed, or plug failure
- (4) Vessel overfilling and spill or overpressurization and venting through relief valves or rupture disks
- (5) Shipping container mishandling and breakage or puncturing leading to a spill

H.1.1.3 Based on comparable analysis, it was determined that the most likely alternative release scenario having an off-site impact from compressed gas systems would be a process piping failure that either is outdoors or is indoors and entrained into an unspecified exhaust system. In either case, discharge results in a continuous emission resulting in a plume on-site or off-site. An accidental release of this type might occur due to mechanical failure, corrosion, failure of a piping component such as a joint or valve, or another cause.

H.1.1.4 The flow rate through a pipe during a release is computed based on the pressure of the container, cylinder, or tank; the liquid head (if a liquid is involved); the fluid density; the line's resistance to flow (based primarily on diameter, length, and number of bends); and the open area available to flow at the exit.

H.1.2 Parameters. Each parameter, whether selected by the user or preselected, as is typical, is explained in H.1.2.1 through H.1.2.5.

H.1.2.1 Container, Cylinder, or Tank Pressure. The highest normal operating pressure should be used for the tank pressure.

H.1.2.2 Liquid Head. The liquid head is the amount of pressure exerted by the weight of the liquid column. For most small containers and cylinders, the liquid head is normally small and can usually be ignored.

H.1.2.3 Fluid Density. Fluid density is the density of the fluid under consideration.

H.1.2.4 Line Length and Configuration. Line configuration is specific to the configuration under consideration.

H.1.2.5 Pipe Break Flow Area. Most piping breaks result in less than the full pipe diameter being open to flow. For example, a full-guillotine break is not nearly as likely as a reduced-flow area break or a small leak. It is unlikely that small leaks will have an off-site impact. Therefore, it is appropriate to select as

an alternative release case a piping failure characterized by a fraction of the full-open area that is typical of the majority of piping failures while significantly greater than that of a small leak.

For the purposes of calculation, a 20 percent flow rate versus a full bore line break should be used. Statistics indicate that piping failures of this magnitude would be expected to occur between 2 and 10 times as often as a full-guillotine break.

H.1.3 Calculations to demonstrate the "maximum credible worst-case leak" must be engineered, and factors to include the nature of flow must be considered, including whether the gas or vapor flowing is gaseous, liquid, or a two-phase-type flow. Detailed air dispersion models and methods of calculation are available. The choice of the model or methodology, or both, must be established by engineering principles and applied by those versed in such matters.

H.2 Physical Properties of Hydrogen.

H.2.1 Physical Properties. Hydrogen is a flammable gas. It is colorless, odorless, tasteless, and nontoxic. It is the lightest gas known, having a specific gravity of 0.0695 (air = 1.0). Hydrogen diffuses rapidly in air and through materials not normally considered porous.

H.2.1.1 Hydrogen burns in air with a pale blue, almost invisible flame. At atmospheric pressure, the ignition temperature of hydrogen-air mixtures has been reported by the U.S. Bureau of Mines to be as low as 932°F (500°C). The flammable limits of hydrogen-air mixtures depend on pressure, temperature, and water vapor content. At atmospheric pressure, the flammable range is approximately 4 percent to 75 percent by volume of hydrogen in air.

H.2.1.2 Hydrogen remains a gas even at high pressures. It is liquefied when cooled to its boiling point of -423°F (-253°C).

H.2.1.3 Hydrogen is nontoxic, but it can cause anoxia (asphyxiation) when it displaces the normal 21 percent oxygen in a confined area without ventilation that will maintain an oxygen content exceeding 19.5 percent. Because hydrogen is colorless, odorless, and tasteless, its presence cannot be detected by the human senses.

H.2.2 Physical Properties of Liquefied Hydrogen. Liquefied hydrogen is transparent, odorless, and not corrosive or noticeably reactive. The boiling point at atmospheric pressure is -423°F (-253°C). It is only as heavy as water. Liquefied hydrogen converted to gaseous hydrogen at standard conditions it expands approximately 850 times.

Annex I Emergency Response Guideline

This annex is not a part of the requirements of this NFPA document but is included for informational purposes only.

I.1 Emergency Response. A Company Emergency Responder is a person who responds to an emergency who is trained and certified under the requirements of 29 CFR 1910.120(q). The Emergency Response (ER) Team Leader is a leader of a Hazardous Material Team that responds to an emergency.

The emergency response training requirements for handling hazardous materials emergencies are found in 29 CFR 1910.120 (OSHA); and although these requirements are focused on hazardous waste they are appropriate for use with

nonwaste materials. Once the material is released in an incident it is viewed as waste from the OSHA perspective.

Congress and OSHA require facilities that handle hazardous waste to comply with the OSHA 29 CFR 1910.120 hazardous waste operations and emergency response standard (known as HAZWOPER) when responding to an emergency. This rule, issued on March 6, 1989, is intended to protect the health and safety of workers, from exposure to toxic and hazardous materials releases. An important criterion to consider is that the emergency response training should be tailored to meet product-specific requirements.

The training requirements on how to respond to an emergency are included in these recommendations. The OSHA regulations define “what an emergency response is” and outline the different training requirements for various responder levels. In addition, the methodology of an emergency response is outlined, and the requirements of an emergency response plan are identified and listed. The information below is a summary of the training recommendations and the health and safety program for individuals who might have to identify an emergency or respond to an emergency or non-emergency response.

Training should be based on the duties and functions to be performed by each responder for their specific facility. The skill and knowledge levels required for responders should be conveyed through training before the responders are permitted to take part in an actual emergency operations incident.

I.2 What Is An Emergency Response According to OSHA? OSHA defines an emergency response as a response effort by employees from outside the immediate release area or by other designated responders to an occurrence which results, or is likely to result, in an uncontrolled release of hazardous substances.

I.3 What Is Not an Emergency Response? Responses to incidental releases of hazardous substance where the substance can be absorbed, neutralized, or otherwise controlled at the time of release by employees in the immediate release area or by maintenance personnel are not considered to be emergency responses within the scope of this standard.

Responses to releases of hazardous substances where there is no significant potential safety or health hazard (i.e., fire, explosion, or chemical exposure) are not considered to be emergency responses.

Spills of this nature are small and can be cleaned up as a normal job function. Typically, they include the small drips and leaks that often occur around pipe junctions or valves, or spills of small quantities of chemicals.

I.4 Training Curriculum for Emergency Response. Training should be based on the duties and function to be performed by each responder. The skill and knowledge levels required for responders should be conveyed to them through training before they are permitted to take part in actual incident emergency operations. Employees who participate, or are expected to participate, in emergency or non-emergency responses, should be given training as follows depending on the specific hazards of the material and the duties and function that are required of the responder:

I.4.1 First Responder Awareness Level. First responders at the awareness level are individuals who are likely to witness or

discover a hazardous substance release and who have been trained to initiate an emergency response sequence by notifying the proper authorities of the release. They would take no further action beyond notifying the authorities of the release. First responders at the awareness level should have sufficient training or have had sufficient experience to objectively demonstrate the following competencies:

- (1) Understand what hazardous substances are and the risks associated with them in an incident for their facility
- (2) Understand the types of hazards at their facility
- (3) Know the hazardous materials present at their facility
- (4) Understand the potential outcomes associated with an emergency created when hazardous substances are present
- (5) Understand the role of the first responder awareness individual in the employer’s emergency response plan, including site security and control and the U.S. Department of Transportation’s *Emergency Response Guidebook*
- (6) Able to realize the need for additional resources, and to make appropriate notifications to the communication center
- (7) Understand the site safety and health plan, including confined space entry, decontamination procedures, and spill containment program

I.4.2 First Responder Operations Level. First responders at the operations level are individuals who respond to releases or potential releases of hazardous substances as part of the initial response to the site for the purpose of protecting nearby persons, property, or the environment from the effects of the release. They are trained to respond in a defensive fashion without actually trying to stop the release. Their function is to contain the release from a safe distance, keep it from spreading, and prevent exposures. The employer should certify that first responders at the operational level have received at least 8 hours of training or have sufficient experience to objectively demonstrate competency in the following areas in addition to those listed for the awareness level:

- (1) Understand the hazards and risks associated with the hazardous materials they work with and risk assessment techniques
- (2) Understand the types of hazards at their facility
- (3) Know the hazardous materials present at their facility
- (4) Understand the potential outcomes associated with an emergency created when the hazardous materials they work with are present
- (5) Able to identify hazardous materials
- (6) Understand their role in their company’s emergency response plan (including facility security plan) and how to use the NAERG Book (*North America Emergency Response Guide*)
- (7) Able to realize the need for additional resources and make appropriate notification to the communication center
- (8) Understand the site safety and health plan, including confined space entry, decontamination procedures, and spill containment program
- (9) Know how to select and use proper personal protective equipment
- (10) Understand hazardous materials terms
- (11) Know how to perform basic control, containment and/or confinement within the capabilities of the resources and personal protective equipment available with their unit

- (12) Know how to implement basic decontamination procedures
- (13) Understand the relevant standard response operation procedures and termination procedures

I.4.3 Hazardous Materials Technician. Hazardous materials technicians are individuals who respond to releases or potential releases for the purpose of stopping the release. They assume a more aggressive role than a first responder at the operations level in that they are responsible for approaching the point of release in order to plug, patch, or otherwise stop the release of a hazardous substance. The employer should certify that hazardous materials technicians have received at least 24 hours of training equal to the first responder operations level and in addition have competency in the following areas:

- (1) Training that meets the requirements for first responder operations and awareness level
- (2) Know how to implement the employer's emergency response plan
- (3) Know the classification, identification, and verification of known and unknown materials by using field survey instruments and equipment
- (4) Able to function within an assigned role in the Incident Command System
- (5) Know how to select and use proper specialized chemical personal protective equipment provided to the hazardous materials technician
- (6) Understand hazard and risk assessment techniques
- (7) Able to perform advance control, containment, and/or confinement operations within the capabilities of the resources and personal protective equipment available with the unit
- (8) Understand and implement decontamination procedures
- (9) Understand termination procedures
- (10) Understand basic chemical and toxicological terminology and behavior

I.4.4 Hazardous Materials Specialist. Hazardous materials specialists are individuals who respond with and provide support to hazardous materials technicians. Their duties parallel those of the hazardous materials technician; however, their duties require a more directed or specific knowledge of the various substances they could be called upon to contain. The hazardous materials specialist would also act as the site liaison with federal, state, local and other government authorities in regards to emergency incidents. The employer should certify that hazardous materials specialists have received at least 24 hours of training equal to the technician level and in addition have competency in the following areas:

- (1) Know how to implement the local emergency response plan
- (2) Understand classification, identification, and verification of known and unknown materials by using advanced survey instruments and equipment
- (3) Know the state emergency response plan
- (4) Able to select and use proper specialized chemical personal protective equipment provided to the hazardous materials specialist
- (5) Understand in-depth hazard and risk techniques
- (6) Able to perform specialized control, containment, and/or confinement operations within the capabilities of the resources and personal protective equipment available

- (7) Able to determine and implement decontamination procedures
- (8) Able to develop a site safety and control plan
- (9) Understand chemical, radiological, and toxicological terminology and behavior

I.4.5 On-Scene Incident Commander. Incident commanders, who will assume control of the incident scene beyond the first responder awareness level, should receive at least 24 hours of training equal to the first responder operations level. In addition, the employer should certify that the incident commanders have competency in the following areas:

- (1) Know and be able to implement the employer's incident command system
- (2) Know how to implement the employer's emergency response plan
- (3) Know and understand the hazards and risks associated with employees working in chemical protective clothing
- (4) Know how to implement the local emergency response plan
- (5) Know of the state emergency response plan and of the Federal Regional Response Team
- (6) Know and understand the importance of decontamination procedures
- (7) Understand the requirements and responsibilities for all levels of emergency response personnel

I.4.6 Hazardous Materials (HAZMAT) Response Team. A hazardous materials (HAZMAT) response team is an organized group of employees, designated by the employer, who are expected to perform work to handle and control actual or potential leaks or spills of hazardous substances requiring possible close approach to the substance. The team members perform responses to releases or potential releases of hazardous substances for the purpose of control or stabilization of the incident. The training requirements of various team members are listed above.

I.5 Example Training Curriculum. Training required should be based on the hazards of the materials present and the potential exposures to the emergency response team and the community as a result of an incident. The details of the training should be based on the duties and the functions the responder is required to perform. Locations with an emergency response plan based on public fire department or a contract response team response to emergencies and non-emergencies can train their employees only to a first responder awareness level.

The following example illustrates the curriculum for hazardous materials technicians for emergency and non-emergency responses in a chlorine and caustic manufacturing complex. The requirements for other facilities could be significantly different. Other training curriculums might be available from other resources including trade associations.

The following list of qualifications was taken from the 2000 edition of NFPA 472 and changed to meet the requirements to respond to incidents involving chlorine and caustic.

Individuals that respond to known hazardous materials and unknown hazardous material to mitigate or control a release should have the most in-depth training. These individuals should know how to assess the situations to determine the hazards and potential exposure so the risk can be determined. The ability to predict potential outcomes associated with an emergency or non-emergency and to realize the need for addi-

tional resources. These individuals need to be able to understand and prepare an emergency response plan. The facilities management should understand the training requirement of the HAZMAT team members to ensure their ability to respond to emergency situations. The facilities management should determine the potential emergencies that could occur at the facilities and develop pre-emergency plans. An emergency response plan for a potential facility emergency should be written and include the following information:

- (1) Pre-emergency planning and coordination with outside parties
- (2) Personnel roles, and lines of authority, training, and communication
- (3) Emergency recognition and prevention
- (4) Safe distances and places of refuge
- (5) Site security and control
- (6) Evacuation routes and procedures
- (7) Decontamination
- (8) Emergency medical treatment and first aid
- (9) Emergency alerting and response procedures
- (10) Critique of response and follow-up
- (11) Personnel protective equipment and emergency equipment

Emergency exercises should be conducted to determine potential problem areas that need to be corrected. Preplanning for emergencies is accomplished by determining communication requirements, conducting facility tours with internal and external responders, coordinating resources, and sharing information. These activities will improve the ability for a hazardous materials team to respond.

The following information from **NFPA 472** lists the training recommendation for hazardous materials technicians. A hazardous materials technician is one who responds to releases or potential releases for the purpose of stopping the release. A hazardous material technician should be trained to the first responder awareness and operational levels listed in **NFPA 472** and the competencies listed below. Hazardous materials technicians also should receive any additional training to meet applicable **U.S. Department of Transportation (DOT)**, **U.S. Environmental Protection Agency (EPA)**, **Occupational Safety and Health Administration (OSHA)**, and other appropriate state, local, or provincial occupational health and safety regulatory requirements that might apply.

Hazardous materials technicians are those persons who respond to releases or potential releases of hazardous materials for the purpose of controlling the release. Hazardous materials technicians are expected to use specialized chemical protective clothing and specialized control equipment.

The required competencies listed below are what a hazardous materials technician needs to know. Therefore, in addition to being competent at both the first responder awareness and operational levels, the hazardous materials technician should be able to do the following:

- (1) Analyze a hazardous materials incident to determine the magnitude of the problem in terms of outcomes by completing the following tasks:
 - (a) Survey the hazardous materials incident to identify special containers involved, to identify or classify unknown materials, and to verify the presence and concentrations of hazardous materials through the use of monitoring equipment

- (b) Collect and interpret hazard and response information from printed resources, technical resources, computer databases, and monitoring equipment
 - (c) Determine the extent of damage to containers
 - (d) Predict the likely behavior of released materials and their containers when multiple materials are involved
 - (e) Estimate the size of an endangered area using computer modeling, monitoring equipment, or specialists in this field
- (2) Plan a response within the capabilities of available personnel, personal protective equipment, and control equipment by completing the following tasks:
 - (a) Identify the response objectives for hazardous materials incidents
 - (b) Identify the potential action options available by response objective
 - (c) Select the personal protective equipment required for a given action option
 - (d) Select the appropriate decontamination procedures
 - (e) Develop a plan of action, including safety considerations, consistent with the local emergency response plan and the organization's standard operating procedures, and within the capability of the available personnel, personal protective equipment, and control equipment
 - (3) Implement the planned response consistent with the organization's standard operating procedures and safety considerations by completing the following tasks:
 - (a) Perform the duties of an assigned hazardous materials branch position within the local incident management system (IMS)
 - (b) Don, work in, and doff appropriate personal protective clothing, including, but not limited to, both liquid splash- and vapor-protective clothing with appropriate respiratory protection
 - (c) Perform the control functions identified in the plan of action
 - (4) Evaluate the progress of the planned response by evaluating the effectiveness of the control functions.
 - (5) Terminate the incident by completing the following tasks:
 - (a) Assist in the incident debriefing
 - (b) Assist in the incident critique
 - (c) Provide reports and documentation of the incident

I.6 Competencies — Analyzing the Incident.

I.6.1 Surveying the Hazardous Materials Incident. The hazardous materials technician should be able to understand the workings and identify chlorine and caustic containers if involved in an incident and, given the appropriate equipment, identify or classify unknown materials, verify the identity of the hazardous materials, and determine the concentration of hazardous materials. The hazardous materials technician should be able to do the following:

- (1) Given examples of various specialized containers, identify each container by name and identify the material, and its hazard class, that is typically found in the container
- (2) Given examples of the following railroad cars, identify each car by type and identify at least one material, and its hazard class, that is typically found in each car:
 - (a) Cryogenic liquid tank cars
 - (b) High-pressure tube cars

- (c) Nonpressure tank cars
 - (d) Pneumatically unloaded hopper car
 - (e) Pressure tank cars
 - (f) Cars and truck designed to handle chlorine and caustic materials
- (3) Be able to identify unknown materials, one of which is a solid, one a liquid, and one a gas, identify or classify by hazard each unknown material.
 - (4) Identify the steps in an analysis process for identifying chlorine and caustic containers as well as unknown solid and liquid materials.
 - (5) Identify the steps in an analysis process for chlorine and caustic and unknown atmosphere.
 - (6) Identify the type(s) of monitoring equipment, test strips, and reagents used to determine identifying the following hazards:
 - (a) Chlorine
 - (b) Caustic
 - (c) Corrosivity (pH)
 - (d) Flammability
 - (e) Oxidation potential
 - (f) Oxygen deficiency
 - (g) Radioactivity
 - (h) Toxic levels
 - (7) Identify the capabilities and limiting factors associated with the selection and use of the following monitoring equipment, test strips, and reagents:
 - (a) Chlorine
 - (b) Caustic
 - (c) Carbon monoxide meter
 - (d) Colorimetric tubes
 - (e) Combustible gas indicator
 - (f) Oxygen meter
 - (g) Passive dosimeter
 - (h) Photo ionization detectors
 - (i) pH indicators and/or pH meters
 - (j) Radiation detection instruments
 - (k) Reagents
 - (l) Test strips
 - (8) Have the ability to identify hazardous materials using the monitoring equipment, test strips, and reagents; select the appropriate equipment; and demonstrate the proper techniques to identify and quantify the materials listed above.
 - (9) Demonstrate the field maintenance and testing procedures for the monitoring equipment, test strips, and reagents provided by the authority having jurisdiction.
- 1.6.2 Collecting and Interpreting Hazard and Response Information.** Given access to printed resources, technical resources, computer databases, and monitoring equipment, the hazardous materials technician should collect and interpret hazard and response information not available from the current edition of the *North American Emergency Response Guidebook* or a safety data sheet (SDS). The hazardous materials technician should be able to do the following:
- (1) Identify and interpret the types of hazard and response information available from each of the following resources and explain the advantages and disadvantages of each resource:
 - (a) Hazardous materials databases
 - (b) Maps and diagrams
 - (c) Monitoring equipment
 - (d) Reference manuals
 - (e) Technical information centers (i.e., CHEMTREC/CANUTEC/SETIQ)
 - (f) Technical information specialists
 - (2) Describe the following terms and explain their significance in the risk assessment process:
 - (a) Acid, caustic
 - (b) Air reactivity
 - (c) Boiling point
 - (d) Catalyst
 - (e) Chemical interactions
 - (f) Chemical reactivity
 - (g) Compound, mixture
 - (h) Concentration
 - (i) Corrosivity (pH)
 - (j) Critical temperatures and pressure
 - (k) Expansion ratio
 - (l) Flammable (explosive) range (LEL and UEL)
 - (m) Fire point
 - (n) Flash point
 - (o) Halogenated hydrocarbon
 - (p) Ignition (autoignition) temperature
 - (q) Inhibitor
 - (r) Instability
 - (s) Ionic and covalent compounds
 - (t) Maximum safe storage temperature (MSST)
 - (u) Melting point/freezing point
 - (v) Miscibility
 - (w) Organic and inorganic
 - (x) Oxidation potential
 - (y) pH
 - (z) Physical state (solid, liquid, gas)
 - (aa) Polymerization
 - (ab) Radioactivity
 - (ac) Saturated, unsaturated, and aromatic hydrocarbons
 - (ad) Self-accelerating decomposition temperature (SADT)
 - (ae) Solution, slurry
 - (af) Specific gravity
 - (ag) Strength
 - (ah) Sublimation
 - (ai) Temperature of product
 - (aj) Toxic products of combustion
 - (ak) Vapor density
 - (al) Vapor pressure
 - (am) Viscosity
 - (an) Volatility
 - (ao) Water reactivity
 - (ap) Water solubility
 - (3) Describe the heat transfer processes that occur as a result of a cryogenic liquid spill specifically for chlorine.
 - (4) Given a hazardous material scenarios and the appropriate reference materials, identify the signs and symptoms of exposure to each material and the target organ effects of exposure to that material.
 - (5) Given the scenario of a chlorine line break determine the area of evacuation.
 - (6) Identify two methods for determining the pressure in bulk packaging or facility containers.
 - (7) Identify one method for determining the amount of lading remaining in damaged bulk packaging or facility containers.

- (8) Describe the condition of the container involved in the incident.
- (9) Given simulated facility and transportation container damage, the hazardous materials technician should describe the damage.
- (10) Given examples of containers, DOT specification markings for nonbulk and bulk packaging, and the appropriate reference guide, identify the basic design and construction features of each container.
- (11) Identify the basic design and construction features, including closures, of the following bulk containers:
 - (a) Cargo tanks:
 - i. Dry bulk cargo tanks
 - ii. MC-306/DOT-406 cargo tanks
 - iii. MC-307/ DOT-407 cargo tanks
 - iv. MC-312/DOT-412 cargo tanks
 - v. MC-331 cargo tanks
 - vi. MC-338 cargo tanks
 - (b) Railroad cars:
 - i. Chlorine
 - ii. Caustic
 - iii. Cryogenic liquid tank cars
 - iv. High-pressure tube cars
 - v. Nonpressure tank cars
 - vi. Pneumatically unloaded hopper cars
 - vi. Pressure tank cars
- (12) Identify the basic design and construction features including closures of the following non-bulk containers for chlorine and caustic.
- (13) Identify the types of damage that a pressure container could incur.
- (14) Given examples of tank car damage, identify the type of damage in each example by name.

I.6.3 Predicting Likely Behavior of Materials and Their Containers When Multiple Materials Are Involved. Given examples of both facility and transportation incidents involving multiple hazardous materials, the hazardous materials technician should predict the likely behavior of the material in each case. The hazardous materials technician should be able to do the following:

- (1) Identify resources available that indicate the effects of mixing various hazardous materials.
- (2) Identify the impact of the following fire and safety features on the behavior of the products during an incident at a bulk storage facility and explain their significance in the risk assessment process:
 - (a) Fire protection systems
 - (b) Monitoring and detection systems
 - (c) Product spillage and control (impoundment and diking)
 - (d) Tank spacing
 - (e) Tank venting and flaring systems
 - (f) Transfer operations

I.6.4 Estimating the Likely Size of an Endangered Area for Chlorine and Caustic. Given various containers and transportation hazardous materials incidents, the hazardous materials technician should estimate the likely size, shape, and concentrations associated with the release of materials involved in the incident by using computer modeling, monitoring equipment, or specialists in this field. The hazardous materials technician should be able to do the following:

- (1) Identify local resources for dispersion pattern prediction and modeling including computers, monitoring equipment, or specialists in the field
- (2) Given the concentrations of the released material, identify the steps for determining the extent of the hazards (e.g., physical, safety, and health) within the endangered area of a hazardous materials incident
- (3) Describe the following toxicological terms and exposure values and explain their significance in the risk assessment process:
 - (a) Parts per million (ppm)
 - (b) Parts per billion (ppb)
 - (c) Lethal dose (LD50)
 - (d) Lethal concentrations (LC50)
 - (e) Permissible exposure limit (PEL)
 - (f) Threshold limit value time-weighted average (TLV-TWA)
 - (g) Threshold limit value short-term exposure limit (TLV-STEL)
 - (h) Threshold limit value ceiling (TLV-C)
 - (i) Immediately dangerous to life and health value (IDLH)

I.6.5 Identifying Response Objectives. Given simulated chlorine and caustic containers and transportation problems, the hazardous materials technician should describe the response objectives for each problem. The hazardous materials technician should be able to describe the steps for determining response objectives (defensive, offensive, nonintervention) given an analysis of a hazardous materials incident.

I.6.6 Identifying the Potential Action Options. Given simulated facility and transportation hazardous materials incidents, the hazardous materials technician should identify the possible action options (defensive, offensive, and nonintervention) by response objective for each problem. The hazardous materials technician should be able to identify the possible action options to accomplish a given response objective.

I.6.7 Selecting Personal Protective Equipment. Given situations with chlorine, caustic and unknown hazardous materials, the hazardous materials technician should determine the appropriate personal protective equipment for the action options specified in the plan of action in each situation. The hazardous materials technician should be able to do the following:

- (1) Identify the four levels of personal protective equipment (EPA/NIOSH or NFPA 472) and describe the equipment for each level and the condition under which each level is used
- (2) Identify the factors to be considered in selecting the proper respiratory protection for a specified action option
- (3) Describe the advantages, limitations, and proper use of the following types of respiratory protection at hazardous materials incidents:
 - (a) Positive pressure self-contained breathing apparatus
 - (b) Positive pressure air line respirators with required escape unit
 - (c) Air-purifying respirators
- (4) Identify the process for selecting the proper respiratory protection at hazardous materials incidents

- (5) Identify the operational components of air purifying respirators and airline respirators by name and describe their functions
- (6) Identify the factors to be considered in selecting the proper chemical-protective clothing for a specified action option
- (7) Describe the following terms and explain their impact and significance on the selection of chemical-protective clothing:
 - (a) Degradation
 - (b) Penetration
 - (c) Permeation
- (8) Identify at least three indications of material degradation of chemical-protective clothing
- (9) Identify the three types of vapor-protective and splash-protective clothing and describe the advantages and disadvantages of each type
- (10) Identify the relative advantages and disadvantages of the following heat exchange units used for the cooling of personnel in chemical-protective clothing:
 - (a) Air-cooled
 - (b) Ice-cooled
 - (c) Water-cooled
- (11) Identify the process for selecting the proper protective clothing at hazardous materials incidents
- (12) For chlorine and caustic determine the appropriate protective clothing construction materials for a given action option using chemical compatibility charts
- (13) Identify the physical and psychological stresses that can affect users of specialized protective clothing
 - (b) Neutralization
 - (c) Overpacking
 - (d) Patching
 - (e) Plugging
- (2) For all chlorine and caustic approved DOT containers and tanks, identify the common methods for product transfer from each type of cargo tank.
- (3) Given a simulated chlorine and caustic incident, develop the safety considerations that must be included in the plan of action, including the following:
 - (a) List and describe the safety considerations to be included.
 - (b) Identify the points that should be made in a safety briefing prior to working at the scene.
 - (c) Identify the atmospheric and physical safety hazards associated with hazardous materials incidents involving confined spaces.
 - (d) Identify the pre-entry activities to be performed.

I.7 Competencies — Implementing the Planned Response.

I.7.1 Performing Incident Management Duties. Given the local emergency response plan or organization's standard operating procedures and a simulated hazardous materials incident, the hazardous materials technician should demonstrate the duties of an assigned hazardous materials branch position within the local incident management system (IMS). The hazardous materials technician should be able to do the following:

- (1) Identify the role of the hazardous materials technician during an incident involving hazardous materials
- (2) Identify the duties and responsibilities of the following hazardous materials branch functions within the incident management system:
 - (a) Backup
 - (b) Decontamination
 - (c) Entry
 - (d) Hazardous materials branch management
 - (e) Hazardous materials branch safety
 - (f) Information/research
 - (g) Reconnaissance
 - (h) Resources
- (3) Demonstrate setup of the decontamination corridor as specified in the planned response
- (4) Demonstrate the decontamination process specified in the planned response

I.7.2 Using Protective Clothing and Respiratory Protection.

The hazardous materials technician should demonstrate the ability to don, work in, and doff both liquid splash- and vapor-protective chemical-protective clothing and any other specialized personal protective equipment provided by the authority having jurisdiction, including the appropriate respiratory protection. The hazardous materials technician should be able to do the following:

- (1) Describe safety procedures for personnel wearing vapor-protective clothing
- (2) Describe emergency procedures for personnel wearing vapor-protective clothing
- (3) Identify the procedures for donning, working in, and doffing the following types of respiratory protection:
 - (a) Air line respirator with required escape unit
 - (b) Air purifying respirator

I.6.8 Developing Appropriate Decontamination Procedures.

For chlorine and caustic incidents, the hazardous materials technician should select an appropriate decontamination procedure and determine the equipment required to implement that procedure. The hazardous materials technician should be able to identify the advantages and limitations and describe an example where each of the following decontamination methods would be used:

- (1) Absorption
- (2) Adsorption
- (3) Chemical degradation
- (4) Dilution
- (5) Disposal
- (6) Evaporation
- (7) Neutralization
- (8) Solidification
- (9) Vacuuming
- (10) Washing

I.6.9 Developing a Plan of Action.

For a chlorine and caustic incident in facility and transportation settings, the hazardous materials technician should develop a plan of action, including safety considerations. The plan should be consistent with the local emergency response plan and the organization's standard operating procedures and be within the capability of available personnel, personal protective equipment, and control equipment for that incident. The hazardous materials technician should be able to do the following:

- (1) Describe the purpose of, procedures for, equipment required, and safety precautions used with the following techniques for hazardous materials control:
 - (a) Adsorption

- (4) Demonstrate donning, working in, and doffing chemical-protective clothing in addition to any other specialized protective equipment provided by the authority having jurisdiction
- (5) Demonstrate the ability to record the use, repair, and testing of chemical-protective clothing according to manufacturer's specifications and recommendations
- (6) Describe the maintenance, testing, inspection, and storage procedures for personal protective equipment provided by the authority having jurisdiction according to the manufacturer's specifications and recommendations

I.7.3 Performing Control Functions Identified in Plan of Action. For chlorine and caustic and other hazardous materials incidents involving nonbulk and bulk packaging and facility containers, the hazardous materials technician selects the tools, equipment, and materials for the control of hazardous materials incidents and identifies the precautions for controlling releases from those packaging/containers. The hazardous materials technician should be able to do the following:

- (1) For chlorine and caustic, select the appropriate material or equipment and demonstrate a method(s) to contain leaks from the following locations:
 - (a) Fusible metal of plug
 - (b) Fusible plug threads
 - (c) Side wall of cylinder
 - (d) Valve blowout
 - (e) Valve gland
 - (f) Valve inlet threads
 - (g) Valve seat
 - (h) Valve stem assembly blowout
- (2) Given the fittings on a pressure container, demonstrate the ability to perform the following:
 - (a) Close valves that are open
 - (b) Replace missing plugs
 - (c) Tighten loose plugs
- (3) Identify considerations for assessing a leak or spill inside a confined space without entering the area
- (4) Identify safety considerations for product for chlorine and caustic transfer operations

I.8 Competencies — Evaluating Progress.

I.8.1 Evaluating the Effectiveness of the Control Functions. Given various simulated facility and transportation hazardous materials incidents involving nonbulk and bulk packaging and the plan of action, the hazardous materials technician can evaluate the effectiveness of any control functions identified in the plan of action.

I.9 Competencies — Terminating the Incident.

I.9.1 Assisting in the Debriefing. Given various simulated facility and transportation hazardous materials incidents involving nonbulk and bulk packaging, the hazardous materials technician should participate in the debriefing of the incident. The hazardous materials technician should be able to do the following:

- (1) Describe components of an effective debriefing
- (2) Describe the key topics of an effective debriefing
- (3) Describe when a debriefing should take place

- (4) Describe who should be involved in a debriefing

I.9.2 Assisting in the Incident Critique. For chlorine and caustic facility and transportation hazardous materials incidents involving nonbulk and bulk packaging, the hazardous materials technician should provide operational observations of the activities that were performed in the hot and warm zones during the incident. The hazardous materials technician should be able to do the following:

- (1) Describe components of an effective critique
- (2) Describe who should be involved in a critique
- (3) Describe why an effective critique is necessary after a hazardous materials incident
- (4) Describe which written documents should be prepared as a result of the critique

I.9.3 Providing Reports and Documentation. For hazardous materials incidents, the hazardous materials technician should complete the reporting and documentation requirements consistent with the organization's emergency response plan and standard operating procedures. The hazardous materials technician should be able to do the following:

- (1) Identify the reports and supporting documentation required by the local emergency response plan and the organization's standard operating procedures
- (2) Demonstrate the proper completion of the reports required by the local emergency response plan and the organization's standard operating procedures
- (3) Describe the importance of personnel exposure records
- (4) Describe the importance of debriefing records
- (5) Describe the importance of critique records
- (6) Identify the steps in keeping an activity log and exposure records
- (7) Identify the steps to be taken in compiling incident reports that meet federal, state, local, and organizational requirements
- (8) Identify the requirements for compiling hot zone entry and exit logs
- (9) Identify the requirements for compiling personal protective equipment logs
- (10) Identify the requirements for filing documents and maintaining records

Annex J Hazardous Material Definitions Comparison Table

This annex is not part of the requirements of this NFPA document but is included for informational purposes only.

Δ J.1 There are multiple published definitions for the various classifications of hazardous material. **Table J.1** provides a tabular presentation of the various definitions published within NFPA 400 as well as the source NFPA document for those definitions that are extracted. In addition, the table presents corresponding definitions, where available, from both the 2012 edition of the *International Fire Code* as well as from the 2012 edition of the *Hazard Communication Standard* developed by the Occupational Health and Safety Administration (OSHA). OSHA's *Hazard Communication Standard* aligns with the United Nations' Globally Harmonized System of Classification and Labeling of Chemicals.

Table J.1 Hazardous Material Definitions Comparison

Material Classification	Class	Controlling Document	400 Definition	2012 IFC Definition	HCS 2012/UN Definition
Combustible liquid	II	30	Any liquid that has a flash point at or above 100°F (60°C) and below 200°F (93°C).	Liquids having a closed cup flash point at or above 100°F (38°C) and below 140°F (60°C).	Flammable liquid Category 3: Flash point $\geq 23^{\circ}\text{C}$ (73.4°F) and $\leq 60^{\circ}\text{C}$ (140°F).
	IIIA	30	Any liquid that has a flash point at or above 140°F (60°C) and below 200°F (93°C).	Liquids having a closed cup flash point at or above 140°F (60°C) and below 200°F (93°C).	Flammable liquid Category 4: Flash point $> 60^{\circ}\text{C}$ (140°F) and $\leq 93^{\circ}\text{C}$ (199.4°F).
	IIIB	30	Any liquid that has a flash point at or above 200°F (93°C).	Liquids having closed cup flash points at or above 200°F (93°C).	
Consumer fireworks		1124	Small fireworks devices containing restricted amounts of pyrotechnic composition, designed primarily to produce visible or audible effects by combustion, that comply with the construction, chemical composition, and labeling regulations of the U.S. Consumer Product Safety Commission (CPSC), as set forth in CPSC 16 CFR 1500 and 1507, 49 CFR 172, and APA Standard 87-1, <i>Standard for the Construction and Approval for Transportation of Fireworks, Novelties, and Theatrical Pyrotechnics</i> .	Any composition or device for the purpose of producing a visible or an audible effect for entertainment purposes by combustion, deflagration or detonation that meets the definition of 1.4G fireworks or 1.3G fireworks as set forth herein.	
Combustible metals		484	Not specifically defined.		Flammable solid means a solid which is a readily combustible solid, or which may cause or contribute to fire through friction. Powders of metals or metal alloys shall be classified as flammable solids when they can be ignited and the reaction spreads over the whole length of the sample in 10 min or less. Category 1: Burning rate test: Metal powders: burning time ≤ 5 min. Category 2: Burning rate test: Metal powders: burning time > 5 min and ≤ 10 min.
Cryogenic fluid	Flammable	55	Not specifically defined.		
	Oxidizing	55	Not specifically defined.		
	Inert	55	Not specifically defined.	A fluid having a boiling point lower than -130°F (-89.9°C) at 14.7 pounds per square inch atmosphere (psia) (an absolute pressure of 101.3 kPa).	Gases under pressure are gases which are contained in a receptacle at a pressure of 200 kPa (gauge) or more at 20°C , or which are liquefied or liquefied and refrigerated. Liquefied gas: A gas which when under pressure is partially liquid at temperatures above -50°C (-58°F). A distinction is made between: (a) High pressure liquefied gas: a gas with a critical temperature between -50°C (-58°F) and $+65^{\circ}\text{C}$ (149°F); and (b) Low pressure liquefied gas: a gas with a critical temperature above $+65^{\circ}\text{C}$ (149°F). The critical temperature is the temperature above which a pure gas cannot be liquefied, regardless of the degree of compression.

(continues)

△ Table J.1 *Continued*

Material Classification	Class	Controlling Document	400 Definition	2012 IFC Definition	HCS 2012/UN Definition
Explosives		495	Any chemical compound, mixture, or device, the primary or common purpose of which is to function by explosion.	A chemical compound, mixture or device, the primary or common purpose of which is to function by explosion. The term includes, but is not limited to, dynamite, black powder, pellet powder, initiating explosives, detonators, safety fuses, squibs, detonating cord, igniter cord, igniters and display fireworks, 1.3G. The term "Explosive" includes any material determined to be within the scope of USC Title 18: Chapter 40 and also includes any material classified as an explosive other than consumer fireworks, 1.4G by the hazardous materials regulations of DOT 49 CFR Parts 100–185.	<p>An explosive chemical is a solid or liquid chemical which is in itself capable by chemical reaction of producing gas at such a temperature and pressure and at such a speed as to cause damage to the surroundings. Pyrotechnic chemicals are included even when they do not evolve gases.</p> <p>A pyrotechnic chemical is a chemical designed to produce an effect by heat, light, sound, gas or smoke or a combination of these as the result of non-detonative self-sustaining exothermic chemical reactions.</p> <p>An explosive item is an item containing one or more explosive chemicals.</p> <p>A pyrotechnic item is an item containing one or more pyrotechnic chemicals.</p> <p>An unstable explosive is an explosive which is thermally unstable and/or too sensitive for normal handling, transport, or use.</p> <p>An intentional explosive is a chemical or item which is manufactured with a view to produce a practical explosive or pyrotechnic effect.</p> <p>Division 1.1: Chemicals and items which have a mass explosion hazard (a mass explosion is one which affects almost the entire quantity present virtually instantaneously);</p> <p>Division 1.2: Chemicals and items which have a projection hazard but not a mass explosion hazard;</p> <p>Division 1.3: Chemicals and items which have a fire hazard and either a minor blast hazard or a minor projection hazard or both, but not a mass explosion hazard:</p> <p>(i) Combustion of which gives rise to considerable radiant heat; or</p> <p>(ii) Which burn one after another, producing minor blast or projection effects or both;</p> <p>Division 1.4: Chemicals and items which present no significant hazard: chemicals and items which present only a small hazard in the event of ignition or initiation. The effects are largely confined to the package and no projection of fragments of appreciable size or range is to be expected. An external fire shall not cause virtually instantaneous explosion of almost the entire contents of the package;</p> <p>Division 1.5: Very insensitive chemicals which have a mass explosion hazard: chemicals which have a mass explosion hazard but are so insensitive that there is very little probability of initiation or of transition from burning to detonation under normal conditions;</p>

(continues)

△ Table J.1 *Continued*

Material Classification	Class	Controlling Document	400 Definition	2012 IFC Definition	HCS 2012/UN Definition
					Division 1.6: Extremely insensitive items which do not have a mass explosion hazard: items which contain only extremely insensitive detonating chemicals and which demonstrate a negligible probability of accidental initiation or propagation.
Flammable gas	Gaseous	55	A material that is a gas at 20°C (68°F) or less at an absolute pressure of 101.325 kPa (14.7 psia), that is ignitable at an absolute pressure of 101.325 kPa (14.7 psia) when in a mixture of 13 percent or less by volume with air; or that has a flammable range at an absolute pressure of 101.325 kPa (14.7 psia) with air of at least 12 percent, regardless of the lower limit.	A material which is a gas at 68°F (20°C) or less at 14.7 pounds per square inch atmosphere (psia) (101 kPa) of pressure [a material that has a boiling point of 68°F (20°C) or less at 14.7 psia (101 kPa)] which: 1. Is ignitable at 14.7 psia (101 kPa) when in a mixture of 13 percent or less by volume with air; or 2. Has a flammable range at 14.7 psia (101 kPa) with air of at least 12 percent, regardless of the lower limit. The limits specified shall be determined at 14.7 psi (101 kPa) of pressure and a temperature of 68°F (20°C) in accordance with ASTM E681.	Flammable gas means a gas having a flammable range with air at 20°C (68°F) and a standard pressure of 101.3 kPa (14.7 psi). Category 1: Gases, which at 20°C (68°F) and a standard pressure of 101.3 kPa (14.7 psi): (a) are ignitable when in a mixture of 13 percent or less by volume in air; or (b) have a flammable range with air of at least 12 percentage points regardless of the lower flammable limit. Category 2: Gases, other than those of Category 1, which, at 20°C (68°F) and a standard pressure of 101.3 kPa (14.7 psi), have a flammable range while mixed in air.
	Liquefied	55	A liquefied compressed gas that, when under a charged pressure, is partially liquid at a temperature of 20°C (68°F) and is flammable.	A liquefied compressed gas which, under a charged pressure, is partially liquid at a temperature of 68°F (20°C) and which is flammable.	Gases under pressure are gases which are contained in a receptacle at a pressure of 200 kPa (gauge) or more at 20°C, or which are liquefied or liquefied and refrigerated. Liquefied gas: A gas which when under pressure is partially liquid at temperatures above -50°C (-58°F). A distinction is made between: (a) High pressure liquefied gas: a gas with a critical temperature between -50°C (-58°F) and +65°C (149°F); and (b) Low pressure liquefied gas: a gas with a critical temperature above +65°C (149°F). The critical temperature is the temperature above which a pure gas cannot be liquefied, regardless of the degree of compression.
	Liquefied petroleum (LP)	58	Not specifically defined.	A material which is composed predominantly of the following hydrocarbons or mixtures of them: propane, propylene, butane (normal butane or isobutane) and butylenes.	
Flammable liquids	I-A	30	Any liquid that has a flash point below 73°F (22.8°C) and a boiling point below 100°F (37.8°C).	Liquids having a flash point below 73°F (23°C) and having a boiling point below 100°F (38°C).	Flammable liquid means a liquid having a flash point of not more than 93°C (199.4°F). Category 1: Flash point <23°C (73.4°F) and initial boiling point ≤35°C (95°F).
	I-B	30	Any liquid that has a flash point below 73°F (22.8°C) and a boiling point at or above 100°F (37.8°C).	Liquids having a flash point below 73°F (23°C) and having a boiling point at or above 100°F (38°C).	Flammable liquid Category 2: Flash point <23°C (73.4°F) and initial boiling point >35°C (95°F).
	I-C	30	Any liquid that has a flash point at or above 73°F (22.8°C) but below 100°F (37.8°C).	Liquids having a flash point at or above 73°F (23°C) and below 100°F (38°C).	Flammable liquid Category 3: Flash point ≥23°C (73.4°F) and ≤60°C (140°F).

(continues)

△ Table J.1 *Continued*

Material Classification	Class	Controlling Document	400 Definition	2012 IFC Definition	HCS 2012/UN Definition
Flammable solid		400	A solid substance, other than a substance defined as a blasting agent or explosive, that is liable to cause fire resulting from friction or retained heat from manufacture, that has an ignition temperature below 212°F (100°C), or that burns so vigorously or persistently when ignited that it creates a serious hazard.	A solid, other than a blasting agent or explosive, that is capable of causing fire through friction, absorption of moisture, spontaneous chemical change or retained heat from manufacturing or processing, or which has an ignition temperature below 212°F (100°C) or which burns so vigorously and persistently when ignited as to create a serious hazard. A chemical shall be considered a flammable solid as determined in accordance with the test method of CPSC 16 CFR Part 1500.44, if it ignites and burns with a self-sustained flame at a rate greater than 0.1 inch (2.5 mm) per second along its major axis.	Flammable solid means a solid which is a readily combustible solid, or which may cause or contribute to fire through friction. Readily combustible solids are powdered, granular, or pasty chemicals which are dangerous if they can be easily ignited by brief contact with an ignition source, such as a burning match, and if the flame spreads rapidly. Category 1: Burning rate test: Chemicals other than metal powders: (a) Wetted zone does not stop fire; and (b) Burning time <45 s or burning rate >2.2 mm/s Metal powders: burning time ≤5 min Category 2: Burning rate test: Chemicals other than metal powders: (a) Wetted zone stops the fire for at least 4 min; and (b) Burning time <45 s or burning rate >2.2 mm/s Metal powders: burning time >5 min and ≤10 min Test Method for burning rate is provided in the UN TDG <i>Manual of Tests and Criteria</i> .
Inert gas	Gaseous	55	A nonreactive, nonflammable, noncorrosive gas such as argon, helium, krypton, neon, nitrogen, and xenon.	A gas that is capable of reacting with other materials only under abnormal conditions such as high temperatures, pressures and similar extrinsic physical forces. Within the context of the code, inert gases do not exhibit either physical or health hazard properties as defined (other than acting as a simple asphyxiant) or hazard properties other than those of a compressed gas. Some of the more common inert gases include argon, helium, krypton, neon, nitrogen and xenon.	Simple asphyxiant means a substance or mixture that displaces oxygen in the ambient atmosphere, and can thus cause oxygen deprivation in those who are exposed, leading to unconsciousness and death. (In HCS 2012, not in GHS)
	Liquefied	55	A nonreactive, nonflammable, noncorrosive gas such as argon, helium, krypton, neon, nitrogen, and xenon.	A gas that is capable of reacting with other materials only under abnormal conditions such as high temperatures, pressures and similar extrinsic physical forces. Within the context of the code, inert gases do not exhibit either physical or health hazard properties as defined (other than acting as a simple asphyxiant) or hazard properties other than those of a compressed gas. Some of the more common inert gases include argon, helium, krypton, neon, nitrogen and xenon.	Simple asphyxiant means a substance or mixture that displaces oxygen in the ambient atmosphere, and can thus cause oxygen deprivation in those who are exposed, leading to unconsciousness and death. (In HCS 2012, not in GHS)

(continues)

△ Table J.1 *Continued*

Material Classification	Class	Controlling Document	400 Definition	2012 IFC Definition	HCS 2012/UN Definition
Organic peroxide	UD	400	Not specifically defined (<i>see definitions of classes of organic peroxides below</i>).	Unclassified detonable: Organic peroxides that are capable of detonation. These peroxides pose an extremely high-explosion hazard through rapid explosive decomposition.	<p>Organic peroxide means a liquid or solid organic chemical which contains the bivalent -O-O- structure and as such is considered a derivative of hydrogen peroxide, where one or both of the hydrogen atoms have been replaced by organic radicals. The term organic peroxide includes organic peroxide mixtures containing at least one organic peroxide. Organic peroxides are thermally unstable chemicals, which may undergo exothermic self-accelerating decomposition. In addition, they may have one or more of the following properties:</p> <p>(a) Be liable to explosive decomposition;</p> <p>(b) Burn rapidly;</p> <p>(c) Be sensitive to impact or friction;</p> <p>(d) React dangerously with other substances</p> <p>Organic peroxide TYPE A: Any organic peroxide which, as packaged, can detonate or deflagrate rapidly.</p> <p>Organic peroxide TYPE B: Any organic peroxide possessing explosive properties and which, as packaged, neither detonates nor deflagrates rapidly, but is liable to undergo a thermal explosion in that package.</p>
	I	400	Class I shall describe those formulations that are more severe than a Class II but do not detonate.	Describes those formulations that are capable of deflagration but not detonation.	Organic peroxide TYPE C: Any organic peroxide possessing explosive properties when the chemical as packaged cannot detonate or deflagrate rapidly or undergo a thermal explosion.
	II	400	Class II shall describe those formulations that burn very rapidly and that present a severe reactivity hazard.	Describes those formulations that burn very rapidly and that pose a moderate reactivity hazard.	<p>Organic peroxide TYPE D: Any organic peroxide which in laboratory testing meets the following criteria:</p> <p>(i) Detonates partially, does not deflagrate rapidly and shows no violent effect when heated under confinement; or</p> <p>(ii) Does not detonate at all, deflagrates slowly and shows no violent effect when heated under confinement; or</p> <p>(iii) Does not detonate or deflagrate at all and shows a medium effect when heated under confinement.</p>
	III	400	Class III shall describe those formulations that burn rapidly and that present a moderate reactivity hazard.	Describes those formulations that burn rapidly and that pose a moderate reactivity hazard.	Organic peroxide TYPE E: Any organic peroxide which, in laboratory testing, neither detonates nor deflagrates at all and shows low or no effect when heated under confinement.

(continues)

△ Table J.1 *Continued*

Material Classification	Class	Controlling Document	400 Definition	2012 IFC Definition	HCS 2012/UN Definition
	IV	400	Class IV shall describe those formulations that burn in the same manner as ordinary combustibles and that present a minimal reactivity hazard.	Describes those formulations that burn in the same manner as ordinary combustibles and that pose a minimal reactivity hazard.	Organic peroxide TYPE F: Any organic peroxide which, in laboratory testing, neither detonates in the cavitated state nor deflagrates at all and shows only a low or no effect when heated under confinement as well as low or no explosive power.
	V	400	Class V shall describe those formulations that burn with less intensity than ordinary combustibles or do not sustain combustion and that present no reactivity hazard.	Describes those formulations that burn with less intensity than ordinary combustibles or do not sustain combustion and that pose no reactivity hazard.	Organic peroxide TYPE G: Any organic peroxide which, in laboratory testing, neither detonates in the cavitated state nor deflagrates at all and shows no effect when heated under confinement nor any explosive power, provided that it is thermally stable [self-accelerating decomposition temperature is 60°C (140°F) or higher for a 50 kg (110 lb) package], and, for liquid mixtures, a diluent having a boiling point of not less than 150°C (302°F) is used for desensitization. If the organic peroxide is not thermally stable or a diluent having a boiling point less than 150°C (302°F) is used for desensitization, it shall be defined as organic peroxide TYPE F.
Oxidizer	4	400	An oxidizer that can undergo an explosive reaction due to contamination or exposure to thermal or physical shock and that causes a severe increase in the burning rate of combustible materials with which it comes into contact.	An oxidizer that can undergo an explosive reaction due to contamination or exposure to thermal or physical shock and that causes a severe increase in the burning rate of combustible materials with which it comes into contact. Additionally, the oxidizer causes a severe increase in the burning rate and can cause spontaneous ignition of combustibles.	Oxidizing solid means a solid which, while in itself is not necessarily combustible, may, generally by yielding oxygen, cause, or contribute to, the combustion of other material. Oxidizing liquid means a liquid which, while in itself not necessarily combustible, may, generally by yielding oxygen, cause, or contribute to, the combustion of other material. Oxidizing liquid Category 1: Any chemical which, in the 1:1 mixture, by mass, of chemical and cellulose tested, spontaneously ignites; or the mean pressure rise time of a 1:1 mixture, by mass, of chemical and cellulose is less than that of a 1:1 mixture, by mass, of 50 percent perchloric acid and cellulose. Oxidizing solid Category 1: Any chemical which, in the 4:1 or 1:1 sample-to-cellulose ratio (by mass) tested, exhibits a mean burning time less than the mean burning time of a 3:2 mixture, by mass, of potassium bromate and cellulose.

(continues)

△ Table J.1 *Continued*

Material Classification	Class	Controlling Document	400 Definition	2012 IFC Definition	HCS 2012/UN Definition
	3	400	An oxidizer that causes a severe increase in the burning rate of combustible materials with which it comes into contact or a solid oxidizer classified as Class 3 when tested in accordance with the test protocol set forth in Section G.1.	An oxidizer that causes a severe increase in the burning rate of combustible materials with which it comes in contact.	Oxidizing liquid Category 2: Any chemical which, in the 1:1 mixture, by mass, of chemical and cellulose tested, exhibits a mean pressure rise time less than or equal to the mean pressure rise time of a 1:1 mixture, by mass, of 40 percent aqueous sodium chlorate solution and cellulose; and the criteria for Category 1 are not met. Oxidizing solid Category 2: Any chemical which, in the 4:1 or 1:1 sample-to-cellulose ratio (by mass) tested, exhibits a mean burning time equal to or less than the mean burning time of a 2:3 mixture (by mass) of potassium bromate and cellulose and the criteria for Category 1 are not met.
	2	400	An oxidizer that causes a moderate increase in the burning rate of combustible materials with which it comes into contact or a solid oxidizer classified as Class 2 when tested in accordance with the test protocol set forth in Section G.1.	An oxidizer that will cause a moderate increase in the burning rate of combustible materials with which it comes in contact.	Oxidizing solid means a solid which, while in itself is not necessarily combustible, may, generally by yielding oxygen, cause, or contribute to, the combustion of other material. Oxidizing liquid means a liquid which, while in itself not necessarily combustible, may, generally by yielding oxygen, cause, or contribute to, the combustion of other material. Oxidizing liquid Category 3: Any chemical which, in the 1:1 mixture, by mass, of chemical and cellulose tested, exhibits a mean pressure rise time less than or equal to the mean pressure rise time of a 1:1 mixture, by mass, of 65 percent aqueous nitric acid and cellulose; and the criteria for Categories 1 and 2 are not met. Oxidizing solid Category 3: Any chemical which, in the 4:1 or 1:1 sample-to-cellulose ratio (by mass) tested, exhibits a mean burning time equal to or less than the mean burning time of a 3:7 mixture (by mass) of potassium bromate and cellulose and the criteria for Categories 1 and 2 are not met.
	1	400	An oxidizer that does not moderately increase the burning rate of combustible materials with which it comes into contact or a solid oxidizer classified as Class 1 when tested in accordance with the test protocol set forth in Section G.1.	An oxidizer that does not moderately increase the burning rate of combustible materials.	
Oxidizing gas	Gaseous	55	A gas that can support and accelerate combustion of other materials.		Oxidizing gas means any gas which may, generally by providing oxygen, cause or contribute to the combustion of other material more than air does.
	Liquefied	55	A gas that can support and accelerate combustion of other materials.		Oxidizing gas means any gas which may, generally by providing oxygen, cause or contribute to the combustion of other material more than air does.

(continues)

△ Table J.1 *Continued*

Material Classification	Class	Controlling Document	400 Definition	2012 IFC Definition	HCS 2012/UN Definition
Pyrophoric		400	A chemical with an autoignition temperature in air at or below 130°F (54.4°C).	A chemical with an autoignition temperature in air, at or below a temperature of 130°F (54°C).	Pyrophoric liquid means a liquid which, even in small quantities, is liable to ignite within 5 min after coming into contact with air; Category 1: The liquid ignites within 5 min when added to an inert carrier and exposed to air, or it ignites or chars a filter paper on contact with air within 5 min. Pyrophoric solid means a solid which, even in small quantities, is liable to ignite within 5 min after coming into contact with air; Category 1: The solid ignites within 5 min of coming into contact with air.
Pyrophoric gas	Gaseous	55	A gas with an autoignition temperature in air at or below 54.4°C (130°F).		Pyrophoric gas means a chemical in a gaseous state that will ignite spontaneously in air at a temperature of 130°F (54.4°C) or below. (In HCS 2012, not GHS)
	Liquefied	55	A gas with an autoignition temperature in air at or below 54.4°C (130°F).		Pyrophoric gas means a chemical in a gaseous state that will ignite spontaneously in air at a temperature of 130°F (54.4°C) or below. (In HCS 2012, not GHS)
Unstable (reactive) gas	4	55	Materials that in themselves are readily capable of detonation or explosive decomposition or explosive reaction at normal temperatures and pressures.		A chemically unstable gas is a flammable gas that is able to react explosively even in the absence of air or oxygen. (In GHS, Rev.4; not HCS 2012) Category A: Flammable gases which are chemically unstable at 20°C and a standard pressure of 101.3 kPa. Category B: Flammable gases which are chemically unstable at a temperature greater than 20°C and/or a pressure greater than 101.3 kPa.
	3	55	Materials that in themselves are capable of detonation or explosive decomposition or explosive reaction, but that require a strong initiating source or that must be heated under confinement before initiation.		
	2	55	Materials that readily undergo violent chemical change at elevated temperatures and pressures.		
	1	55	A gas that, in the pure state or as commercially produced, will vigorously polymerize, decompose, or condense, become self-reactive, or otherwise undergo a violent chemical change under conditions of shock, pressure, or temperature.		

(continues)

△ Table J.1 *Continued*

Material Classification	Class	Controlling Document	400 Definition	2012 IFC Definition	HCS 2012/UN Definition
Unstable (reactive)	4	400	Materials are those that, in themselves, are readily capable of detonation, explosive decomposition, or explosive reaction at normal temperatures and pressures and include, among others, materials that are sensitive to localized thermal or mechanical shock at normal temperatures and pressures.	Materials that in themselves are readily capable of detonation or explosive decomposition or explosive reaction at normal temperatures and pressures. This class includes materials that are sensitive to mechanical or localized thermal shock at normal temperatures and pressures.	<p>Self-reactive chemicals are thermally unstable liquid or solid chemicals liable to undergo a strongly exothermic decomposition even without participation of oxygen (air). This definition excludes chemicals classified under this section as explosives, organic peroxides, oxidizing liquids or oxidizing solids.</p> <p>A self-reactive chemical is regarded as possessing explosive properties when in laboratory testing the formulation is liable to detonate, to deflagrate rapidly or to show a violent effect when heated under confinement.</p> <p>Self-reactive chemical TYPE A: Any self-reactive chemical which can detonate or deflagrate rapidly, as packaged.</p> <p>Self-reactive chemical TYPE B: Any self-reactive chemical possessing explosive properties and which, as packaged, neither detonates nor deflagrates rapidly, but is liable to undergo a thermal explosion in that package.</p>
	3	400	Materials are those that, in themselves, are capable of detonation, explosive decomposition, or explosive reaction, but that require a strong initiating source or that must be heated under confinement before initiation, and include, among others, materials that are sensitive to thermal or mechanical shock at elevated temperatures and pressures.	Materials that in themselves are capable of detonation or of explosive decomposition or explosive reaction but which require a strong initiating source or which must be heated under confinement before initiation. This class includes materials that are sensitive to thermal or mechanical shock at elevated temperatures and pressures.	<p>Self-reactive chemicals are thermally unstable liquid or solid chemicals liable to undergo a strongly exothermic decomposition even without participation of oxygen (air). This definition excludes chemicals classified under this section as explosives, organic peroxides, oxidizing liquids or oxidizing solids.</p> <p>A self-reactive chemical is regarded as possessing explosive properties when in laboratory testing the formulation is liable to detonate, to deflagrate rapidly or to show a violent effect when heated under confinement.</p> <p>Self-reactive chemical TYPE C: Any self-reactive chemical possessing explosive properties when the chemical as packaged cannot detonate or deflagrate rapidly or undergo a thermal explosion.</p> <p>Self-reactive chemical TYPE D: Any self-reactive chemical which in laboratory testing meets the following criteria:</p> <ul style="list-style-type: none"> (i) Detonates partially, does not deflagrate rapidly and shows no violent effect when heated under confinement; or (ii) Does not detonate at all, deflagrates slowly and shows no violent effect when heated under confinement; or (iii) Does not detonate or deflagrate at all and shows a medium effect when heated under confinement

(continues)

△ Table J.1 *Continued*

Material Classification	Class	Controlling Document	400 Definition	2012 IFC Definition	HCS 2012/UN Definition
	2	400	Materials are those that readily undergo violent chemical change at elevated temperatures and pressures and include, among others, materials that exhibit an exotherm at temperatures less than or equal to 30°F (-1°C) when tested by differential scanning calorimetry.	Materials that in themselves are normally unstable and readily undergo violent chemical change but do not detonate. This class includes materials that can undergo chemical change with rapid release of energy at normal temperatures and pressures, and that can undergo violent chemical change at elevated temperatures and pressures.	<p>Self-reactive chemicals are thermally unstable liquid or solid chemicals liable to undergo a strongly exothermic decomposition even without participation of oxygen (air). This definition excludes chemicals classified under this section as explosives, organic peroxides, oxidizing liquids or oxidizing solids.</p> <p>A self-reactive chemical is regarded as possessing explosive properties when in laboratory testing the formulation is liable to detonate, to deflagrate rapidly or to show a violent effect when heated under confinement.</p> <p>Self-reactive chemical TYPE E: Any self-reactive chemical which, in laboratory testing, neither detonates nor deflagrates at all and shows low or no effect when heated under confinement.</p> <p>Self-reactive chemical TYPE F: Any self-reactive chemical which, in laboratory testing, neither detonates in the cavitated state nor deflagrates at all and shows only a low or no effect when heated under confinement as well as low or no explosive power.</p>
	1	400	Materials are those that, in themselves, are normally stable, but that can become unstable at elevated temperatures and pressures and include among others, materials that change or decompose on exposure to air, light, or moisture and that exhibit an exotherm at temperatures greater than 30°F (-1°C), but less than or equal to 57°F (14°C), when tested by differential scanning calorimetry.	Materials that in themselves are normally stable but which can become unstable at elevated temperatures and pressure.	<p>Self-reactive chemicals are thermally unstable liquid or solid chemicals liable to undergo a strongly exothermic decomposition even without participation of oxygen (air). This definition excludes chemicals classified under this section as explosives, organic peroxides, oxidizing liquids or oxidizing solids.</p> <p>A self-reactive chemical is regarded as possessing explosive properties when in laboratory testing the formulation is liable to detonate, to deflagrate rapidly or to show a violent effect when heated under confinement.</p> <p>Self-reactive chemical TYPE G: Any self-reactive chemical which, in laboratory testing, neither detonates in the cavitated state nor deflagrates at all and shows no effect when heated under confinement nor any explosive power, provided that it is thermally stable [self-accelerating decomposition temperature is 60°C (140°F) to 75°C (167°F) for a 50 kg (110 lb) package], and, for liquid mixtures, a diluent having a boiling point greater than or equal to 150°C (302°F) is used for desensitization. If the mixture is not thermally stable or a diluent having a boiling point less than 150°C (302°F) is used for desensitization, the mixture shall be defined as self-reactive chemical TYPE F.</p>

(continues)

△ Table J.1 *Continued*

Material Classification	Class	Controlling Document	400 Definition	2012 IFC Definition	HCS 2012/UN Definition
Water-reactive	3	400	Materials whose heat of mixing is greater or equal to 600 cal/g.	Materials that react explosively with water without requiring heat or confinement.	Chemicals which, in contact with water, emit flammable gases are solid or liquid chemicals which, by interaction with water, are liable to become spontaneously flammable or to give off flammable gases in dangerous quantities. Category 1: Any chemical which reacts vigorously with water at ambient temperatures and demonstrates generally a tendency for the gas produced to ignite spontaneously, or which reacts readily with water at ambient temperatures such that the rate of evolution of flammable gas is equal to or greater than 10 liters per kilogram of chemical over any 1 minute.
	2	400	Materials whose heat of mixing is at or above 100 cal /g and less than 600 cal/g.	Materials that react violently with water or have the ability to boil water. Materials that produce flammable, toxic or other hazardous gases, or evolve enough heat to cause autoignition or ignition of combustibles upon exposure to water or moisture.	Chemicals which, in contact with water, emit flammable gases Category 2: Any chemical which reacts readily with water at ambient temperatures such that the maximum rate of evolution of flammable gas is equal to or greater than 20 liters per kilogram of chemical per hour, and which does not meet the criteria for Category 1.
	1	400	Materials whose heat of mixing is at or above 30 cal/g and less than 100 cal/g.	Materials that react with water with some release of energy, but not violently.	Chemicals which, in contact with water, emit flammable gases Category 3: Any chemical which reacts slowly with water at ambient temperatures such that the maximum rate of evolution of flammable gas is equal to or greater than 1 liter per kilogram of chemical per hour, and which does not meet the criteria for Categories 1 and 2.
Corrosive		400	A chemical that causes visible destruction of, or irreversible alterations in, living tissue by chemical action at the site of contact.	A chemical that causes visible destruction of, or irreversible alterations in, living tissue by chemical action at the point of contact. A chemical shall be considered corrosive if, when tested on the intact skin of albino rabbits by the method described in DOT 49 CFR 173.137, such chemical destroys or changes irreversibly the structure of the tissue at the point of contact following an exposure period of 4 hours. This term does not refer to action on inanimate surfaces.	Skin corrosion is the production of irreversible damage to the skin; namely, visible necrosis through the epidermis and into the dermis, following the application of a test substance for up to 4 hours. Corrosive reactions are typified by ulcers, bleeding, bloody scabs, and, by the end of observation at 14 days, by discoloration due to blanching of the skin, complete areas of alopecia, and scars. Histopathology should be considered to evaluate questionable lesions.

(continues)

△ Table J.1 *Continued*

Material Classification	Class	Controlling Document	400 Definition	2012 IFC Definition	HCS 2012/UN Definition
Corrosive Gas	Gaseous	55	A gas that causes visible destruction of or irreversible alterations in living tissue by chemical action at the site of contact.		Skin corrosion is the production of irreversible damage to the skin; namely, visible necrosis through the epidermis and into the dermis, following the application of a test substance for up to 4 hours. Corrosive reactions are typified by ulcers, bleeding, bloody scabs, and, by the end of observation at 14 days, by discoloration due to blanching of the skin, complete areas of alopecia, and scars. Histopathology should be considered to evaluate questionable lesions.
	Liquefied	55	A gas that causes visible destruction of or irreversible alterations in living tissue by chemical action at the site of contact.		Skin corrosion is the production of irreversible damage to the skin; namely, visible necrosis through the epidermis and into the dermis, following the application of a test substance for up to 4 hours. Corrosive reactions are typified by ulcers, bleeding, bloody scabs, and, by the end of observation at 14 days, by discoloration due to blanching of the skin, complete areas of alopecia, and scars. Histopathology should be considered to evaluate questionable lesions.
Highly toxic		400	A material that produces a lethal dose or lethal concentration that falls within any of the following categories: (1) a chemical that has a median lethal dose (LD50) of 50 mg/kg or less of body weight when administered orally to albino rats weighing between 200 g and 300 g each; (2) a chemical that has a median lethal dose (LD50) of 200 mg/kg or less of body weight when administered by continuous contact for 24 hours, or less if death occurs within 24 hours, with the bare skin of albino rabbits weighing between 2 kg and 3 kg each or albino rats weighing 200 g and 300 g each; (3) a chemical that has a median lethal concentration (LC50) in air of 200 parts per million by volume or less of gas or vapor, or 2 mg/L or less of mist, fume, or dust, when administered by continuous inhalation for 1 hour, or less if death occurs within 1 hour, to albino rats weighing between 200 g and 300 g each.	A material which produces a lethal dose or lethal concentration which falls within any of the following categories: 1. A chemical that has a median lethal dose (LD50) of 50 milligrams or less per kilogram of body weight when administered orally to albino rats weighing between 200 and 300 grams each. 2. A chemical that has a median lethal dose (LD50) of 200 milligrams or less per kilogram of body weight when administered by continuous contact for 24 hours (or less if death occurs within 24 hours) with the bare skin of albino rabbits weighing between 2 and 3 kilograms each. 3. A chemical that has a median lethal concentration (LC50) in air of 200 parts per million by volume or less of gas or vapor, or 2 milligrams per liter or less of mist, fume or dust, when administered by continuous inhalation for one hour (or less if death occurs within 1 hour) to albino rats weighing between 200 and 300 grams each.	Acute toxicity refers to those adverse effects occurring following oral or dermal administration of a single dose of a substance, or multiple doses given within 24 hours, or an inhalation exposure of 4 hours. Oral Category 1: LD50 ≤5 mg/kg; Oral Category 2: LD50 >5 and ≤50; Dermal Category 1: LD50 ≤50; Dermal Category 2: LD50 >50 and ≤200.

(continues)

△ Table J.1 *Continued*

Material Classification	Class	Controlling Document	400 Definition	2012 IFC Definition	HCS 2012/UN Definition
Highly toxic gas	Gaseous	55	A chemical that has a median lethal concentration (LC50) in air of 200 ppm by volume or less of gas or vapor, or 2 mg/L or less of mist, fume, or dust, when administered by continuous inhalation for 1 hour (or less if death occurs within 1 hour) to albino rats weighing between 200 g and 300 g (0.44 lb and 0.66 lb) each.		<p>Acute toxicity refers to those adverse effects occurring following oral or dermal administration of a single dose of a substance, or multiple doses given within 24 hours, or an inhalation exposure of 4 hours.</p> <p>Inhalation - Gases Category 1: LD50 ≤100; Inhalation - Gases Category 2: LD50 >100 and ≤500; Inhalation - Vapors Category 1: LD50 ≤0.5; Inhalation - Vapors Category 2: LD50 >0.5 and ≤2.0; Inhalation - Dusts and Mists Category 1: LD50 ≤0.05; Inhalation - Dusts and Mists Category 2: LD50 >0.05 and ≤0.5; Inhalation - Dusts and Mists Category 3: LD50 >0.5 and ≤1.0.</p>
	Liquefied	55	A chemical that has a median lethal concentration (LC50) in air of 200 ppm by volume or less of gas or vapor, or 2 mg/L or less of mist, fume, or dust, when administered by continuous inhalation for 1 hour (or less if death occurs within 1 hour) to albino rats weighing between 200 g and 300 g (0.44 lb and 0.66 lb) each.		<p>Acute toxicity refers to those adverse effects occurring following oral or dermal administration of a single dose of a substance, or multiple doses given within 24 hours, or an inhalation exposure of 4 hours.</p> <p>Inhalation - Gases Category 1: LD50 ≤100; Inhalation - Gases Category 2: LD50 >100 and ≤500; Inhalation - Vapors Category 1: LD50 ≤0.5; Inhalation - Vapors Category 2: LD50 >0.5 and ≤2.0; Inhalation - Dusts and Mists Category 1: LD50 ≤0.05; Inhalation - Dusts and Mists Category 2: LD50 >0.05 and ≤0.5; Inhalation - Dusts and Mists Category 3: LD50 >0.5 and ≤1.0.</p>

(continues)

△ Table J.1 *Continued*

Material Classification	Class	Controlling Document	400 Definition	2012 IFC Definition	HCS 2012/UN Definition
Toxic		400	A material that produces a lethal dose or a lethal concentration within any of the following categories: (1) a chemical or substance that has a median lethal dose (LD50) of more than 50 mg/kg but not more than 500 mg/kg of body weight when administered orally to albino rats weighing between 200 g and 300 g each; (2) a chemical or substance that has a median lethal dose (LD50) of more than 200 mg/kg but not more than 1000 mg/kg of body weight when administered by continuous contact for 24 hours, or less if death occurs within 24 hours, with the bare skin of albino rabbits weighing between 2 kg and 3 kg each; (3) a chemical or substance that has a median lethal concentration (LC50) in air of more than 200 parts per million but not more than 2000 parts per million by volume of gas or vapor, or more than 2 mg/L but not more than 20 mg/L, of mist, fume, or dust when administered by continuous inhalation for 1 hour, or less if death occurs within 1 hour, to albino rats weighing between 200 g and 300 g each.	A chemical falling within any of the following categories: 1. A chemical that has a median lethal dose (LD50) of more than 50 milligrams per kilogram, but not more than 500 milligrams per kilogram of body weight when administered orally to albino rats weighing between 200 and 300 grams each. 2. A chemical that has a median lethal dose (LD50) of more than 200 milligrams per kilogram but not more than 1,000 milligrams per kilogram of body weight when administered by continuous contact for 24 hours (or less if death occurs within 24 hours) with the bare skin of albino rabbits weighing between 2 and 3 kilograms each. 3. A chemical that has a median lethal concentration (LC50) in air of more than 200 parts per million but not more than 2,000 parts per million by volume of gas or vapor, or more than 2 milligrams per liter but not more than 20 milligrams per liter of mist, fume or dust, when administered by continuous inhalation for 1 hour (or less if death occurs within 1 hour) to albino rats weighing between 200 and 300 grams each.	Acute toxicity refers to those adverse effects occurring following oral or dermal administration of a single dose of a substance, or multiple doses given within 24 hours, or an inhalation exposure of 4 hours. Oral Category 2: LD50 >5 and ≤50; Oral Category 3: LD50 >50 and ≤300; Oral Category 4: LD50 >300 and ≤2000; Dermal Category 2: LD50 >50 and ≤200; Dermal Category 3: LD50 >200 and ≤1000; Dermal Category 4: LD50 >1000 and ≤2000; Inhalation - Gases Category 2: LD50 >100 and ≤500; Inhalation - Gases Category 3: LD50 >500 and ≤2500; Inhalation - Gases Category 4: LD50 >2500 and ≤20000; Inhalation - Vapors Category 3: LD50 >2.0 and ≤10.0; Inhalation - Vapors Category 4: LD50 >10.0 and ≤20.0; Inhalation - Dusts and Mists Category 4: LD50 >1.0 and ≤5.0.
Toxic gas	Gaseous	55	A gas with a median lethal concentration (LC50) in air of more than 200 ppm, but not more than 2000 ppm by volume of gas or vapor, or more than 2 mg/L, but not more than 20 mg/L of mist, fume, or dust, when administered by continuous inhalation for 1 hour (or less if death occurs within 1 hour) to albino rats weighing between 200 g and 300 g (0.44 lb and 0.66 lb) each.		Acute toxicity refers to those adverse effects occurring following oral or dermal administration of a single dose of a substance, or multiple doses given within 24 hours, or an inhalation exposure of 4 hours. Oral Category 2: LD50 >5 and ≤50; Oral Category 3: LD50 >50 and ≤300; Oral Category 4: LD50 >300 and ≤2000; Inhalation - Gases Category 2: LD50 >100 and ≤500; Inhalation - Gases Category 3: LD50 >500 and ≤2500; Inhalation - Gases Category 4: LD50 >2500 and ≤20000; Inhalation - Vapors Category 3: LD50 >2.0 and ≤10.0; Inhalation - Vapors Category 4: LD50 >10.0 and ≤20.0; Inhalation - Dusts and Mists Category 4: LD50 >1.0 and ≤5.0.
	Liquefied	55	A gas with a median lethal concentration (LC50) in air of more than 200 ppm, but not more than 2000 ppm by volume of gas or vapor, or more than 2 mg/L, but not more than 20 mg/L of mist, fume, or dust, when administered by continuous inhalation for 1 hour (or less if death occurs within 1 hour) to albino rats weighing between 200 g and 300 g (0.44 lb and 0.66 lb) each.		

Not specifically defined.

Gas means a substance which
(continues)

△ Table J.1 *Continued*

Material Classification	Class	Controlling Document	400 Definition	2012 IFC Definition	HCS 2012/UN Definition
					(i) at 50°C has a vapor pressure greater than 300 kPa (absolute); or (ii) is completely gaseous at 20°C at a standard pressure of 101.3 kPa. (In GHS, not HCS 2012)
			Not specifically defined.		Liquid means a substance or mixture which at 50°C has a vapour pressure of not more than 300 kPa (3 bar), which is not completely gaseous at 20°C and at a standard pressure of 101.3 kPa, and which has a melting point or initial melting point of 20°C or less at a standard pressure of 101.3 kPa. A viscous substance or mixture for which a specific melting point cannot be determined shall be subjected to the ASTM D4359-90 test; or to the test for determining fluidity (penetrometer test) prescribed in section 2.3.4 of Annex A of the European Agreement concerning the International Carriage of Dangerous Goods by Road (ADR). (In GHS, not HCS 2012)
			Not specifically defined.		Solid means a substance or mixture which does not meet the definitions of liquid or gas. (In GHS, not HCS 2012)

(continues)

△ Table J.1 *Continued*

Material Classification	Class	Controlling Document	400 Definition	2012 IFC Definition	HCS 2012/UN Definition
			Not specifically defined.		<p><i>Flammable Aerosol</i> means any non-refillable receptacle containing a gas compressed, liquefied or dissolved under pressure, and fitted with a release device allowing the contents to be ejected as particles in suspension in a gas, or as a foam, paste, powder, liquid or gas.</p> <p>Aerosol Category 1: Contains ≥85 percent flammable components and the chemical heat of combustion is ≥30 kJ/g; or</p> <p>a) For spray aerosols, in the ignition distance test, ignition occurs at a distance ≥75 cm (29.5 in), or</p> <p>b) For foam aerosols, in the aerosol foam flammability test</p> <p>(i) The flame height is ≥20 cm (7.87 in) and the flame duration ≥2 s; or</p> <p>(ii) The flame height is ≥4 cm (1.57 in) and the flame duration ≥7 s</p> <p>Aerosol Category 2: Contains >1 percent flammable components, or the heat of combustion is ≥20 kJ/g; and</p> <p>a) for spray aerosols, in the ignition distance test, ignition occurs at a distance ≥15 cm (5.9 in), or in the enclosed space ignition test, the</p> <p>(i) Time equivalent is ≤300 s/m³; or</p> <p>(ii) Deflagration density is ≤300 g/m³</p> <p>b) For foam aerosols, in the aerosol foam flammability test, the flame height is ≥4 cm and the flame duration is ≥2 s and it does not meet the criteria for Category 1. (Definition from HCS 2012; GHS Rev 4 includes non-flammable aerosols)</p>
			Not specifically defined.		<p>Gases under pressure are gases which are contained in a receptacle at a pressure of 200 kPa (29 psi) (gauge) or more, or which are liquefied or liquefied and refrigerated.</p> <p>They comprise compressed gases, liquefied gases, dissolved gases and refrigerated liquefied gases.</p>
			Not specifically defined.		<p>Skin irritation is the production of reversible damage to the skin following the application of a test substance for up to 4 hours. A chemical which is corrosive to metals means a chemical which by chemical action will materially damage, or even destroy, metals.</p>

(continues)

△ Table J.1 *Continued*

Material Classification	Class	Controlling Document	400 Definition	2012 IFC Definition	HCS 2012/UN Definition
			Not specifically defined.		<p>A self-heating chemical is a solid or liquid chemical, other than a pyrophoric liquid or solid, which, by reaction with air and without energy supply, is liable to self-heat; this chemical differs from a pyrophoric liquid or solid in that it will ignite only when in large amounts (kilograms) and after long periods of time (hours or days).</p> <p>NOTE: Self-heating of a substance or mixture is a process where the gradual reaction of that substance or mixture with oxygen (in air) generates heat. If the rate of heat production exceeds the rate of heat loss, then the temperature of the substance or mixture will rise which, after an induction time, may lead to self-ignition and combustion.</p>

Annex K Sample Ordinance for Adopting NFPA 400

This annex is not a part of the requirements of this NFPA document but is included for informational purposes only.

K.1 The following sample ordinance is provided to assist a jurisdiction in the adoption of this code and is not part of this code.

ORDINANCE NO. _____

An ordinance of the [jurisdiction] adopting the [year] edition of NFPA [document number], [complete document title], and documents listed in Chapter 2 of that [code, standard]; prescribing regulations governing conditions hazardous to life and property from fire or explosion; providing for the issuance of permits and collection of fees; repealing Ordinance No. _____ of the [jurisdiction] and all other ordinances and parts of ordinances in conflict therewith; providing a penalty; providing a severability clause; and providing for publication; and providing an effective date.

BE IT ORDAINED BY THE [governing body] OF THE [jurisdiction]:

SECTION 1 That the [complete document title] and documents adopted by Chapter 2, three (3) copies of which are on file and are open to inspection by the public in the office of the [jurisdiction's keeper of records] of the [jurisdiction], are hereby adopted and incorporated into this ordinance as fully as if set out at length herein, and from the date on which this ordinance shall take effect, the provisions thereof shall be controlling within the limits of the [jurisdiction]. The same are hereby adopted as the [code, standard] of the [jurisdiction] for the purpose of prescribing regulations governing conditions hazardous to life and property from fire or explosion and providing for issuance of permits and collection of fees.

SECTION 2 Any person who shall violate any provision of this code or standard hereby adopted or fail to comply thereunder; or who shall violate or fail to comply with any order made thereunder; or who shall build in violation of any detailed statement of specifications or plans submitted and approved thereunder; or fail to operate in accordance with any certificate or permit issued thereunder; and from which no appeal has been taken; or who shall fail to comply with such an order as affirmed or modified by a court of competent jurisdiction, within the time fixed herein, shall severally for each and every such violation and noncompliance, respectively, be guilty of a misdemeanor, punishable by a fine of not less than \$ _____ nor more than \$ _____ or by imprisonment for not less than _____ days nor more than _____ days or by both such fine and imprisonment. The imposition of one penalty for any violation shall not excuse the violation or permit it to continue; and all such persons shall be required to correct or remedy such violations or defects within a reasonable time; and when not otherwise specified the application of the above penalty shall not be held to prevent the enforced removal of prohibited conditions. Each day that prohibited conditions are maintained shall constitute a separate offense.

SECTION 3 Additions, insertions, and changes — that the [year] edition of NFPA [document number], [complete document title] is amended and changed in the following respects:

List Amendments

SECTION 4 That ordinance No. _____ of [jurisdiction] entitled [fill in the title of the ordinance or ordinances in effect at the present time] and all other ordinances or parts of ordinances in conflict herewith are hereby repealed.

SECTION 5 That if any section, subsection, sentence, clause, or phrase of this ordinance is, for any reason, held to be invalid or unconstitutional, such decision shall not affect the validity or constitutionality of the remaining portions of this ordinance. The [governing body] hereby declares that it would have passed this ordinance, and each section, subsection, clause, or phrase hereof, irrespective of the fact that any one or more sections, subsections, sentences, clauses, and phrases be declared unconstitutional.

SECTION 6 That the [jurisdiction's keeper of records] is hereby ordered and directed to cause this ordinance to be published.

[NOTE: An additional provision may be required to direct the number of times the ordinance is to be published and to specify that it is to be in a newspaper in general circulation. Posting may also be required.]

SECTION 7 That this ordinance and the rules, regulations, provisions, requirements, orders, and matters established and adopted hereby shall take effect and be in full force and effect [time period] from and after the date of its final passage and adoption.

Annex L Informational References

L.1 Referenced Publications. The documents or portions thereof listed in this annex are referenced within the informational sections of this code and are not part of the requirements of this document unless also listed in Chapter 2 for other reasons.

▲ L.1.1 NFPA Publications. National Fire Protection Association, 1 Batterymarch Park, Quincy, MA 02169-7471.

NFPA 1, *Fire Code*, 2018 edition.

NFPA 2, *Hydrogen Technologies Code*, 2016 edition.

NFPA 13, *Standard for the Installation of Sprinkler Systems*, 2019 edition.

NFPA 30, *Flammable and Combustible Liquids Code*, 2018 edition.

NFPA 45, *Standard on Fire Protection for Laboratories Using Chemicals*, 2015 edition.

NFPA 52, *Vehicular Natural Gas Fuel Systems Code*, 2016 edition.

NFPA 54, *National Fuel Gas Code*, 2018 edition.

NFPA 55, *Compressed Gases and Cryogenic Fluids Code*, 2016 edition.

NFPA 58, *Liquefied Petroleum Gas Code*, 2017 edition.

NFPA 59, *Utility LP-Gas Plant Code*, 2018 edition.

NFPA 68, *Standard on Explosion Protection by Deflagration Venting*, 2018 edition.

NFPA 69, *Standard on Explosion Prevention Systems*, 2014 edition.

NFPA 99, *Health Care Facilities Code*, 2018 edition.

NFPA 101[®], *Life Safety Code*[®], 2018 edition.

NFPA 220, *Standard on Types of Building Construction*, 2018 edition.

NFPA 259, *Standard Test Method for Potential Heat of Building Materials*, 2018 edition.

NFPA 472, *Standard for Competence of Responders to Hazardous Materials/Weapons of Mass Destruction Incidents*, 2018 edition.

NFPA 495, *Explosive Materials Code*, 2018 edition.

NFPA 505, *Fire Safety Standard for Powered Industrial Trucks Including Type Designations, Areas of Use, Conversions, Maintenance, and Operations*, 2018 edition.

NFPA 601, *Standard for Security Services in Fire Loss Prevention*, 2015 edition.

NFPA 652, *Standard on the Fundamentals of Combustible Dust*, 2019 edition.

NFPA 704, *Standard System for the Identification of the Hazards of Materials for Emergency Response*, 2017 edition.

NFPA 730, *Guide for Premises Security*, 2018 edition.

NFPA 731, *Standard for the Installation of Electronic Premises Security Systems*, 2017 edition.

NFPA 1620, *Standard for Pre-Incident Planning*, 2015 edition.

NFPA 2001, *Standard on Clean Agent Fire Extinguishing Systems*, 2018 edition.

NFPA 5000[®], *Building Construction and Safety Code*[®], 2018 edition.

NFPA Fire Protection Guide to Hazardous Materials, 2002 edition.

SFPE Engineering Guide to Performance-Based Fire Protection, 2007.

SFPE Handbook of Fire Protection Engineering, 2016.

L.1.2 Other Publications.

■ L.1.2.1 ACC Publications. American Chemistry Council, 1300 Wilson Boulevard, Arlington, VA 22209.

“Responsible Care[®] Process Safety Code of Management Practices.”

“Responsible Care[®] Security Code of Management Practices.”

L.1.2.2 AIChE Publications. American Institute of Chemical Engineers, Center for Chemical Process Safety, 120 Wall Street, FL 23, New York, NY 10005-4020.

Guidelines for Analyzing and Managing the Security Vulnerabilities of Fixed Chemical Sites, 2010.

Guidelines of Chemical Reactivity Evaluation and Application to Process Design, 1995.

Guidelines for Mechanical Integrity Systems, 2006.

Guidelines for Safe and Reliable Instrumented Protective Systems, 2007.

Guidelines for Safe Process Operation and Maintenance, 1995.

Guidelines for Technical Management of Chemical Process Safety, 1993.

Guidelines for Writing Effective Operating and Maintenance Procedures, 1996.

L.1.2.3 ANSI Publications. American National Standards Institute, Inc., 25 West 43rd Street, 4th Floor, New York, NY 10036.

ANSI Z400.1/Z129.1, *Hazardous Workplace Chemicals — Hazard Evaluation and Safety Data Sheet and Precautionary Labeling Preparation*, 2010.

N L.1.2.4 APA Publications. American Pyrotechnics Association, 7910 Woodmont Avenue, Suite 1220, Bethesda, MD 20814.

APA 87-1, *Standard for Construction and Approval for Transportation of Fireworks, Novelties and Theatrical Pyrotechnics*, 2001.

Δ L.1.2.5 API Publications. American Petroleum Institute, 1220 L Street, NW, Washington, DC 20005-4070.

API RP 70, *Security for Offshore Oil and Natural Gas Operations*, 2005.

Security Guidance for the Petroleum and Petrochemical Industries, April 2005.

Security Vulnerability Assessment Methodology for the Petroleum and Petrochemical Industries, October 2004.

Δ L.1.2.6 ASME Publications. American Society of Mechanical Engineers, Two Park Avenue, New York, NY 10016-5990.

Boiler and Pressure Vessel Code, 2017.

L.1.2.7 ASTM Publications. ASTM International, 100 Barr Harbor Drive, P.O. Box C700, West Conshohocken, PA 19428-2959.

ASTM D4359, *Standard Test Method for Determining Whether a Material Is a Liquid or a Solid*, 1990, reapproved 2012.

ASTM E136, *Standard Test Method for Behavior of Materials in a Vertical Tube Furnace at 750°C*, 2016a.

ASTM E176, *Standard Terminology of Fire Standards*, 2015ae1.

ASTM E681, *Standard Test Method for Concentration Limits of Flammability of Chemicals (Vapors and Gases)*, 2009, reapproved 2015.

ASTM E1226, *Standard Test Method for Explosibility of Dust Clouds*, 2012a.

ASTM E1472, *Standard Guide for Documenting Computer Software for Fire Models*, 2007 (withdrawn 2011).

ASTM E1515, *Standard Test Method for Minimum Explosible Concentration of Combustible Dusts*, 2014.

ASTM E2067, *Standard Practice for Full-Scale Oxygen Consumption Calorimetry Fire Tests*, 2012.

ASTM E2652, *Standard Test Method for Behavior of Materials in a Tube Furnace with a Cone-shaped Airflow Stabilizer, at 750°C*, 2016.

Δ L.1.2.8 CGA Publications. Compressed Gas Association, 14501 George Carter Way, Suite 103, Chantilly, VA 20151.

CGA G-5.5, *Hydrogen Vent Systems*, 2014.

CGA P-18, *Standard for Bulk Inert Gas Systems*, 2013.

CGA P-50, *Site Security Standard*, 2014.

CGA P-51, *Transportation Security Standard for the Compressed Gas Industry*, 2014.

CGA P-52, *Security Guidelines for Qualifying Customers Purchasing Compressed Gases*, 2014.

Handbook of Compressed Gases, 2013.

N L.1.2.9 FPRF Publications. Fire Protection Research Foundation, 1 Batterymarch Park, Quincy, MA 02169-7471.

Buc, Elizabeth, *Oxidizer Classification Research Project: Tests and Criteria, Final Report*, Fire and Materials Research Laboratory, November 2, 2009.

Development of an Enhanced Hazard Classification System for Oxidizers, 2006.

National Oxidizing Pool Chemicals Storage Fire Test Project, 1998.

N L.1.2.10 IME Publications. Institute of Makers of Explosives, 1212 New York Avenue, NW, Suite 650, Washington, DC 20005.

IME SLP 2, “American Table of Distances (ATD),” June 1991 (incorporates changes through April 2017).

IME SLP 27, “Security in Manufacturing, Transportation, Storage and Use of Commercial Explosives,” April 2012.

L.1.2.11 ISO Publications. International Organization for Standardization, ISO Central Secretariat, BIBC II, Chemin de Blandonnet 8, CP 401, 1214 Vernier, Geneva, Switzerland.

ISO 6184-1, *Explosion Protection Systems — Part 1: Determination of Explosion Indices of Combustible Dusts in Air*, 1985.

L.1.2.12 OSHA Publications. Occupational Safety and Health Administration, 200 Constitution Avenue, NW, Washington, DC 20210.

Hazard Communication Standard, 2012.

N L.1.2.13 SwRI Publications. Southwest Research Institute, 6220 Culebra Road, San Antonio, TX 78238-5166.

Huczek, Jason P. SwRI Project No. 01.13538.01.303, *Medium-Scale Burn Testing: Determination of Total (Oxygen Consumption and Carbon Dioxide Generation) and Convective (Temperature Rise) Heat Release Rates of Various Chemical Oxidizers, Final Report*, January 7, 2009.

Trevino, Javier O., A. F. Grand, M. L. Janssens. “Simplified Calibration Procedure for Large Scale Oxygen Consumption Calorimeters.”

L.1.2.14 UL Publications. Underwriters Laboratories Inc., 333 Pfingsten Road, Northbrook, IL 60062-2096.

ANSI/UL 30, *Standard for Metal Safety Cans*, 1995, revised 2014.

ANSI/UL 558, *Standard for Safety Industrial Trucks, Internal Combustion Engine-Powered*, 2012, revised 2015.

ANSI/UL 583, *Standard for Safety Electric-Battery-Powered Industrial Trucks*, 2012, revised 2016.

ANSI/UL 1313, *Standard for Non-Metallic Safety Cans for Petroleum Products*, 2015.

L.1.2.15 UN Publications. United Nations Publications, Sales and Marketing Section, Room DC2-853, Dept. I004, New York, NY 10017.

Manual of Tests and Criteria, 5th edition, 2010.

ST/SG/AC.10/30/Rev.4, *Globally Harmonized System of Classification and Labelling of Chemicals (GHS)*, 4th edition, 2011.

ST/SG/AC.10/40/Add.2, *Report of the Committee of Experts on the Transport of Dangerous Goods and on the Globally Harmonized System of Classification and Labelling of Chemicals on its Sixth Session*, December 14, 2012, Geneva, Switzerland. Addendum, Annex II, Amendments to the Fifth Revised Edition of the Recommendations on the Transport of Dangerous Goods, Manual of Tests and Criteria (ST/SG/AC.10/11/Rev.5).

Recommendations on the Transport of Dangerous Goods, Model Regulations, 19th revised edition, 2015.

L.1.2.16 U.S. Bureau of Mines Publications. U.S. Bureau of Mines, Pittsburgh Mining and Safety Research Center, 4800 Forbes Avenue, Pittsburgh, PA 15213.

Report of Investigations 4994, *Investigations of the Explosibility of Ammonium Nitrate*, 1953.

Report of Investigations 6746, *Sympathetic Detonation of Ammonium Nitrate and Ammonium Nitrate Fuel Oil*, 1966.

Report of Investigations 6773, *Explosion Hazards of Ammonium Nitrate Under Fire Exposure*, 1966.

Report of Investigations 6903, *Further Studies on Sympathetic Detonation*, 1966.

L.1.2.17 U.S. Government Publications. U.S. Government Publishing Office, 732 North Capitol Street, NW, Washington, DC 20401-0001.

Clean Air Act (CAA), 1970.

Emergency Response Guidebook, U.S. Department of Transportation, 2008.

EPA 550-F-15-001, *Chemical Advisory: Safe Storage, Handling, and Management of Solid Ammonium Nitrate Prills*, U.S. Environmental Protection Agency, Occupational Safety and Health Administration, and Bureau of Alcohol, Tobacco, Firearms, and Explosives, 2015.

Guide to Developing an Effective Security Plan for the Highway Transportation of Hazardous Materials, Federal Motor Carrier Safety Administration (FMCSA), U.S. Department of Transportation, www.fmcsa.dot.gov.

High Production Volume (HPV) Challenge Program List, U.S. Environmental Protection Agency.

NSS 1740.16, *Safety for Hydrogen and Hydrogen Systems*, 1997, cancelled 2005.

Resource Conservation and Recovery Act (RCRA), 1976.

Title 16, Code of Federal Regulations, Part 1500, “Hazardous Substances and Articles: Administration and Enforcement Regulations.”

Title 16, Code of Federal Regulations, Part 1500.41, “Method for Testing Primary Irritant Substances.”

Title 16, Code of Federal Regulations, Part 1500.42, “Test for Eye Irritants.”

Title 16, Code of Federal Regulations, Part 1507, “Fireworks Devices.”

Title 18, United States Code, Part 40, “Importation, Manufacture, Distribution and Storage of Explosive Materials.”

Title 29, Code of Federal Regulations, Part 1910.38, “Emergency Action Plans.”

Title 29, Code of Federal Regulations, Part 1910.119, “Process Safety Management of Highly Hazardous Chemicals.”

Title 29, Code of Federal Regulations, Part 1910.120, “Hazardous Waste Operations and Emergency Response.”

Title 29, Code of Federal Regulations, Part 1910.165, “Employee Alarm Systems.”

Title 29, Code of Federal Regulations, Part 1910.1000, “Air Contaminants.”

Title 29, Code of Federal Regulations, Part 1910.1200, “Hazard Communication.”

Title 40, Code of Federal Regulations, Part 68, “Chemical Accident Prevention Provisions.”

Title 40, Code of Federal Regulations, Parts 260–299, “Solid Wastes.”

Title 40, Code of Federal Regulations, Part 355, “Emergency Planning and Notification.”

Title 40, Code of Federal Regulations, Part 370.66, “How Are Key Words in this Part Defined?”

Title 49, Code of Federal Regulations, Parts 100–199, “Pipeline and Hazardous Materials Safety Administration, Department of Transportation.”

Title 49, Code of Federal Regulations, Part 171–180, “Hazardous Materials Regulations.”

Title 49, Code of Federal Regulations, Part 171.8, “Definitions and Abbreviations.”

Title 49, Code of Federal Regulations, Part 172, “Hazardous Materials Table, Special Provisions, Hazardous Materials Communications, Emergency Response Information, Training Requirements, and Security Plans.”

Title 49, Code of Federal Regulations, Part 172.101, “Purpose and Use of Hazardous Materials Table.”

Title 49, Code of Federal Regulations, Part 173, “Shippers — General Requirements for Shipments and Packagings.”

Title 49, Code of Federal Regulations, Part 173.56, “New Explosives — Definition and Procedures for Classification and Approval.”

Title 49, Code of Federal Regulations, Parts 173.57, “Acceptance Criteria for New Explosives.”

Title 49, Code of Federal Regulations, Parts 173.58, “Assignment of Class and Division for New Explosives.”

Title 49, Code of Federal Regulations, Part 173.137, “Class 8 — Assignment of Packing Group.”

Title 49, Code of Federal Regulations, Part 173.225, “Packaging Requirements and Other Provisions for Organic Peroxides.”

TM-5 1300 (NAVFAC P-397, AFM 88-22), “Structures to Resist the Effects of Accidental Explosions,” November 1990.

Transportation of Dangerous Goods Regulations, U.S. Department of Transportation.

▲ L.1.2.18 Other Publications. *ADR: European Agreement Concerning the International Carriage of Dangerous Goods by Road*, Economic Commission for Europe Inland Transport Committee, United Nations, New York and Geneva, 2016.

Bretherick's Handbook of Reactive Chemical Hazards, Elsevier Science and Technology Books, 7th ed., 2007.

CI Pamphlet 155, *The Security Management Plan for the Transportation and On-site Storage and Use of Chlorine Cylinders, Ton Containers and Cargo Tanks*, 2008, The Chlorine Institute, 1300 Wilson Boulevard, Arlington, VA 22209, www.chlorineinstitute.org.

Comprehensive Guide to Hazardous Properties of Chemical Substances, 3rd edition, Wiley Interscience, Hoboken, NJ, 2007.

Design and Safety Handbook, 4th ed., Scott Specialty Gases, Pennsylvania, 2006.

“Guidance for the Storage, Handling and Transportation of Solid Mineral Fertilisers,” European Fertilizers Manufacturers’ Association, 2007. www.fertilizerseurope.com.

International Fire Code, 2012.

Safety and Security Guidelines for the Storage and Transportation of Fertilizer Grade Ammonium Nitrate at Fertilizer Retail Facilities, February 2014, Agricultural Retailers Association (ARA), The Fertilizer Institute, Washington, D.C.

HSE INDG230, “Storing and Handling Ammonium Nitrate,” Health and Safety Executive, 1996. <http://www.hse.gov.uk/explosives/ammonium>.

North America Emergency Response Guide (NAERG), U.S. Department of Transportation, Transport Canada, and Secretariat of Communications and Transportation of Mexico (SCT), 2008.

Nitric Acid and Fertilizer Nitrates, Marcel Dekker, Inc., 1985.

Organization for Economic Co-operation and Development (OECD) Integrated HPV Database, OECD, Paris, France.

Organic Peroxide Safety Division Society of the Plastics Industry, www.OPPSD.org.

Oxley, J., J. Smith, E. Rogers, and M. Yu. “Ammonium nitrate: thermal stability and explosivity modifiers.” *Thermochimica Acta* 384 (2002): 23–45.

NACD Responsible Distribution, “Code of Management Practice,” National Association of Chemical Distributors, 1560 Wilson Boulevard, Arlington, VA 22209, www.nacd.com.

“Safety and Security Guidelines for Ammonium Nitrate,” December 2013, International Fire Chiefs Association (IFCA), Institute of Makers of Explosives (IME), National Stone, Sand & Gravel Association (NSSGA), and International Society of Explosives Engineers (ISEE), 1120 19th Street, NW, Suite 310, Washington, DC 20036.

“Summary Report: Workshop on Ammonium Nitrate,” 30 January–1 February 2002, Major Accident Hazard Bureau, European Commission’s Joint Research Center, Ispra, Italy, p. 5.

The Fertilizer Manual, 1998, Kluwer Academic Publishers, The United Nations Industrial Development Organization and the International Fertilizer Development Center.

VDI 3673, *Pressure Venting of Dust Explosions*, 2012.

L.2 Informational References. The following documents or portions thereof are listed here as informational resources only. They are not a part of the requirements of this document.

L.2.1 NFPA Publications. National Fire Protection Association, 1 Batterymarch Park, Quincy, MA 02169-7471.

NFPA 10, *Standard for Portable Fire Extinguishers*, 2018 edition.

NFPA 14, *Standard for the Installation of Standpipe and Hose Systems*, 2016 edition.

NFPA 24, *Standard for the Installation of Private Fire Service Mains and Their Appurtenances*, 2019 edition.

NFPA 25, *Standard for the Inspection, Testing, and Maintenance of Water-Based Fire Protection Systems*, 2017 edition.

NFPA 51, *Standard for the Design and Installation of Oxygen–Fuel Gas Systems for Welding, Cutting, and Allied Processes*, 2018 edition.

NFPA 53, *Recommended Practice on Materials, Equipment, and Systems Used in Oxygen-Enriched Atmospheres*, 2016 edition.

NFPA 59A, *Standard for the Production, Storage, and Handling of Liquefied Natural Gas (LNG)*, 2016 edition.

NFPA 70[®], *National Electrical Code*[®], 2017 edition.

NFPA 77, *Recommended Practice on Static Electricity*, 2019 edition.

NFPA 86, *Standard for Ovens and Furnaces*, 2019 edition.

NFPA 221, *Standard for High Challenge Fire Walls, Fire Walls, and Fire Barrier Walls*, 2018 edition.

NFPA 251, *Standard Methods of Tests of Fire Resistance of Building Construction and Materials*, 2006 edition (withdrawn).

NFPA 496, *Standard for Purged and Pressurized Enclosures for Electrical Equipment*, 2017 edition.

NFPA 560, *Standard for the Storage, Handling, and Use of Ethylene Oxide for Sterilization and Fumigation*, 2007 edition (withdrawn).

NFPA 654, *Standard for the Prevention of Fire and Dust Explosions from the Manufacturing, Processing, and Handling of Combustible Particulate Solids*, 2017 edition.

▲ L.2.2 Other Publications. OPPSD/SPI. *Organic Peroxide Producers Safety Division*, The Society of the Plastics Industry,

Inc., 1667 K Street, NW, Suite 1000, Washington, DC 20006-1620, www.OPPSD.org.

The Transition of the Hazardous Materials Codes and the Emergence of the Threshold Quantity System to NFPA 1 UFC, 2008, Fire Protection Research Foundation, Quincy, MA.

Transportation of Dangerous Goods Regulations, Transport Canada, 330 Sparks Street, Ottawa, ON K1A 0N5, Canada.

L.3 References for Extracts in Informational Sections.

NFPA 30, *Flammable and Combustible Liquids Code*, 2018 edition.

NFPA 55, *Compressed Gases and Cryogenic Fluids Code*, 2016 edition.

NFPA 101[®], *Life Safety Code*[®], 2018 edition.

NFPA 652, *Standard on the Fundamentals of Combustible Dust*, 2019 edition.

NFPA 704, *Standard System for the Identification of the Hazards of Materials for Emergency Response*, 2017 edition.

NFPA 5000[®], *Building Construction and Safety Code*[®], 2018 edition.

Index

Copyright © 2018 National Fire Protection Association. All Rights Reserved.

The copyright in this index is separate and distinct from the copyright in the document that it indexes. The licensing provisions set forth for the document are not applicable to this index. This index may not be reproduced in whole or in part by any means without the express written permission of NFPA.

-A-

- Absolute Pressure [Gas]**
 - Definition, 3.3.1, A.3.3.1
 - Access Aisle**
 - Definition, 3.3.2, A.3.3.2
 - Administration, Chap. 1**
 - Application, 1.3
 - Buildings, 1.3.4
 - Conflicts, 1.3.1
 - Multiple Occupancies, 1.3.2
 - Severability, 1.3.5
 - Vehicles and Marine Vessels, 1.3.3
 - Emergency Planning, 1.10
 - Activation, 1.10.2
 - Emergency Action Plan, 1.10.1
 - Enforcement, 1.7
 - Equivalency, 1.5
 - Alternatives, 1.5.3
 - Approval, 1.5.8
 - Modifications, 1.5.4
 - Tests, 1.5.9
 - Facility Closure, 1.9
 - Closure Plan, 1.9.4
 - Facilities Out of Service, 1.9.3
 - Facilities Permanently Out of Service, 1.9.3.2
 - Facilities Temporarily Out of Service, 1.9.3.1
 - Hazardous Materials Inventory Statement (HMIS), 1.12, A.1.12
 - Hazardous Materials Management Plan (HMMP), 1.11
 - Permits, 1.8, A.1.8
 - Plans and Specifications, 1.8.1
 - Stop Work or Evacuation, 1.8.2
 - Plan Review, 1.13
 - Purpose, 1.2, A.1.2
 - Retroactivity, 1.4
 - Scope, 1.1
 - Applicability, 1.1.1, A.1.1.1
 - Multiple Hazards, 1.1.1.2
 - Occupancies, 1.1.1.1
 - Exemptions, 1.1.2
 - Technical Assistance, 1.14
 - Units and Formulas, 1.6
 - Aisle**
 - Definition, 3.3.3, A.3.3.3
 - Ammonium Nitrate Solids and Liquids, Chap. 11**
 - General, 11.1
 - Construction Requirements, 11.1.4
 - General Requirements for Storage, 11.1.3
 - Retroactivity, 11.1.5, A.11.1.5
 - Scope, 11.1.1, A.11.1.1
 - Sources of Ignition, 11.1.2
 - General Requirements for Storage, 11.2
 - Alarms, 11.2.14
 - Drainage and Secondary Containment, 11.2.2
 - Emergency and Standby Power, 11.2.12
 - Emergency Planning, 11.2.17, A.11.2.17
 - Emergency Action Plans, 11.2.17.1
 - Explosion Control, 11.2.11, A.11.2.11
 - Extinguishing Devices, 11.2.9
 - Fire Detection Systems, 11.2.6
 - Audible and Visual Alarm, 11.2.6.2
 - Supervision, 11.2.6.1
 - Fire Protection Systems, 11.2.5, A.11.2.5
 - Fire Protection Water Supplies, 11.2.10
 - Limit Controls, 11.2.13
 - Monitoring/Supervision, 11.2.15
 - Monitoring/Supervision, 11.2.8
 - Public Notification/Siren System, 11.2.7
 - Signage, 11.2.18, A.11.2.18
 - Special Requirements, 11.2.16
 - Lightning, 11.2.16.3
 - Prohibited Articles, 11.2.16.2
 - Security (Control of Access), 11.2.16.4
 - Separation, 11.2.16.1
 - Spill Control, 11.2.1, A.11.2.1
 - Treatment Systems, 11.2.4
 - Ventilation, 11.2.3, A.11.2.3
 - General Requirements for Use, 11.5
 - Alarms, 11.5.9
 - Drainage, 11.5.2
 - Emergency and Standby Power, 11.5.7
 - Explosion Control, 11.5.6
 - Fire Protection Systems, 11.5.5
 - Limit Controls, 11.5.8
 - Liquid Transfer, 11.5.12
 - Monitoring/Supervision, 11.5.10
 - Secondary Containment, 11.5.3
 - Spill Control, 11.5.1
 - System Design, 11.5.11
 - Ventilation, 11.5.4
- Handling, 11.8**
 - Handling, 11.8.1
 - Handling Equipment, 11.8.1.2, A.11.8.1.2
 - Vehicles and Lift Trucks, 11.8.1.1
- Indoor Storage, 11.3**
 - Detached Storage, 11.3.3
 - Housekeeping, 11.3.1
 - Storage Conditions/Arrangement, 11.3.2
 - Containers, 11.3.2.1
 - Piles and Compartments for Bulk Solid Storage, 11.3.2.3
 - Piles of Bags, Drums, or Other Containers, 11.3.2.2

- Indoor Use, 11.6
 - Open Systems, 11.6.1
 - Explosion Control, 11.6.1.2
 - Spill Control, Drainage, and Containment, 11.6.1.3
 - Ventilation, 11.6.1.1
- Outdoor Storage, 11.4
 - Clearance from Combustibles, 11.4.1
 - Outdoor Storage in Enclosed Hoppers or Bins, 11.4.3
 - Special Requirements — Outdoor Storage, 11.4.5, A.11.4.5
 - Storage in Railcars, 11.4.4
 - Weather Protection, 11.4.2
- Outdoor Use, 11.7
 - Open Systems, 11.7.1
 - Clearance from Combustibles, 11.7.1.3
 - Location, 11.7.1.1
 - Spill Control, Drainage, and Containment, 11.7.1.2

Analysis

- Definition, 3.4.1
- Sensitivity Analysis
 - Definition, 3.4.1.1
- Uncertainty Analysis
 - Definition, 3.4.1.2

Approved

- Definition, 3.2.1, A.3.2.1

Area

- Control Area
 - Definition, 3.3.4.1
- Definition, 3.3.4
- Indoor Area [Gas]
 - Definition, 3.3.4.2
- Organic Peroxide Storage Area
 - Definition, 3.3.4.3
- Outdoor Area [Gas]
 - Definition, 3.3.4.4
- Outdoor Control Area
 - Definition, 3.3.4.5

ASME

- Definition, 3.3.5

ASTM [Gas]

- Definition, 3.3.6

Authority Having Jurisdiction (AHJ)

- Definition, 3.2.2, A.3.2.2

-B-**Basement**

- Definition, 3.3.7

Building

- Definition, 3.3.8

Building Code

- Definition, 3.3.9

Bulk Ammonium Nitrate

- Definition, 3.3.10

Bulk Hydrogen Compressed Gas System

- Definition, 3.3.11, A.3.3.11

Bulk Inert Gas System

- Definition, 3.3.12, A.3.3.12

Bulk Liquefied Hydrogen System [Gas]

- Definition, 3.3.13, A.3.3.13

Bulk Oxygen System

- Definition, 3.3.14, A.3.3.14

-C-**CFR**

- Definition, 3.3.15

CGA [Gas]

- Definition, 3.3.16

Chemical Data, Annex B

- Chemical Family — A Pointer to Hazard Classification, B.3
- Additional Source Material, B.3.3
- Chemical Families Related to Hazard Category, B.3.2
 - Multiple Hazard Materials, B.3.2.2
 - Illustration of Table B.3.2, B.3.2.2.1
- Table Descriptions, B.3.2.1
- General, B.3.1
- Description of Chemical Families, B.4
- General, B.4.1
 - Acids, B.4.1.1
 - Acids (Carboxylic) (R-COOH, Ar-COOH), B.4.1.1.1
 - Acids (Gaseous), B.4.1.1.4
 - Acids (Mineral), B.4.1.1.3
 - Acids (Oxidizing), B.4.1.1.5
 - Acids (Peroxy) (R-OOH, Ar-OOH), B.4.1.1.2
 - Alcohols, B.4.1.2
 - Aliphatic Alcohols (R-OH), B.4.1.2.1
 - Aromatic Alcohols (Ar-OH), B.4.1.2.2
 - Alkyl Halides (R-X), B.4.1.3
 - Amines, B.4.1.4
 - Amines (Aliphatic) (R-NH₂, R₂NH, R₃N), B.4.1.4.1
 - Amines (Aromatic) (Ar-NH₂, Ar(N)), B.4.1.4.2
 - Bases, B.4.1.5
 - Alkalis, B.4.1.5.1
 - Gaseous, B.4.1.5.2
 - Carbides/Nitrides, B.4.1.6
 - Carbonyl Compounds, B.4.1.7
 - Carbonyl Compounds (Acid Anhydrides) (R₁-C(O)OC(O)-R₂), B.4.1.7.1
 - Carbonyl Compounds (Acyl Halides) (R, Ar-C(O)X; R, Ar-SO₂-X), B.4.1.7.2
 - Carbonyl Compounds (Aldehydes) (R-CH=O, Ar-CH=O), B.4.1.7.3
 - Carbonyl Compounds (Esters) (R₁O(C=O)R₂), B.4.1.7.4
 - Carbonyl Compounds (Halides) (C(O)X₂, C(S)X₂), B.4.1.7.5
 - Carbonyl Compounds (Ketones) (R₁R₂C=O), B.4.1.7.6
 - Cyanides, B.4.1.8
 - Cyanides (Gaseous), B.4.1.8.1
 - Cyanides (Inorganic) (M-CN), B.4.1.8.2
 - Nitriles (Organic), B.4.1.8.3
 - Epoxides, B.4.1.9
 - Ethers/Glycols (R-O-R), B.4.1.10
 - Gases, B.4.1.11
 - Gases (Flammable), B.4.1.11.1

- Gases (Halogens) (X-X), B.4.1.11.2
- Gases (Nonflammable), B.4.1.11.3
- Gases (Oxidizing), B.4.1.11.4
- Gases (Pyrophoric), B.4.1.11.5
- Gases (Sulfur Gases) (R-SH), B.4.1.11.6
- Hydrocarbons, B.4.1.12
 - Hydrocarbons (Aliphatic) (R), B.4.1.12.1
 - Hydrocarbons (Alkenes) (R1CH=CHR2), B.4.1.12.2
 - Hydrocarbons (Alkynes) (R1C CR2, R-C CH), B.4.1.12.3
 - Hydrocarbons (Aromatic) (Ar), B.4.1.12.4
- Isocyanates (R-N=C=O, Ar-N=C=O), B.4.1.13
- Metals, B.4.1.14
 - Metal Alkyls (M-R), B.4.1.14.1
 - Metal Halides (M-X), B.4.1.14.2
 - Metal Hydrides (Gaseous), B.4.1.14.4
 - Metal Hydrides (Solids), B.4.1.14.3
 - Metals (Alkali), B.4.1.14.5
 - Metals (Powdered), B.4.1.14.6
- Nitrated Organic Compounds, B.4.1.15
 - Azides (R, Ar-N3), B.4.1.15.4
 - Azo (Aliphatic) (R-N=N-R), B.4.1.15.2
 - Azo (Aromatic) (Ar-N=N-Ar), B.4.1.15.3
 - Nitrates (Inorganic) (M-NO3), B.4.1.15.6
 - Nitrites (Inorganic) (M-NO2), B.4.1.15.5
 - Organic Nitro Compounds (R, Ar-NO2), B.4.1.15.1
- Nitrogen-Halogen Compounds (R-N-X), B.4.1.16
- Oxyanion (M-ClO2, M-ClO3, M-ClO4, M-OCl), B.4.1.17
- Peroxides, B.4.1.18
 - Metal Peroxides (Inorganic) (M-O-O), B.4.1.18.2
 - Peroxides (Organic) (R-O-O-R), B.4.1.18.1
- Phosphorus-Halogen Compounds (O=P-X3, P-X), B.4.1.19
- General, B.1
- Hazard Category Based on Concentration, B.5
 - General, B.5.1
- Hazard Recognition, B.2
- Safety Data Sheets (SDSs) — A Starting Point for Hazards Identification, B.6
 - General, B.6.1
 - SDS Format, B.6.2
 - Composition/Information on Ingredients, B.6.2.3
 - Hazards Identification, B.6.2.2
 - Identification, B.6.2.1
 - Physical and Chemical Properties, B.6.2.4
 - Stability and Reactivity, B.6.2.5
 - Toxicological Information, B.6.2.6
 - Transportation, B.6.2.7
- Classification of Materials, Wastes, and Hazard of Contents**, Chap. 4
 - Classification of High-Hazard Contents, 4.2
 - General, 4.2.1
 - Classification of Waste, 4.5, A.4.5
 - Combustibility of Materials, 4.6
 - Limited-Combustible Material, 4.6.2, A.4.6.2
 - Noncombustible Material, 4.6.1, A.4.6.1
 - Hazardous Material Classification, 4.1, A.4.1
 - Mixtures, 4.3
 - Multiple Hazards, 4.4, A.4.4
- Code**
 - Definition, 3.2.3, A.3.2.3
- Combustible**
 - Definition, 3.3.17
- Combustible Dust**
 - Definition, 3.3.18, A.3.3.18
- Combustible Liquid**
 - Definition, 3.3.19
- Compressed Gas System**
 - Definition, 3.3.20, A.3.3.20
- Compressed Gases and Cryogenic Fluids**, Annex H
 - Attended Operations, H.1
 - Introduction, H.1.1
 - Parameters, H.1.2
 - Container, Cylinder, or Tank Pressure, H.1.2.1
 - Fluid Density, H.1.2.3
 - Line Length and Configuration, H.1.2.4
 - Liquid Head, H.1.2.2
 - Pipe Break Flow Area, H.1.2.5
 - Physical Properties of Hydrogen, H.2
 - Physical Properties, H.2.1
 - Physical Properties of Liquefied Hydrogen, H.2.2
- Container**
 - Aboveground Tank [Flammable and Combustible Liquid]
 - Definition, 3.3.21.10
 - Aerosol Container [Liquid]
 - Definition, 3.3.21.17
 - ASME Container
 - Definition, 3.3.21.1
 - Closed Container [Flammable and Combustible Liquid]
 - Definition, 3.3.21.3
 - Combustible Containers
 - Definition, 3.3.21.4
 - Compressed Gas Container (Gas)
 - Definition, 3.3.21.14
 - Container [Flammable and Combustible Liquid]
 - Definition, 3.3.21.2, A.3.3.21.2
 - Cylinder [Gas]
 - Definition, 3.3.21.13
 - Cylinder Containment Vessel [Gas]
 - Definition, 3.3.21.8
 - Definition, 3.3.21
 - ISO Module
 - Definition, 3.3.21.15, A.3.3.21.15
 - Noncombustible Containers
 - Definition, 3.3.21.5
 - Nonmetallic Container [Solid, Flammable and Combustible Liquid]
 - Definition, 3.3.21.6, A.3.3.21.6
 - Overpack Container
 - Definition, 3.3.21.7
 - Portable Tank [Flammable and Combustible Liquid]
 - Definition, 3.3.21.11, A.3.3.21.11
 - Pressure Vessel
 - Definition, 3.3.21.12, A.3.3.21.12

Safety Can [Liquid]
 Definition, 3.3.21.16, A.3.3.21.16

Storage Tank [Flammable and Combustible Liquid]
 Definition, 3.3.21.9

Continuous Gas Detection System [Gas]
 Definition, 3.3.22

Corrosive Solids and Liquids, Chap. 12
 General, 12.1
 Construction Requirements, 12.1.1
 General Requirements for Storage, 12.2
 Drainage, 12.2.2
 Emergency and Standby Power, 12.2.7
 Explosion Control, 12.2.6
 Fire Protection Systems, 12.2.5
 Limit Controls, 12.2.8
 Monitoring/Supervision, 12.2.9
 Secondary Containment, 12.2.3
 Spill Control, 12.2.1
 Ventilation, 12.2.4
 General Requirements for Use, 12.5
 Clearance from Combustibles, 12.5.10
 Drainage, 12.5.2
 Emergency and Standby Power, 12.5.7
 Explosion Control, 12.5.6
 Fire Protection System, 12.5.5
 Floors, 12.5.11
 Limit Controls, 12.5.8
 Liquid Transfer, 12.5.13
 Monitoring/Supervision, 12.5.9
 Secondary Containment, 12.5.3
 Spill Control, 12.5.1
 System Design, 12.5.12
 Ventilation, 12.5.4
 Handling, 12.8
 Indoor Storage, 12.3
 Detached Storage, 12.3.2
 Floors, 12.3.1
 Indoor Use, 12.6
 Closed Systems, 12.6.2
 Explosion Control, 12.6.2.2
 Spill Control, Drainage, and Containment, 12.6.2.3
 Ventilation, 12.6.2.1
 Open Systems, 12.6.1
 Explosion Control, 12.6.1.2
 Spill Control, Drainage, and Containment, 12.6.1.3
 Ventilation, 12.6.1.1
 Outdoor Storage, 12.4
 Exposures, 12.4.1
 Clearance from Combustibles, 12.4.1.1
 Distance Reduction, 12.4.1.3
 Location, 12.4.1.2
 Weather Protection, 12.4.2
 Outdoor Use, 12.7
 Closed Systems, 12.7.2
 Clearance from Combustibles, 12.7.2.3
 Location, 12.7.2.1
 Spill Control, Drainage, and Containment, 12.7.2.2

Open Systems, 12.7.1
 Clearance from Combustibles, 12.7.1.3
 Location, 12.7.1.1
 Spill Control, Drainage, and Containment, 12.7.1.2

Court

Definition, 3.3.23
 Enclosed Court
 Definition, 3.3.23.1

Cryogenic Fluid [Gas]

Definition, 3.3.24
 Flammable Cryogenic Fluid
 Definition, 3.3.24.1
 Inert Cryogenic Fluid
 Definition, 3.3.24.2
 Oxidizing Cryogenic Fluid
 Definition, 3.3.24.3

Cylinder [Gas]

Definition, 3.3.25, A.3.3.25

Cylinder Containment System [Gas]

Definition, 3.3.26

Cylinder Containment Vessel [Gas]

Definition, 3.3.27

Cylinder Pack [Gas]

Definition, 3.3.28, A.3.3.28

-D-**Data Conversion**

Definition, 3.4.2

Definitions, Chap. 3**Deflagration**

Definition, 3.3.29

Design Fire Scenario

Definition, 3.4.3

Design Specification

Definition, 3.4.4

Design Team

Definition, 3.4.5

Detached Building

Definition, 3.3.30

Detonation

Definition, 3.3.31

Distributor [Gas]

Definition, 3.3.32

DOT

Definition, 3.3.33

-E-**Emergency Planning, Fire Risk Control, and Chemical Hazard Requirements for Industrial Processes, Chap. 7**

Document Retention, 7.6

General, 7.1, A.7.1

 Analysis of Upset Conditions, 7.1.2

 Applicability, 7.1.1

 Substantiating Documentation, 7.1.3

Incident Investigation Plan, 7.5

 Documentation, 7.5.2

 General, 7.5.1, A.7.5.1

- Operating and Maintenance Procedures, 7.3
 - Maintenance Procedures, 7.3.2
 - Contents, 7.3.2.2, A.7.3.2.2
 - General, 7.3.2.1
 - Operating Procedures, 7.3.1
 - Contents, 7.3.1.2, A.7.3.1.2
 - General, 7.3.1.1
 - Review, 7.3.1.3
 - Process Review and Plan Preparation, 7.2
 - Emergency Action Planning, 7.2.3
 - Plan Access, 7.2.3.3
 - Plan Review, 7.2.3.4
 - Plan Updating, 7.2.3.5
 - Provisions Within the Emergency Action Plan, 7.2.3.2
 - Written Emergency Action Plan, 7.2.3.1
 - Fire Risk Controls, 7.2.2
 - General, 7.2.1, A.7.2.1
 - Safety Reviews, 7.4, A.7.4
 - Emergency Response**
 - Definition, 3.3.34
 - Emergency Response Guideline**, Annex I
 - Competencies — Analyzing the Incident, I.6
 - Collecting and Interpreting Hazard and Response Information, I.6.2
 - Developing a Plan of Action, I.6.9
 - Developing Appropriate Decontamination Procedures, I.6.8
 - Estimating the Likely Size of an Endangered Area for Chlorine and Caustic, I.6.4
 - Identifying Response Objectives, I.6.5
 - Identifying the Potential Action Options, I.6.6
 - Predicting Likely Behavior of Materials and Their Containers When Multiple Materials Are Involved, I.6.3
 - Selecting Personal Protective Equipment, I.6.7
 - Surveying the Hazardous Materials Incident, I.6.1
 - Competencies — Evaluating Progress, I.8
 - Evaluating the Effectiveness of the Control Functions, I.8.1
 - Competencies — Implementing the Planned Response, I.7
 - Performing Control Functions Identified in Plan of Action, I.7.3
 - Performing Incident Management Duties, I.7.1
 - Using Protective Clothing and Respiratory Protection, I.7.2
 - Competencies — Terminating the Incident, I.9
 - Assisting in the Debriefing, I.9.1
 - Assisting in the Incident Critique, I.9.2
 - Providing Reports and Documentation, I.9.3
 - Emergency Response, I.1
 - Example Training Curriculum, I.5
 - Training Curriculum for Emergency Response, I.4
 - First Responder Awareness Level, I.4.1
 - First Responder Operations Level, I.4.2
 - Hazardous Materials (HAZMAT) Response Team, I.4.6
 - Hazardous Materials Specialist, I.4.4
 - Hazardous Materials Technician, I.4.3
 - On-Scene Incident Commander, I.4.5
 - What Is An Emergency Response According to OSHA?, I.2
 - What Is Not an Emergency Response?, I.3
 - Emergency Response Liaison**
 - Definition, 3.3.35
 - Emergency Shutoff Valve [Gas]**
 - Automatic Emergency Shutoff Valve [Gas]
 - Definition, 3.3.36.1
 - Definition, 3.3.36
 - Manual Emergency Shutoff Valve [Gas]
 - Definition, 3.3.36.2
 - Excess Flow Control [Gas]**
 - Definition, 3.3.37
 - Exhausted Enclosure [Gas]**
 - Definition, 3.3.38, A.3.3.38
 - Explanatory Material**, Annex A
 - Explosion Control [Gas]**
 - Definition, 3.3.39, A.3.3.39
 - Explosion Vent**
 - Definition, 3.3.40
 - Explosive**
 - Definition, 3.3.41, A.3.3.41
 - Explosive Decomposition**
 - Definition, 3.3.42, A.3.3.42
 - Explosive Reaction**
 - Definition, 3.3.43, A.3.3.43
 - Exposure Fire**
 - Definition, 3.4.6, A.3.4.6
- F-
- Fire Model**
 - Definition, 3.4.7, A.3.4.7
 - Fire Prevention Code**
 - Definition, 3.3.44
 - Fire Protection System**
 - Definition, 3.3.45
 - Fire Scenario**
 - Definition, 3.4.8, A.3.4.8
 - Design Fire Scenario
 - Definition, 3.4.8.1
 - Flammable Liquid (Class I)**
 - Definition, 3.3.46, A.3.3.46
 - Flammable Solid**
 - Definition, 3.3.47, A.3.3.47
 - Flammable Solids**, Chap. 13
 - General, 13.1
 - Construction Requirements, 13.1.1
 - General Requirements for Storage, 13.2
 - Drainage, 13.2.2
 - Emergency and Standby Power, 13.2.7
 - Explosion Control, 13.2.6
 - Fire Protection Systems, 13.2.5
 - Limit Controls, 13.2.8
 - Monitoring/Supervision, 13.2.9
 - Secondary Containment, 13.2.3
 - Spill Control, 13.2.1
 - Ventilation, 13.2.4
 - General Requirements for Use, 13.5
 - Clearance from Combustibles, 13.5.10
 - Drainage, 13.5.2
 - Emergency and Standby Power, 13.5.7
 - Explosion Control, 13.5.6

- Fire Protection System, 13.5.5
- Floors, 13.5.11
- Limit Controls, 13.5.8
- Monitoring/Supervision, 13.5.9
- Secondary Containment, 13.5.3
- Spill Control, 13.5.1
- System Design, 13.5.12
- Ventilation, 13.5.4
- Handling, 13.8
 - Handling, 13.8.1
- Indoor Storage, 13.3
 - Detached Storage, 13.3.2
 - Floors, 13.3.1
- Indoor Use, 13.6
 - Closed Systems, 13.6.2
 - Explosion Control, 13.6.2.2
 - Spill Control, Drainage, and Containment, 13.6.2.3
 - Ventilation, 13.6.2.1
 - Open Systems, 13.6.1
 - Explosion Control, 13.6.1.2
 - Spill Control, Drainage, and Containment, 13.6.1.3
 - Ventilation, 13.6.1.1
- Outdoor Storage, 13.4
 - Exposures, 13.4.1
 - Clearance from Combustibles, 13.4.1.1
 - Distance Reduction, 13.4.1.3
 - Location, 13.4.1.2
 - Special Requirements, 13.4.3
 - Aisles, 13.4.3.2
 - Pile Size Limit, 13.4.3.1
 - Weather Protection, 13.4.2
- Outdoor Use, 13.7
 - Closed Systems, 13.7.2
 - Clearance from Combustibles, 13.7.2.3
 - Location, 13.7.2.1
 - Spill Control, Drainage, and Containment, 13.7.2.2
 - Open Systems, 13.7.1
 - Clearance from Combustibles, 13.7.1.3
 - Location, 13.7.1.1
 - Spill Control, Drainage, and Containment, 13.7.1.2
- Fuel Load**
 - Definition, 3.4.9, A.3.4.9
- Fundamental Requirements, Chap. 6**
 - General Requirements, 6.1
 - Applicability, 6.1.1
 - Electrical Wiring and Equipment, 6.1.10
 - General, 6.1.10.1
 - Static Accumulation, 6.1.10.2
 - Empty Containers and Tanks, 6.1.7
 - General Storage, 6.1.13
 - Shelf Storage, 6.1.13.2
 - Shelf Construction, 6.1.13.2.1
 - Storage, 6.1.13.1
 - Hazardous Materials Storage Cabinets, 6.1.18
 - Ignition Source Controls, 6.1.5
 - Energy-Consuming Equipment, 6.1.5.3
 - Powered Industrial Trucks, 6.1.5.3.1, A.6.1.5.3.1
 - Open Flames and High-Temperature Devices, 6.1.5.2
 - Smoking, 6.1.5.1
 - Installation of Tanks, 6.1.19
 - Aboveground Tanks, 6.1.19.2
 - Marking, 6.1.19.2.3
 - Underground Tanks, 6.1.19.1
 - Maintenance Required, 6.1.16
 - Outdoor Storage and Use Areas, 6.1.15
 - Personnel Training, 6.1.4, A.6.1.4
 - Awareness, 6.1.4.1
 - Completion, 6.1.4.1.1
 - Emergency Plan, 6.1.4.1.3
 - Hazard Communications, 6.1.4.1.2
 - Documentation, 6.1.4.6
 - Emergency Responders, 6.1.4.4, A.6.1.4.4
 - Emergency Response Team Leader, 6.1.4.4.1, A.6.1.4.4.1
 - On-Site Emergency Response Team, 6.1.4.4.3, A.6.1.4.4.3
 - Response to Incipient Events, 6.1.4.4.2, A.6.1.4.4.2
 - Emergency Response Liaison, 6.1.4.3
 - Operations Personnel, 6.1.4.2
 - Actions in an Emergency, 6.1.4.2.5
 - Changes, 6.1.4.2.6
 - Dispensing, Using, and Processing, 6.1.4.2.2
 - Physical and Health Hazard Properties, 6.1.4.2.1
 - Storage, 6.1.4.2.3
 - Transport (Handling), 6.1.4.2.4
 - Training Mandated by Other Agencies, 6.1.4.5
 - Protection from Light, 6.1.11
 - Protection from Vehicles, 6.1.9
 - Release of Hazardous Materials, 6.1.3
 - Container Failure, 6.1.3.5
 - Control and Mitigation of Unauthorized Releases, 6.1.3.2
 - Notification of Unauthorized Releases, 6.1.3.4, A.6.1.3.4
 - Overpack Containers, 6.1.3.6
 - Prohibited Releases, 6.1.3.1
 - Records of Unauthorized Releases, 6.1.3.3
 - Responsibility for Cleanup of Unauthorized Releases, 6.1.3.7
 - Safety Data Sheets (SDS), 6.1.2, A.6.1.2
 - Seismic Protection, 6.1.14, A.6.1.14
 - Shock Padding, 6.1.14.1
 - Separation of Incompatible Materials, 6.1.12
 - Signs, 6.1.8
 - General, 6.1.8.1
 - Design and Construction, 6.1.8.1.1
 - Language, 6.1.8.1.2
 - Maintenance, 6.1.8.1.3
 - Hazardous Materials Identification, 6.1.8.2
 - Identification of Containers, Cartons, and Packages, 6.1.8.2.2
 - NFPA 704 Placard, 6.1.8.2.1
 - No Smoking Signs, 6.1.8.3
 - Systems, Equipment, and Processes, 6.1.6
 - Additional Regulations for Supply Piping for Health Hazard Materials, 6.1.6.3

- Design and Construction of Containers and Tanks, 6.1.6.1
- Equipment, Machinery, and Alarms, 6.1.6.4
- Piping, Tubing, Valves, and Fittings, 6.1.6.2
- Testing, 6.1.17
- Requirements for Occupancies Storing Quantities of Hazardous Materials Exceeding the Maximum Allowable Quantities per Control Area for High-Hazard Contents, 6.2
 - Indoor Storage General Requirements, 6.2.1
 - Building Height Exception, 6.2.1.2
 - Egress, 6.2.1.4
 - Capacity of Means of Egress, 6.2.1.4.2
 - Common Path of Travel Distance Limit, 6.2.1.4.4
 - Dead Ends, 6.2.1.4.5
 - Doors, 6.2.1.4.6
 - Number of Means of Egress, 6.2.1.4.3
 - Travel Distance Limit, 6.2.1.4.1
 - Explosion Control, 6.2.1.6, A.6.2.1.6
 - Fire Protection Systems, 6.2.1.1
 - Floors in Storage Rooms, 6.2.1.10
 - Limit Controls, 6.2.1.7
 - Pressure Control, 6.2.1.7.2
 - Temperature Control, 6.2.1.7.1
 - Separation of Occupancies Having High Hazards, 6.2.1.3
 - Spill Control and Secondary Containment for Hazardous Materials Liquids and Solids, 6.2.1.9
 - General, 6.2.1.9.1
 - Secondary Containment, 6.2.1.9.3
 - Spill Control, 6.2.1.9.2
 - Standby and Emergency Power, 6.2.1.8
 - Supervision of Alarm, Detection, and Automatic Fire-Extinguishing Systems, 6.2.1.11
 - Ventilation, 6.2.1.5
 - Outdoor Storage, 6.2.7
 - Clearance from Combustibles, 6.2.7.1
 - Secondary Containment, 6.2.7.3
 - Containment Pallets, 6.2.7.3.3
 - General, 6.2.7.3.1
 - Where Required, 6.2.7.3.2
 - Weather Protection, 6.2.7.2
 - Protection Level 1, 6.2.2
 - Detached Building Required, 6.2.2.2
 - Frangible Building, 6.2.2.4
 - General, 6.2.2.1
 - Minimum Distance to Property Lines or Horizontal Separation, 6.2.2.3
 - Protection Level 2, 6.2.3
 - Detached Building Required, 6.2.3.4
 - Exterior Wall Required, 6.2.3.2
 - General, 6.2.3.1
 - Minimum Distance to Property Lines or Horizontal Separation, 6.2.3.3
 - Water-Reactive Materials, 6.2.3.5
 - Protection Level 3, 6.2.4
 - Detached Building Required, 6.2.4.4
 - Detached Unprotected Building, 6.2.4.5
 - Exterior Wall Required, 6.2.4.2
 - General, 6.2.4.1
 - Minimum Distance to Property Lines or Horizontal Separation, 6.2.4.3
 - Roofs, 6.2.4.6
 - Water-Reactive Materials, 6.2.4.7
 - Protection Level 4, 6.2.5
 - Gas Rooms, 6.2.5.3
 - Highly Toxic Solids and Liquids, 6.2.5.2
 - Protection Level 5, 6.2.6
 - Requirements for Use, Dispensing, and Handling of Hazardous Materials in Amounts Exceeding Maximum Allowable Quantities, 6.3
 - General, 6.3.1, A.6.3.1
 - Lighting, 6.3.1.5
 - Limit Controls, 6.3.1.2
 - General, 6.3.1.2.1
 - Liquid Level, 6.3.1.2.4
 - High Level, 6.3.1.2.4.1
 - Low Level, 6.3.1.2.4.2
 - Pressure Control, 6.3.1.2.3
 - Temperature Control, 6.3.1.2.2
 - Liquid Transfer, 6.3.1.7
 - Spill Control and Secondary Containment for Hazardous Materials Liquids, 6.3.1.4
 - Secondary Containment, 6.3.1.4.2
 - Spill Control, 6.3.1.4.1
 - General, 6.3.1.4.1.1
 - Standby and Emergency Power, 6.3.1.3
 - Supervision of Alarm, Detection, and Automatic Fire-Extinguishing Systems, 6.3.1.8
 - System Design, 6.3.1.6
 - Uses Not Required to Comply, 6.3.1.1
 - Handling, 6.3.4
 - Carts and Trucks, 6.3.4.3
 - Attendance, 6.3.4.3.5
 - Construction, 6.3.4.3.3
 - Design, 6.3.4.3.1
 - Incompatible Materials, 6.3.4.3.6
 - Speed-Control Devices, 6.3.4.3.2
 - Spill Control, 6.3.4.3.4
 - Carts and Trucks Required, 6.3.4.2
 - Emergency Alarm for Transportation of Hazardous Materials in Corridors or Exit Enclosures, 6.3.4.4
 - General, 6.3.4.1
 - Indoor Dispensing and Use, 6.3.2
 - General Indoor Requirements, 6.3.2.1
 - Explosion Control, 6.3.2.1.4
 - General, 6.3.2.1.4.1
 - Process Vessels, 6.3.2.1.4.2
 - Fire Protection Systems, 6.3.2.1.1
 - Fire-Extinguishing System for Laboratory Fume Hoods and Spray Booths, 6.3.2.1.1.2
 - General, 6.3.2.1.1.1
 - Protection Level 1 through Protection Level 4, 6.3.2.1.2
 - Building Height Exception, 6.3.2.1.2.1
 - Egress, 6.3.2.1.2.3

- Separation of Occupancies Having High Hazards, 6.3.2.1.2.2
- Ventilation, 6.3.2.1.3
 - Exceptions to Ventilation Requirement, 6.3.2.1.3.2
 - General, 6.3.2.1.3.1
 - Standby and Emergency Power, 6.3.2.1.3.3
- Indoor — Closed Systems, 6.3.2.3
 - General, 6.3.2.3.1
 - Spill Control and Secondary Containment for Hazardous Materials Liquids, 6.3.2.3.3
 - Secondary Containment, 6.3.2.3.3.2
 - Spill Control, 6.3.2.3.3.1
 - Ventilation, 6.3.2.3.2
- Indoor — Open Systems, 6.3.2.2
 - Floor Construction, 6.3.2.2.3
 - General, 6.3.2.2.1
 - Spill Control and Secondary Containment for Hazardous Materials Liquids, 6.3.2.2.4
 - Secondary Containment, 6.3.2.2.4.2
 - Spill Control, 6.3.2.2.4.1
 - Ventilation, 6.3.2.2.2
- Outdoor Dispensing and Use, 6.3.3
 - General, 6.3.3.1
 - Clearance from Combustibles, 6.3.3.1.2
 - Location, 6.3.3.1.1
 - Weather Protection, 6.3.3.1.3
- Outdoor — Closed Systems, 6.3.3.3
 - General, 6.3.3.3.1
 - Spill Control and Secondary Containment for Hazardous Materials Liquids, 6.3.3.3.2
 - Secondary Containment, 6.3.3.3.2.2
 - Spill Control, 6.3.3.3.2.1
- Outdoor — Open Systems, 6.3.3.2
 - General, 6.3.3.2.1
 - Spill Control and Secondary Containment for Hazardous Materials Liquids, 6.3.3.2.2
 - Secondary Containment, 6.3.3.2.2.2
 - Incompatible Materials, 6.3.3.2.2.2(B)
 - Spill Control, 6.3.3.2.2.1

-G-**Gallon [Gas]**

Definition, 3.3.48

Gas

Compressed Gas [Gas]

Definition, 3.3.49.1, A.3.3.49.1

Corrosive Gas [Gas]

Definition, 3.3.49.2

Definition, 3.3.49

Flammable Gas [Gas]

Definition, 3.3.49.3

Flammable Liquefied Gas [Gas]

Definition, 3.3.49.4

Highly Toxic Gas [Gas]

Definition, 3.3.49.5

Inert Gas [Gas]

Definition, 3.3.49.6

Irritant Gas [Gas]

Definition, 3.3.49.7, A.3.3.49.7

Nonflammable Gas [Gas]

Definition, 3.3.49.8

Other Gas [Gas]

Definition, 3.3.49.9, A.3.3.49.9

Oxidizing Gas [Gas]

Definition, 3.3.49.10

Pyrophoric Gas [Gas]

Definition, 3.3.49.11

Toxic Gas [Gas]

Definition, 3.3.49.12

Unstable Reactive Gas [Gas]

Definition, 3.3.49.13, A.3.3.49.13

Gas Cabinet [Gas]

Definition, 3.3.50, A.3.3.50

Gas Manufacturer/Producer [Gas]

Definition, 3.3.51

Gas Room [Gas]

Definition, 3.3.52, A.3.3.52

Gaseous Hydrogen (GH₂) System

Definition, 3.3.53, A.3.3.53

-H-**Handling**

Definition, 3.3.54

Hazardous Material Definitions Comparison Table, Annex J**Hazardous Materials Management Plans and Hazardous Materials Inventory Statements, Annex C**

Hazardous Materials Inventory Statements (HMIS), C.2

Changes to HMIS, C.2.2

Where Required, C.2.1

Hazardous Materials Management Plan (HMMP), C.3

General, C.3.1

HMMP Short Form (Minimal Storage Site), C.3.3

Information Required, C.3.2

Building Floor Plan, C.3.2.3

Chemical Compatibility and Separation, C.3.2.5

Emergency Response, C.3.2.9

Employee Training, C.3.2.8

General Information, C.3.2.1

General Site Plan, C.3.2.2

Hazardous Materials Handling, C.3.2.4

Inspection and Record Keeping, C.3.2.7

Monitoring Program, C.3.2.6

Maintenance of Records, C.4

Scope, C.1

Hazardous Materials Storage Cabinet

Definition, 3.3.55

High-Hazard Level Contents

Definition, 3.3.56

High-Hazard Level 1 Contents

Definition, 3.3.56.1

High-Hazard Level 2 Contents

Definition, 3.3.56.2

High-Hazard Level 3 Contents

Definition, 3.3.56.3

High-Hazard Level 4 Contents
Definition, 3.3.56.4

-I-**Immediately Dangerous to Life and Health (IDLH) [Gas]**

Definition, 3.3.57, A.3.3.57

Informational References, Annex L**Input Data Specification**

Definition, 3.4.10

ISO Module [Gas]

Definition, 3.3.58, A.3.3.58

-L-**Labeled**

Definition, 3.2.4

Limit

Ceiling Limit

Definition, 3.3.59.1

Definition, 3.3.59

Permissible Exposure Limit (PEL) [Gas]

Definition, 3.3.59.2, A.3.3.59.2

Short-Term Exposure Limit (STEL) [Gas]

Definition, 3.3.59.3, A.3.3.59.3

Liquefied Hydrogen (LH2) System

Definition, 3.3.60

Listed

Definition, 3.2.5, A.3.2.5

-M-**Manufacturing Plants**

Definition, 3.3.61

Material

Combustible (Material)

Definition, 3.3.62.1

Corrosive Material

Definition, 3.3.62.2, A.3.3.62.2

Definition, 3.3.62

Hazard Material

Definition, 3.3.62.3

Hazardous Material

Definition, 3.3.62.4, A.3.3.62.4

Incompatible Material

Definition, 3.3.62.5, A.3.3.62.5

Limited-Combustible (Material)

Definition, 3.3.62.6

Noncombustible Material

Definition, 3.3.62.7, A.3.3.62.7

Pyrophoric Material

Definition, 3.3.62.8

Toxic Material

Definition, 3.3.62.9, A.3.3.62.9

Unstable (Reactive) Material

Definition, 3.3.62.10, A.3.3.62.10

Water-Reactive Material

Definition, 3.3.62.11, A.3.3.62.11

Maximum Allowable Quantity Per Control Area (MAQ)

Definition, 3.3.63, A.3.3.63

Mechanical Code [Gas]

Definition, 3.3.64

Mobile Supply Unit [Gas]

Definition, 3.3.65, A.3.3.65

-N-**Nesting [Gas]**

Definition, 3.3.66, A.3.3.66

Nonbulk Flammable Gas System

Definition, 3.3.67, A.3.3.67

Normal Temperature and Pressure (NTP) [Gas]

Definition, 3.3.68, A.3.3.68

-O-**Occupancy**

Assembly Occupancy

Definition, 3.3.69.1, A.3.3.69.1

Business Occupancy

Definition, 3.3.69.2, A.3.3.69.2

Day-Care Occupancy

Definition, 3.3.69.3, A.3.3.69.3

Definition, 3.3.69

Detention and Correctional Occupancy

Definition, 3.3.69.4, A.3.3.69.4

Educational Occupancy

Definition, 3.3.69.5, A.3.3.69.5

Health Care Occupancy

Definition, 3.3.69.6, A.3.3.69.6

Industrial Occupancy

Definition, 3.3.69.7, A.3.3.69.7

Mercantile Occupancy

Definition, 3.3.69.8, A.3.3.69.8

Multiple Occupancy

Definition, 3.3.69.9

Residential Board and Care Occupancy

Definition, 3.3.69.10, A.3.3.69.10

Residential Occupancy

Definition, 3.3.69.11, A.3.3.69.11

Storage Occupancy

Definition, 3.3.69.12, A.3.3.69.12

Occupant Characteristics

Definition, 3.4.11

Organic Peroxide

Definition, 3.3.70

Organic Peroxide Formulation

Class I Organic Peroxide

Definition, 3.3.71.1

Class II Organic Peroxide

Definition, 3.3.71.2

Class III Organic Peroxide

Definition, 3.3.71.3

Class IV Organic Peroxide

Definition, 3.3.71.4

Class V Organic Peroxide

Definition, 3.3.71.5

Definition, 3.3.71

Organic Peroxide Formulations, Chap. 14

- General, 14.1
 - Construction Requirements, 14.1.2, A.14.1.2
- General Requirements for Storage, 14.2
 - Drainage, 14.2.2
 - Emergency and Standby Power, 14.2.7
 - Explosion Control, 14.2.6
 - Fire Protection Systems, 14.2.5
 - Limit Controls, 14.2.8
 - Monitoring/Supervision, 14.2.9
 - Secondary Containment, 14.2.3
 - Special Requirements, 14.2.10
 - Combustible Waste, 14.2.10.7
 - Cutting and Welding, 14.2.10.5
 - Damaged Containers, 14.2.10.8, A.14.2.10.8
 - Electrical, 14.2.10.6
 - Heating and Cooling, 14.2.10.10
 - Container Contact, 14.2.10.10.5
 - Cooling Systems, 14.2.10.10.3
 - Heating Systems, 14.2.10.10.4
 - Outside of Ambient Temperature, 14.2.10.10.2
 - Temperature Range, 14.2.10.10.1
 - Maintenance Operations, 14.2.10.4
 - Packaging Marking, 14.2.10.2
 - Specific Disposal Procedures, 14.2.10.9
 - Temperature Markings, 14.2.10.3
 - Spill Control, 14.2.1
 - Ventilation, 14.2.4, A.14.2.4
- General Requirements for Use, 14.5
 - Clearance from Combustibles, 14.5.10
 - Drainage, 14.5.2
 - Emergency and Standby Power, 14.5.7, A.14.5.7
 - Explosion Control, 14.5.6
 - Fire Protection System, 14.5.5
 - Floors, 14.5.11
 - Limit Controls, 14.5.8
 - Liquid Transfer, 14.5.13
 - Monitoring/Supervision, 14.5.9
 - Secondary Containment, 14.5.3
 - Special Requirements, 14.5.14
 - Waste Disposal, 14.5.14.3, A.14.5.14.3
 - Spill Control, 14.5.1
 - System Design, 14.5.12
 - Ventilation, 14.5.4
- Handling, 14.8
 - Handling, 14.8.1
- Indoor Storage, 14.3
 - Detached Storage, 14.3.4
 - Building Construction, 14.3.4.3
 - Building Location, 14.3.4.2
 - General, 14.3.4.1
 - Detection Systems, 14.3.1
 - Floors, 14.3.3
 - Storage Conditions/Arrangement, 14.3.2, A.14.3.2
 - Separation Distance, 14.3.2.9
 - Storage Arrangements, 14.3.2.8
 - Storage Limitations, 14.3.2.1
- Indoor Use, 14.6
 - Closed Systems, 14.6.2
 - Explosion Control, 14.6.2.2
 - Spill Control, Drainage, and Containment, 14.6.2.3
 - Ventilation, 14.6.2.1
 - Open Systems, 14.6.1
 - Explosion Control, 14.6.1.2
 - Spill Control, Drainage, and Containment, 14.6.1.3
 - Ventilation, 14.6.1.1
- Outdoor Storage, 14.4
 - Exposures, 14.4.1
 - Clearance from Combustibles, 14.4.1.1
 - Distance Reduction, 14.4.1.3
 - Location, 14.4.1.2
 - Weather Protection, 14.4.2
- Outdoor Use, 14.7
 - Closed Systems, 14.7.2
 - Clearance from Combustibles, 14.7.2.3
 - Location, 14.7.2.1
 - Spill Control, Drainage, and Containment, 14.7.2.2
 - Open Systems, 14.7.1
 - Clearance from Combustibles, 14.7.1.3
 - Location, 14.7.1.1
 - Spill Control, Drainage, and Containment, 14.7.1.2
- OSHA [Gas]**
 - Definition, 3.3.72
- Oxidizer**
 - Class 1
 - Definition, 3.3.73.1
 - Class 2
 - Definition, 3.3.73.2
 - Class 3
 - Definition, 3.3.73.3
 - Class 4
 - Definition, 3.3.73.4
 - Definition, 3.3.73, A.3.3.73
- Oxidizer Solids and Liquids, Chap. 15**
 - General, 15.1
 - Construction Requirements, 15.1.3
 - General Requirements for Storage, 15.2
 - Detection Systems, 15.2.10
 - Drainage, 15.2.2
 - Emergency and Standby Power, 15.2.7
 - Explosion Control, 15.2.6
 - Fire Protection Systems, 15.2.5, A.15.2.5
 - Dry Pipe and Preaction Sprinkler Systems, 15.2.5.1, A.15.2.5.1
 - Fire Protection Water Supplies, 15.2.5.2
 - Portable Extinguishers, 15.2.5.3
 - Dry Chemical and CO₂ Extinguishers, 15.2.5.3.1, A.15.2.5.3.1
 - Halocarbon Clean Agent Extinguishers, 15.2.5.3.3, A.15.2.5.3.3
 - Halon Extinguishers, 15.2.5.3.2, A.15.2.5.3.2
 - Limit Controls, 15.2.8
 - Monitoring/Supervision, 15.2.9
 - Secondary Containment, 15.2.3
 - Special Requirements, 15.2.11, A.15.2.11

- Clearance from Combustibles, 15.2.11.13
- Contact with Water, 15.2.11.10, A.15.2.11.10
- Materials Not Included, 15.2.11.9
- Mercantile Signage for Different Classifications, 15.2.11.12
- Personnel Training and Procedures, 15.2.11.7
- Storage Containers, Tanks, and Bins, 15.2.11.8
 - Shipping Containers, 15.2.11.8.1
 - Tanks and Bins, 15.2.11.8.2
- Spill Control, 15.2.1
- Ventilation, 15.2.4
- General Requirements for Use, 15.5
 - Alarms, 15.5.10
 - Clearance from Combustibles, 15.5.11
 - Drainage, 15.5.2
 - Emergency and Standby Power, 15.5.7
 - Explosion Control, 15.5.6
 - Fire Protection System, 15.5.5
 - Portable Extinguishers, 15.5.5.1
 - Dry Chemical and CO₂ Extinguishers, 15.5.5.1.1
 - Halocarbon Clean Agent Extinguishers, 15.5.5.1.3
 - Halon Extinguishers, 15.5.5.1.2
 - Floors, 15.5.12
 - Limit Controls, 15.5.8
 - Liquid Transfer, 15.5.14
 - Monitoring/Supervision, 15.5.9
 - Secondary Containment, 15.5.3
 - Spill Control, 15.5.1
 - System Design, 15.5.13
 - Ventilation, 15.5.4
- Handling, 15.8
 - Handling, 15.8.1
- Indoor Storage, 15.3
 - Detached Storage, 15.3.4
 - Detection Systems, 15.3.1
 - Floors, 15.3.3
 - Special Requirements, 15.3.5
 - Application for Mercantile, Storage, or Industrial Occupancies, 15.3.5.1
 - General Requirements, 15.3.5.2
 - Containers, 15.3.5.2.12
 - Quantity Limitations, 15.3.5.2.13
 - Storage Arrangements in Nonsprinklered Mercantile, Storage, or Industrial Occupancies, 15.3.5.2.11
 - Storage Conditions/Arrangement, 15.3.2
 - Bulk Storage of Class 1 Oxidizers, 15.3.2.1
 - Bins, 15.3.2.1.3
 - Bulk Storage Separation, 15.3.2.1.2
 - Combustible Building Materials, 15.3.2.1.1, A.15.3.2.1.1
 - Wooden Bins, 15.3.2.1.4
 - Class 2 Oxidizers, 15.3.2.3
 - Building Construction, 15.3.2.3.3
 - Detached Storage, 15.3.2.3.5
 - Sprinkler Protection, 15.3.2.3.4
 - Storage Protection with In-Rack Sprinklers, 15.3.2.3.4.3
 - Storage Arrangements of Class 2 Oxidizers, 15.3.2.3.2
 - Basement Storage, 15.3.2.3.2.9
 - Maximum Height of Storage, 15.3.2.3.2.10
 - Storage of Class 2 Oxidizers, 15.3.2.3.2.3
 - Class 3 Oxidizers, 15.3.2.4
 - Building Construction, 15.3.2.4.12
 - Detached Storage, 15.3.2.4.14
 - Maximum Height of Storage, 15.3.2.4.11
 - Sprinkler Criteria for Class 3 Oxidizers, 15.3.2.4.13
 - Class 3 Oxidizers Greater Than or Equal to 2700 lb (1225 kg), 15.3.2.4.13.4
 - Class 3 Oxidizers Less Than 2700 lb (1225 kg), 15.3.2.4.13.1
 - In-Rack Sprinkler Criteria, 15.3.2.4.13.3
 - Special In-Rack Sprinkler Protection for Class 3 Oxidizers Stored in Total Quantities Greater Than or Equal to 2700 lb (1225 kg), 15.3.2.4.13.5
 - Storage of Class 3 Oxidizers, 15.3.2.4.5
 - Type of Storage, 15.3.2.4.2
 - Class 4 Oxidizers, 15.3.2.5
 - Building Construction and Location, 15.3.2.5.4
 - Sprinkler Protection, 15.3.2.5.4.6
 - Storage Arrangements, 15.3.2.5.3
 - Storage Arrangements of Class 1 Oxidizers, 15.3.2.2
 - Class 1 Detached Storage, 15.3.2.2.4
 - Class 1 Oxidizers, 15.3.2.2.2
 - Application, 15.3.2.2.2.1
 - Storage Arrangements, 15.3.2.2.2.2
 - Storage of Class 1 Oxidizers, 15.3.2.2.2.2(A), A.15.3.2.2.2.2(A)
 - Nonsprinklered Buildings, 15.3.2.2.1
 - Sprinkler Protection — Class 1, 15.3.2.2.3, A.15.3.2.2.3
- Indoor Use, 15.6
 - Closed Systems, 15.6.3
 - Explosion Control, 15.6.3.2
 - Spill Control, Drainage, and Containment, 15.6.3.3
 - Ventilation, 15.6.3.1
 - Detection Systems, 15.6.2
 - Open Systems, 15.6.1
 - Explosion Control, 15.6.1.2
 - Spill Control, Drainage, and Containment, 15.6.1.3
 - Ventilation, 15.6.1.1
- Outdoor Storage, 15.4
 - Exposures, 15.4.1
 - Clearance from Combustibles, 15.4.1.1
 - Distance Reduction, 15.4.1.3
 - Location, 15.4.1.2
 - Special Requirements, 15.4.3
 - Weather Protection, 15.4.2
- Outdoor Use, 15.7
 - Closed Systems, 15.7.2
 - Clearance from Combustibles, 15.7.2.3
 - Location, 15.7.2.1
 - Spill Control, Drainage, and Containment, 15.7.2.2
 - Open Systems, 15.7.1
 - Clearance from Combustibles, 15.7.1.3

- Location, 15.7.1.1
 - Spill Control, Drainage, and Containment, 15.7.1.2
 - Oxidizers, Annex G**
 - General, G.1
 - Bench-Scale Test, G.1.4
 - Instrumentation and Test Set-Up, G.1.4.2
 - Test Criteria, G.1.4.6
 - Test Data, G.1.4.5
 - Test Materials, G.1.4.1
 - Test Methodology, G.1.4.3
 - Test Sequence, G.1.4.4
 - Definitions, G.1.3
 - Active Burning Time, G.1.3.1
 - Burning Behavior, G.1.3.2
 - Burning Rate, G.1.3.3
 - Fire-test-response Characteristic, G.1.3.4
 - Formulated Product, G.1.3.5
 - Heat Release Rate (HRR), G.1.3.6
 - Mass Burning Rate, G.1.3.7
 - Mass Loss, G.1.3.8
 - Test Packaging, G.1.3.9
 - Visual Burning Duration, G.1.3.10
 - Intermediate-Scale Fire Exposure Test, G.1.5
 - Instrumentation and Test Set-Up, G.1.5.2
 - Test Criteria, G.1.5.6
 - Test Data, G.1.5.5
 - Test Materials, G.1.5.1
 - Test Methodology, G.1.5.3
 - Test Sequence, G.1.5.4
 - Solid Oxidizers, G.1.1
 - Tests and Criteria, G.1.2
 - Methods and Procedures for Emergency Response Involving Solid Oxidizers, G.6
 - Handling Incidents Involving Oxidizers, G.6.2
 - Procedure for Cleaning Uncontaminated Dry Spills, G.6.2.3
 - Spill Responses, G.6.2.2
 - Oxidizer Hazards, G.6.1
 - Specific Hazards of Oxidizer Fires, Reacting Oxidizers, and Large Oxidizer Incidents, G.6.3
 - Emergency Response Plans and Actions, G.6.3.1
 - Specific Emergencies, G.6.3.2
 - Fire and Fume Hazards, G.6.3.2.1
 - Personal Protective Equipment, G.6.3.2.3
 - Reacting Oxidizers, G.6.3.2.2
 - Safety Information on Oxidizers Used as Fertilizers—Ammonium Nitrate (AN) Prill, G.5
 - Safety Information on Oxidizers Used in Detergents, G.3
 - Sodium Percarbonate, G.3.1
 - Safety Information on Oxidizers Used in Swimming Pools, G.4
 - Handling Swimming Pool Chemicals, G.4.1
 - Calcium Hypochlorite, G.4.1.1
 - Lithium Hypochlorite, G.4.1.2
 - Sodium Dichloroisocyanurate, G.4.1.3
 - Sodium Hypochlorite, G.4.1.5
 - Trichloroisocyanuric Acid, G.4.1.4
 - Specific Response Information for Calcium Hypochlorite, G.4.3
 - Specific Response Information for Chlorinated Isocyanurates (Dichlor, Trichlor), G.4.2
 - Typical Oxidizers, G.2
 - Class 1 Oxidizers, G.2.2
 - Class 2 Oxidizers, G.2.3
 - Class 3 Oxidizers, G.2.4
 - Class 4 Oxidizers, G.2.5
 - General, G.2.1
- P-**
- Performance Criteria**
 - Definition, 3.4.12, A.3.4.12
 - Performance-Based Option, Chap. 10**
 - Design Scenarios, 10.4, A.10.4
 - General, 10.4.1
 - Required Design Scenarios — Safety During Building Use, 10.4.5
 - Building Use Design Scenario 1, 10.4.5.1, A.10.4.5.1
 - Building Use Design Scenario 2, 10.4.5.2
 - Required Design Scenarios — Explosion, 10.4.3
 - Explosion Design Scenario 1, 10.4.3.1, A.10.4.3.1
 - Required Design Scenarios — Fire, 10.4.2
 - Fire Design Scenario 1, 10.4.2.1, A.10.4.2.1
 - Fire Design Scenario 2, 10.4.2.2, A.10.4.2.2
 - Fire Design Scenario 3, 10.4.2.3, A.10.4.2.3
 - Fire Design Scenario 4, 10.4.2.4, A.10.4.2.4
 - Fire Design Scenario 5, 10.4.2.5, A.10.4.2.5
 - Fire Design Scenario 6, 10.4.2.6, A.10.4.2.6
 - Fire Design Scenario 7, 10.4.2.7, A.10.4.2.7
 - Fire Design Scenario 8, 10.4.2.8, A.10.4.2.8
 - Required Design Scenarios — Hazardous Materials, 10.4.4, A.10.4.4
 - Hazardous Materials Design Scenario 1, 10.4.4.1
 - Hazardous Materials Design Scenario 2, 10.4.4.2
 - Hazardous Materials Design Scenario 3, 10.4.4.3
 - Hazardous Materials Design Scenario 4, 10.4.4.4
 - Documentation Requirements, 10.7
 - Design Scenarios, 10.7.6
 - Evidence of Modeler Capability, 10.7.12
 - Facility Design Specifications, 10.7.3
 - General, 10.7.1, A.10.7.1
 - Input Data, 10.7.7
 - Modeling Features, 10.7.11, A.10.7.11
 - Occupant Characteristics, 10.7.5
 - Output Data, 10.7.8
 - Performance Criteria, 10.7.4
 - Performance Evaluation, 10.7.13
 - Prescriptive Requirements, 10.7.10
 - Safety Factors, 10.7.9
 - Technical References and Resources, 10.7.2, A.10.7.2
 - Use of Performance-Based Design Option, 10.7.14
 - Evaluation of Proposed Designs, 10.5
 - General, 10.5.1
 - Input Data, 10.5.3
 - Data, 10.5.3.1
 - Data Requirements, 10.5.3.2
 - Uncertainty and Conservatism of Data, 10.5.3.3
 - Output Data, 10.5.4

- Use, 10.5.2
- Validity, 10.5.5
- General, 10.1, A.10.1
 - Annual Certification, 10.1.11, A.10.1.11
 - Application, 10.1.1, A.10.1.1
 - Approved Qualifications, 10.1.3, A.10.1.3
 - Design Feature Maintenance, 10.1.10, A.10.1.10
 - Final Determination, 10.1.7
 - Goals and Objectives, 10.1.2, A.10.1.2
 - Hazardous Materials, 10.1.12
 - Independent Review, 10.1.5, A.10.1.5
 - Information Transfer to the Fire Service, 10.1.9, A.10.1.9
 - Operations and Maintenance (O&M) Manual, 10.1.8, A.10.1.8
 - Plan Submittal Documentation, 10.1.4, A.10.1.4
 - Sources of Data, 10.1.6
 - Special Definitions, 10.1.13
- Performance Criteria, 10.2
 - General, 10.2.1
 - Specific Performance Criteria, 10.2.2, A.10.2.2
 - Emergency Responder Protection, 10.2.2.7
 - Explosion Conditions, 10.2.2.2, A.10.2.2.2
 - Fire Conditions, 10.2.2.1, A.10.2.2.1
 - Hazardous Materials Exposure, 10.2.2.3, A.10.2.2.3
 - Occupant Protection from Structural Failure, 10.2.2.8
 - Occupant Protection from Untenable Conditions, 10.2.2.6
 - Property Protection, 10.2.2.4, A.10.2.2.4
 - Public Welfare, 10.2.2.5, A.10.2.2.5
- Retained Prescriptive Requirements, 10.3
 - Electrical Systems, 10.3.2, A.10.3.2
 - Equivalency, 10.3.5
 - General, 10.3.3
 - Means of Egress, 10.3.4, A.10.3.4
 - Systems and Features, 10.3.1
- Safety Factors, 10.6, A.10.6
- Permissible Storage and Use Locations**, Chap. 5
 - Control Areas, 5.2
 - Construction Requirements for Control Areas, 5.2.2
 - Number of Control Areas, 5.2.2.1
 - General, 5.1, A.5.1
 - Control Areas or Special Protection Required, 5.1.1
 - High-Hazard Contents, 5.1.3
 - Weather Protection Structures, 5.1.2
 - Outdoor Areas, 5.4, A.5.4
 - Outdoor Control Areas, 5.4.1
 - General, 5.4.1.1
 - Maximum Allowable Quantity per Outdoor Control Area, 5.4.1.2
 - Number of Outdoor Control Areas, 5.4.1.3
 - Outdoor Storage and Use Areas, 5.4.2
 - Protection Levels, 5.3
 - Detached Building Required for High-Hazard Level 2 and High-Hazard Level 3 Materials, 5.3.7
 - Protection Level 1, 5.3.3
 - Protection Level 2, 5.3.4
 - Protection Level 3, 5.3.5
 - Protection Level 4, 5.3.6
- File**
 - Definition, 3.3.74
- Properties and Uses of Ammonium Nitrate and Fire-Fighting Procedures**, Annex E
 - Ammonium Nitrate Resources, E.3
 - Properties and Uses of Ammonium Nitrate, E.1
 - Suggested Fire-Fighting Procedure, E.2
- Proposed Design**
 - Definition, 3.4.13, A.3.4.13
- Protection Level**
 - Definition, 3.3.75, A.3.3.75
- Pyrophoric Solids and Liquids**, Chap. 17
 - General, 17.1
 - Construction Requirements, 17.1.1
 - General Requirements for Storage, 17.2
 - Drainage, 17.2.2
 - Emergency and Standby Power, 17.2.7
 - Explosion Control, 17.2.6
 - Fire Protection Systems, 17.2.5, A.17.2.5
 - Limit Controls, 17.2.8
 - Monitoring/Supervision, 17.2.9
 - Secondary Containment, 17.2.3
 - Spill Control, 17.2.1
 - Ventilation, 17.2.4
 - General Requirements for Use, 17.5
 - Clearance from Combustibles, 17.5.10
 - Drainage, 17.5.2
 - Emergency and Standby Power, 17.5.7
 - Explosion Control, 17.5.6
 - Fire Protection System, 17.5.5
 - Floors, 17.5.11
 - Limit Controls, 17.5.8
 - Liquid Transfer, 17.5.13
 - Monitoring/Supervision, 17.5.9
 - Secondary Containment, 17.5.3
 - Spill Control, 17.5.1
 - System Design, 17.5.12
 - Ventilation, 17.5.4
 - Handling, 17.8
 - Handling, 17.8.1
 - Indoor Storage, 17.3
 - Detached Storage, 17.3.3
 - Floors, 17.3.2
 - Storage Conditions/Arrangement, 17.3.1
 - Indoor Use, 17.6
 - Closed Systems, 17.6.2
 - Explosion Control, 17.6.2.2
 - Spill Control, Drainage, and Containment, 17.6.2.3
 - Ventilation, 17.6.2.1
 - Open Systems, 17.6.1
 - Explosion Control, 17.6.1.2
 - Spill Control, Drainage, and Containment, 17.6.1.3, A.17.6.1.3
 - Ventilation, 17.6.1.1
 - Outdoor Storage, 17.4
 - Exposures, 17.4.1
 - Clearance from Combustibles, 17.4.1.1

- Distance Reduction, 17.4.1.3
- Location, 17.4.1.2, A.17.4.1.2
- Special Requirements, 17.4.3
- Storage Arrangement, 17.4.3.1, A.17.4.3.1
- Weather Protection, 17.4.2
- Outdoor Use, 17.7
 - Closed Systems, 17.7.2
 - Clearance from Combustibles, 17.7.2.3
 - Location, 17.7.2.1
 - Spill Control, Drainage, and Containment, 17.7.2.2
 - Open Systems, 17.7.1
 - Clearance from Combustibles, 17.7.1.3
 - Location, 17.7.1.1
 - Spill Control, Drainage, and Containment, 17.7.1.2, A.17.7.1.2

-R-

Referenced Publications, Chap. 2

Remotely Located, Manually Activated Shutdown Control [Gas]

Definition, 3.3.76

-S-

Safe Location

Definition, 3.4.14

Safety Data Sheet (SDS)

Definition, 3.3.77, A.3.3.77

Safety Factor

Definition, 3.4.15

Safety Margin

Definition, 3.4.16

Sample Ordinance for Adopting NFPA 400, Annex K

Secondary Containment

Definition, 3.3.78, A.3.3.78

Security for Hazardous Materials, Chap. 9

General, 9.1

Applicability, 9.1.1

Security Plan, 9.1.2, A.9.1.2

Security Information, Annex D

Informational References Relevant to Security, D.2

American Chemistry Council, D.2.1

American Institute of Chemical Engineers, D.2.2

American Petroleum Institute, D.2.3

Chlorine Institute, D.2.4

Compressed Gas Association, D.2.5

Federal Motor Carrier Association, D.2.6

Institute of Makers of Explosives, D.2.7

National Association of Chemical Distributors, D.2.8

National Fire Protection Association, D.2.9

Security Plans, D.1

Sensitivity Analysis

Definition, 3.4.17

Shall

Definition, 3.2.6

Should

Definition, 3.2.7

Specification

Definition, 3.4.18

Design Specification

Definition, 3.4.18.1

Input Data Specification

Definition, 3.4.18.2

Spill Control

Definition, 3.3.79

Stakeholder

Definition, 3.4.19

Standard Cubic Foot (scf) of Gas [Gas]

Definition, 3.3.80

Storage (Hazardous Material)

Definition, 3.3.82, A.3.3.82

Storage Height

Definition, 3.3.83

Storage, Compressed Gases or Cryogenic Fluids [Gas]

Bulk Solid Storage

Definition, 3.3.81.1

Definition, 3.3.81

Detached Storage

Definition, 3.3.81.2

Segregated Storage

Definition, 3.3.81.3

Storage, Use, and Handling of Compressed Gases and Cryogenic Fluids, Chap. 21

Acetylene Cylinder Charging Plants, 21.11

Building-Related Controls, 21.2

Control Areas, 21.2.2

Construction, 21.2.2.1

Number, 21.2.2.2

Quantities Less than or Equal to the MAQ, 21.2.2.3

Detached Buildings, 21.2.5, A.21.2.5

Electrical Equipment, 21.2.7

Emergency Power, 21.2.7.2

Standby Power, 21.2.7.1

Employee Alarm System, 21.2.8, A.21.2.8

Exhausted Enclosures, 21.2.18

Ventilation Requirements, 21.2.18.1

Control Velocity at Access Openings, 21.2.18.1.1

Fire Protection, 21.2.18.1.3

Separation, 21.2.18.1.4

Separation of Incompatible Gases Within Enclosures, 21.2.18.1.2

Explosion Control, 21.2.9, A.21.2.9

Fire Protection Systems, 21.2.10, A.21.2.10

Sprinkler System Design, 21.2.10.2

Gas Cabinets, 21.2.17

Construction, 21.2.17.1

Access to Controls, 21.2.17.1.2

Materials of Construction, 21.2.17.1.1

Self-Closing Doors, 21.2.17.1.3

Fire Protection, 21.2.17.3

Quantity Limits, 21.2.17.4

Separation of Incompatibles, 21.2.17.5

Ventilation Requirements, 21.2.17.2

Gas Rooms, 21.2.4

Construction, 21.2.4.3

Exhaust Ventilation, 21.2.4.2

- Limitation on Contents, 21.2.4.5
- Pressure Control, 21.2.4.1
- Separation, 21.2.4.4
- General, 21.2.1
 - Flammable and Oxidizing Gases, 21.2.1.2
 - Occupancy, 21.2.1.1
 - Occupancy Classification, 21.2.1.1.1
 - Toxic and Highly Toxic Compressed Gases, 21.2.1.3
- Hazard Identification Signs, 21.2.12
 - No Smoking, 21.2.12.3
 - Signs, 21.2.12.2
- Lighting, 21.2.11
- Occupancy Protection Levels, 21.2.3
 - Classification of Protection Levels, 21.2.3.2
 - Protection Level 1, 21.2.3.2.1
 - Protection Level 2, 21.2.3.2.2
 - Protection Level 3, 21.2.3.2.3
 - Protection Level 4, 21.2.3.2.4
 - Protection Level 5, 21.2.3.2.5
 - Quantity Thresholds for Compressed Gases and Cryogenic Fluids Requiring Special Provisions, 21.2.3.1
 - Incompatible Materials, 21.2.3.1.2
 - Multiple Hazards, 21.2.3.1.3
 - Quantities Greater than the MAQ, 21.2.3.1.1
- Shelving, 21.2.14
- Source Valve, 21.2.19
- Spill Control, Drainage, and Secondary Containment, 21.2.13
- Vent Pipe Termination, 21.2.15
- Ventilation, 21.2.16
 - Air Intakes, 21.2.16.6
 - Compressed Air, 21.2.16.1
 - Inlets to the Exhaust System, 21.2.16.3
 - Mechanical Exhaust Ventilation, 21.2.16.2
 - Continuous Operation, 21.2.16.2.2
 - Manual Shutoff Switch, 21.2.16.2.4
 - Shutoff Controls, 21.2.16.2.3
 - Ventilation Rate, 21.2.16.2.1
 - Recirculation of Exhaust, 21.2.16.4
 - Ventilation Discharge, 21.2.16.5
- Weather Protection, 21.2.6
- Bulk Liquefied Hydrogen Systems, 21.7
- Bulk Oxygen Systems, 21.5
- Compressed Gases, 21.3
 - Corrosive Gases, 21.3.5
 - Distance to Exposures, 21.3.5.2
 - General, 21.3.5.1
 - Indoor Use, 21.3.5.3
 - Exhausted Enclosures, 21.3.5.3.2
 - Gas Cabinets, 21.3.5.3.1
 - Gas Rooms, 21.3.5.3.3
 - Treatment Systems, 21.3.5.3.4
 - Flammable Gases, 21.3.6
 - Distance to Exposures, 21.3.6.2
 - Electrical, 21.3.6.4
 - Ignition Source Control, 21.3.6.3
 - Heating, 21.3.6.3.3
 - No Smoking or Open Flame, 21.3.6.3.2
 - Static-Producing Equipment, 21.3.6.3.1
 - Maintenance of Piping Systems, 21.3.6.5
 - Storage, Use, and Handling, 21.3.6.1
- General, 21.3.1
 - Cathodic Protection, 21.3.1.3
 - Corrosion Expert, 21.3.1.3.4
 - Impressed Current Systems, 21.3.1.3.3
 - Inspection, 21.3.1.3.2
 - Operation, 21.3.1.3.1
- Compressed Gas Systems, 21.3.1.1
 - Design, 21.3.1.1.1
 - Installation, 21.3.1.1.2
- Cylinders, Containers, and Tanks, 21.3.1.2
 - Cylinders, Containers, and Tanks Containing Residual Gas, 21.3.1.2.4
 - Defective Cylinders, Containers, and Tanks, 21.3.1.2.2
 - Design and Construction, 21.3.1.2.1
 - Pressure Relief Devices, 21.3.1.2.5
 - Supports, 21.3.1.2.3
- Cylinders, Containers, and Tanks Exposed to Fire, 21.3.1.10
- Labeling Requirements, 21.3.1.4
 - Containers, 21.3.1.4.1
 - Label Maintenance, 21.3.1.4.2
 - Piping Systems, 21.3.1.4.4
 - Stationary Compressed Gas Cylinders, Containers, and Tanks, 21.3.1.4.3
- Leaks, Damage, or Corrosion, 21.3.1.11
 - Handling of Cylinders, Containers, and Tanks Removed from Service, 21.3.1.11.3, A.21.3.1.11.3
 - Leaking Systems, 21.3.1.11.4
 - Removal from Service, 21.3.1.11.1
 - Replacement and Repair, 21.3.1.11.2
- Security, 21.3.1.5
 - General, 21.3.1.5.1
 - Physical Protection, 21.3.1.5.3
 - Securing Compressed Gas Cylinders, Containers, and Tanks, 21.3.1.5.4
 - Security of Areas, 21.3.1.5.2
- Separation from Hazardous Conditions, 21.3.1.7
 - Clearance from Combustibles and Vegetation, 21.3.1.7.3, A.21.3.1.7.3
 - Exposure to Chemicals, 21.3.1.7.9
 - Exposure to Electrical Circuits, 21.3.1.7.10
 - Falling Objects, 21.3.1.7.6
 - General, 21.3.1.7.1
 - Heating, 21.3.1.7.7
 - Electrically Powered Heating Devices, 21.3.1.7.7.1
 - Fail-Safe Design, 21.3.1.7.7.2
 - Incompatible Materials, 21.3.1.7.2, A.21.3.1.7.2
 - Ledges, Platforms, and Elevators, 21.3.1.7.4
 - Sources of Ignition, 21.3.1.7.8
 - Temperature Extremes, 21.3.1.7.5
- Service and Repair, 21.3.1.8
- Storage Area Temperature, 21.3.1.13
 - Compressed Gas Containers, 21.3.1.13.1

- Surfaces, 21.3.1.12
- Unauthorized Use, 21.3.1.9
- Underground Piping, 21.3.1.14
- Valve Protection, 21.3.1.6
 - General, 21.3.1.6.1
 - Valve Outlet Caps or Plugs, 21.3.1.6.3
 - Valve-Protective Caps, 21.3.1.6.2
- Medical Gas Systems, 21.3.4
- Oxidizing Gases, 21.3.7
 - Distance to Exposures, 21.3.7.2
 - General, 21.3.7.1
- Pyrophoric Gases, 21.3.8
 - Distance to Exposures, 21.3.8.3
 - General, 21.3.8.1
 - Silane and Silane Mixtures, 21.3.8.2
- Storage, 21.3.2
 - General, 21.3.2.1
 - Applicability, 21.3.2.1.1
 - Classification of Weather Protection as an Indoor Versus Outdoor Area, 21.3.2.1.3
 - Upright Storage Flammable Gas in Solution and Liquefied Flammable Gas, 21.3.2.1.2
 - Cylinders and Containers of 1.3 Gal (5 L) or Less, 21.3.2.1.2.1
 - Cylinders, Containers, and Tanks Designed for Horizontal Use, 21.3.2.1.2.2
 - Palletized Cylinders, Containers, and Tanks, 21.3.2.1.2.3
 - Material-Specific Regulations, 21.3.2.2
 - Exterior Storage, 21.3.2.2.2
 - General, 21.3.2.2.2.1
 - Separation, 21.3.2.2.2.2
 - Indoor Storage, 21.3.2.2.1
- Toxic and Highly Toxic Gases, 21.3.9
 - Automatic Smoke Detection System, 21.3.9.7
 - Emergency Power, 21.3.9.5
 - Alternative to Emergency Power, 21.3.9.5.2
 - General, 21.3.9.5.1
 - Level, 21.3.9.5.4
 - Where Required, 21.3.9.5.3
 - Gas Detection, 21.3.9.6
 - Alarm Monitored, 21.3.9.6.3
 - Automatic Shutdown, 21.3.9.6.4
 - Detection Points, 21.3.9.6.5
 - Point of Use, 21.3.9.6.5.2
 - Source, 21.3.9.6.5.3
 - Storage, 21.3.9.6.5.4
 - Treatment System Discharge, 21.3.9.6.5.1
 - Level of Detection, 21.3.9.6.6
 - Local Alarm, 21.3.9.6.2
 - Where Gas Detection Is Not Required, 21.3.9.6.1
 - General, 21.3.9.1
 - Leaking Containers, Cylinders, and Tanks, 21.3.9.4
 - Containment Vessels or Systems, 21.3.9.4.2
 - Location, 21.3.9.4.2.3
 - Performance, 21.3.9.4.2.1
 - Personnel, 21.3.9.4.2.2
 - Gas Cabinets or Exhausted Enclosures, 21.3.9.4.1
- Treatment Systems, 21.3.9.3
 - Maximum Flow Rate of Release, 21.3.9.3.6, A.21.3.9.3.6
 - Rate of Release, 21.3.9.3.5
 - Storage of Toxic or Highly Toxic Gases, 21.3.9.3.1
 - Containment Devices Provided, 21.3.9.3.1.3
 - Handwheels Secured, 21.3.9.3.1.2
 - Valve Outlets Protected, 21.3.9.3.1.1
 - Treatment System Design and Performance, 21.3.9.3.3
 - Treatment System Sizing, 21.3.9.3.4
 - Attended Operations — Alternative Method of System Sizing, 21.3.9.3.4.3
 - Largest Compressed Gas Vessel, 21.3.9.3.4.2
 - Worst-Case Release of Gas, 21.3.9.3.4.1
 - Use of Toxic Gases, 21.3.9.3.2
 - Fail-Safe Automatic Closing Valve, 21.3.9.3.2.2
 - Gas Detection, 21.3.9.3.2.1
 - Ventilation and Arrangement, 21.3.9.2
 - Air Intakes, 21.3.9.2.3
 - Distance to Exposures, 21.3.9.2.2
 - Indoors, 21.3.9.2.1
- Unstable Reactive Gases (Nondetonable), 21.3.10
 - Basements, 21.3.10.4
 - Distances to Exposures for Class 2, 21.3.10.1
 - Distances to Exposures for Class 3, 21.3.10.2
 - Storage Configuration, 21.3.10.3
 - Unstable Reactive Gases (Detonable), 21.3.10.5
 - Location, 21.3.10.5.2
 - Storage or Use, 21.3.10.5.1
- Use and Handling, 21.3.3
 - General, 21.3.3.1
 - Applicability, 21.3.3.1.1
 - Controls, 21.3.3.1.2
 - Cylinders and Containers of 5 L (1.3 Gal) or Less, 21.3.3.1.8
 - Emergency Isolation, 21.3.3.1.12
 - Location Exemptions, 21.3.3.1.12.4
 - Emergency Shutoff Valves, 21.3.3.1.11
 - Inverted Use, 21.3.3.1.7
 - Piping Systems, 21.3.3.1.3
 - Backflow Prevention, 21.3.3.1.3.2
 - Integrity, 21.3.3.1.3.1
 - Transfer, 21.3.3.1.9
 - Upright Use, 21.3.3.1.6
 - Use of Compressed Gases for Inflation, 21.3.3.1.10
 - Valves, 21.3.3.1.4
 - Vent Pipe Termination, 21.3.3.1.5
 - Handling, 21.3.3.3
 - Applicability, 21.3.3.3.1
 - Carts and Trucks, 21.3.3.3.2
 - Lifting Devices, 21.3.3.3.3
 - Material-Specific Regulations, 21.3.3.2
 - Exterior Use, 21.3.3.2.2
 - General, 21.3.3.2.2.1
 - Separation, 21.3.3.2.2.2
 - Indoor Use, 21.3.3.2.1
- Cryogenic Fluids, 21.4

- Containers — Design, Construction, and Maintenance, 21.4.2, A.21.4.2
 - Aboveground Tanks, 21.4.2.1
 - Construction of the Inner Vessel, 21.4.2.1.1
 - Construction of the Vacuum Jacket (Outer Vessel), 21.4.2.1.2
 - Vacuum Level Monitoring, 21.4.2.1.2.3
 - Foundations and Supports, 21.4.2.3
 - Corrosion Protection, 21.4.2.3.5
 - Excessive Loads, 21.4.2.3.1
 - Expansion and Contraction, 21.4.2.3.2
 - Support of Ancillary Equipment, 21.4.2.3.3
 - Temperature Effects, 21.4.2.3.4
 - Nonstandard Containers, 21.4.2.2
 - Pressure-Relief Devices, 21.4.2.4
 - Accessibility, 21.4.2.4.5
 - Arrangement, 21.4.2.4.6
 - Portable Containers with Volume Less than 2 ft³ (0.057 m³), 21.4.2.4.6.2
 - Pressure Relief Devices, 21.4.2.4.6.1
 - Containers Open to the Atmosphere, 21.4.2.4.2
 - Equipment Other than Containers, 21.4.2.4.3
 - General, 21.4.2.4.1
 - Shutoffs Between Pressure Relief Devices and Containers, 21.4.2.4.7
 - General, 21.4.2.4.7.1
 - Location, 21.4.2.4.7.2
 - Multiple Pressure Relief Devices, 21.4.2.4.7.2(B)
 - Security, 21.4.2.4.7.2(A)
 - Sizing, 21.4.2.4.4
 - Temperature Limits, 21.4.2.4.8
 - Electrical Wiring and Equipment, 21.4.8
 - Electrical Ground and Bonding, 21.4.8.3
 - General, 21.4.8.1
 - Location, 21.4.8.2
 - General, 21.4.1
 - Leaks, Damage, and Corrosion, 21.4.11
 - Lighting, 21.4.12
 - Marking, 21.4.4
 - Container Specification, 21.4.4.3
 - General, 21.4.4.1
 - Identification Signs, 21.4.4.1.3
 - Portable Containers, 21.4.4.1.1
 - Stationary Tanks, 21.4.4.1.2
 - Identification of Container Connections, 21.4.4.4
 - Identification of Contents, 21.4.4.2
 - Identification of Emergency Shutoff Valves, 21.4.4.6
 - Identification of Piping Systems, 21.4.4.5
 - Medical Cryogenic Systems, 21.4.5
 - Pressure Relief Vent Piping, 21.4.3
 - Arrangement, 21.4.3.3
 - General, 21.4.3.1
 - Installation, 21.4.3.4
 - Overfilling, 21.4.3.5
 - Sizing, 21.4.3.2
 - Security, 21.4.6
 - General, 21.4.6.1
 - Physical Protection, 21.4.6.5
 - Securing of Containers, 21.4.6.3
 - Securing of Vaporizers, 21.4.6.4
 - Security of Areas, 21.4.6.2
 - Separation from Hazardous Conditions, 21.4.7
 - General, 21.4.7.1
 - Portable Cryogenic Containers, 21.4.7.3
 - Fire Barriers, 21.4.7.3.2
 - Stationary Cryogenic Containers, 21.4.7.2, A.21.4.7.2
 - Fire Barriers, 21.4.7.2.1
 - Point-of-Fill Connections, 21.4.7.2.2
 - Surfaces Beneath Containers, 21.4.7.2.3
 - Service and Repair, 21.4.9
 - Containers, 21.4.9.1
 - Pressure Relief Device Testing, 21.4.9.1.2
 - Testing, 21.4.9.1.1
 - Systems, 21.4.9.2
 - Storage, 21.4.13
 - Indoor Storage, 21.4.13.1
 - Cryogenic Fluids, 21.4.13.1.3
 - Installation, 21.4.13.1.1
 - Stationary Containers, 21.4.13.1.2
 - Ventilation, 21.4.13.1.4
 - Outdoor Storage, 21.4.13.2
 - Access, 21.4.13.2.2
 - Areas Subject to Flooding, 21.4.13.2.5, A.21.4.13.2.5
 - Elevated Tanks, 21.4.13.2.5.1
 - Underground Tanks, 21.4.13.2.5.2
 - Diked Areas Containing Other Hazardous Materials, 21.4.13.2.4
 - Drainage, 21.4.13.2.6
 - Grade, 21.4.13.2.6.4
 - Drainage Control, 21.4.13.2.6.4(B), A.21.4.13.2.6.4(B)
 - General, 21.4.13.2.1
 - Outdoor Installations, 21.4.13.2.7
 - Courts, 21.4.13.2.7.2, A.21.4.13.2.7.2
 - Enclosed Courts, 21.4.13.2.7.1
 - Fire Department Access, 21.4.13.2.7.3
 - Physical Protection, 21.4.13.2.3
 - Unauthorized Use, 21.4.10
 - Use and Handling, 21.4.14
 - Cathodic Protection, 21.4.14.9
 - Corrosion Expert, 21.4.14.9.4
 - Impressed Current Systems, 21.4.14.9.3
 - Inspection, 21.4.14.9.2
 - Operation, 21.4.14.9.1
 - Corrosion Protection, 21.4.14.8
 - General, 21.4.14.1
 - Attended Delivery, 21.4.14.1.2
 - Design, 21.4.14.1.4
 - Nationally Recognized Good Practices, 21.4.14.1.4.1
 - Piping Systems, 21.4.14.1.4.2
 - Inspection, 21.4.14.1.3
 - Operating Instructions, 21.4.14.1.1
 - Joints, 21.4.14.3
 - Material-Specific Requirements, 21.4.14.11
 - Filling and Dispensing, 21.4.14.11.3

- Dispensing Areas, 21.4.14.11.3.2
 - Indoor Dispensing Areas, 21.4.14.11.3.2(A)
 - Piping Systems, 21.4.14.11.3.2(C)
 - Ventilation, 21.4.14.11.3.2(B)
 - Filling Controls, 21.4.14.11.3.5
 - General, 21.4.14.11.3.1
 - Vehicle Loading and Unloading Areas, 21.4.14.11.3.3
 - Handling, 21.4.14.11.4
 - Applicability, 21.4.14.11.4.1
 - Carts and Trucks, 21.4.14.11.4.2
 - Closed Containers, 21.4.14.11.4.4
 - Design, 21.4.14.11.4.3
 - Indoor Use, 21.4.14.11.1
 - Outdoor Use, 21.4.14.11.2
 - Emergency Shutoff Valves, 21.4.14.11.2.3, A.21.4.14.11.2.3
 - General, 21.4.14.11.2.1
 - Separation, 21.4.14.11.2.2
 - Physical Protection and Support, 21.4.14.7
 - Piping and Appurtenances, 21.4.14.2
 - Shutoff Valves on Containers, 21.4.14.5
 - Shutoff Valves on Piping, 21.4.14.6
 - Testing, 21.4.14.10
 - Valves and Accessory Equipment, 21.4.14.4
 - Gas Generation Systems, 21.8
 - General Provisions, 21.1
 - Applicability, 21.1.1
 - Specific Applications, 21.1.1.2
 - Hazardous Materials Classification, 21.1.2
 - Flammability of Gas Mixtures, 21.1.2.6
 - Hazard Classification Pure Gases, 21.1.2.1
 - Mixtures, 21.1.2.3
 - Other Hazards, 21.1.2.2
 - Responsibility for Classification, 21.1.2.4
 - Toxicity, 21.1.2.5
 - Hydrogen Compressed Gas Systems, 21.6
 - Insulated Liquid Carbon Dioxide Systems, 21.9
 - Nitrous Oxide Systems, 21.12
 - Storage, Handling, and Use of Ethylene Oxide for Sterilization and Fumigation, 21.10
- T-**
- Tank**
 - Container Tank
 - Definition, 3.3.84.1
 - Definition, 3.3.84, A.3.3.84
 - Portable Tank
 - Definition, 3.3.84.2, A.3.3.84.2
 - Stationary Tank
 - Definition, 3.3.84.3, A.3.3.84.3
 - TC [Gas]**
 - Definition, 3.3.85
 - Toxic or Highly Toxic Solids and Liquids, Chap. 18**
 - General, 18.1
 - Construction Requirements, 18.1.1
 - General Requirements for Storage, 18.2
 - Drainage, 18.2.2
 - Emergency and Standby Power, 18.2.8
 - Explosion Control, 18.2.7
 - Fire Protection Systems, 18.2.6
 - Limit Controls, 18.2.9
 - Monitoring/Supervision, 18.2.10
 - Secondary Containment, 18.2.3
 - Spill Control, 18.2.1
 - Treatment Systems, 18.2.5
 - Ventilation, 18.2.4
 - General Requirements for Use, 18.5
 - Clearance from Combustibles, 18.5.11
 - Drainage, 18.5.2
 - Emergency and Standby Power, 18.5.8
 - Explosion Control, 18.5.7
 - Fire Protection System, 18.5.6
 - Floors, 18.5.12
 - Limit Controls, 18.5.9
 - Liquid Transfer, 18.5.14
 - Monitoring/Supervision, 18.5.10
 - Secondary Containment, 18.5.3
 - Spill Control, 18.5.1
 - System Design, 18.5.13
 - Treatment Systems, 18.5.5
 - Ventilation, 18.5.4
 - Handling, 18.8
 - Handling, 18.8.1
 - Indoor Storage, 18.3
 - Detached Storage, 18.3.2
 - Floors, 18.3.1
 - Special Requirements, 18.3.3
 - Indoor Use, 18.6
 - Closed Systems, 18.6.2
 - Explosion Control, 18.6.2.2
 - Spill Control, Drainage, and Containment, 18.6.2.3
 - Ventilation, 18.6.2.1
 - Open Systems, 18.6.1
 - Explosion Control, 18.6.1.2
 - Spill Control, Drainage, and Containment, 18.6.1.3
 - Ventilation, 18.6.1.1
 - Outdoor Storage, 18.4
 - Exposures, 18.4.1
 - Clearance from Combustibles, 18.4.1.1
 - Distance Reduction, 18.4.1.3
 - Location, 18.4.1.2
 - Special Requirements, 18.4.3
 - Fire-Extinguishing Systems, 18.4.3.1
 - Storage Arrangement, 18.4.3.2
 - Aisles, 18.4.3.2.2
 - Pile Size Limit, 18.4.3.2.1
 - Treatment System, 18.4.3.3
 - Weather Protection, 18.4.2
 - Outdoor Use, 18.7
 - Closed Systems, 18.7.2
 - Clearance from Combustibles, 18.7.2.3
 - Location, 18.7.2.1
 - Spill Control, Drainage, and Containment, 18.7.2.2
 - Open Systems, 18.7.1

- Clearance from Combustibles, 18.7.1.3
- Location, 18.7.1.1
- Spill Control, Drainage, and Containment, 18.7.1.2
- Treatment System [Gas]**
 - Definition, 3.3.86
- Tube Trailer [Gas]**
 - Definition, 3.3.87, A.3.3.87
- Typical Organic Peroxide Formulations**, Annex F
 - Class IIB Formulations, F.4
 - Fire-Fighting Information, F.4.2
 - Fire-Hazard Characteristics, F.4.1
 - Typical Class IIB Formulations, F.4.3
 - Class I Formulations, F.2
 - Fire Hazard Characteristics, F.2.1
 - Fire-Fighting Information, F.2.2
 - Typical Class I Formulations, F.2.3
 - Class IIA Formulations, F.3
 - Fire-Fighting Information, F.3.2
 - Fire-Hazard Characteristics, F.3.1
 - Typical Class IIA Formulations, F.3.3
 - Class III Formulations, F.5
 - Fire Hazard Characteristics, F.5.1
 - Fire-Fighting Information, F.5.2
 - Typical Class III Formulations, F.5.3
 - Class IV Formulations, F.6
 - Fire Hazard Characteristics, F.6.1
 - Fire-Fighting Information, F.6.2
 - Typical Class IV Formulations, F.6.3
 - Class V Formulations, F.7
 - Fire Hazard Characteristics, F.7.1
 - Fire-Fighting Information, F.7.2
 - Typical Class V Formulations, F.7.3
 - General, F.1
 - Subsidiary Risks and Remarks, F.8
- U-
- Uncertainty Analysis**
 - Definition, 3.4.20
- Unstable (Reactive) Solids and Liquids**, Chap. 19
 - General, 19.1
 - Construction Requirements, 19.1.1
 - General Requirements for Storage, 19.2
 - Drainage, 19.2.2
 - Emergency and Standby Power, 19.2.7
 - Explosion Control, 19.2.6
 - Fire Protection Systems, 19.2.5
 - Limit Controls, 19.2.8
 - Monitoring/Supervision, 19.2.9
 - Secondary Containment, 19.2.3
 - Special Requirements, 19.2.10
 - Spill Control, 19.2.1
 - Ventilation, 19.2.4
 - General Requirements for Use, 19.5
 - Clearance from Combustibles, 19.5.10
 - Drainage, 19.5.2
 - Emergency and Standby Power, 19.5.7
 - Explosion Control, 19.5.6
 - Fire Protection System, 19.5.5
 - Floors, 19.5.11
 - Limit Controls, 19.5.8
 - Liquid Transfer, 19.5.13
 - Monitoring/Supervision, 19.5.9
 - Secondary Containment, 19.5.3
 - Special Requirements, 19.5.14
 - Spill Control, 19.5.1
 - System Design, 19.5.12
 - Ventilation, 19.5.4
 - Handling, 19.8
 - Handling, 19.8.1
 - Special Requirements, 19.8.2
 - Indoor Storage, 19.3
 - Detached Storage, 19.3.2
 - Floors, 19.3.1
 - Special Requirements, 19.3.3
 - Indoor Use, 19.6
 - Closed Systems, 19.6.2
 - Explosion Control, 19.6.2.2
 - Special Requirements, 19.6.2.4
 - Spill Control, Drainage, and Containment, 19.6.2.3
 - Ventilation, 19.6.2.1
 - Open Systems, 19.6.1
 - Explosion Control, 19.6.1.2
 - Special Requirements, 19.6.1.4
 - Spill Control, Drainage, and Containment, 19.6.1.3
 - Ventilation, 19.6.1.1
 - Outdoor Storage, 19.4
 - Exposures, 19.4.1
 - Clearance from Combustibles, 19.4.1.1
 - Distance Reduction, 19.4.1.3
 - Nondeflagrating Materials, 19.4.1.3.1
 - Location, 19.4.1.2
 - Deflagrating Material, 19.4.1.2.2
 - Detonable Material, 19.4.1.2.3
 - Nondeflagrating Material, 19.4.1.2.1
 - Special Requirements, 19.4.3
 - Storage Arrangement, 19.4.3.1
 - Aisles, 19.4.3.1.2
 - Pile Size Limit, 19.4.3.1.1
 - Weather Protection, 19.4.2
 - Outdoor Use, 19.7
 - Closed Systems, 19.7.2
 - Clearance from Combustibles, 19.7.2.3
 - Location, 19.7.2.1
 - Spill Control, Drainage, and Containment, 19.7.2.2
 - Open Systems, 19.7.1
 - Clearance from Combustibles, 19.7.1.3
 - Location, 19.7.1.1
 - Special Requirements, 19.7.1.4
 - Spill Control, Drainage, and Containment, 19.7.1.2
- Use**
 - Closed System Use
 - Definition, 3.3.88.1, A.3.3.88.1
 - Definition, 3.3.88, A.3.3.88

- Open System Use
 - Definition, 3.3.88.2, A.3.3.88.2
- V-
- Valve Outlet Cap or Plug [Gas]**
 - Definition, 3.3.89
- Valve Protection Cap [Gas]**
 - Definition, 3.3.90
- Valve Protection Device [Gas]**
 - Definition, 3.3.91
- Verification Method**
 - Definition, 3.4.21
- W-
- Waste**
 - Definition, 3.3.92
- Water-Reactive Solids and Liquids, Chap. 20**
 - General, 20.1
 - Construction Requirements, 20.1.1
 - General Requirements for Storage, 20.2
 - Drainage, 20.2.2
 - Emergency and Standby Power, 20.2.7
 - Explosion Control, 20.2.6
 - Fire Protection Systems, 20.2.5
 - Limit Controls, 20.2.8
 - Monitoring/Supervision, 20.2.9
 - Secondary Containment, 20.2.3
 - Spill Control, 20.2.1
 - Ventilation, 20.2.4
 - General Requirements for Use, 20.5
 - Clearance from Combustibles, 20.5.10
 - Drainage, 20.5.2
 - Emergency and Standby Power, 20.5.7
 - Explosion Control, 20.5.6
 - Fire Protection System, 20.5.5
 - Floors, 20.5.11
 - Limit Controls, 20.5.8
 - Liquid Transfer, 20.5.13
- Monitoring/Supervision, 20.5.9
- Secondary Containment, 20.5.3
- Spill Control, 20.5.1
- System Design, 20.5.12
- Ventilation, 20.5.4
- Handling, 20.8
 - Handling, 20.8.1
- Indoor Storage, 20.3
 - Detached Storage, 20.3.2
 - Floors, 20.3.1
- Indoor Use, 20.6
 - Closed Systems, 20.6.2
 - Explosion Control, 20.6.2.2
 - Spill Control, Drainage, and Containment, 20.6.2.3
 - Ventilation, 20.6.2.1
 - Open Systems, 20.6.1
 - Explosion Control, 20.6.1.2
 - Spill Control, Drainage, and Containment, 20.6.1.3
 - Ventilation, 20.6.1.1
- Outdoor Storage, 20.4
 - Exposures, 20.4.1
 - Clearance from Combustibles, 20.4.1.1
 - Distance Reduction, 20.4.1.3
 - Location, 20.4.1.2
 - Class 1 and 2 Materials, 20.4.1.2.1
 - Special Requirements, 20.4.3
 - Aisles, 20.4.3.2
 - Pile Size Limits, 20.4.3.1
 - Weather Protection, 20.4.2
- Outdoor Use, 20.7
 - Closed Systems, 20.7.2
 - Clearance from Combustibles, 20.7.2.3
 - Location, 20.7.2.1
 - Spill Control, Drainage, and Containment, 20.7.2.2
 - Open Systems, 20.7.1
 - Clearance from Combustibles, 20.7.1.3
 - Location, 20.7.1.1
 - Spill Control, Drainage, and Containment, 20.7.1.2

Sequence of Events for the Standards Development Process

Once the current edition is published, a Standard is opened for Public Input.

Step 1 – Input Stage

- Input accepted from the public or other committees for consideration to develop the First Draft
- Technical Committee holds First Draft Meeting to revise Standard (23 weeks); Technical Committee(s) with Correlating Committee (10 weeks)
- Technical Committee ballots on First Draft (12 weeks); Technical Committee(s) with Correlating Committee (11 weeks)
- Correlating Committee First Draft Meeting (9 weeks)
- Correlating Committee ballots on First Draft (5 weeks)
- First Draft Report posted on the document information page

Step 2 – Comment Stage

- Public Comments accepted on First Draft (10 weeks) following posting of First Draft Report
- If Standard does not receive Public Comments and the Technical Committee chooses not to hold a Second Draft meeting, the Standard becomes a Consent Standard and is sent directly to the Standards Council for issuance (see Step 4) or
- Technical Committee holds Second Draft Meeting (21 weeks); Technical Committee(s) with Correlating Committee (7 weeks)
- Technical Committee ballots on Second Draft (11 weeks); Technical Committee(s) with Correlating Committee (10 weeks)
- Correlating Committee Second Draft Meeting (9 weeks)
- Correlating Committee ballots on Second Draft (8 weeks)
- Second Draft Report posted on the document information page

Step 3 – NFPA Technical Meeting

- Notice of Intent to Make a Motion (NITMAM) accepted (5 weeks) following the posting of Second Draft Report
- NITMAMs are reviewed and valid motions are certified by the Motions Committee for presentation at the NFPA Technical Meeting
- NFPA membership meets each June at the NFPA Technical Meeting to act on Standards with “Certified Amending Motions” (certified NITMAMs)
- Committee(s) vote on any successful amendments to the Technical Committee Reports made by the NFPA membership at the NFPA Technical Meeting

Step 4 – Council Appeals and Issuance of Standard

- Notification of intent to file an appeal to the Standards Council on Technical Meeting action must be filed within 20 days of the NFPA Technical Meeting
- Standards Council decides, based on all evidence, whether to issue the standard or to take other action

Notes:

1. Time periods are approximate; refer to published schedules for actual dates.
2. Annual revision cycle documents with certified amending motions take approximately 101 weeks to complete.
3. Fall revision cycle documents receiving certified amending motions take approximately 141 weeks to complete.

Committee Membership Classifications^{1,2,3,4}

The following classifications apply to Committee members and represent their principal interest in the activity of the Committee.

1. M *Manufacturer*: A representative of a maker or marketer of a product, assembly, or system, or portion thereof, that is affected by the standard.
2. U *User*: A representative of an entity that is subject to the provisions of the standard or that voluntarily uses the standard.
3. IM *Installer/Maintainer*: A representative of an entity that is in the business of installing or maintaining a product, assembly, or system affected by the standard.
4. L *Labor*: A labor representative or employee concerned with safety in the workplace.
5. RT *Applied Research/Testing Laboratory*: A representative of an independent testing laboratory or independent applied research organization that promulgates and/or enforces standards.
6. E *Enforcing Authority*: A representative of an agency or an organization that promulgates and/or enforces standards.
7. I *Insurance*: A representative of an insurance company, broker, agent, bureau, or inspection agency.
8. C *Consumer*: A person who is or represents the ultimate purchaser of a product, system, or service affected by the standard, but who is not included in (2).
9. SE *Special Expert*: A person not representing (1) through (8) and who has special expertise in the scope of the standard or portion thereof.

NOTE 1: “Standard” connotes code, standard, recommended practice, or guide.

NOTE 2: A representative includes an employee.

NOTE 3: While these classifications will be used by the Standards Council to achieve a balance for Technical Committees, the Standards Council may determine that new classifications of member or unique interests need representation in order to foster the best possible Committee deliberations on any project. In this connection, the Standards Council may make such appointments as it deems appropriate in the public interest, such as the classification of “Utilities” in the National Electrical Code Committee.

NOTE 4: Representatives of subsidiaries of any group are generally considered to have the same classification as the parent organization.

Submitting Public Input / Public Comment Through the Online Submission System

Soon after the current edition is published, a Standard is open for Public Input.

Before accessing the Online Submission System, you must first sign in at www.nfpa.org. *Note: You will be asked to sign-in or create a free online account with NFPA before using this system:*

- a. Click on Sign In at the upper right side of the page.
- b. Under the Codes and Standards heading, click on the “List of NFPA Codes & Standards,” and then select your document from the list or use one of the search features.

OR

- a. Go directly to your specific document information page by typing the convenient shortcut link of www.nfpa.org/document# (Example: NFPA 921 would be www.nfpa.org/921). Sign in at the upper right side of the page.

To begin your Public Input, select the link “The next edition of this standard is now open for Public Input” located on the About tab, Current & Prior Editions tab, and the Next Edition tab. Alternatively, the Next Edition tab includes a link to Submit Public Input online.

At this point, the NFPA Standards Development Site will open showing details for the document you have selected. This “Document Home” page site includes an explanatory introduction, information on the current document phase and closing date, a left-hand navigation panel that includes useful links, a document Table of Contents, and icons at the top you can click for Help when using the site. The Help icons and navigation panel will be visible except when you are actually in the process of creating a Public Input.

Once the First Draft Report becomes available there is a Public Comment period during which anyone may submit a Public Comment on the First Draft. Any objections or further related changes to the content of the First Draft must be submitted at the Comment stage.

To submit a Public Comment you may access the online submission system utilizing the same steps as previously explained for the submission of Public Input.

For further information on submitting public input and public comments, go to: <http://www.nfpa.org/publicinput>.

Other Resources Available on the Document Information Pages

About tab: View general document and subject-related information.

Current & Prior Editions tab: Research current and previous edition information on a Standard.

Next Edition tab: Follow the committee’s progress in the processing of a Standard in its next revision cycle.

Technical Committee tab: View current committee member rosters or apply to a committee.

Technical Questions tab: For members and Public Sector Officials/AHJs to submit questions about codes and standards to NFPA staff. Our Technical Questions Service provides a convenient way to receive timely and consistent technical assistance when you need to know more about NFPA codes and standards relevant to your work. Responses are provided by NFPA staff on an informal basis.

Products & Training tab: List of NFPA’s publications and training available for purchase.

Information on the NFPA Standards Development Process

I. Applicable Regulations. The primary rules governing the processing of NFPA standards (codes, standards, recommended practices, and guides) are the NFPA *Regulations Governing the Development of NFPA Standards (Regs)*. Other applicable rules include NFPA *Bylaws*, NFPA *Technical Meeting Convention Rules*, NFPA *Guide for the Conduct of Participants in the NFPA Standards Development Process*, and the NFPA *Regulations Governing Petitions to the Board of Directors from Decisions of the Standards Council*. Most of these rules and regulations are contained in the *NFPA Standards Directory*. For copies of the *Directory*, contact Codes and Standards Administration at NFPA Headquarters; all these documents are also available on the NFPA website at “www.nfpa.org.”

The following is general information on the NFPA process. All participants, however, should refer to the actual rules and regulations for a full understanding of this process and for the criteria that govern participation.

II. Technical Committee Report. The Technical Committee Report is defined as “the Report of the responsible Committee(s), in accordance with the Regulations, in preparation of a new or revised NFPA Standard.” The Technical Committee Report is in two parts and consists of the First Draft Report and the Second Draft Report. (See *Regs* at Section 1.4.)

III. Step 1: First Draft Report. The First Draft Report is defined as “Part one of the Technical Committee Report, which documents the Input Stage.” The First Draft Report consists of the First Draft, Public Input, Committee Input, Committee and Correlating Committee Statements, Correlating Notes, and Ballot Statements. (See *Regs* at 4.2.5.2 and Section 4.3.) Any objection to an action in the First Draft Report must be raised through the filing of an appropriate Comment for consideration in the Second Draft Report or the objection will be considered resolved. [See *Regs* at 4.3.1(b).]

IV. Step 2: Second Draft Report. The Second Draft Report is defined as “Part two of the Technical Committee Report, which documents the Comment Stage.” The Second Draft Report consists of the Second Draft, Public Comments with corresponding Committee Actions and Committee Statements, Correlating Notes and their respective Committee Statements, Committee Comments, Correlating Revisions, and Ballot Statements. (See *Regs* at 4.2.5.2 and Section 4.4.) The First Draft Report and the Second Draft Report together constitute the Technical Committee Report. Any outstanding objection following the Second Draft Report must be raised through an appropriate Amending Motion at the NFPA Technical Meeting or the objection will be considered resolved. [See *Regs* at 4.4.1(b).]

V. Step 3a: Action at NFPA Technical Meeting. Following the publication of the Second Draft Report, there is a period during which those wishing to make proper Amending Motions on the Technical Committee Reports must signal their intention by submitting a Notice of Intent to Make a Motion (NITMAM). (See *Regs* at 4.5.2.) Standards that receive notice of proper Amending Motions (Certified Amending Motions) will be presented for action at the annual June NFPA Technical Meeting. At the meeting, the NFPA membership can consider and act on these Certified Amending Motions as well as Follow-up Amending Motions, that is, motions that become necessary as a result of a previous successful Amending Motion. (See 4.5.3.2 through 4.5.3.6 and Table 1, Columns 1-3 of *Regs* for a summary of the available Amending Motions and who may make them.) Any outstanding objection following action at an NFPA Technical Meeting (and any further Technical Committee consideration following successful Amending Motions, see *Regs* at 4.5.3.7 through 4.6.5.3) must be raised through an appeal to the Standards Council or it will be considered to be resolved.

VI. Step 3b: Documents Forwarded Directly to the Council. Where no NITMAM is received and certified in accordance with the Technical Meeting Convention Rules, the standard is forwarded directly to the Standards Council for action on issuance. Objections are deemed to be resolved for these documents. (See *Regs* at 4.5.2.5.)

VII. Step 4a: Council Appeals. Anyone can appeal to the Standards Council concerning procedural or substantive matters related to the development, content, or issuance of any document of the NFPA or on matters within the purview of the authority of the Council, as established by the Bylaws and as determined by the Board of Directors. Such appeals must be in written form and filed with the Secretary of the Standards Council (see *Regs* at Section 1.6). Time constraints for filing an appeal must be in accordance with 1.6.2 of the *Regs*. Objections are deemed to be resolved if not pursued at this level.

VIII. Step 4b: Document Issuance. The Standards Council is the issuer of all documents (see Article 8 of *Bylaws*). The Council acts on the issuance of a document presented for action at an NFPA Technical Meeting within 75 days from the date of the recommendation from the NFPA Technical Meeting, unless this period is extended by the Council (see *Regs* at 4.7.2). For documents forwarded directly to the Standards Council, the Council acts on the issuance of the document at its next scheduled meeting, or at such other meeting as the Council may determine (see *Regs* at 4.5.2.5 and 4.7.4).

IX. Petitions to the Board of Directors. The Standards Council has been delegated the responsibility for the administration of the codes and standards development process and the issuance of documents. However, where extraordinary circumstances requiring the intervention of the Board of Directors exist, the Board of Directors may take any action necessary to fulfill its obligations to preserve the integrity of the codes and standards development process and to protect the interests of the NFPA. The rules for petitioning the Board of Directors can be found in the *Regulations Governing Petitions to the Board of Directors from Decisions of the Standards Council* and in Section 1.7 of the *Regs*.

X. For More Information. The program for the NFPA Technical Meeting (as well as the NFPA website as information becomes available) should be consulted for the date on which each report scheduled for consideration at the meeting will be presented. To view the First Draft Report and Second Draft Report as well as information on NFPA rules and for up-to-date information on schedules and deadlines for processing NFPA documents, check the NFPA website (www.nfpa.org/docinfo) or contact NFPA Codes & Standards Administration at (617) 984-7246.



Xchange™

The place to connect online with your fire, electrical, and life safety peers

Have a question about the code or standard you're reading now?

NFPA Xchange™ can help!

NFPA Xchange™ brings together over 30,000 professionals worldwide, asking and answering each other's questions, sharing ideas, and discussing the issues impacting your industry today.

NFPA Xchange™ is free to join and offers:

- ➔ A robust collection of previously asked and answered questions to search
- ➔ Access to thousands of peers for problem-solving and on-the-job advice
- ➔ NFPA blogs, white papers, and webinars in one convenient place

NFPA members also enjoy Xchange™ Members Only, the online space for technical questions* answered by NFPA staff, exclusive NFPA live events, and premier access to curated content.

Join NFPA Xchange™ TODAY!

www.nfpa.org/xchange

Xchange Today. Safer Tomorrow.

*For the full terms of use, please visit nfpa.org/standard_items/terms-of-use#xchange. NFPA® is a registered trademark of the National Fire Protection Association, Quincy, MA 02169.